

11/5/98
C.O. 12:00

PERMIT

SEWAGE DISPOSAL SYSTEM

DEPARTMENT OF HEALTH AND MENTAL HYGIENE

NO Record found

P 511063

A REPAIR

DISTRICT _____

DATE 10-22-98

HOWARD COUNTY HEALTH DEPARTMENT
BUREAU OF ENVIRONMENTAL HEALTH
~~XXXXXXXX~~ 410-313-2640

INDEXED

DATE SYSTEM APPROVED _____

INSPECTOR _____

Abbott Brothers Plumbing & Heating IS PERMITTED TO INSTALL _____ ALTER

ADDRESS 3510 Keswick Drive, Baltimore, Maryland 21211 PHONE _____

SUBDIVISION _____ LOT _____ ROAD 8685 Baltimore Washington Boulevard

PROPERTY OWNER _____ AMI Leasing (Tenant)

ADDRESS _____

INSTALL 1000 GALLON TOP SEAMED SEPTIC TANK FOR INTERIM SERVICE AS A HOLDING TANK UNTIL A DETERMINATION CAN BE REACHED AS TO A PERMANENT METHOD OF DISPOSAL.

DIANE MUKHOLAN

REPAIR - PURPOSE - TO SERVE RECENTLY INSTALLED PLUMBING THAT HAS NO POINT-OF-DISCHARGE.

Call for inspection when tank is in place so that a sanitarian can approve the size and location.

PLANS APPROVED BY _____ DATE _____

COVER NO WORK UNTIL INSPECTED AND APPROVED

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM

NOTE: CLEANOUT REQUIRED EVERY 70 FEET OF SEWER LINE AND/OR AT 90° SWEEPS IN LINES FROM HOUSE TO DRAIN FIELDS, 90° ELBOWS NOT ACCEPTABLE.

NOTE: ALL PARTS OF SEPTIC SYSTEMS (I.E. TANK, DISTRIBUTION BOX TRENCHES) TO BE 100 FEET FROM WELL (UNLESS OTHERWISE SPECIFICALLY AUTHORIZED)

NOTE: IF DEEP TRENCH(ES) ARE USED CALL FOR INSPECTION BEFORE AND AFTER PLACING GRAVEL IN TRENCH(ES)

NOTE: NO DRY WELL SHALL EXCEED 15 FOOT IN DIAMETER NO ABSORPTION TRENCH TO EXCEED 100 FEET IN LENGTH

NOTE: ALL PIPE FROM HOUSE TO SEPTIC TANK MUST BE CAST IRON OR SCHEDULE 35/40 PVC OR ABS

PERMIT VOID AFTER TWO YEARS

NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL STAND PIPES MUST BE 8 INCHES IN DIAMETER CAST IRON, CONCRETE OR TERRA COTTA OF PVA OR ABS ACCEPTED. IF TOP OF SEPTIC TANK IS DEEPER THAN 3 FEET, MANHOLE TO GRADE REQUIRED.


NOTE: DISTRIBUTION BOXES MUST HAVE BAFFLES

OLD PERMIT SIGNED AND RETURNED 4/9/98
B00109659 interior alterations

*INSTALLER IS RESPONSIBLE FOR OBTAINING FINAL APPROVAL ON THIS PERMIT

CALL 410-313 FOR INSPECTION OF SEPTIC SYSTEM.

511063

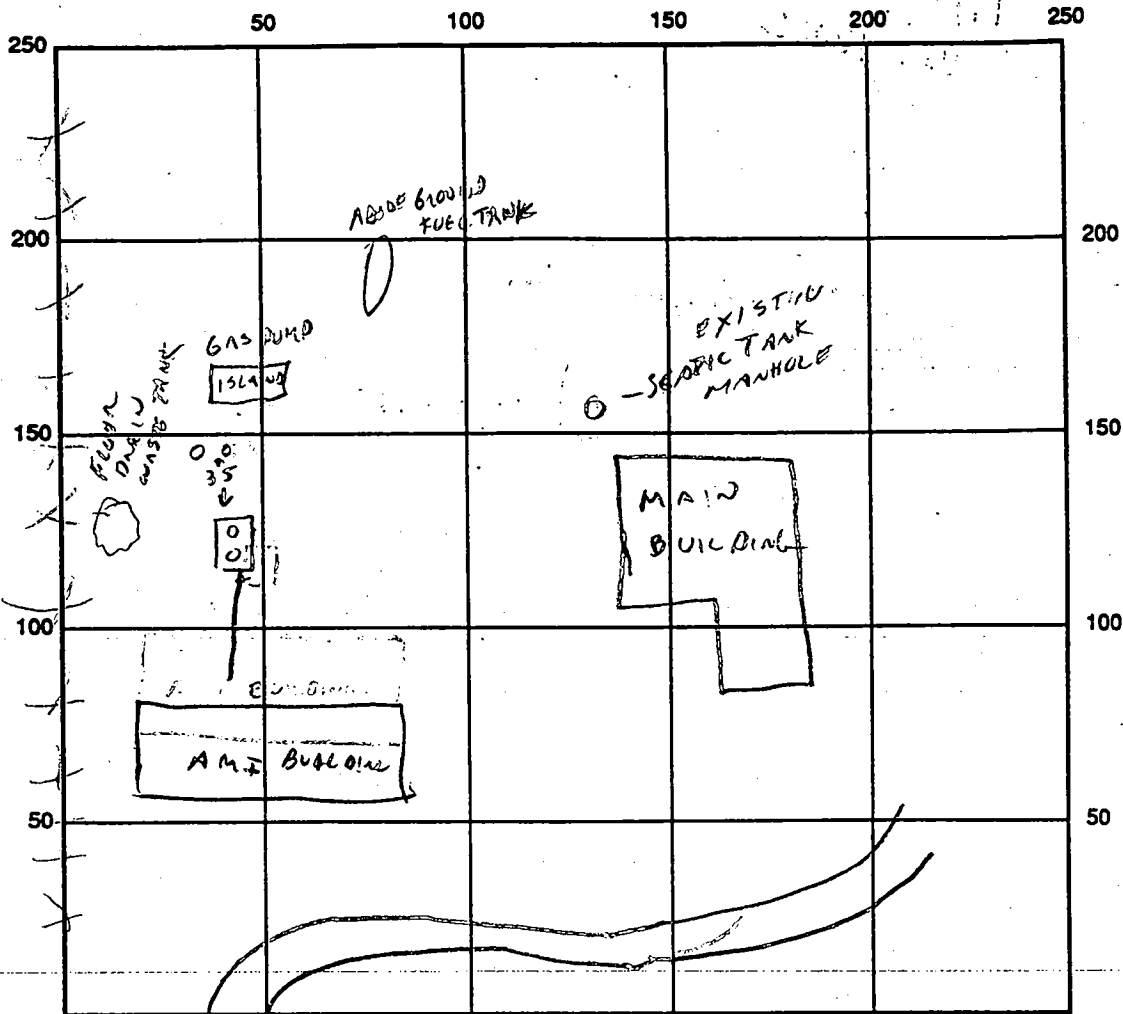

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE

SEPTIC TANK LEVEL 1000 TOP SEALED CLEANOUTS 2 MANHOLE CLEANOUTS

REMARKS: NEW PLUMBING CONNECTED TO WHAT WAS REPORTED TO BE SEPTIC SYSTEM,
BUT TURNED OUT TO BE FLOOR DRAIN WASTE TANK FOR AUTOMOTIVE FLUIDS,
SITE HAS 4" THICK ASPHALT; FUEL TANKS AND OTHER TANKS
DISTRIBUTED ALL ACROSS SITE AS WELL AS UTILITY LINES
IN UNKNOWN LOCATIONS,

TANK ALL ALL SAND - APPEARANCE, LANDSCAPE POSITION, HISTORY
OF SITE & GENERAL VICINITY SUGGEST THIS IS PROBABLE FILL MATERIAL,

CONCLUSION: NO REASONABLE LOCATION TO INSTALL DRAINFIELD;
SEPTIC HOLDING TANK TO BE UTILIZED UNTIL PUBLIC SEWER IS PRACTICAL,

DATE SYSTEM APPROVED _____ INSPECTOR _____

Plumber: Mr. Jim Brown

(410) 366-0265

Called re: 8685 Washington Blvd

BP for interior alterations, incl.

2 new powder rooms

BP # B00109659

He called to request perc test

and/or permit to install

septic system to serve

the new alterations

It was thought (by him?)

that public sewer served

the property, but NO

PLEASE CALL HIM TO ADVISE

Klm

Howard County Health Department

PERMIT
LANGUAGE

To: _____

REPAIR TO SERVE
RECENTLY INSTALLED
PLUMBING ~~WITH~~ THAT HAS NO
POINT-OF-DISCHARGE.

INSTALL 1000 GALLON
TOP SEAMED SEPTIC TANK
FOR INTERIM SERVICE
AS A HOLDING TANK UNTIL
A DETERMINATION CAN BE
REACHED AS TO A PERMANENT

From: ~~AMERICA~~
_____ METHOD OF DISPOSAL.

Date: _____

HD-170

(CW)

APPLICATION

PERCOLATION TESTING

HOWARD COUNTY HEALTH DEPARTMENT
BUREAU OF ENVIRONMENTAL HEALTH
3525-H ELLICOTT MILLS DRIVE/ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 313-2640

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I HEREBY APPLY FOR THE NECESSARY TEST PRIOR TO APPLICATION FOR PERMIT TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER Joseph J Hock Inc. 410 702 0018
ADDRESS 5500 Belle Grove Rd. PHONE 410 787 4400 James Brown

AGENT OR PROSPECTIVE OWNER ~~AMT Leasing~~ Abbott Bros Inc 3510 Keswick Rd
ADDRESS Baltimore 21211 MD PHONE 410 366 0265

PROPERTY LOCATION: JAMES BROWN FOR ABBOTT PLUMBING
SUBDIVISION _____ LOT NO. _____

ROAD AND DESCRIPTION 8685 Baltimore Washington Blvd (AMT LEASING - TENANT)
Jessup Maryland 20794

TAX MAP 48 PARCEL # 121
SIZE OF LOT _____ TYPE BLDG. Office & Repair Shop
(SINGLE FAMILY DWELLING OR COMMERCIAL)

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE. I FULLY UNDERSTAND THE FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER ANY CIRCUMSTANCES. I ALSO AGREE TO COMPLY WITH ALL M.O.S.H.A. REQUIREMENTS IN TESTING THIS LOT. James J Brown
(SIGNATURE OF APPLICANT)

APPROVED BY _____ FOR _____ DATE _____
DISAPPROVED BY _____ FOR _____ DATE _____
HOLD PENDING FURTHER TESTS _____

REASONS FOR REJECTION OR HOLDING _____
PERCOLATION TEST PLAT/PRELIMINARY PLAT - TITLE OR I.D. # _____ DATE _____
SITE DEVELOPMENT PLAN/FINAL PLAT - TITLE OR I.D. # _____ DATE _____

*SEE SOILS
ADDN PLUMBING TO
AN EXISTING FACILITY
(BP WAS INADEQUATELY
ISSUED FOR PUBLIC SEWER.
PROPERTY IS IN THE
DISTRICT BUT IS NOT SEWERED)
SEPARATE BUILDING ON
SITE IS ALREADY
SEWERED BY SEPTIC SYSTEM*

*25 REPAIR FEE
25 OK*
A _____
P _____
DISTRICT 6
DATE 10 21 98

THIS IS NOT A PERMIT

US ROUTE 1

