

LAYOUT _____ INSP 4 _____

INSP 2 _____ INSP 5 _____

INSP 3 _____ INSP 6 _____

ISSUE DATE: 6/6/73

P 18563

APPROVAL DATE: 6/18/73

A 517283

**PERMIT
INDEXED**

TAX ID # 05357497

**ON-SITE SEWAGE DISPOSAL SYSTEM
HOWARD COUNTY HEALTH DEPARTMENT
BUREAU OF ENVIRONMENTAL HEALTH**

Reginald R Leishear IS PERMITTED TO INSTALL ALTER

ADDRESS: 14157 Triadelphia Mill Road, Dayton PHONE NUMBER: 410-286-3700

SUBDIVISION: _____

ADDRESS: 14080 Howard Road Ken Stone

SEPTIC TANK CAPACITY (GALLONS): 1000 OUTLET BAFFLE FILTER REQUIRED

PUMP CHAMBER CAPACITY (GALLONS): _____ COMPARTMENTED TANK REQUIRED

NUMBER OF BEDROOMS: 3

SQUARE FEET PER BEDROOM: _____

LINEAR FEET OF TRENCH REQUIRED: _____

TRENCHES:	Trench to be _____ feet wide. Inlet _____ feet below original grade. Bottom maximum depth _____ feet below original grade. Effective area begins at _____ feet below original grade. _____ feet of stone below distribution pipe.
LOCATION:	_____
NOTES:	_____

PLANS APPROVED: _____ DATE: _____

- NOTE: PERMIT VOID AFTER 2 YEARS
- NOTE: CONTRACTOR RESPONSIBLE FOR SCHEDULING A PRE-CONSTRUCTION INSPECTION FOR ALL INSTALLATIONS
- NOTE: WATERTIGHT SEPTIC TANKS REQUIRED
- NOTE: ALL PARTS OF SEPTIC SYSTEM SHALL BE 100 FEET FROM ANY WATER WELL
- NOTE: MANHOLE RISERS REQUIRED ON ALL SEPTIC TANKS AND PUMP CHAMBERS UNLESS SPECIFICALLY AUTHORIZED

**NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS
RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM
PERMITTEE RESPONSIBLE FOR OBTAINING FINAL APPROVAL ON THIS PERMIT
CALL 410-313-2640 FOR INSPECTION OF SEPTIC SYSTEM**

A517283

File Final OK
18563

6/18/73

PERMIT

SEWAGE DISPOSAL SYSTEM

MARYLAND STATE DEPARTMENT OF HEALTH

HOWARD COUNTY

05 357497

ELLICOTT CITY

DISTRICT 5th

INDEXED

DATE 6/6/73

Reginald R. Leishear IS PERMITTED TO INSTALL ALTER

ADDRESS 14157 Triadelphia Mill Rd., Dayton, Md. PHONE 286-3700

A SEWAGE DISPOSAL SYSTEM LOCATED AT

SUBDIVISION ROAD Howard Road - see appl. for directions LOT

PROPERTY OWNER Reginald R. Leishear

ADDRESS same as above

SPECIFICATIONS 3 bedrooms

DRAIN FIELD DEPTH FEET, BOTTOM AREA SQ. FT.

SEEPAGE PITS ABSORBENT SIDE-WALL AREA SQ. FT.

SEPTIC TANK CAPACITY 1000 GALLONS

FOR GARBAGE GRINDER, INCREASE DISPOSAL AREA 22% & TANK CAPACITY 50%.

OTHER DRY WELL - To have 130 sq. ft. effective absorbent sidewall area per bedroom. Inlet to be 2 1/2 ft. below original grade and 1 1/4 ft. maximum depth. Location 75 ft. from back property line and 105 ft. from left property line when facing lot from Howard Road.

NOTE: ALL PIPE FROM HOUSE TO DRY WELL MUST BE CAST IRON.

PERMIT VOID AFTER THREE YEARS.

NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL.

PLANS APPROVED BY Charles B. Streaker DATE 8/24/72

FILL SEPTIC TANK AND DISTRIBUTION BOX WITH WATER BEFORE CALLING FOR AN INSPECTION. COVER NO WORK UNTIL INSPECTED AND APPROVED.

NEITHER THE HOWARD COUNTY COMMISSIONERS NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE

BUILDING PERMIT SIGNED

AND RETURNED

3/24/05 B00157643-DECK + GARAGE

A 17283

INSPECTOR DATE SYSTEM APPROVED



INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE.

PERMIT CARD Signed OK Rd. S.T. OK D.W. OK 52
 SEPTIC TANK, LEVEL OK 41.6

DISTRIBUTION BOX, LEVEL _____
 TILE FIELD, DEPTH _____ FT. TRENCH WIDTH _____ FT.

GRAVEL DEPTH _____ IN. TOTAL LENGTH _____ FT.
 NUMBER OF TRENCHES _____ TOTAL BOTTOM AREA _____
 SEEPAGE PITS, INSIDE DIAMETER 52 FT. DEPTH BELOW INLET 8 FT.

ABSORBENT AREA 5114.76 SQ. FT.
 REMARKS 6/18/73 D.W. well in general area of tract C-88

DATE SYSTEM APPROVED 6/18/73 INSPECTOR C. Shuster

APPLICATION

A 17283

SEWAGE DISPOSAL TESTING

P _____

MARYLAND STATE DEPARTMENT OF HEALTH

HOWARD COUNTY

*Septic Tank 3 beds - no 1000 gallons
1 bed - no 1200 gallons*

ELLICOTT CITY

DISTRICT 5

DATE 8/2/72

*Try Well to have 130 sq. ft. effective absorbent
side wall area per bedroom. Inlet to be 2 1/2' below
original grade and 1 1/2' maximum depth. Location 75' from
back property line + 105' from left property line when
facing lot from Howard Road.*

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I, HEREBY, APPLY FOR THE NECESSARY TESTS IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER Reginald R. Leishear & Mary Ellen Leishear (Contract Purchaser)

ADDRESS 14157 Triadelphia Mill Road, Dayton, Md. PHONE 286-3700

PROPERTY LOCATION:

SUBDIVISION _____ LOT NO. _____

ROAD AND DESCRIPTION Howard Road - approx. 1 1/4 miles in on right from intersection of
Howard Road and Linthicum Road
next to woods

OCCUPANT _____ PHONE _____

PERSON TO CONSTRUCT SYSTEM _____

ADDRESS _____ PHONE _____

SIZE OF LOT 5,000 acres TYPE BLDG. 3 or 4

NUMBER OF BEDROOMS
(Single Fmly. Dwllg.)

IF NOT SINGLE RESIDENCE DESCRIBE _____

SIGNATURE OF APPLICANT Mary Ellen Leishear

APPROVED BY F. Stinson FOR P. W. D. DATE 8/24/72

(KIND OF SYSTEM)


REJECTED BY _____ FOR _____ DATE _____

(KIND OF SYSTEM)

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING _____

THIS IS NOT A PERMIT

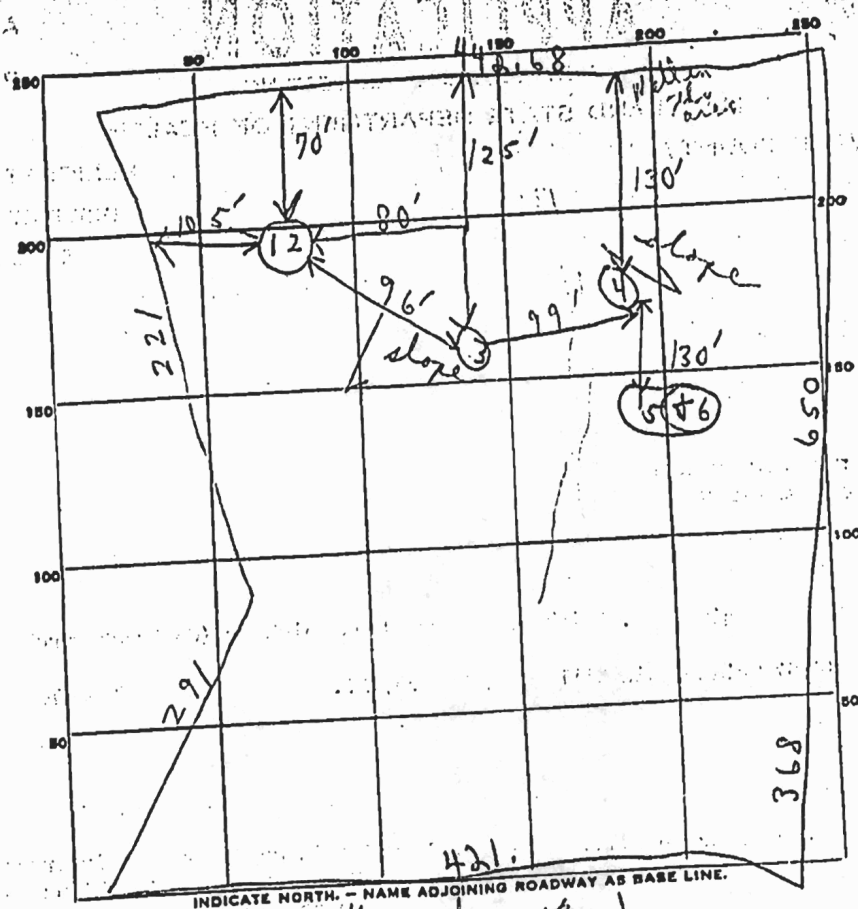

Howard Road

DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME
			START	STOP	START	STOP	
8/24/72	1	3'	10:00	10:02	10:02	10:05	3 min
	2	11 1/2'	10:01	10:07	10:07	10:14	7 min
	3	10' hole	good soil		railway		land
	4	11' hole	good soil		railway		
	5	3'	10:15	10:17	10:17	10:19	2 min
	6	11'	10:16	10:20	10:20	10:29	9 min
							4/27/6 min

SOIL AUGER FINDING: None in 2 1/2'

TESTED BY: B. Stecker

REMARKS: No basement facilities
Good sandy soil