

313003820

Building Permit Application

Howard County Maryland
Department of Inspections, Licenses and Permits
3430 Court House Drive
Permits: 410-313-2455
www.howardcountymd.gov

Date Received: _____

Permit No.: _____



Wolk Shu

Building Address: 13105 Bucks Ridge Ct.
City: Elliot City State: MD Zip Code: 21042
Suite/Apt. #: _____ SDP/WP/BA #: F 05-61
Census Tract: _____ Subdivision: Buckskin Oaks
Section: _____ Area: _____ Lot: _____
Tax Map: 22 Parcel: 73 Grid: 16
Zoning: _____ Map Coordinates: _____ Lot Size: _____

Property Owner's Name: Williamsburg Homes
Address: 5485 Harpers Farm Rd #200
City: Columbia State: MD Zip Code: 21044
Phone: 410-997-8800 Fax: _____
Email: marinamorris@williamsburgllc.com

Applicant's Name & Mailing Address, (if other than stated herein)
Applicant's Name: _____
Address: _____
City: _____ State: _____ Zip Code: _____
Phone: _____ Fax: _____
Email: _____

Existing Use: SFH
Proposed Use: SFH w/ finished Basement
Estimated Construction Cost: \$ 25,000
Description of Work: Finish Basement
Guest room, FB storage
media room, rec room
Occupant or Tenant: 1008 SF
Was tenant space previously occupied? Yes No
Contact Name: _____
Address: _____
City: _____ State: _____ Zip Code: _____
Phone: _____ Fax: _____
Email: _____

Contractor Company: Williamsburg Homes
Contact Person: Marina Morris
Address: 5485 Harpers Farm Rd #200
City: Columbia State: MD Zip Code: 21044
License No.: 155
Phone: 410-997-8800 Fax: _____
Email: marinamorris@williamsburgllc.com

Engineer/Architect Company: _____
Responsible Design Prof.: _____
Address: _____
City: _____ State: _____ Zip Code: _____
Phone: _____ Fax: _____
Email: _____

Commercial Building Characteristics	Residential Building Characteristics	
Height:	<input checked="" type="checkbox"/> SF Dwelling <input type="checkbox"/> SF Townhouse	
No. of stories:	<u>Depth</u>	<u>Width</u>
Gross area, sq. ft./floor:	1 st floor:	
	2 nd floor:	
Area of construction (sq. ft.):	Basement:	
	<input type="checkbox"/> Finished Basement	
Use group:	<input type="checkbox"/> Unfinished Basement	
	<input type="checkbox"/> Crawl Space	
Construction type:	<input type="checkbox"/> Slab on Grade	
<input type="checkbox"/> Reinforced Concrete	No. of Bedrooms:	
<input type="checkbox"/> Structural Steel	Multi-family Dwelling	
<input type="checkbox"/> Masonry	No. of efficiency units:	
<input type="checkbox"/> Wood Frame	No. of 1 BR units:	
<input type="checkbox"/> State Certified Modular	No. of 2 BR units:	
	No. of 3 BR units:	
	Other Structure:	
	Dimensions:	
<input checked="" type="checkbox"/> Roadside Tree Project Permit	Footings:	
<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Roof:	
Roadside Tree Project Permit #	<input type="checkbox"/> State Certified Modular	
	<input type="checkbox"/> Manufactured Home	

Utilities	
Water Supply	
<input type="checkbox"/> Public	
<input checked="" type="checkbox"/> Private	
Sewage Disposal	
<input type="checkbox"/> Public	
<input checked="" type="checkbox"/> Private	
Electric: <input type="checkbox"/> Yes <input type="checkbox"/> No	
Gas: <input type="checkbox"/> Yes <input type="checkbox"/> No	
Heating System	
<input checked="" type="checkbox"/> Electric <input type="checkbox"/> Oil	
<input type="checkbox"/> Natural Gas <input checked="" type="checkbox"/> Propane Gas	
<input type="checkbox"/> Other:	
Sprinkler System:	
<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Grading Permit Number:	
Building Shell Permit Number:	

THE UNDERSIGNED HEREBY CERTIFIES AND AGREES AS FOLLOWS: (1) THAT HE/SHE IS AUTHORIZED TO MAKE THIS APPLICATION; (2) THAT THE INFORMATION IS CORRECT; (3) THAT HE/SHE WILL COMPLY WITH ALL REGULATIONS OF HOWARD COUNTY WHICH ARE APPLICABLE THERETO; (4) THAT HE/SHE WILL PERFORM NO WORK ON THE ABOVE REFERENCED PROPERTY NOT SPECIFICALLY DESCRIBED IN THIS APPLICATION; (5) THAT HE/SHE GRANTS COUNTY OFFICIALS THE RIGHT TO ENTER ONTO THIS PROPERTY FOR THE PURPOSE OF INSPECTING THE WORK PERMITTED AND POSTING NOTICES.

Applicant's Signature: Marina Morris Print Name: Marina Morris
Email Address: marinamorris@williamsburgllc.com Date: _____
Title/Company: agent / WGLCC

Checks Payable to: DIRECTOR OF FINANCE OF HOWARD COUNTY
PLEASE WRITE NEATLY & LEGIBLY
-FOR OFFICE USE ONLY-


AGENCY	DATE	SIGNATURE OF APPROVAL
State Highways		
Building Officials		
PSZA (Zoning)		
PSZA (Engineering)		
Health	<u>2-4-15</u>	<u>[Signature]</u>

Is Sediment Control approval required for issuance? Yes No
 CONTINGENCY CONSTRUCTION START


DPZ SETBACK INFORMATION	
Front:	
Rear:	
Side:	
Side St.:	
All minimum setbacks met?	<input type="checkbox"/> Yes <input type="checkbox"/> No
Is Entrance Permit Required?	<input type="checkbox"/> Yes <input type="checkbox"/> No
Historic District?	<input type="checkbox"/> Yes <input type="checkbox"/> No
Lot Coverage for New Town Zone:	
SDP/Red-line approval date:	

Filing Fee	\$
Permit Fee	\$
Tech Fee	\$
Excise Tax	\$
PSFS	\$ <u>135</u>
Guaranty Fund	\$
Add'l per Fee	\$
Total Fees	\$
Sub-Total Paid	\$
Balance Due	\$
Check	# <u>10603</u>


Distribution of Copies: White: Building Officials Green: PSZA,Zoning Yellow: PSZA,Engineering Pink: Health Gold: SHA

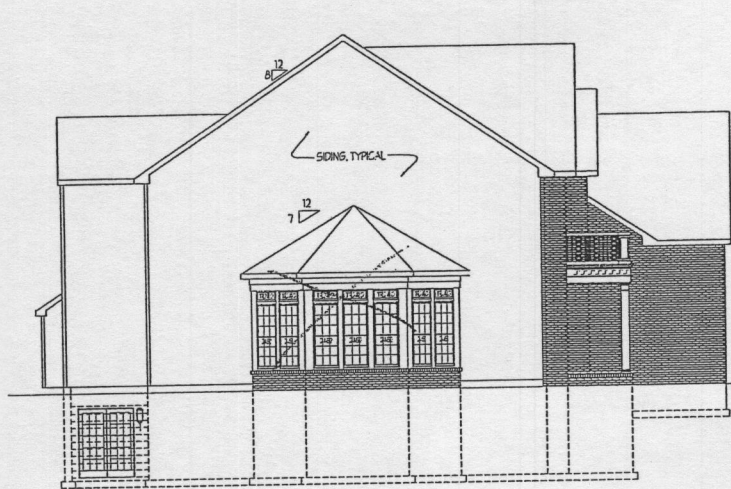


LEFT SIDE ELEVATION 1/8"=1'-0"
 OPTIONAL WALL OF WINDOWS,
 2 EXTENSION AND CONSERVATORY

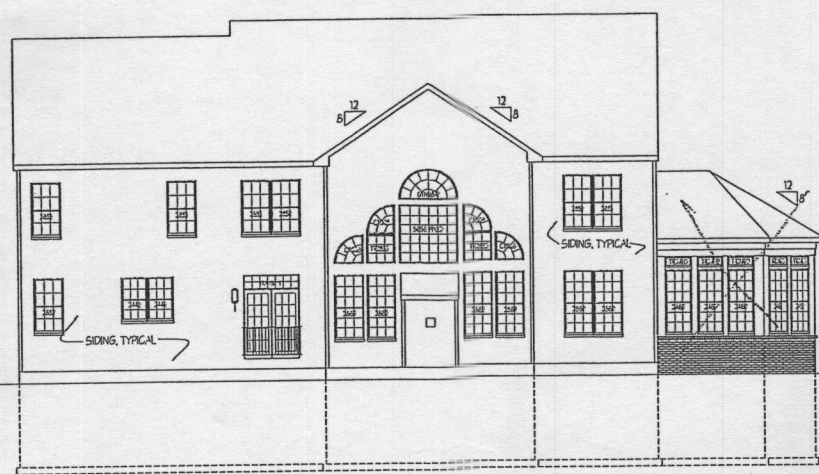

REAR ELEVATION 1/8"=1'-0"
 OPTIONAL WALL OF WINDOWS,
 2 EXTENSION AND CONSERVATORY

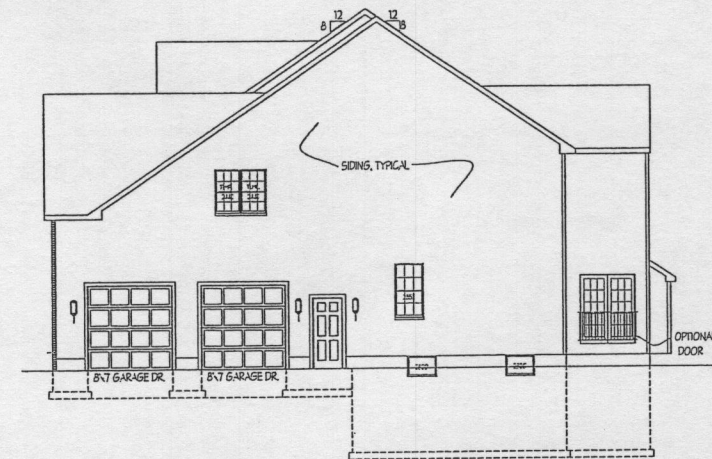

RIGHT SIDE ELEVATION 1/8"=1'-0"
 OPTIONAL WALL OF WINDOWS,
 2 EXTENSION, CONSERVATORY AND
 OPTIONAL SIDE LOAD CONDITION

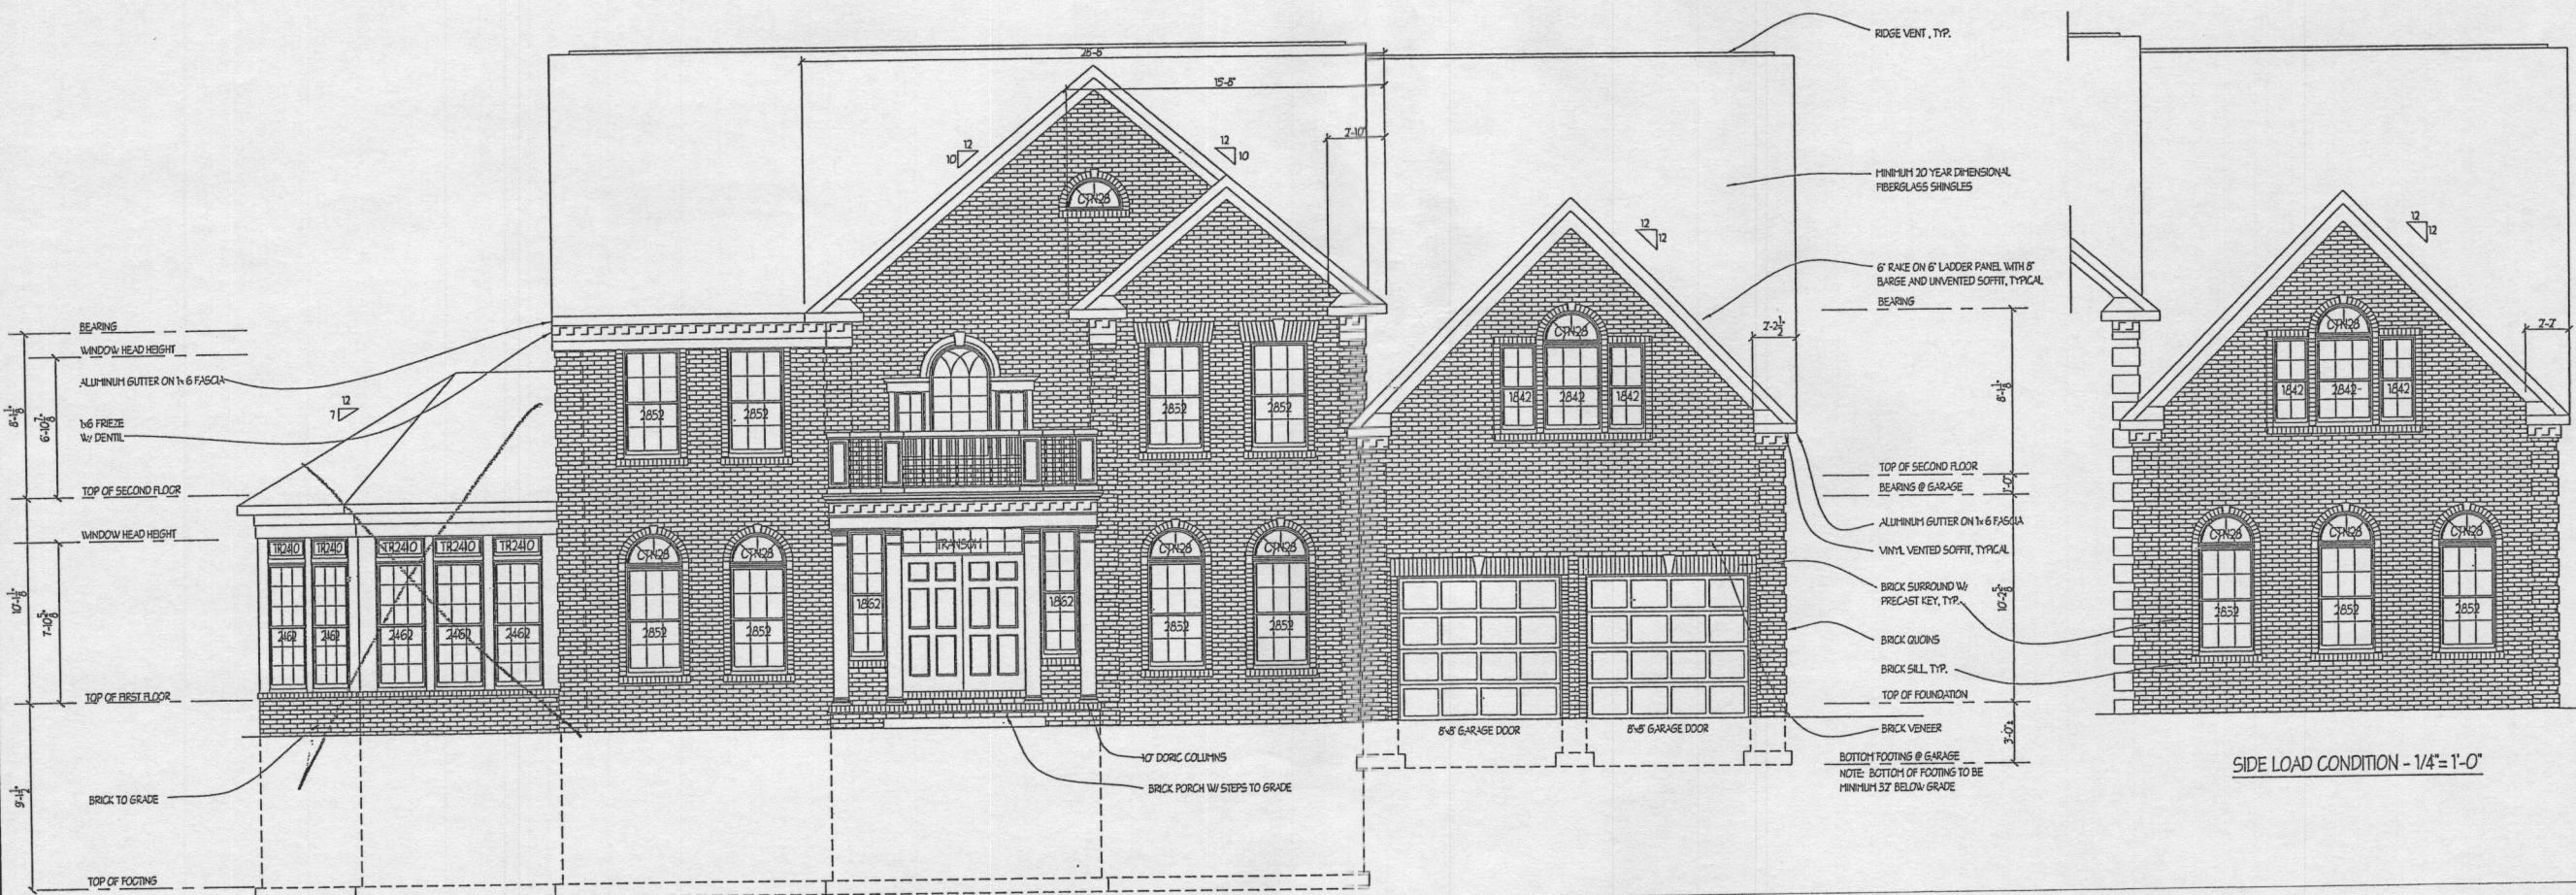

FRONT ELEVATION 1/4"=1'-0"
 5'-DOWN WITH OPTIONAL PORCH/CO
 PORCH, BRICK VENEER AND SUNROOM


SIDE LOAD CONDITION - 1/4"=1'-0"

DATE	REVISION

Date: 8/12
 Scale: NOTED
 Drawn: TIM

Drawing: ELEVATION 4
 Project: WILLIAMSBURG GROUP
 DORCHESTER 4

1067.D4
 Project No.



GENERAL REQUIREMENTS

1. WRITTEN DIMENSIONS ON THESE DRAWINGS SHALL HAVE PRECEDENCE OVER SCALED DIMENSIONS. CONTRACTORS SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS AND CONDITIONS ON THE JOB AND SHALL NOTIFY THE ARCHITECT OF ANY VARIATIONS FROM THE DIMENSIONS AND CONDITIONS SHOWN ON THESE DRAWINGS. SHOP DRAWINGS MUST BE SUBMITTED TO THE OWNER BEFORE PROCEEDING WITH FABRICATION OF STAIRS, ROOF AND/OR FLOOR TRUSSES.

1. DRAWINGS SHALL NOT BE SCALED FOR CONSTRUCTION. WHERE DRAWINGS ARE IN CONFLICT WITH OTHER DRAWINGS, SPECS OR DETAILS, THE CONTRACTOR SHALL CONTACT THE ARCHITECT FOR CLARIFICATION. LARGER SCALE DRAWINGS AND WRITTEN SPECIFICATION HAVE PRECEDENCE.

2. IN THE EVENT THAT CERTAIN FEATURES OR DETAILS ARE NOT FULLY SHOWN, CONTACT THE ARCHITECT FOR CLARIFICATION BEFORE PROCEEDING WITH THE WORK.

3. ALL PRODUCTS AND MATERIALS MUST BE INSTALLED IN STRICT ACCORDANCE WITH THE MANUFACTURERS WRITTEN INSTRUCTIONS. IF A CONFLICT EXISTS BETWEEN THE DRAWINGS AND THE MANUFACTURERS RECOMMENDATION, CONTACT THE ARCHITECT FOR CLARIFICATION. THE CONTRACTOR SHALL VERIFY THAT ALL MATERIAL INSTALLED SHALL COMPLY WITH APPLICABLE CODES AND REGULATIONS.

4. PROVIDE 22 1/2" x 30" ATTIC ACCESS WITH SWITCHED LIGHT, UNLESS OTHERWISE NOTED.

5. PROVIDE HANDRAILS 34"-36" ABOVE NOSINGS ON ALL STAIRS W/ THREE OR MORE RISERS. RETURN RAILS TO WALL OR NEWEL. REQUIRED HANDRAILS SHALL BE CONTINUOUS THE FULL LENGTH OF STAIR. HANDRAILS MAY BE INTERRUPTED BY A NEWEL AT A TURN. PROVIDE GUARDRAILS AT RAISED FLOORS, BALCONIES, ETC. 30" OR MORE ABOVE GRADE OR FLOOR BELOW. GUARDS SHALL BE MIN. 36" HIGH UNLESS NOTED OTHERWISE AND HAVE CLOSURES SPACED TO PREVENT PASSAGE OF 4" SPHERE. HANDRAILS SHALL HAVE MAX. 2 1/2" GRIP CROSS SECTION.

6. PROVIDE NOMINAL 2X FIRE BLOCKING AT EVERY FLOOR INTERIOR, BUILDINGS, CHASES, AND MIN-HEIGHT FOR WALLS OVER 9' TALL. IF OPEN WEB FLOOR TRUSSES ARE UTILIZED, PROVIDE 1/2" GYP. BRD. DRAFTSTOPPING, NOT TO EXCEED 500 S.F. UNLESS OTHERWISE, ARE FULLY SPRINKLERED.

7. PROVIDE A MINIMUM OF 6'-9" HEAD CLEARANCE FOR ALL STAIRS. STAIR RISERS SHALL NOT EXCEED 8" AND TREADS SHALL BE AT LEAST 9" WITH NOSINGS, UNLESS LOCAL JURISDICTION REQUIRES OTHERWISE. MAX. RISER AT EXTERIOR DOORS SHALL BE 7 1/4".

8. THE CONTRACTOR SHALL SEAL ALL PENETRATIONS AND OPENINGS IN FLOORS AND WALLS TO MINIMIZE THE TRANSFER OF DRAFTS & MOISTURE. SHEATHING PENETRATION SHALL BE PATCHED AND REPAIRED TO MANUFACTURERS SPECIFICATIONS.

9. SLOPE ALL CONCRETE STOODS, PORCHES, WALKS AND GARAGE SLABS 1/8" IN 12 TO DRAIN, OR AS NOTED ON PLANS.

10. ALL DESIGNS FOR MANUFACTURED FLOOR JOISTS, RAFTERS, AND TRUSSES SHALL BE CERTIFIED BY THE MANUFACTURER. INSTALLATION OF SUCH ITEMS SHALL BE IN STRICT ACCORDANCE WITH MANUFACTURERS SHOP DRAWINGS AND RECOMMENDATIONS.

11. CHIMNEYS SHALL EXTEND A MINIMUM OF 2' ABOVE ANY ROOF STRUCTURE WITHIN 10 FEET, BUT NO LESS THAN 3' AT POINT OF ROOF PENETRATION.

12. FLOOR JOISTS/TRUSSES AND ROOF TRUSSES SHALL ALIGN WITH BEARING STUDS AND/OR PROVIDE TRIPLE PLATES.

13. PRIVATE GARAGES SHALL BE SEPARATED FROM ADJACENT DWELLINGS AND ATTIC WITH MINIMUM 5/8" GYP. BRD. ON GARAGE SIDING AND 20 MINUTE SELF-CLOSING DOOR. WHEN BENEATH LIVING SPACE INSTALL 5/8" RATED G.B. ON CEILING & ALL SUPPORTING STRUCTURE.

14. DIMENSIONS GIVEN ON SCHEDULES ARE NOMINAL. GENERAL CONTRACTORS AND MANUFACTURERS ARE TO COORDINATE ALL DIMENSIONS CONCERNING DOORS, PANELS, WINDOWS AND THEIR OPENINGS PRIOR TO FABRICATION AND CONSTRUCTION.

15. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS, GRADES, BOUNDARIES, AND CONSTRUCTION BEFORE PROCEEDING WITH THE WORK AND REPORT IMMEDIATELY ANY DISCREPANCIES TO THE ARCHITECT AND/OR OWNER.

16. CONSTRUCTION SHALL COMPLY WITH THE LATEST EDITION OF THE CODES NOTED ON THE COVER SHEET AND ALL APPLICABLE LOCAL CODES AND ORDINANCES, AND FEDERAL, STATE AND LOCAL SAFETY REQUIREMENTS.

17. ALL CONSTRUCTION SHALL BE CLASSIFIED AS NOTED ON THE COVER SHEET.

18. DIMENSIONS GIVEN ON SCHEDULES ARE NOMINAL. GENERAL CONTRACTORS AND MANUFACTURERS ARE TO COORDINATE ALL DIMENSIONS CONCERNING DOORS, PANELS, WINDOWS AND THEIR OPENINGS PRIOR TO FABRICATION AND CONSTRUCTION.

19. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS, GRADES, BOUNDARIES, AND CONSTRUCTION BEFORE PROCEEDING WITH THE WORK AND REPORT IMMEDIATELY ANY DISCREPANCIES TO THE ARCHITECT AND/OR OWNER.

20. CONSTRUCTION SHALL COMPLY WITH THE LATEST EDITION OF THE CODES NOTED ON THE COVER SHEET AND ALL APPLICABLE LOCAL CODES AND ORDINANCES, AND FEDERAL, STATE AND LOCAL SAFETY REQUIREMENTS.

21. ALL CONSTRUCTION SHALL BE CLASSIFIED AS NOTED ON THE COVER SHEET.

22. DIMENSIONS GIVEN ON SCHEDULES ARE NOMINAL. GENERAL CONTRACTORS AND MANUFACTURERS ARE TO COORDINATE ALL DIMENSIONS CONCERNING DOORS, PANELS, WINDOWS AND THEIR OPENINGS PRIOR TO FABRICATION AND CONSTRUCTION.

23. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS, GRADES, BOUNDARIES, AND CONSTRUCTION BEFORE PROCEEDING WITH THE WORK AND REPORT IMMEDIATELY ANY DISCREPANCIES TO THE ARCHITECT AND/OR OWNER.

SITE WORK

21. PROVIDE HOUSE NUMBERS CLEARLY VISIBLE FROM THE STREET.

22. EXCAVATION SHALL BE SUFFICIENT TO PROVIDE FULL DESIGN DIMENSIONS OR TO ALLOW FORMING AS REQUIRED. NO FOOTINGS SHALL BE PLACED ON UNSATURATED MATERIAL (PROVIDING LESS THAN 1500 PSF CAPACITY).

23. SOIL BEARING CAPACITY SHALL BE VERIFIED BY THE CONTRACTOR.

24. BACKFILL SHALL ONLY BE CLEAN EARTH CONTAINING NO ORGANIC MATTER, GRADED WITH POSITIVE SLOPE. MIN. 6" IN FIRST 10'. FILL BENEATH STRUCTURE SHALL BE COMPACTED TO 90% DENSITY AS PER ASTM D1557 METHOD D.

25. PROVIDE 4" MINIMUM CONTINUOUS DRAIN TILE AROUND PERIMETER OF BASEMENT FOUNDATION. OPTIONAL INTERIOR DRAIN TILE MAY BE INSTALLED AT THE BUILDERS DISCRETION.

26. PROVIDE PASSIVE UNDER SLAB RADON VENTING W/ MIN. 3" DIA. VENT THROUGH ROOF WHEN REQUIRED BY LOCAL JURISDICTION AND IN ACCORDANCE WITH APPENDIX F OF THE IRC. SEE NOTE 10.5

27. APPLY TERMITICIDE WITH 2 FEET OF ENTIRE STRUCTURE IN ACCORDANCE WITH LOCAL AND APA STANDARDS. TREATMENT MUST HAVE A 5 YEAR GUARANTEE.

28. EXTREME CARE AND PROPER MEASURES SHALL BE USED WHILE INSTALLING BACKFILL SO AS NOT TO DAMAGE, BULGE, OR TIP WALL, SHORING, BRACING, ETC. SHALL BE EMPLOYED UNTIL THE FULL DEAD LOAD OF THE BUILDING IS ON THE WALLS.

CONCRETE

31. CONCRETE WORK SHALL CONFORM TO THE LATEST EDITION OF THE AMERICAN CONCRETE INSTITUTE STANDARDS, ACI-308, ACI-308.1, ACI-308.2, & ACI-308.3.

32. CONCRETE FOOTINGS SHALL HAVE MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 2500 PSI (UNLESS OTHERWISE NOTED).

33. ALL INTERIOR CONCRETE SLABS EXCEPT GARAGES SHALL HAVE MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 2500 PSI.

34. FOUNDATION WALLS SHALL HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 3000 PSI FOR MODERATE WEATHER & 3500 PSI FOR SEVERE WEATHER.

35. REINFORCING STEEL SHALL MEET ASTM A-615 AND A-305, HESH: 6-6 - 1.41.4 WAF ASTM A-483. REINFORCING IN FOOTINGS IS REQUIRED WHERE VARIATIONS IN SOIL CONDITIONS MAY EXIST OR AS NOTED ON COVER SHEET.

36. EXTERIOR CONCRETE AND GARAGE SLABS SHALL BE 5# TO 7# AIR ENTRAINED AND HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 3000 PSI FOR MODERATE WEATHER AND 3500 FOR SEVERE WEATHER.

37. ALL INTERIOR CONCRETE SLABS 30 FEET OR MORE IN ANY DIMENSION SHALL HAVE WAF, CONTROL JOINTS, OR FIBER REINFORCEMENT, PROVIDED BY EXPANSION MATERIAL AT ALL COLD POUR JOINTS.

38. PROVIDED VAPOR BARRIERS UNDER ALL SLABS. 6 MIL POLYETHYLENE L.P. ALL EDGES 6". LAY OVER 4" POROUS FILL.

39. THE BOTTOM OF ANY FOOTING SHALL BE PLACED AT MINIMUM FROST DEPTH AS NOTED ON COVER SHEET.

310. POURED WALL VERTICAL REINFORCING WHEN REQUIRED SHALL BE PLACED MIN. 5" FROM SOIL FACE.

311. PROVIDE VAPOR BARRIERS UNDER ALL SLABS. 6 MIL POLYETHYLENE L.P. ALL EDGES 6". LAY OVER 4" POROUS FILL.

312. THE BOTTOM OF ANY FOOTING SHALL BE PLACED AT MINIMUM FROST DEPTH AS NOTED ON COVER SHEET.

313. POURED WALL VERTICAL REINFORCING WHEN REQUIRED SHALL BE PLACED MIN. 5" FROM SOIL FACE.

314. PROVIDE VAPOR BARRIERS UNDER ALL SLABS. 6 MIL POLYETHYLENE L.P. ALL EDGES 6". LAY OVER 4" POROUS FILL.

315. THE BOTTOM OF ANY FOOTING SHALL BE PLACED AT MINIMUM FROST DEPTH AS NOTED ON COVER SHEET.

316. POURED WALL VERTICAL REINFORCING WHEN REQUIRED SHALL BE PLACED MIN. 5" FROM SOIL FACE.

317. PROVIDE VAPOR BARRIERS UNDER ALL SLABS. 6 MIL POLYETHYLENE L.P. ALL EDGES 6". LAY OVER 4" POROUS FILL.

318. THE BOTTOM OF ANY FOOTING SHALL BE PLACED AT MINIMUM FROST DEPTH AS NOTED ON COVER SHEET.

319. POURED WALL VERTICAL REINFORCING WHEN REQUIRED SHALL BE PLACED MIN. 5" FROM SOIL FACE.

320. PROVIDE VAPOR BARRIERS UNDER ALL SLABS. 6 MIL POLYETHYLENE L.P. ALL EDGES 6". LAY OVER 4" POROUS FILL.

321. THE BOTTOM OF ANY FOOTING SHALL BE PLACED AT MINIMUM FROST DEPTH AS NOTED ON COVER SHEET.

322. POURED WALL VERTICAL REINFORCING WHEN REQUIRED SHALL BE PLACED MIN. 5" FROM SOIL FACE.

4.12 ONLY IF APPLICABLE AND SHOWN IN THE DRAWINGS, FOR ATTACHED DWELLINGS, MASONRY FIREWALLS SHALL BE CONSTRUCTED TO CLASSIFICATION D-2, 8" CMU IN ACCORDANCE WITH U.L. 1805 TO PROVIDE 2-HOUR SEPARATION FROM FOUNDATION TO UNDERSIDE OF ROOF SHEATHING.

4.13 BEAMS OR HEADERS BEARING ON MASONRY FIREWALLS SHALL HAVE A MIN. 4" MASONRY SEPARATION FROM ADJACENT DWELLINGS, AND SHALL BE FIRE CUT.

4.14 MANUFACTURED THIN STONE VENEER SHALL BE INSTALLED PER MANUFACTURER'S REQUIREMENTS AND NER602.

METALS

5.1 ALL STRUCTURAL STL SHALL CONFORM TO ASTM SPECIFICATION A-36.

5.2 STRAP ANCHORS OR ANCHOR BOLTS SHALL BE BUILDING INSPECTOR APPROVED. MINIMUM (2) 1/2" DIA. BOLTS PER SECTION OR PLATING, 12" FROM EACH END WITH INTER-GRATE BOLTS AT 6'-0" O.C. MAXIMUM STRAP SPACING NOT TO EXCEED MANUFACTURERS SPECIFICATIONS.

5.3 METAL JOIST HANGERS SHALL BE USED AT ALL FLUSH CONNECTIONS TO SUPPORT THE FULL CAPACITY OF THE JOIST OR BEAM. CONNECTORS USED FOR P.T. LUMBER SHALL BE CORROSION RESISTANT AS APPROVED BY THE MANUFACTURER. ALUM. FLASHING SHALL BE USED IN DIRECT CONTACT WITH P.T. LUMBER.

5.4 NAILS: USE NUMBER AND TYPE FOR EACH APPLICATION AS CALLED FOR IN THE CURRENT MODEL CODE OR MANUFACTURERS RECOMMENDED STANDARD.

5.5 VENEER TIES SHALL BE 1" WIDE, 20GA, GALVANIZED STEEL, INSTALLED 24" O.C. HORIZONTAL AND 16" O.C. VERTICALLY.

5.6 PROVIDE STEEL LINTELS FOR ALL OPENINGS AND RECESSES IN BRICK OR BRICK FACED MASONRY WALL 50" IF NOT OTHERWISE NOTED.

5.7 LINTEL SCHEDULE (UNLESS OTHERWISE NOTED ON PLANS): L-1 3 1/2" x 3 1/2" x 5/16" STEEL ANGLE UP TO 3' OPG. L-2 4" x 3 1/2" x 5/16" STEEL ANGLE 3 TO 5' OPG. L-3 5" x 3 1/2" x 5/16" STEEL ANGLE 5 TO 6'-6" OPG. L-4 6" x 3 1/2" x 5/16" STEEL ANGLE UP TO 9' OPG.

5.8 LINTELS SHOWN SHALL NOT SUPPORT ANY SUPERPOSED LOADS.

5.9 ALL STEEL ANGLES IN MASONRY WALLS SHALL BE FLASHED AND PAINTED.

5.10 COAT ALL FERROUS METALS EXCEPT COMPLETELY PRE-FINISHED FACTORY ITEMS, WITH RUST INHIBITIVE PAINT.

5.11 ADJUSTABLE STEEL COLUMNS SHOWN ON THE DRAWINGS SHALL BE MANUFACTURED IN ACCORDANCE WITH CURRENT MODEL CODE STANDARDS IN O.D. SIZES SPECIFIED.

5.12 WOOD PLATE ATTACHMENT TO STEEL BEAMS SHALL BE WITH 1/2" DIA. BOLTS AT 24" STAGGERED O.C.

WOOD

6.1 ALL STRUCTURAL LUMBER SHALL BE STAMPED IN ACCORDANCE WITH THE "CONSTRUCTION HANDBOOK" OF THE AMERICAN INSTITUTE OF WOOD PRESERVATION AND STORE IN DRY LOCATION.

6.2 PRESSURE TREATED LUMBER SHALL CONFORM WITH ANPA-11 & 14. FOR THE SPECIES, PRODUCT, PRESERVATIVE, AND END USE.

6.3 JOISTS AND GIRDERS: SEE PLANS FOR SIZE, SPACING AND MINIMUM GRADE AND SPECIES. HEM FIR AND SPRUCE-PINE-FIR (SPF) SHALL BE NORTHERN SPECIES ONLY. MAX. MOISTURE CONTENT SHALL NOT EXCEED 19%.

6.4 PROVIDE DOUBLE SOLID JOISTS UNDER ALL PARALLEL PARTITIONS OVER 5'-0" IN LENGTH UNLESS MANUFACTURERS SHOP DRAWINGS SHOW OTHERWISE.

6.5 WHEN ENGINEERING BEAMS ARE SPECIFIED ON THE DRAWINGS AS LVL OR PSL, THEY ARE INTERCHANGEABLE. (MIN. Fb = 2600 PSF) NO OTHER SUBSTITUTIONS ARE TO BE MADE WITHOUT ARCHITECTS APPROVAL. ALL SUCH BEAMS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH THE MANUFACTURERS WRITTEN INSTRUCTIONS.

6.6 BEARING WALL STUDS SHALL BE MINIMUM SPF STUD GRADE, 10 OR BETTER AT 16" O.C. L.P. ALL DOUBLE TOP PLATE JOINTS A MIN. OF 24".

6.7 EXTERIOR WALLS, UP TO 10' SUPPORTING (1) FLOOR & ROOF MAY BE 24" @ 16" O.C. SUPPORTING (2) FLOORS AND ROOF SHALL BE 24" @ 16" O.C. COMPLY W/ IRC-602.3.

6.8 INTERIOR NON-BEARING WALLS MAY BE SPF 13-24 STUDS, 24" O.C.

6.9 LATERAL WALL BRACINGS SHALL BE PROVIDED BY CONTINUOUS APPROVED STRUCTURAL SHEATHING INSTALLED IN ACCORDANCE WITH THE MANUFACTURERS SPECS. ALTERNATIVE WALL BRACINGS MUST COMPLY W/ SECTION 6020 OF THE IRC.

6.10 RAFTERS-SEE PLANS FOR SIZE, SPACING, MINIMUM GRADE AND SPECIES.

6.11 DESIGN, FABRICATION AND INSTALLATION OF WOOD TRUSSES AND SHEET METAL CONNECTORS SHALL BE IN ACCORDANCE WITH TRUSS PLATE INSTITUTE TP-82. STRUCTURAL DESIGN OR MODIFICATION SHALL BE BY A REGISTERED PROFESSIONAL ENGINEER.

6.12 BRACINGS OF WOOD TRUSSES TO BE IN ACCORDANCE WITH THE APPROVED SHOP DRAWINGS AND THE TRUSS PLATE INSTITUTE, INC. PUBLICATION. BRACING WOOD TRUSSES CONCURRENTLY AND RECOMMENDATIONS - HB 3L INSTALL MIN. OF (2) 24" DIAGONAL BRACES AT APPROX. 45 DEGREES, FROM BOTTOM CHORD TO RIDGE IN EACH ROOF SECTION.

6.13 ALL PLYWOOD USED STRUCTURALLY SHALL MEET THE PERFORMANCE STANDARDS AND ALL OTHER REQUIREMENTS OF APPLICABLE U.S. COMMERCIAL STANDARDS FOR THAT TYPE, GRADE AND SPECIES OF WOOD, AND SHALL BE IDENTIFIED BY AN APPROVED TESTING AGENCY.

6.14 PLYWOOD SUBFLOORING SHALL BE GLUED AND NAILED TO JOISTS IN ACCORDANCE WITH APA RECOMMENDATIONS. LEAVE 1/8" SPACER AT ALL EDGES FOR EXPANSION OR AS PER MANUF. RECOMMENDATIONS.

6.15 PLYWOOD ROOF SHEATHING SHALL BE INSTALLED WITH PANEL CLIPS (1 PER BAY), LEAVE 1/8" SPACE AT PANEL EDGES.

6.16 REFERENCE TO NOMINAL THICKNESS SHALL MEAN THE FOLLOWING ACTUAL THICKNESS AND SPECIFICATIONS: 3/4" = 23/32" APA RATED STURD-FLOOR 24 O.C. EXPOSURE 5/8" = 19/32" APA RATED STURD-FLOOR 24 O.C. EXPOSURE 1/2" = 15/32" APA RATED SHEATHING 3246 EXPOSURE 7/8" = 21/32" RATED SHEATHING 3250 2446 EXPOSURE.

6.17 ONLY IF APPLICABLE AND SHOWN ON THE DRAWINGS ATTACHED DWELLINGS W/ 2 HOUR RATED FIRE SEPARATION SHALL HAVE FIRE RESISTANT TREATED (F.R.T.) ROOF SHEATHING 4-FEET EACH SIDE OF THE PARTYWALL CENTERLINE. PLYWOOD SHALL BE CERTIFIED NOT TO CAUSE ACO HYDROLYSIS AT MOST CONDITIONS AT TEMPERATURE BELOW 400 F. ALTERNATIVES TO THE USE OF F.R.T. SHALL ONLY BE AS APPROVED BY THE LOCAL JURISDICTION. THE INSTALLATION OF AN APPROVED FIRE RESISTANT SYSTEM INSTALLED IN ACCORDANCE WITH NFPA 130 MAY ALLEVIATE THE NEED FOR F.R.T. IN CERTAIN JURISDICTIONS. VERIFY WITH BUILDING CODE OFFICIAL.

6.18 ALL WOOD LESS THAN 8" FROM GRADE OR IN DIRECT CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE TREATED PER CURRENT ANPA STANDARDS.

6.19 NAILS IN TOP OR BOTTOM OF SOLID JOIST SHALL BE 16" ON CENTER, 16" OF DEPTH AND SHALL NOT OCCUR IN CENTER THIRD OF SPAN.

6.20 HOLES BORED IN SOLID JOIST SHALL NOT BE WITHIN 2" OF TOP OR BOTTOM, AND SHALL NOT EXCEED 1/3 DEPTH.

6.21 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR HEADERS SHALL BE MIN. SPF NO. 2 (Fb = 675 PSF) OF SIZE SPECIFIED ON DRAWINGS.

6.22 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR JACK STUDS SHALL BE MIN. STUD GRADE, KD OR BETTER. PROVIDE SINGLE JACK STUDS AT OPENINGS LESS THAN 4'-0" AND DOUBLE JACK STUDS AT OPENINGS UP TO 7'-0".

6.23 ALL FASTENERS SHALL BE IN ACCORD WITH TABLE 6023.3 AND RANGES OF THE IRC. ATTACH BASEMENT WALL PLATES TO SLAB W/ POWER DRIVEN DRIVERS @ 16" O.C.

6.24 HOLE STUDS OR POSTS SHALL BE BLOCKED SOLID THROUGH FLOORS AS REQUIRED TO PROVIDE CONTINUOUS SUPPORT TO THE FOUNDATION.

6.25 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR JACK STUDS SHALL BE MIN. STUD GRADE, KD OR BETTER. PROVIDE SINGLE JACK STUDS AT OPENINGS LESS THAN 4'-0" AND DOUBLE JACK STUDS AT OPENINGS UP TO 7'-0".

6.26 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR HEADERS SHALL BE MIN. SPF NO. 2 (Fb = 675 PSF) OF SIZE SPECIFIED ON DRAWINGS.

6.27 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR JACK STUDS SHALL BE MIN. STUD GRADE, KD OR BETTER. PROVIDE SINGLE JACK STUDS AT OPENINGS LESS THAN 4'-0" AND DOUBLE JACK STUDS AT OPENINGS UP TO 7'-0".

6.28 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR HEADERS SHALL BE MIN. SPF NO. 2 (Fb = 675 PSF) OF SIZE SPECIFIED ON DRAWINGS.

6.29 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR JACK STUDS SHALL BE MIN. STUD GRADE, KD OR BETTER. PROVIDE SINGLE JACK STUDS AT OPENINGS LESS THAN 4'-0" AND DOUBLE JACK STUDS AT OPENINGS UP TO 7'-0".

6.30 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR HEADERS SHALL BE MIN. SPF NO. 2 (Fb = 675 PSF) OF SIZE SPECIFIED ON DRAWINGS.

6.31 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR JACK STUDS SHALL BE MIN. STUD GRADE, KD OR BETTER. PROVIDE SINGLE JACK STUDS AT OPENINGS LESS THAN 4'-0" AND DOUBLE JACK STUDS AT OPENINGS UP TO 7'-0".

6.32 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR HEADERS SHALL BE MIN. SPF NO. 2 (Fb = 675 PSF) OF SIZE SPECIFIED ON DRAWINGS.

6.33 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR JACK STUDS SHALL BE MIN. STUD GRADE, KD OR BETTER. PROVIDE SINGLE JACK STUDS AT OPENINGS LESS THAN 4'-0" AND DOUBLE JACK STUDS AT OPENINGS UP TO 7'-0".

6.34 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR HEADERS SHALL BE MIN. SPF NO. 2 (Fb = 675 PSF) OF SIZE SPECIFIED ON DRAWINGS.

6.35 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR JACK STUDS SHALL BE MIN. STUD GRADE, KD OR BETTER. PROVIDE SINGLE JACK STUDS AT OPENINGS LESS THAN 4'-0" AND DOUBLE JACK STUDS AT OPENINGS UP TO 7'-0".

6.36 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR HEADERS SHALL BE MIN. SPF NO. 2 (Fb = 675 PSF) OF SIZE SPECIFIED ON DRAWINGS.

6.37 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR JACK STUDS SHALL BE MIN. STUD GRADE, KD OR BETTER. PROVIDE SINGLE JACK STUDS AT OPENINGS LESS THAN 4'-0" AND DOUBLE JACK STUDS AT OPENINGS UP TO 7'-0".

6.38 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR HEADERS SHALL BE MIN. SPF NO. 2 (Fb = 675 PSF) OF SIZE SPECIFIED ON DRAWINGS.

6.39 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR JACK STUDS SHALL BE MIN. STUD GRADE, KD OR BETTER. PROVIDE SINGLE JACK STUDS AT OPENINGS LESS THAN 4'-0" AND DOUBLE JACK STUDS AT OPENINGS UP TO 7'-0".

6.40 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR HEADERS SHALL BE MIN. SPF NO. 2 (Fb = 675 PSF) OF SIZE SPECIFIED ON DRAWINGS.

6.41 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR JACK STUDS SHALL BE MIN. STUD GRADE, KD OR BETTER. PROVIDE SINGLE JACK STUDS AT OPENINGS LESS THAN 4'-0" AND DOUBLE JACK STUDS AT OPENINGS UP TO 7'-0".

6.42 UNLESS NOTED ELSEWHERE ON THESE DRAWINGS, STRUCTURAL WINDOW AND DOOR HEADERS SHALL BE MIN. SPF NO. 2 (Fb = 675 PSF) OF SIZE SPECIFIED ON DRAWINGS.

DOORS AND WINDOWS

8.1 THE CONTRACTOR SHALL VERIFY & COORDINATE ROUGH OPENINGS FOR ALL DOORS & WINDOWS PRIOR TO START OF CONSTRUCTION. INSTALLATION SHALL BE IN ACCORD W/ MANUFACTURERS INSTRUCTIONS.

8.2 EACH SLEEPING ROOM AND BASEMENT SPACE (UNLESS AMENDED OTHERWISE BY LOCAL JURISDICTION) SHALL HAVE AT LEAST ONE OPERABLE WINDOW PROVIDING 5.7 S.F. (5.4 S.F. AT GRADE CONDITIONS) OF NET CLEAR OPENING AS CERTIFIED BY THE MANUFACTURER. PERS. WITH ALL SILL HEIGHT NOT MORE THAN 44" A.F.F. OR OTHER CLEAR DIRECT MEANS OF EGRESS TO THE OUTSIDE. WINDOW WELLS, IF REQUIRED, SHALL BE MIN. 3" x 3".

8.3 SAFETY (TEMPERED) GLAZING SHALL BE PROVIDED IN: - GLASS DOORS, E. SIDELIGHTS - SHOWER AND TUB ENCLOSURES AND WINDOWS WITHIN 6" OF TUB - GLAZING ON STAIR LANDINGS - FIXED PANELS GREATER THAN 9 S.F., WITHIN 18" A.F.F. - GLAZING WITHIN 12" OF A STAIR RAILING - GLAZING WITHIN 24" RADIUS OF CLOSED DOORS

8.4 IF APPLICABLE, PROVIDE SELF-CLOSING DOOR BETWEEN DWELLINGS AND 6-RANGE. DOOR SHALL BE 1/2" THICK SOLID WOOD OR INSULATED STEEL W/ MIN. 20 MIN. RATINGS.

FINISHES

9.1 DRYWALL: 1/2" TAPERED EDGE GYPSUM BOARD APPLIED, TAPED, AND FINISHED IN ACCORDANCE WITH GYPSUM ASSOCIATION 6A-206 AND ASTM C-840.

9.2 5/8" GYPSUM BOARD IS TO BE USED TO COMPLETELY SEPARATE GARAGE FROM LIVING AREA, APPLIED ON GARAGE SIDE PER THE PLANS, OR IN MANNER ACCEPTABLE TO LOCAL JURISDICTION.

9.3 IF APPLICABLE AND AS SHOWN ON THE DRAWINGS, PROVIDE FIRE RESISTANT RATED ASSEMBLIES AS DETAILED FOR PARTYWALLS OR OTHER RATED WALLS OR FLOORS. INSTALLATION SHALL BE IN STRICT ACCORDANCE WITH THE TESTING AGENCY'S REQUIREMENTS.

9.4 UNDERSIDE & WALLS OF ACCESSIBLE ENCLOSED SPACE UNDER STAIRS SHALL BE PROTECTED W/ 1/2" GYPSUM BOARD.

9.5 WHEN CERAMIC TILE IS USED, WATER RESISTANT GYPSUM BOARD 1/2" THICK OR APPROVED EQUAL, IS REQUIRED AT TUB AND SHOWER SURROUNDS TO A HEIGHT OF 36" ABOVE TUB OR SHOWER PAN. GLASS MESH REINFORCEMENT BOARD IS A PREFERRED ALTERNATIVE. NOTE: W.R. GYP. BOARD SHALL NOT BE INSTALLED OVER A VAPOR BARRIER IN TUB OR SHOWER COMPARTMENTS.

9.6 PAINT (INTERIOR) UNLESS DIRECTED OTHERWISE: CEILING: (1) COAT PRIMER, (2) COAT FLAT LATEX FINISH WALLS; (3) COAT PRIMER, (4) COAT FLAT LATEX FINISH TRIM; (5) COAT PRIMER, (6) COAT SEMI-GLOSS ENAMEL FINISH TRIM.

9.7 PAINT (EXTERIOR) UNLESS DIRECTED OTHERWISE: (1) TRIM; (2) COAT PRIMER, (3) COAT EXTERIOR GRADE EXTERIOR LATEX ENAMEL.

9.8 CERAMIC TILE WALLS SHALL BE GLAZED MOSAIC TILE OVER WATER RESISTANT GYPSUM BOARD OR GLASS MESH REINFORCING UNITS. USE THIN SET ORGANIC ADHESIVE (ANSI A108.4) OVER GYPSUM BOARD AND DRY-SET LATEX PORTLAND MORTAR (ANSI A108.5) OVER CEMENT BOARD. FLOOR TILES SHALL BE GLAZED MOSAIC TILE OVER MINIMUM 5/8" PLYWOOD UNDERLAYMENT, SCREWED 12" O.C. TO SUBFLOOR OR AS RECOMMENDED BY MANUFACTURER. USE EPOXY MORTAR AND GROUP APPLICATION (ANSI A118.3) JOIST SPACING SHALL NOT EXCEED 18" O.C.

9.9 RESILIENT FLOORS SHALL BE SELF-VINYL RESILIENT FLOORING, OVER 1/2" MINIMUM FIBERBOARD OR PLYWOOD UNDERLAYMENT OR AS DIRECTED BY THE OWNER.

9.10 TOILET AND BATH ACCESSORIES SHALL BE AS SPECIFIED BY THE OWNER.

9.11 MIRRORS: MIRROR QUALITY & SIZES PER PLANS, OR AS SPECIFIED BY THE OWNER.

9.12 PROVIDE EITHER SHOWER RODS 807 A.F.F. OR TEMPERED OR SAFETY LAMINATE GLASS DOORS, AS SPECIFIED BY THE OWNER.

9.13 PROVIDE ONE DAMPER REGISTER PER 400 SQUARE FEET OF UNFINISHED BASEMENT SPACE IF APPLICABLE.

9.14 PROVIDE EXHAUST FANS AT EACH BATH, AND VENT TO EXTERIOR OF DWELLINGS. MIN. 50 CFM.

9.15 IF APPLICABLE & REQUIRED BY THE GOVERNING LAWS, PROVIDE FIRE SUPPRESSION SYSTEMS IN ACCORDANCE WITH NFPA 13D. CONFIRM SUCH REQUIREMENTS WITH THE LOCAL JURISDICTION BEFORE PROCEEDING WITH ANY WORK.

9.16 ALL DUCTWORK THAT PENETRATES A RATED WALL OR FLOOR ASSEMBLY SHALL BE PROVIDED WITH FIRE DAMPERS.

9.17 PROVIDE ONE DAMPER REGISTER PER 400 SQUARE FEET OF UNFINISHED BASEMENT SPACE IF APPLICABLE.


9.18 PROVIDE EXHAUST FANS AT EACH BATH, AND VENT TO EXTERIOR OF DWELLINGS. MIN. 50 CFM.

9.19 IF APPLICABLE & REQUIRED BY THE GOVERNING LAWS, PROVIDE FIRE SUPPRESSION SYSTEMS IN ACCORDANCE WITH NFPA 13D. CONFIRM SUCH REQUIREMENTS WITH THE LOCAL JURISDICTION BEFORE PROCEEDING WITH ANY WORK.


9.20 ALL DUCTWORK THAT PENETRATES A RATED WALL OR FLOOR ASSEMBLY SHALL BE PROVIDED WITH FIRE DAMPERS.

9.21 PROVIDE ONE DAMPER REGISTER PER 400 SQUARE FEET OF UNFINISHED BASEMENT SPACE IF APPLICABLE.

9.22 PROVIDE EXHAUST FANS AT EACH BATH, AND VENT TO EXTERIOR OF DWELLINGS. MIN. 50 CFM.

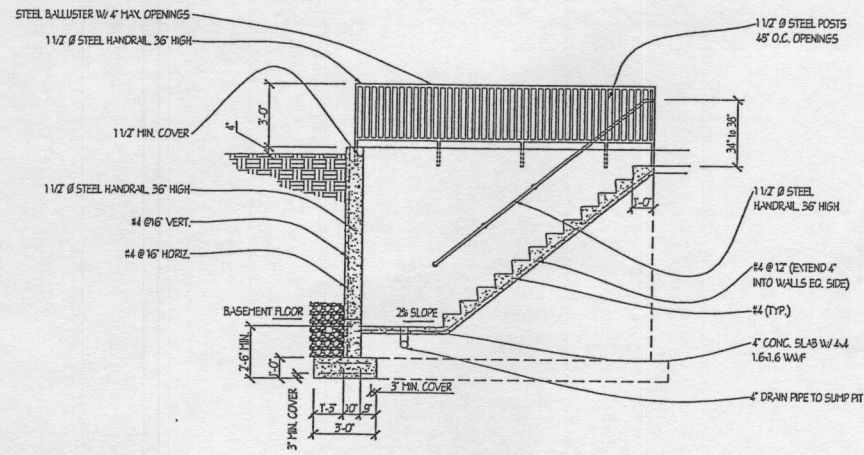


LONGITUDINAL SECTION-AREAWAY STAIR

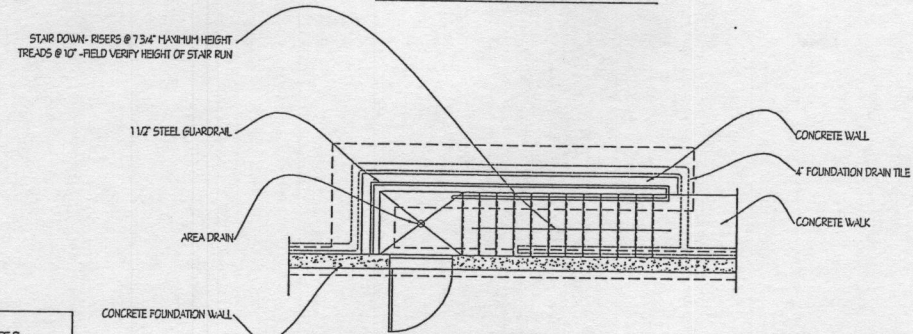


AREA FLOOR PLAN

BASEMENT AREAWAY/DRAIN NOTES:

- 1- THE AREAWAY STAIR LANDINGS SHALL BE AT LEAST 4" BELOW THE INTERIOR FLOOR SLAB AND SLOPE TO DRAIN TO AN APPROVED GENERAL PURPOSE AREA DRAIN.
- 2- THE GENERAL PURPOSE DRAIN SHALL HAVE AN INTAKE OR STRAINER WITH A MINIMUM DIAMETER OF 6" AND A MINIMUM PIPE OUTFALL OF 4".
- 3- THE DRAIN SHALL HAVE A STRAINER LID OR BODY THAT PROVIDES ACCESSIBILITY FOR MAINTENANCE OF DRAIN BODY AND PIPE.
- 4- THE AREA DRAIN SHALL BE CONNECTED TO A RIGID PIPE WITH MINIMUM FALL OF 1/8" PER FOOT PIPED TO SUMP PUMP CROCK OR A DAY-LIGHTED OUTFALL AT GRADE.
- 5- THE RIGID PIPE SHALL NOT BE CONNECTED TO THE INTERIOR OR EXTERIOR FOUNDATION DRAIN OR DRAIN TILE.
- 6- THE PIPE SHALL BE SLEEVED WHERE IT PASSES THROUGH THE FOUNDATION WALL OR FROST PROTECTED FOOTING.
- 7- THE GENERAL PURPOSE DRAIN ASSEMBLY AND RIGID PIPE MAY BE CONSTRUCTED OF SCHEDULE 40 PVC, CAST IRON, OR EQUIVALENT APPROVED RIGID PIPE.

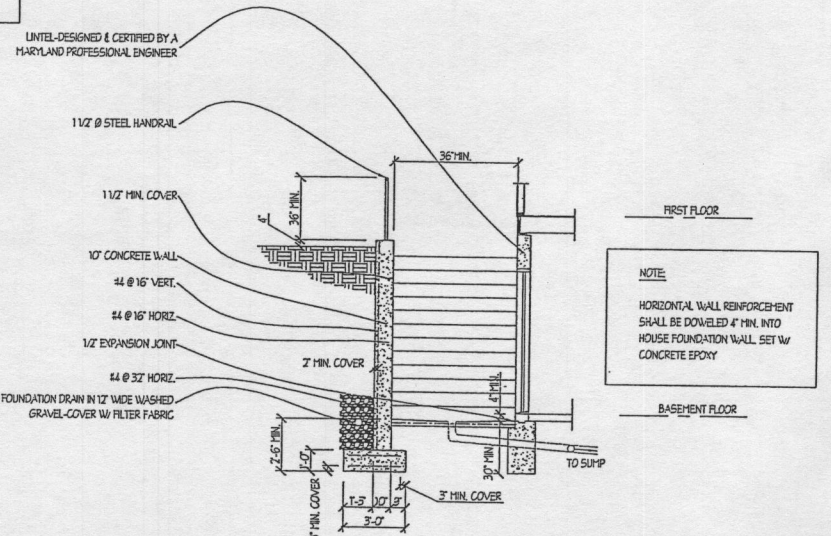


CROSS SECTION-AREAWAY

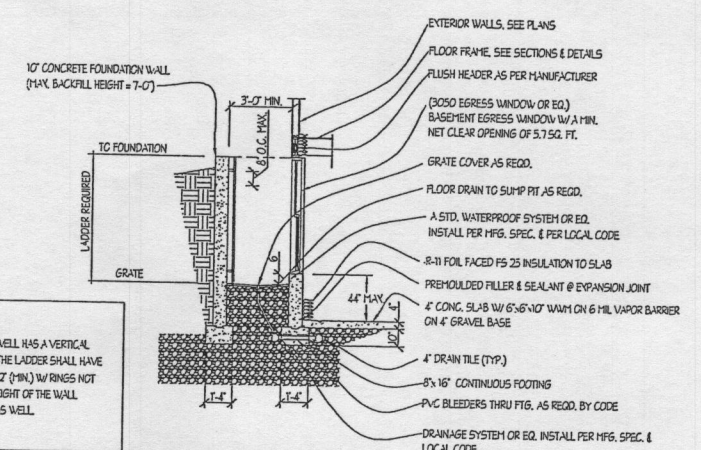


WINDOW WELL DETAIL

NOTE:
LADDER TO BE PROVIDED WHEN WINDOW WELL HAS A VERTICAL DEPTH GREATER THAN 4' BELOW GRADE. THE LADDER SHALL HAVE AN INSIDE DIMENSION OF NOT LESS THAN 12" (MIN) W/ RINGS NOT MORE THAN 18" O.C. VERT. FOR THE FULL HEIGHT OF THE WALL. LADDER LOCATED ON SIDE WALL OF EGRESS WELL.

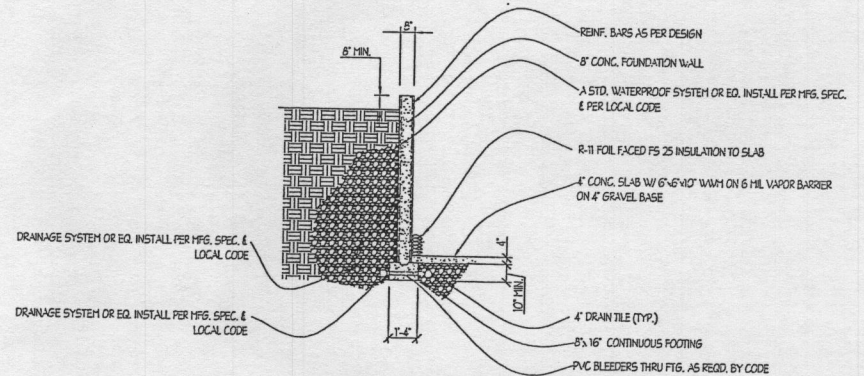

8" WALL SECTION (NO BRICK OR STONE ABOVE GRADE)

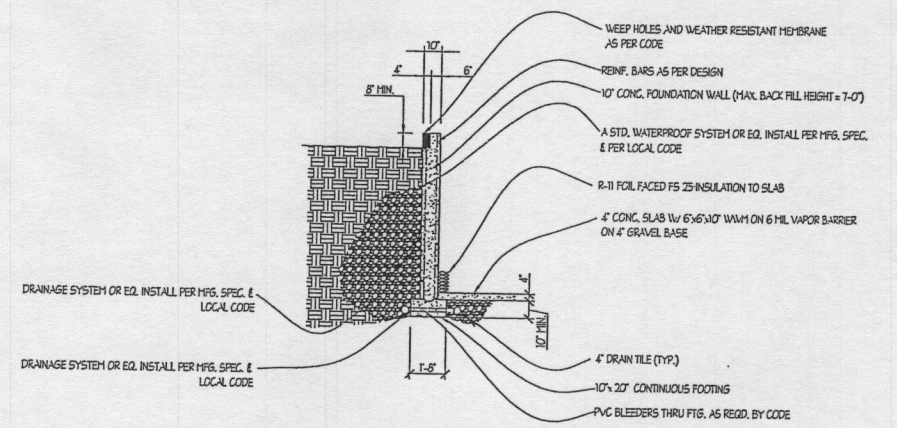

10" WALL SECTION (TO SUPPORT BRICK OR STONE VENEER ABOVE GRADE)

Plymouth Road Architects
640 Plymouth Road, Catonsville, MD 21229 410-788-0281

DATE	REVISION


Date: 8/10
Scale: 1/4"=1'-0"
Drawn: TIM

Drawing: AREAWAY DETAILS
Project: WILLIAMSBURG GROUP
DORCHESTER 4


1067.D4
Project No.

D3


REVISED 8/12

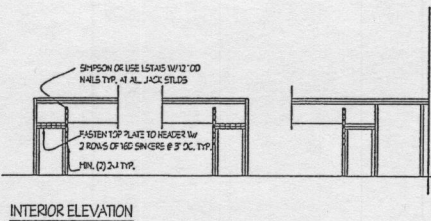


INTERIOR ELEVATION

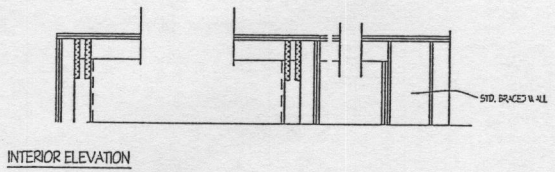


INTERIOR ELEVATION

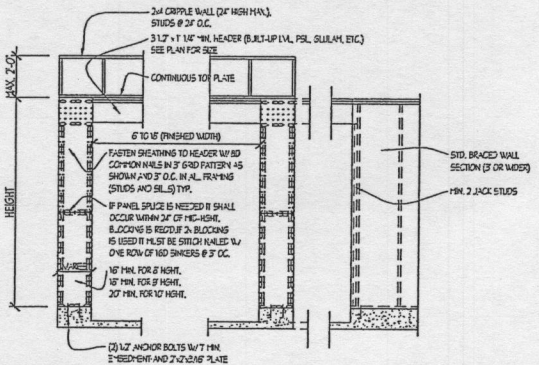


EXTERIOR ELEV. DIRECT TO FOUNDATION

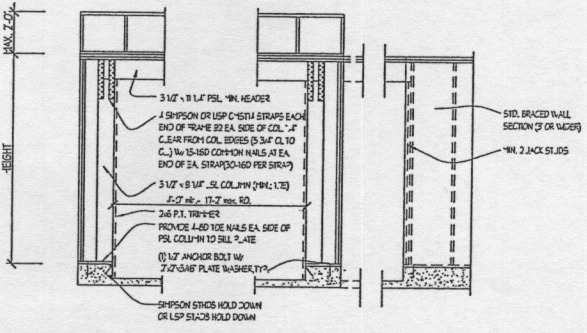

EXTERIOR ELEV. DIRECT TO FOUNDATION



EXTERIOR ELEV. OVER RAISED FLOOR



EXTERIOR ELEV. OVER RAISED FLOOR

NARROW WALL PORTAL DETAILS - TYPE 1
2-6 WALLS MEET SAME REQUIREMENT

LSL COLUMN PORTAL DETAILS - TYPE 2

NARROW WALL BRACING DETAILS, SCALE: 1/4"=1'-0"

NOTE: PORTAL FRAMES ARE DESIGNED TO REPLACE THE REG. BRACED WALL SEGMENT UP TO 47' LONG FOR 8\"/>

LENGTH REQUIREMENTS FOR BRACED WALL PANELS IN A CONTINUOUSLY SHEATHED WALL


A. LINEAR INTERPOLATIONS SHALL BE PERMITTED
B. FULL-HEIGHT SHEATHED WALL SEGMENTS TO EITHER SIDE OF GARAGE OPENINGS THAT SUPPORT LIGHT FRAME ROOFS ONLY, WITH ROOF COVERING DEAD LOADS OF 30PSF OR LESS SHALL BE PERMITTED TO HAVE A 4:1 ASPECT RATIO.

MINIMUM LENGTH OF BRACED WALL PANEL (INCHES)			MAXIMUM OPENING HEIGHT NEXT TO THE BRACED WALL PANEL (% OF WALL HEIGHT)	
48	54	60	100%	
32	36	40	85%	
24	27	30	65%	



NOTE:
WALL BRACING:
ALL EXTERIOR WALLS SHALL BE BRACED IN ACCORDANCE WITH THIS SECTION. IN ADDITION, INTERIOR BRACED WALL LINES SHALL BE PROVIDED IN ACCORDANCE WITH SECTION 602.10.1.1. FOR BUILDINGS IN SEISMIC DESIGN CATEGORIES, D1 AND D2, WALLS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE ADDITIONAL REQUIREMENTS OF 602.10.9, 602.10.11, AND 602.11.
602.10.1
BRACED WALL LINES SHALL CONSIST OF BRACED WALL PANEL CONSTRUCTION METHODS IN ACCORDANCE WITH SECTION 602.10.3. THE AMOUNT AND LOCATION OF BRACING SHALL BE IN ACCORDANCE WITH TABLE 602.10.1 AND THE AMOUNT OF BRACING SHALL BE THE GREATER OF THAT REQUIRED BY THE SEISMIC DESIGN CATEGORY OR THE DESIGN WIND SPEED. BRACED WALL PANELS SHALL BEGIN NO MORE THAN 12.5' (3810 MM) FROM EACH END OF A BRACED WALL LINE. BRACED WALL PANELS THAT ARE COUNTED AS PART OF A BRACED WALL LINE, EXCEPT THAT OFFSETS OUT-OF-PLANE OF UP TO 4 FEET (1219 MM) SHALL BE PERMITTED PROVIDED THAT THE TOTAL OUT-TO-OUT OFFSET DIMENSION IN ANY BRACED WALL LINE IS NOT MORE THAN 8' (2438 MM). A DESIGNED COLLECTOR SHALL BE PROVIDED IF THE BRACING BEGINS MORE THAN 12' (3658 MM) FROM EACH END OF A BRACED WALL LINE.
602.10.1.1 SPACING:
SPACING OF BRACED WALL LINES SHALL NOT EXCEED 35' (10,668 MM) ON CENTER IN BOTH THE LONGITUDINAL AND TRANSVERSE DIRECTIONS IN EACH STORY.
EXCEPTION:
SPACING OF BRACED WALL LINES NOT EXCEEDING 50' SHALL BE PERMITTED WHERE:
1. THE WALL BRACING PROVIDED EQUALS OR EXCEEDS THE AMOUNT OF BRACING REQUIRED BY TABLE 602.10.1 MULTIPLIED BY A FACTOR EQUAL TO THE BRACED WALL LINE SPACING DIVIDED BY 35', AND
2. THE LENGTH-TO-MINIMUM RATIO FOR THE FLOOR/WALL DIAPHRAGM DOES NOT EXCEED 3:1.

NOTE: WIND BRACING DESIGN AS REQUIRED BY SECTION 602.10 OF THE IRC HAVE BEEN SATISFIED BY THE ALTERNATIVE CONTINUOUS STRUCTURAL PANEL SHEATHING METHOD (602.10.5) AND NARROW WALL PORTAL FRAMED BRACING, REFER TO PLAN CONSTRUCTION DETAILS THIS SHEET. ADDITIONALLY, ALL STRUCTURAL HEADERS SHALL BE FURNISHED IN ACCORDANCE WITH TABLE 602.10.1 OF THE INTERNATIONAL RESIDENTIAL CODE, AND THE MANUFACTURERS RECOMMENDATIONS IN THE CASE OF ENGINEERED COMPONENTS. MINIMUM BRACED WALL LENGTHS ARE BASED ON THE TABLE BELOW:

MAX. ADJACENT OPENING HEIGHT EQUIVALENT TO	MIN. LENGTH OF BRACED WALL PANELS							FULL HEIGHT
	30 WIND W/ WINDOW	35 WIND W/ WINDOW	50 WIND W/ WINDOW	60 WIND W/ WINDOW	65 WIND W/ WINDOW	65 DR W/ 10 TR	65 DR W/ 20 TR	
WALL HEIGHT	34'	36'	38'	39'	39'	39'	39'	45'
8' WALL	27'	27'	27'	27'	27'	27'	27'	32'
10' WALL	37'	37'	37'	37'	37'	37'	37'	45'

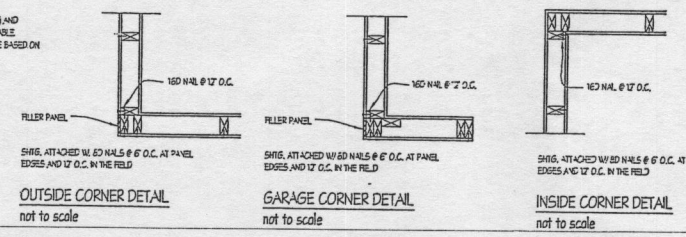

ALL BRACED EXTERIOR WALLS SHALL BE MIN. 2\"/>

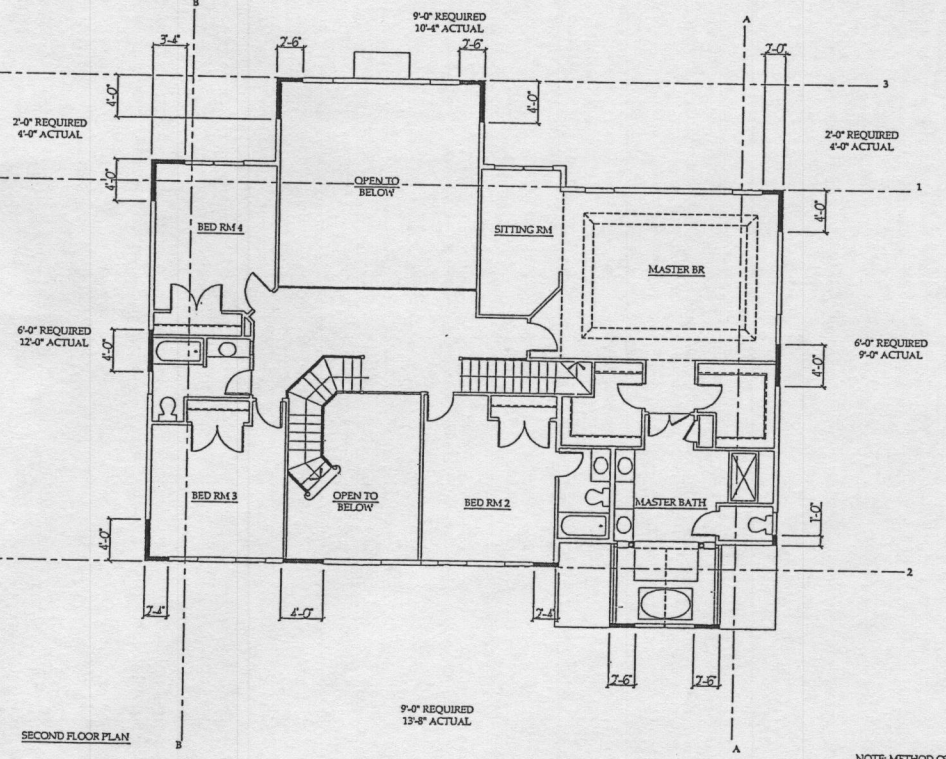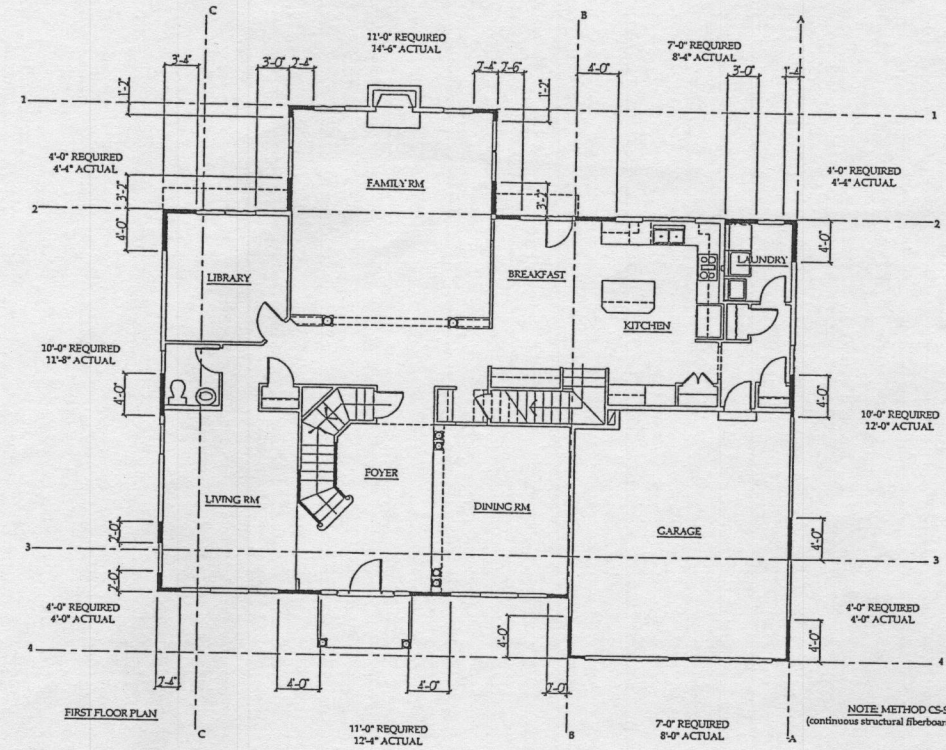

Plymouth Road Architects
640 Plymouth Road, Catonsville, MD 21229 410-788-0281

DATE:	REVISION:	DATE:	REVISION:
8/10/12	REVISED FOR 2012 IBC AND IECC		


Date: 8/10
Scale: 1/8"=1'-0"
Drawn: TIM

Drawing: SHEAR WALL DETAILS
Project: WILLIAMSBURG GROUP
DORCHESTER 4


1067.D4
Project No.

D2

REVISED 8/12

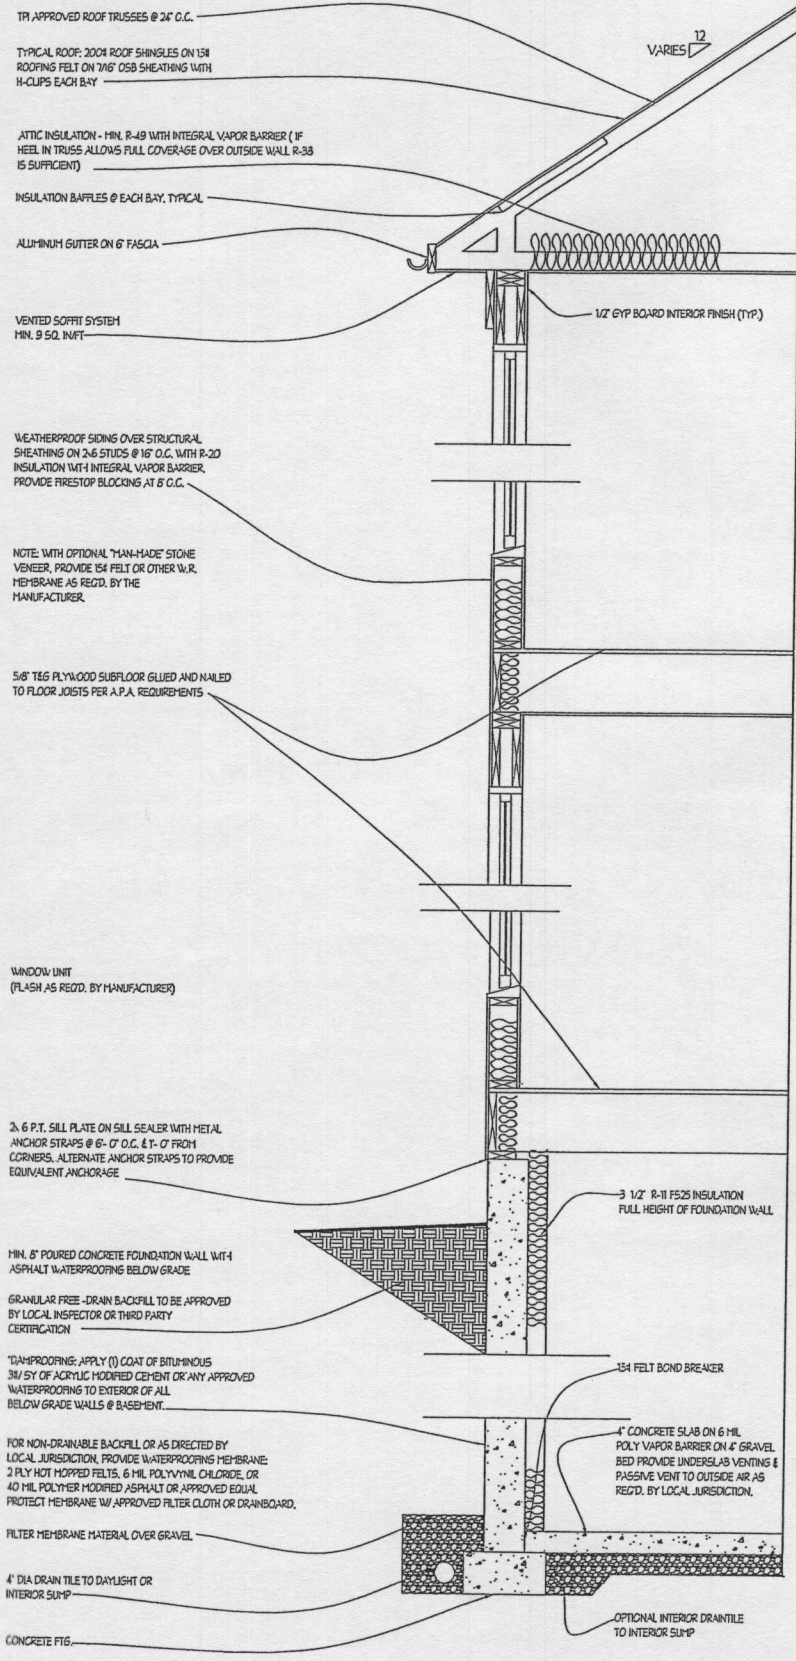

WALL SECTION W/ SIDING
SCALE: 3/4"=1'-0"

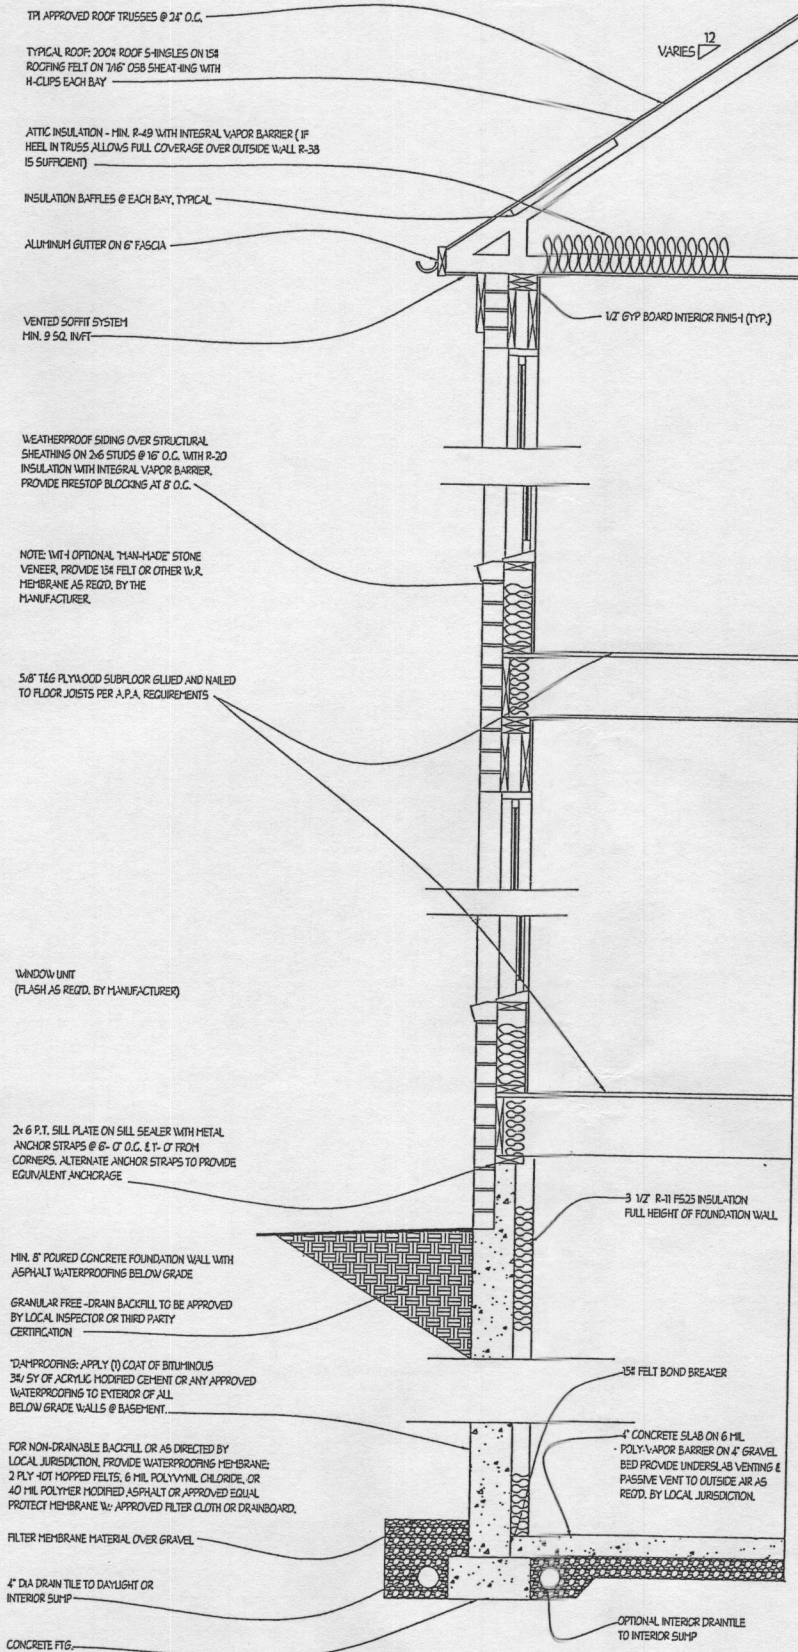

WALL SECTION W/ BRICK VENEER
SCALE: 3/4"=1'-0"

FOUNDATION DESIGN SCHEDULES

PLAIN CONCRETE WALLS
BASED ON GROUP 1 SOILS (S.W.G. SW. 5.7)
WALL THICKNESS WALL HEIGHT MAX. UNBALANCED FILL

6"	8' OR 9'	7'
10"	8' OR 9'	8'

BASED ON GROUP 2 (G1, G2, S1, S1-SC, E1) GROUP 3 (SC, HL, HL-CL, E CL)
WALL THICKNESS WALL HEIGHT MAX. UNBALANCED FILL

8"	8' OR 9'	6'
10"	8' OR 9'	7'
12"	8' OR 9'	8'

* MIN. 10" WALL THICKNESS 1/4" BRICK VENEER

REINFORCED CONCRETE WALLS
BASED ON GROUP 2 OR 3 SOILS
WALL THICKNESS WALL HEIGHT MAX. UNBALANCED FILL & REINFORCING

8" W/ #5@24" O.C.	8'	7'
8" W/ #5@24" O.C.	9'	8'
10" W/ #5@24" O.C.	8'	7'
10" W/ #5@24" O.C.	9'	8'
12" W/ #5@24" O.C.	8'	7'
12" W/ #5@24" O.C.	9'	8'

NOTE: PLACE REBAR MIN. 1 1/2" FROM INSIDE WALL FACE

PERIMETER SPREAD FOOTINGS:

MIN. WIDTHS BASED ON SOIL BEARING CAPACITY NOTED. MIN. THICKNESS IS 8", SUPPORTING


	1500# PSF SOIL	2000# PSF SOIL
1 FLOOR AND ROOF	16"	16"
2 FLOORS AND ROOF	20"	18"
3 FLOORS AND ROOF	24"	20"
1 FLOOR AND ROOF W/ BRICK	22"	20"
2 FLOORS AND ROOF W/ BRICK	26"	20"
3 FLOORS AND ROOF W/ BRICK	32"	24"

PIER FOOTINGS AND COLUMNS:

MIN. PLAN CONCRETE FOOTING SIZES BASED ON COLUMN DESIGN LOADS AND SOIL BEARING CAPACITY NOTED:

KEY	MAX. VERT. LOAD	MAX. COLUMN HEIGHT	COLUMN SIZE	1500# PSF SOIL FTG.	2000# PSF SOIL FTG.
A	15,000#	100'	3", 11 sq.	36"x36"x6"	37"x37"x4"
B	17,500#	100'	3", 11 sq.	42"x42"x6"	36"x36"x6"
C	21,000#	100'	4", 11 sq.	48"x48"x6"	40"x40"x6"
D	32,000#	100'	3" SCH 40	56"x56"x6"	50"x50"x6"

NOTE: FTG. DEPTHS MAYBE REDUCED TO MIN. 12" THICKNESS W/ REIN. : #5 BARS @ 8" O.C. EACH WAY, 3" FROM BOTTOM

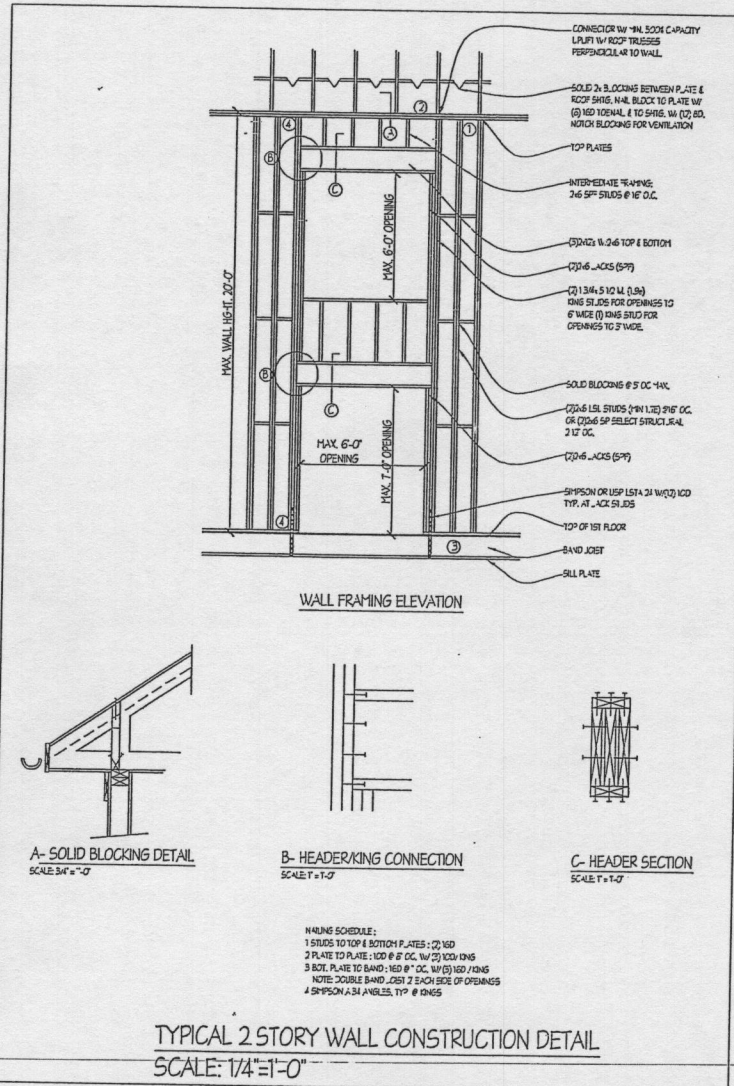

Plymouth Road Architects
640 Plymouth Road, Catonsville, MD 21229 410-788-0281

DATE	REVISIONS
8/14/12 <td>REVISED FOR 2012 IRC AND IECC</td>	REVISED FOR 2012 IRC AND IECC


Date: 8/10
Scale: NOTED
Drawn: TIM

Drawing: WALL DETAIL SECTIONS
Project: WILLIAMSBURG GROUP DORCHESTER 4


1067.D4
Project No.

D1

REVISED 8/12

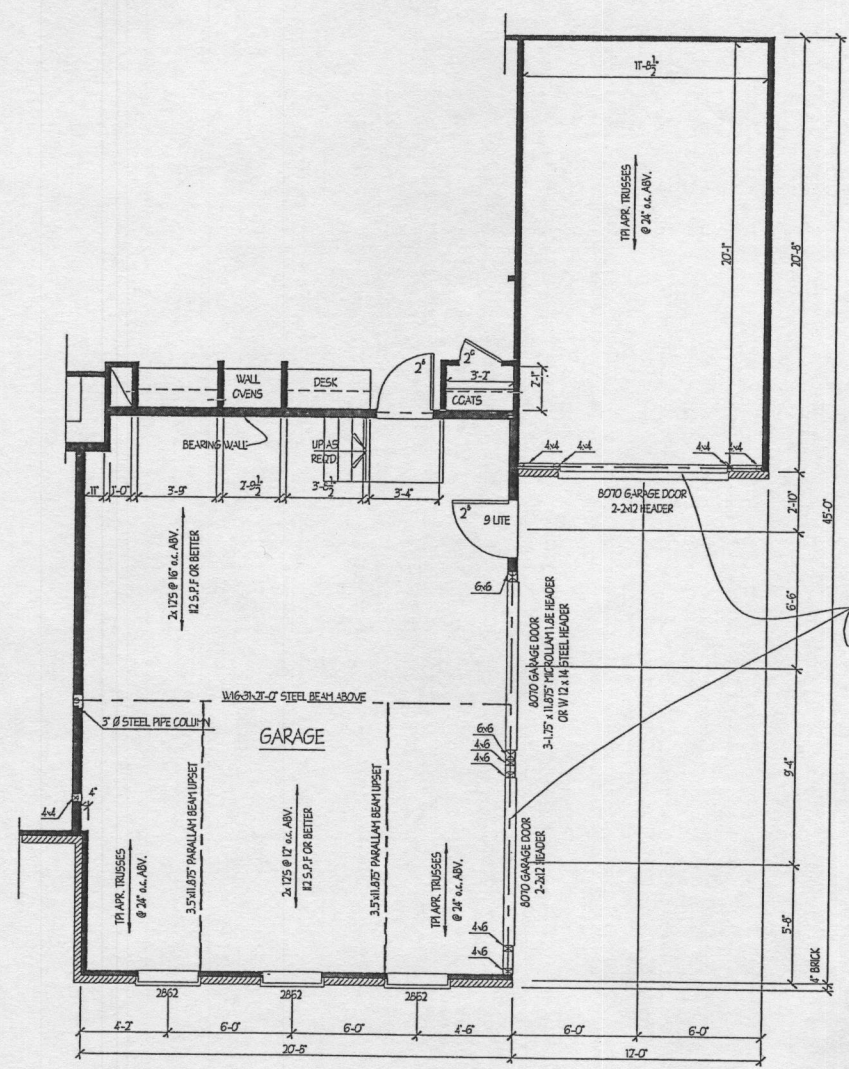


TYPE I-NARROW WALL PORTAL DETAIL

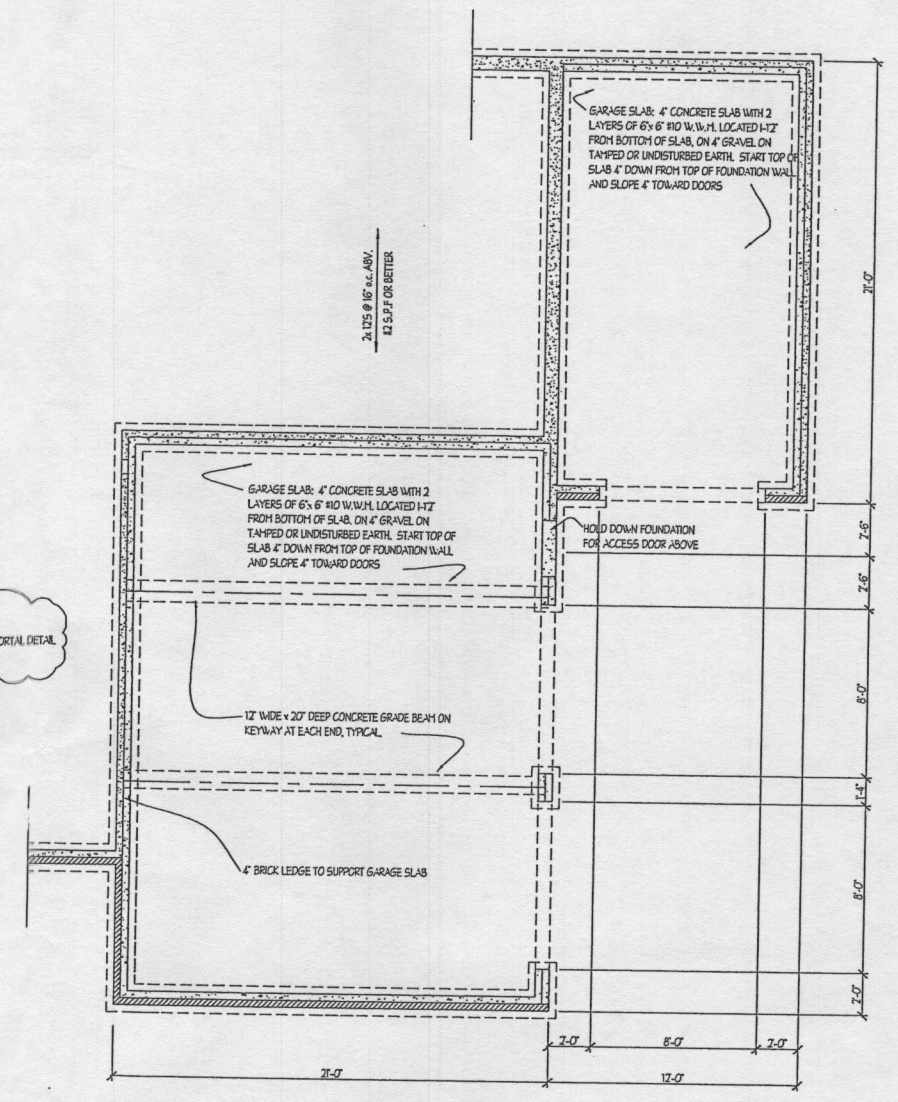


REVISED SET 8/12


Plymouth Road Architects 640 Plymouth Road, Catonsville, MD 21229 410-788-0281													
Drawing: 3RD CAR GARAGE PLANS Project: WILLIAMSBURG GROUP DORCHESTER 4	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 20%;">DATE: 8/10</td> <td style="width: 20%;">REVISION:</td> <td style="width: 20%;">DATE:</td> <td style="width: 20%;">REVISION:</td> <td style="width: 20%;">DATE:</td> <td style="width: 20%;">REVISION:</td> </tr> <tr> <td colspan="6" style="text-align: center;"> Date: 8/10 Scale: 1/4" = 1'-0" Drawn: TIM </td> </tr> </table>	DATE: 8/10	REVISION:	DATE:	REVISION:	DATE:	REVISION:	Date: 8/10 Scale: 1/4" = 1'-0" Drawn: TIM					
DATE: 8/10	REVISION:	DATE:	REVISION:	DATE:	REVISION:								
Date: 8/10 Scale: 1/4" = 1'-0" Drawn: TIM													
1067.D4 Project No.	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="text-align: center; font-size: 2em; font-weight: bold;">8c</td> </tr> </table>	8c											
8c													

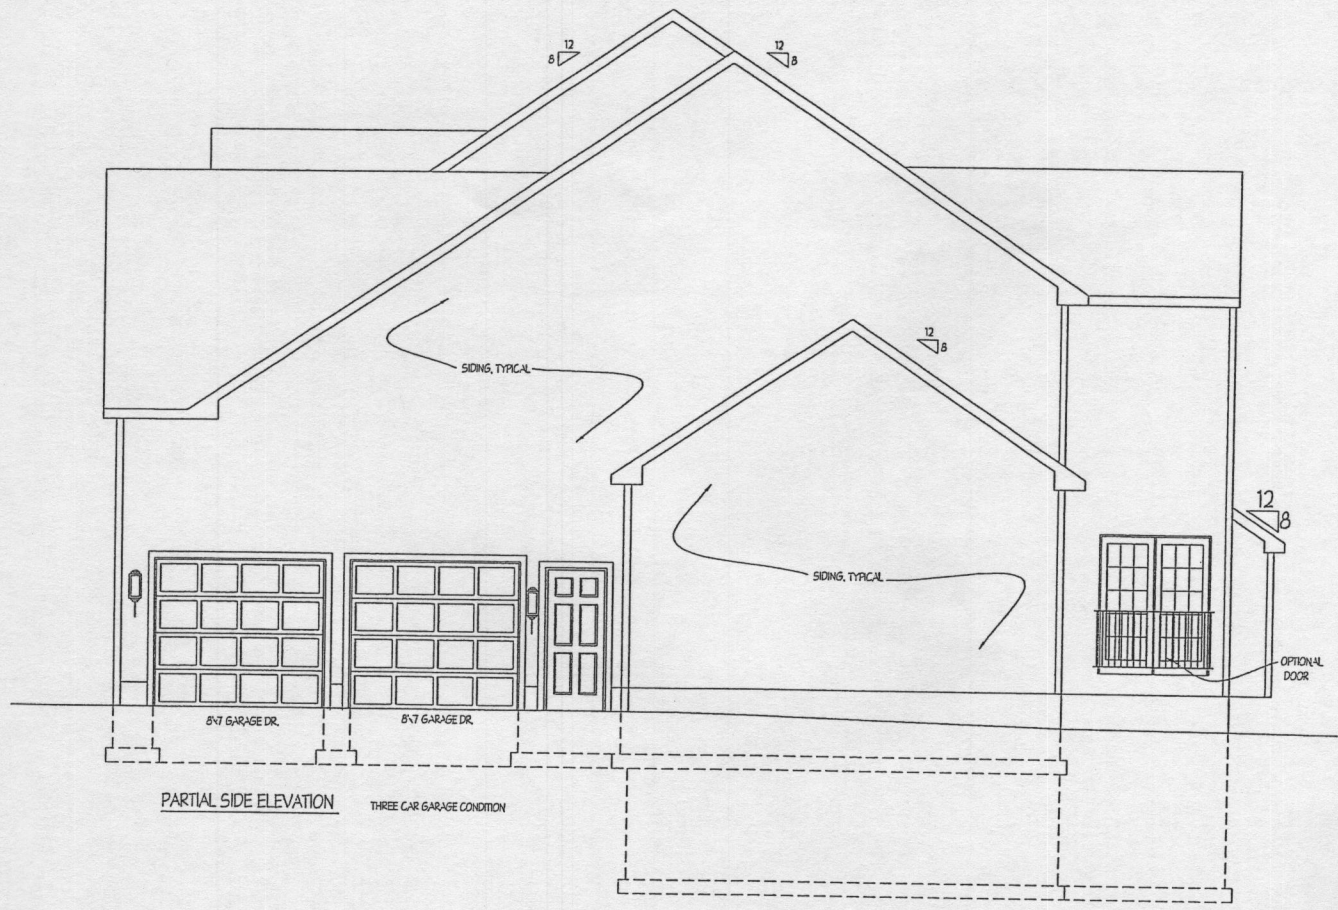

THIRD CAR GARAGE (SETBACK)

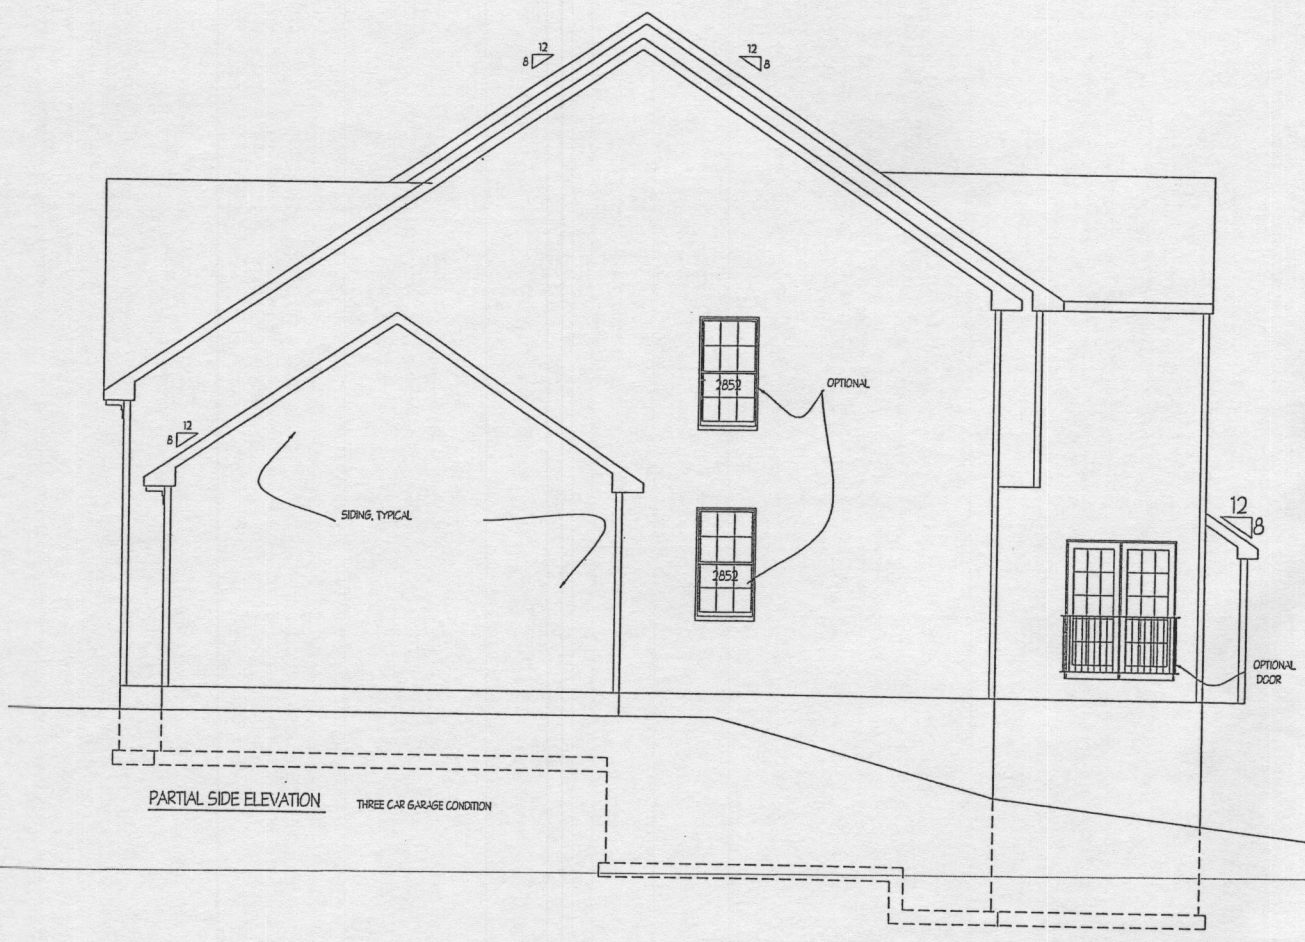

THIRD CAR FRONT LOADING GARAGE

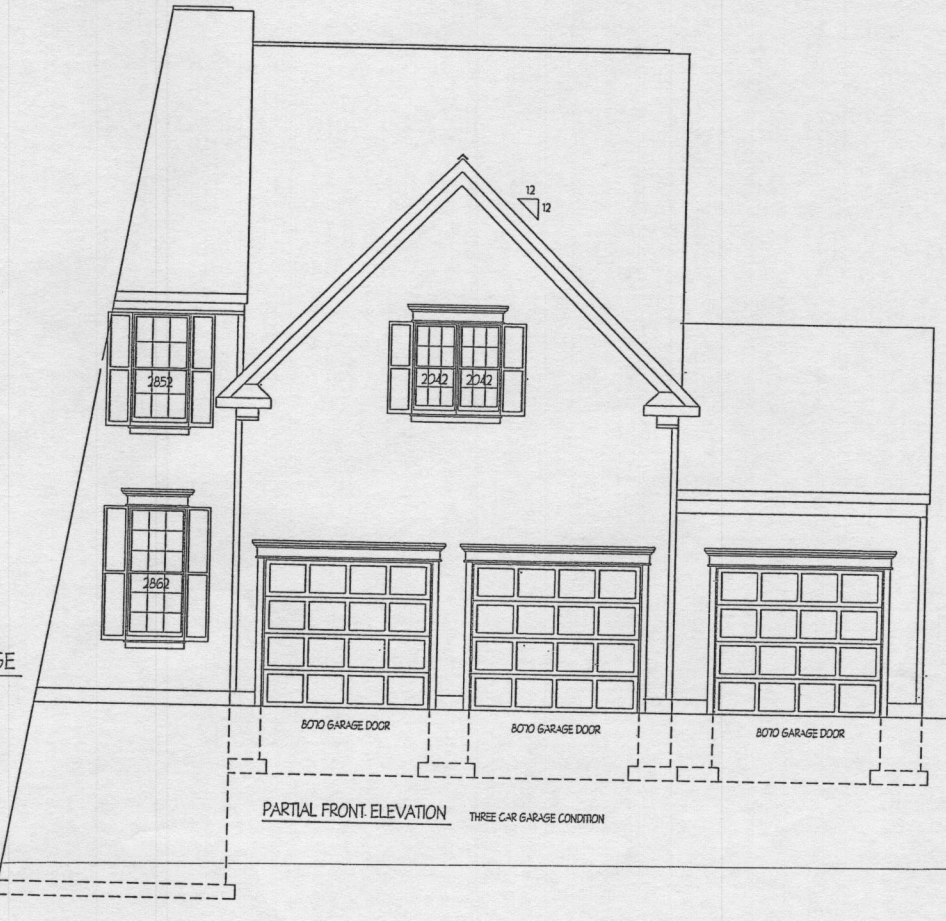

DATE	REVISION


Date: 8/10
 Scale: 1/4" = 1'-0"
 Drawn: TIM

Drawing: 3RD CAR GARAGE ELEVATIONS
 Project: WILLIAMSBURG GROUP
 DORCHESTER 4


1067.D4
 Project No.

8b


REVISED SET 8/12

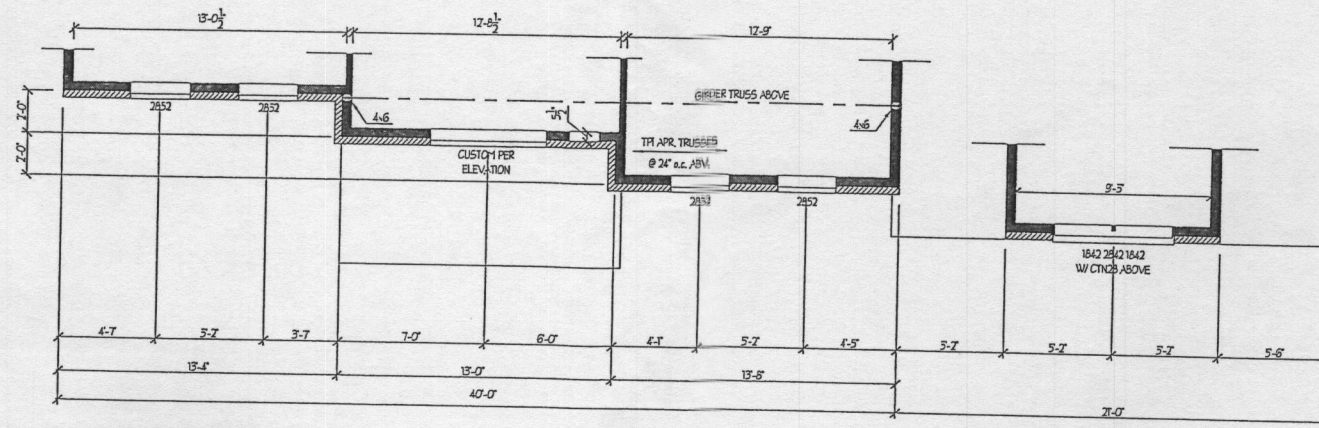

PARTIAL SECOND FLOOR PLAN
ELEVATION 4- BRICK

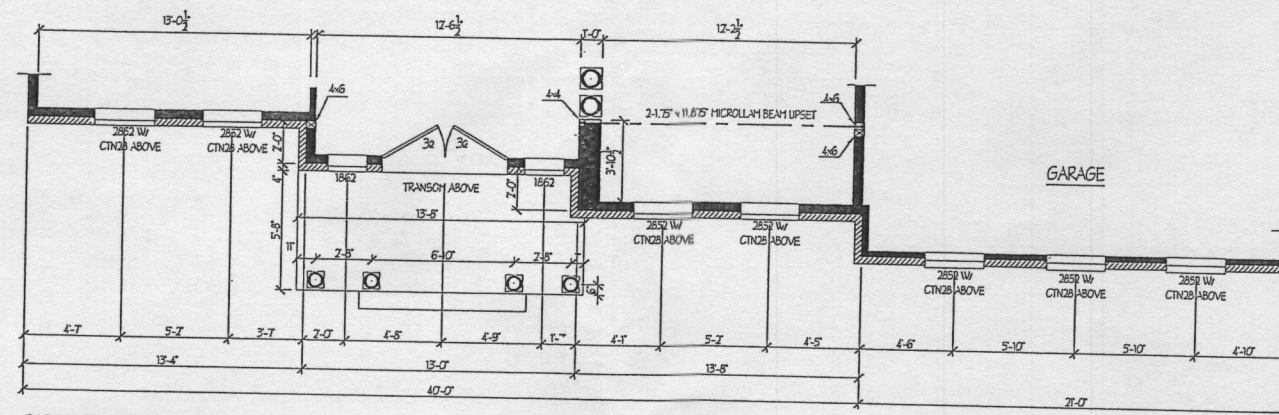

PARTIAL FIRST FLOOR PLAN
ELEVATION 4- BRICK

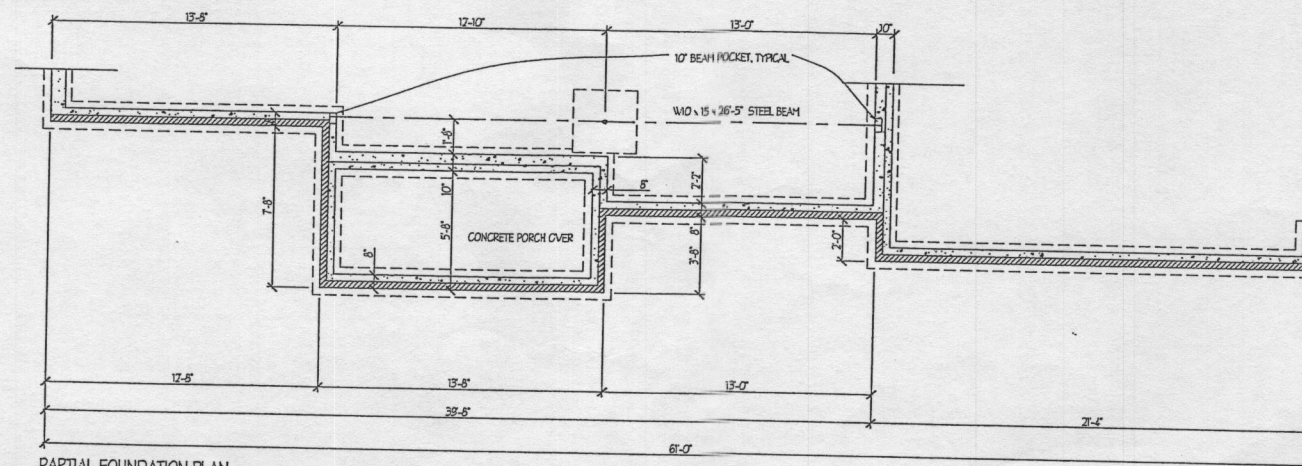

PARTIAL FOUNDATION PLAN
ELEVATION 4- BRICK

Plymouth Road Architects
640 Plymouth Road, Catonsville, MD 21229 410-788-0281

DATE:	REVISION:	DATE:	REVISION:


Date: 8/12
Scale: 1/4"=1'-0"
Drawn: TIM

Drawing: PARTIAL PLANS- ELEVATION 4
Project: WILLIAMSBURG GROUP
DORCHESTER 4


1067.D4
Project No.

5b


REVISED SET 8/12

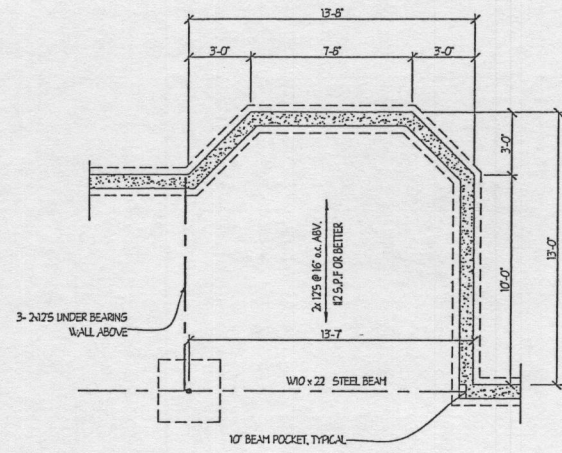


LARGE MORNING RM. FOUNDATION PLAN 1/4"=1'-0"

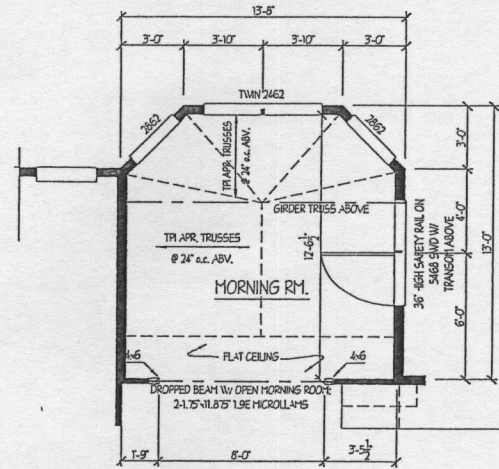


LARGE MORNING RM. PLAN 1/4"=1'-0"

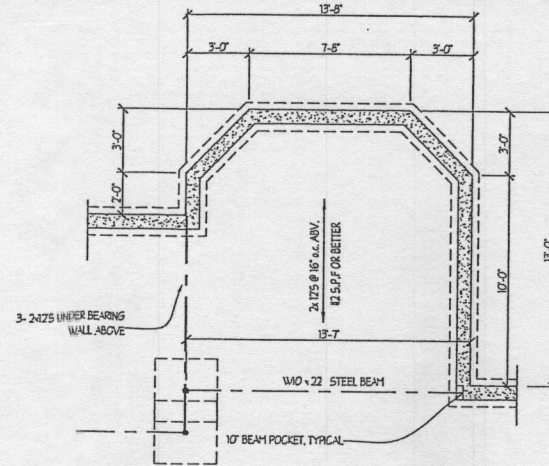


LARGE MORNING RM. FOUNDATION PLAN W/ 2' KITCHEN EXTENSION 1/4"=1'-0"

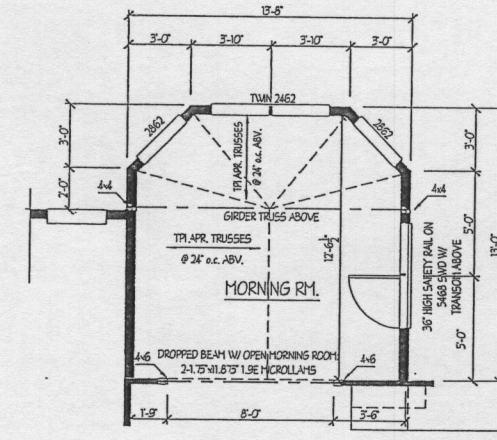


LARGE MORNING RM. PLAN W/ 2' KITCHEN EXTENSION 1/4"=1'-0"

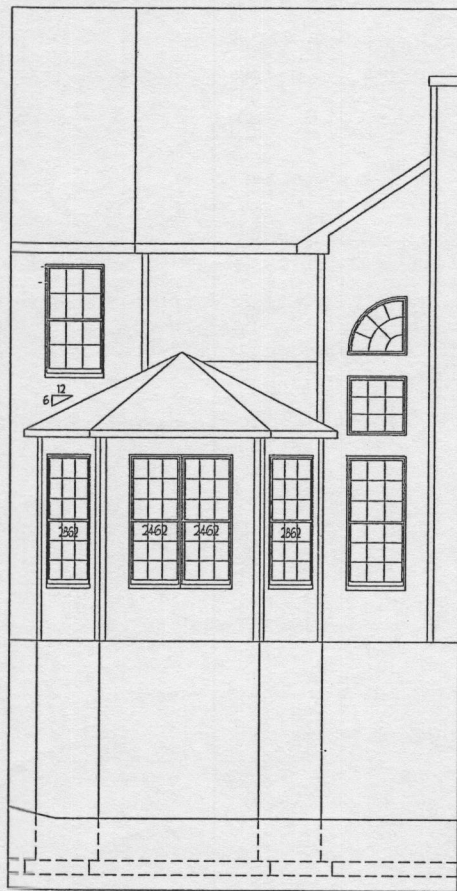


REAR ELEVATION 1/4"=1'-0"

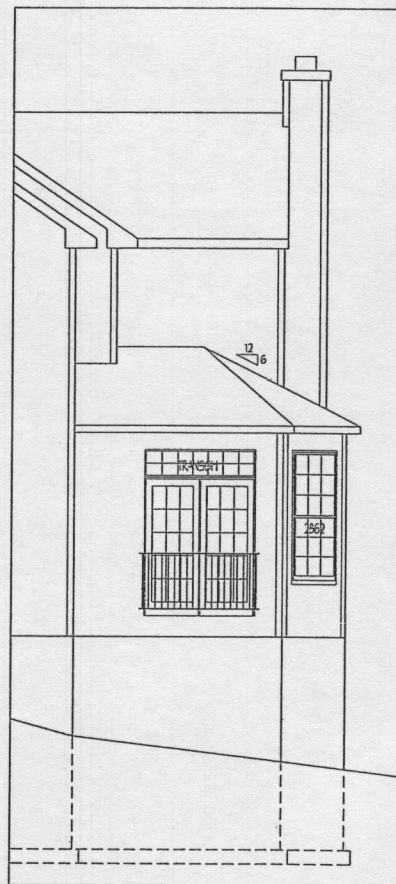


SIDE ELEVATION 1/4"=1'-0"

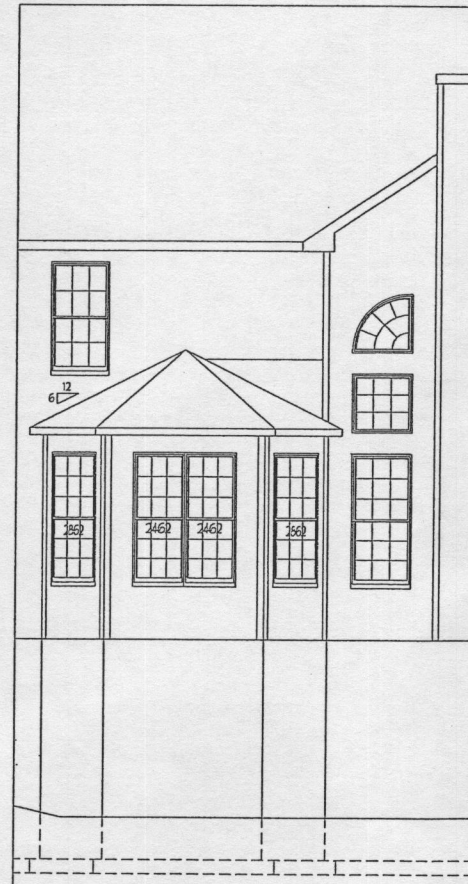

REAR ELEVATION 1/4"=1'-0" W/ 2' EXTENSION

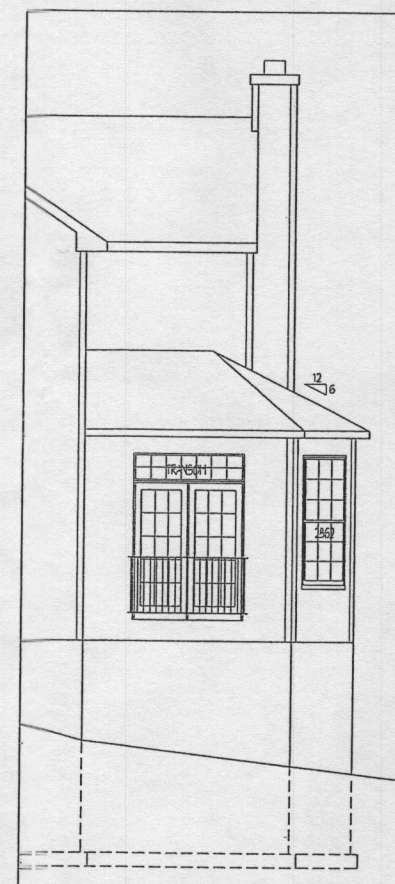

SIDE ELEVATION 1/4"=1'-0" W/ 2' EXTENSION

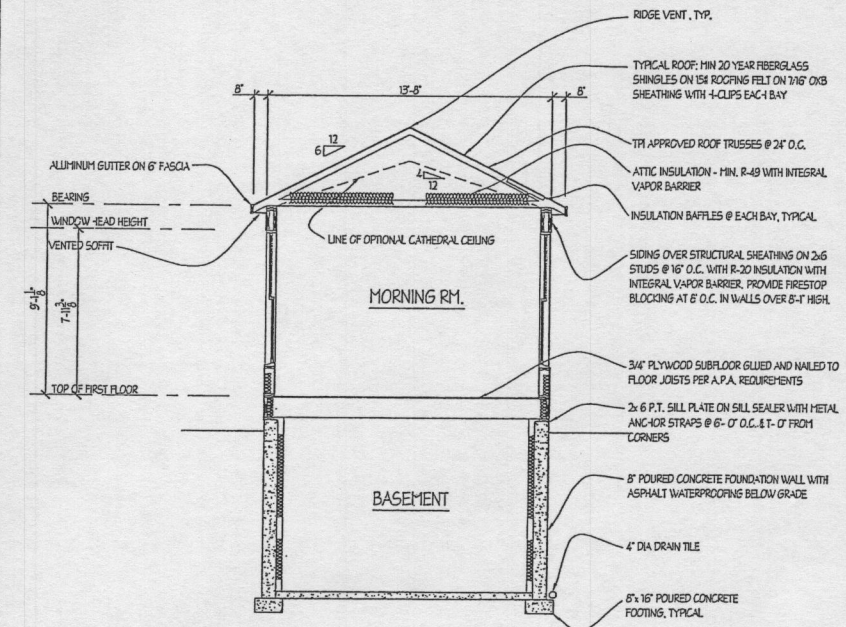

SECTION 1/4"=1'-0"

DATE	REVISION	DATE	REVISION

Date: 8/10
 Scale: 1/4"=1'-0"
 Drawn: TIM





Drawing: MORNING RM. PLANS & ELEVATIONS
 Project: WILLIAMSBURG GROUP
 DORCHESTER 4

1067.D4
 Project No.

9a

REVISED SET 8/12

Plymouth Road Architects
 640 Plymouth Road, Catonsville, MD 21229 410-788-0281

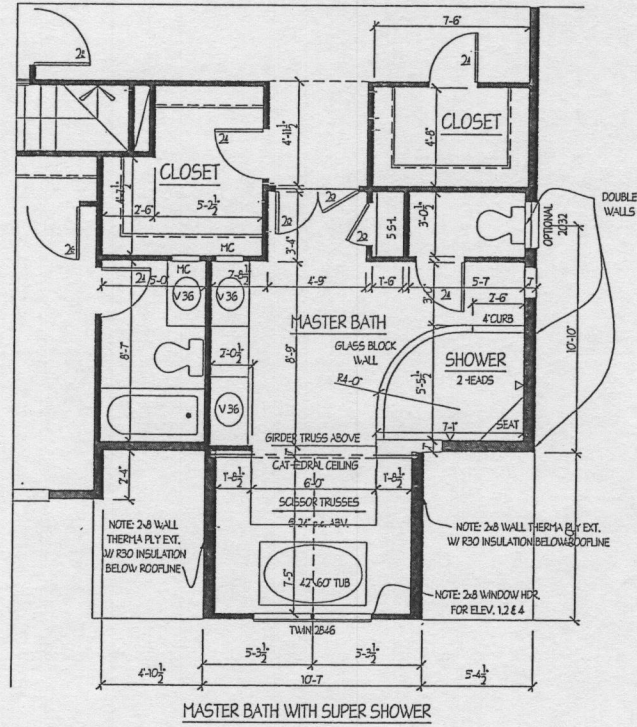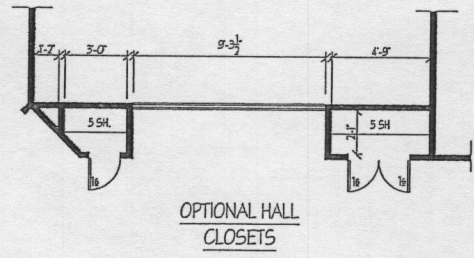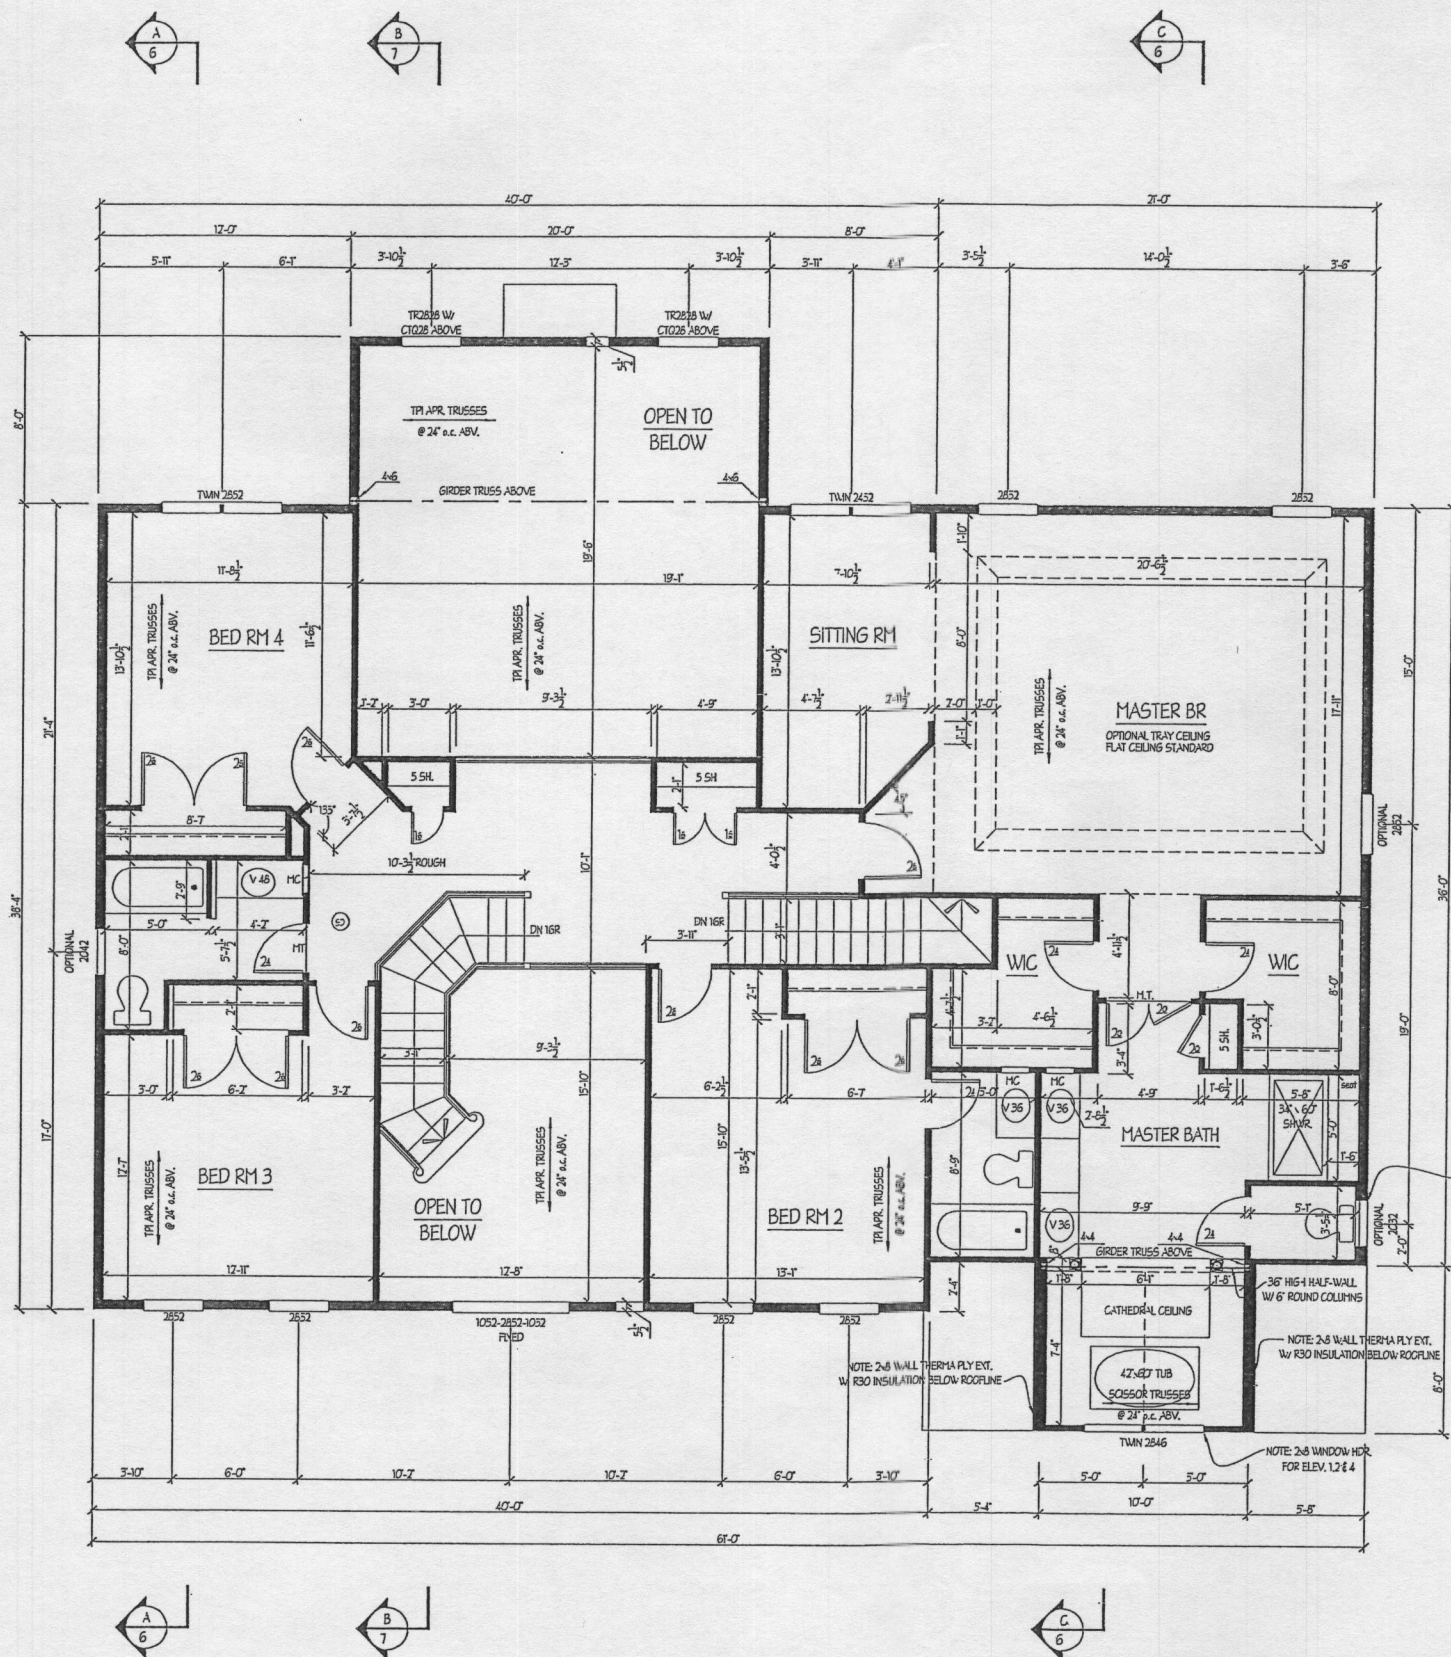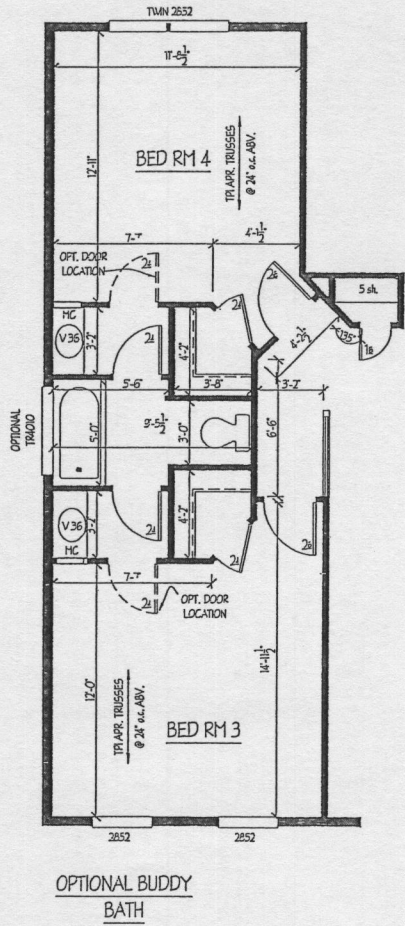

NOTES:
 WINDOW HEADERS ARE 2-2X12S AND ROUGH HEAD HEIGHTS ARE AT 7'-10" UNLESS NOTED OTHERWISE.
 ALL HEADERS IN BEARING WALLS ARE 2-2X12S UNLESS NOTED OTHERWISE.
 WOOD COLLUMS SPECIFIED MAY BE BUILT UP OF 2X MEMBERS, FASTENED TOGETHER AS REQUIRED.
 ALL EXTERIOR WALLS TO BE 2-6 @ 16" OC UNLESS OTHERWISE NOTED

NOTE: SEE SHEET SA, SB FOR PARTIAL PLANS ON ELEVATIONS 3,4

NOTE: SECOND FLOOR PLAN WITH 4' WIDENING THROUGH FOYER AND FAMILY ROOM, 2' ADDED TO KITCHEN AND LIBRARY, AND ANGLED STAIR

Plymouth Road Architects
 640 Plymouth Road, Catonsville, MD 21229 410-788-0281

DATE:	8/10
REVISION:	
DATE:	9/27/10
REVISION:	STAIR REVISIONS


Date: 8/10
 Scale: 1/4" = 1'-0"
 Drawn: TIM

Drawing: SECOND FLOOR PLAN +2'
 Project: WILLIAMSBURG GROUP
 DORCHESTER 4

1067.D4
 Project No.

4b

REVISED SET 8/12

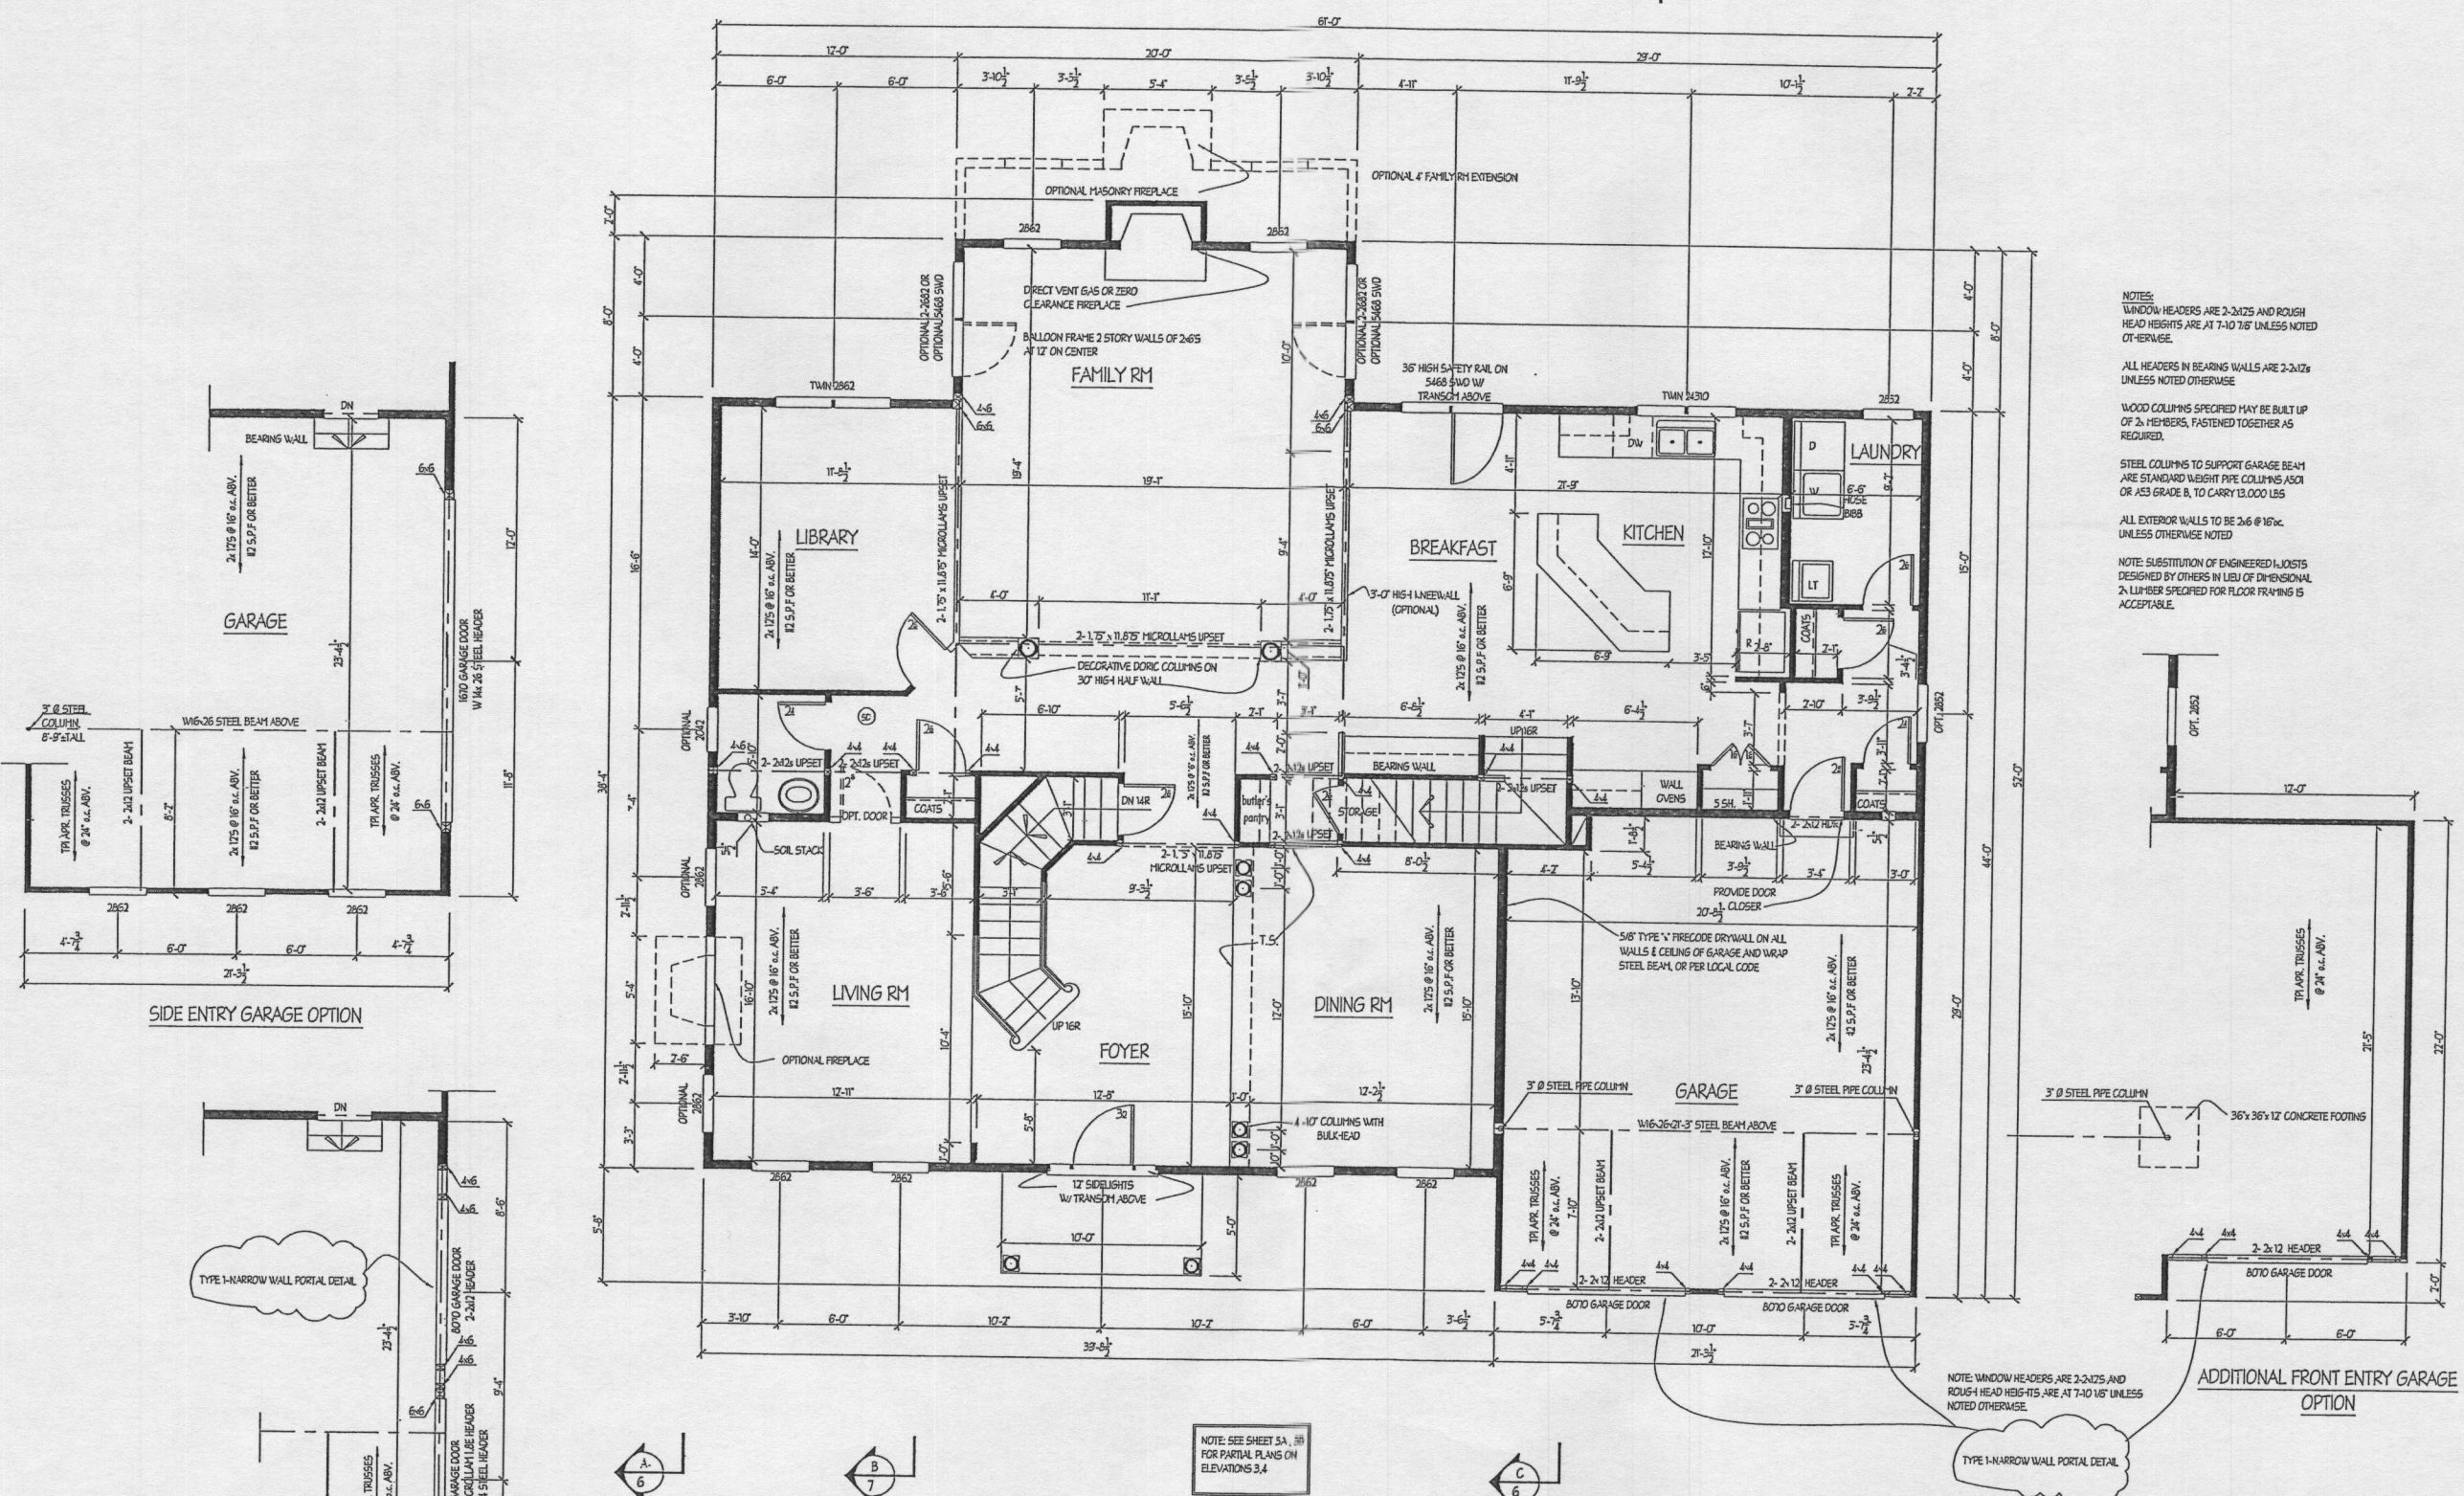

NOTES:
 WINDOW HEADERS ARE 2-2X12S AND ROUGH HEAD HEIGHTS ARE AT 7'-10" UNLESS NOTED OTHERWISE.
 ALL HEADERS IN BEARING WALLS ARE 2-2X12S UNLESS NOTED OTHERWISE.
 WOOD COLUMNING SPECIFIED MAY BE BUILT UP OF 2x MEMBERS, FASTENED TOGETHER AS REQUIRED.
 STEEL COLUMNING TO SUPPORT GARAGE BEAM ARE STANDARD WEIGHT PIPE COLUMNING A501 OR A53 GRADE B, TO CARRY 13,000 LBS.
 ALL EXTERIOR WALLS TO BE 2x6 @ 16" OC UNLESS OTHERWISE NOTED.
 NOTE: SUBSTITUTION OF ENGINEERED JOISTS DESIGNED BY OTHERS IN LIEU OF DIMENSIONAL 2x LUMBER SPECIFIED FOR FLOOR FRAMING IS ACCEPTABLE.

NOTE: FIRST FLOOR PLAN WITH 4' WIDENING THROUGH FOYER AND FAMILY ROOM, 2' ADDED TO KITCHEN AND LIBRARY, AND ANGLED STAIR

REVISED SET 8/12

DATE	REVISION / STATE REVISIONS	DATE	REVISION
9/2/10			

Date: 8/10
 Scale: 1/4"=1'-0"
 Drawn: TTM

Drawing: FIRST FLOOR PLAN +2
 Project: WILLIAMSBURG GROUP DORCHESTER 4

1067.D4
 Project No.

3b


DATE	REVISION	DATE	REVISION
9/9/10	STAIR REVISIONS		

Date: 8/10
 Scale: 1/4" = 1'-0"
 Drawn: TIM

Drawing: BSMY/FOUNDATION PLAN +2'
 Project: WILLIAMSBURG GROUP
 DORCHESTER 4

1067.D4
 Project No.

2b

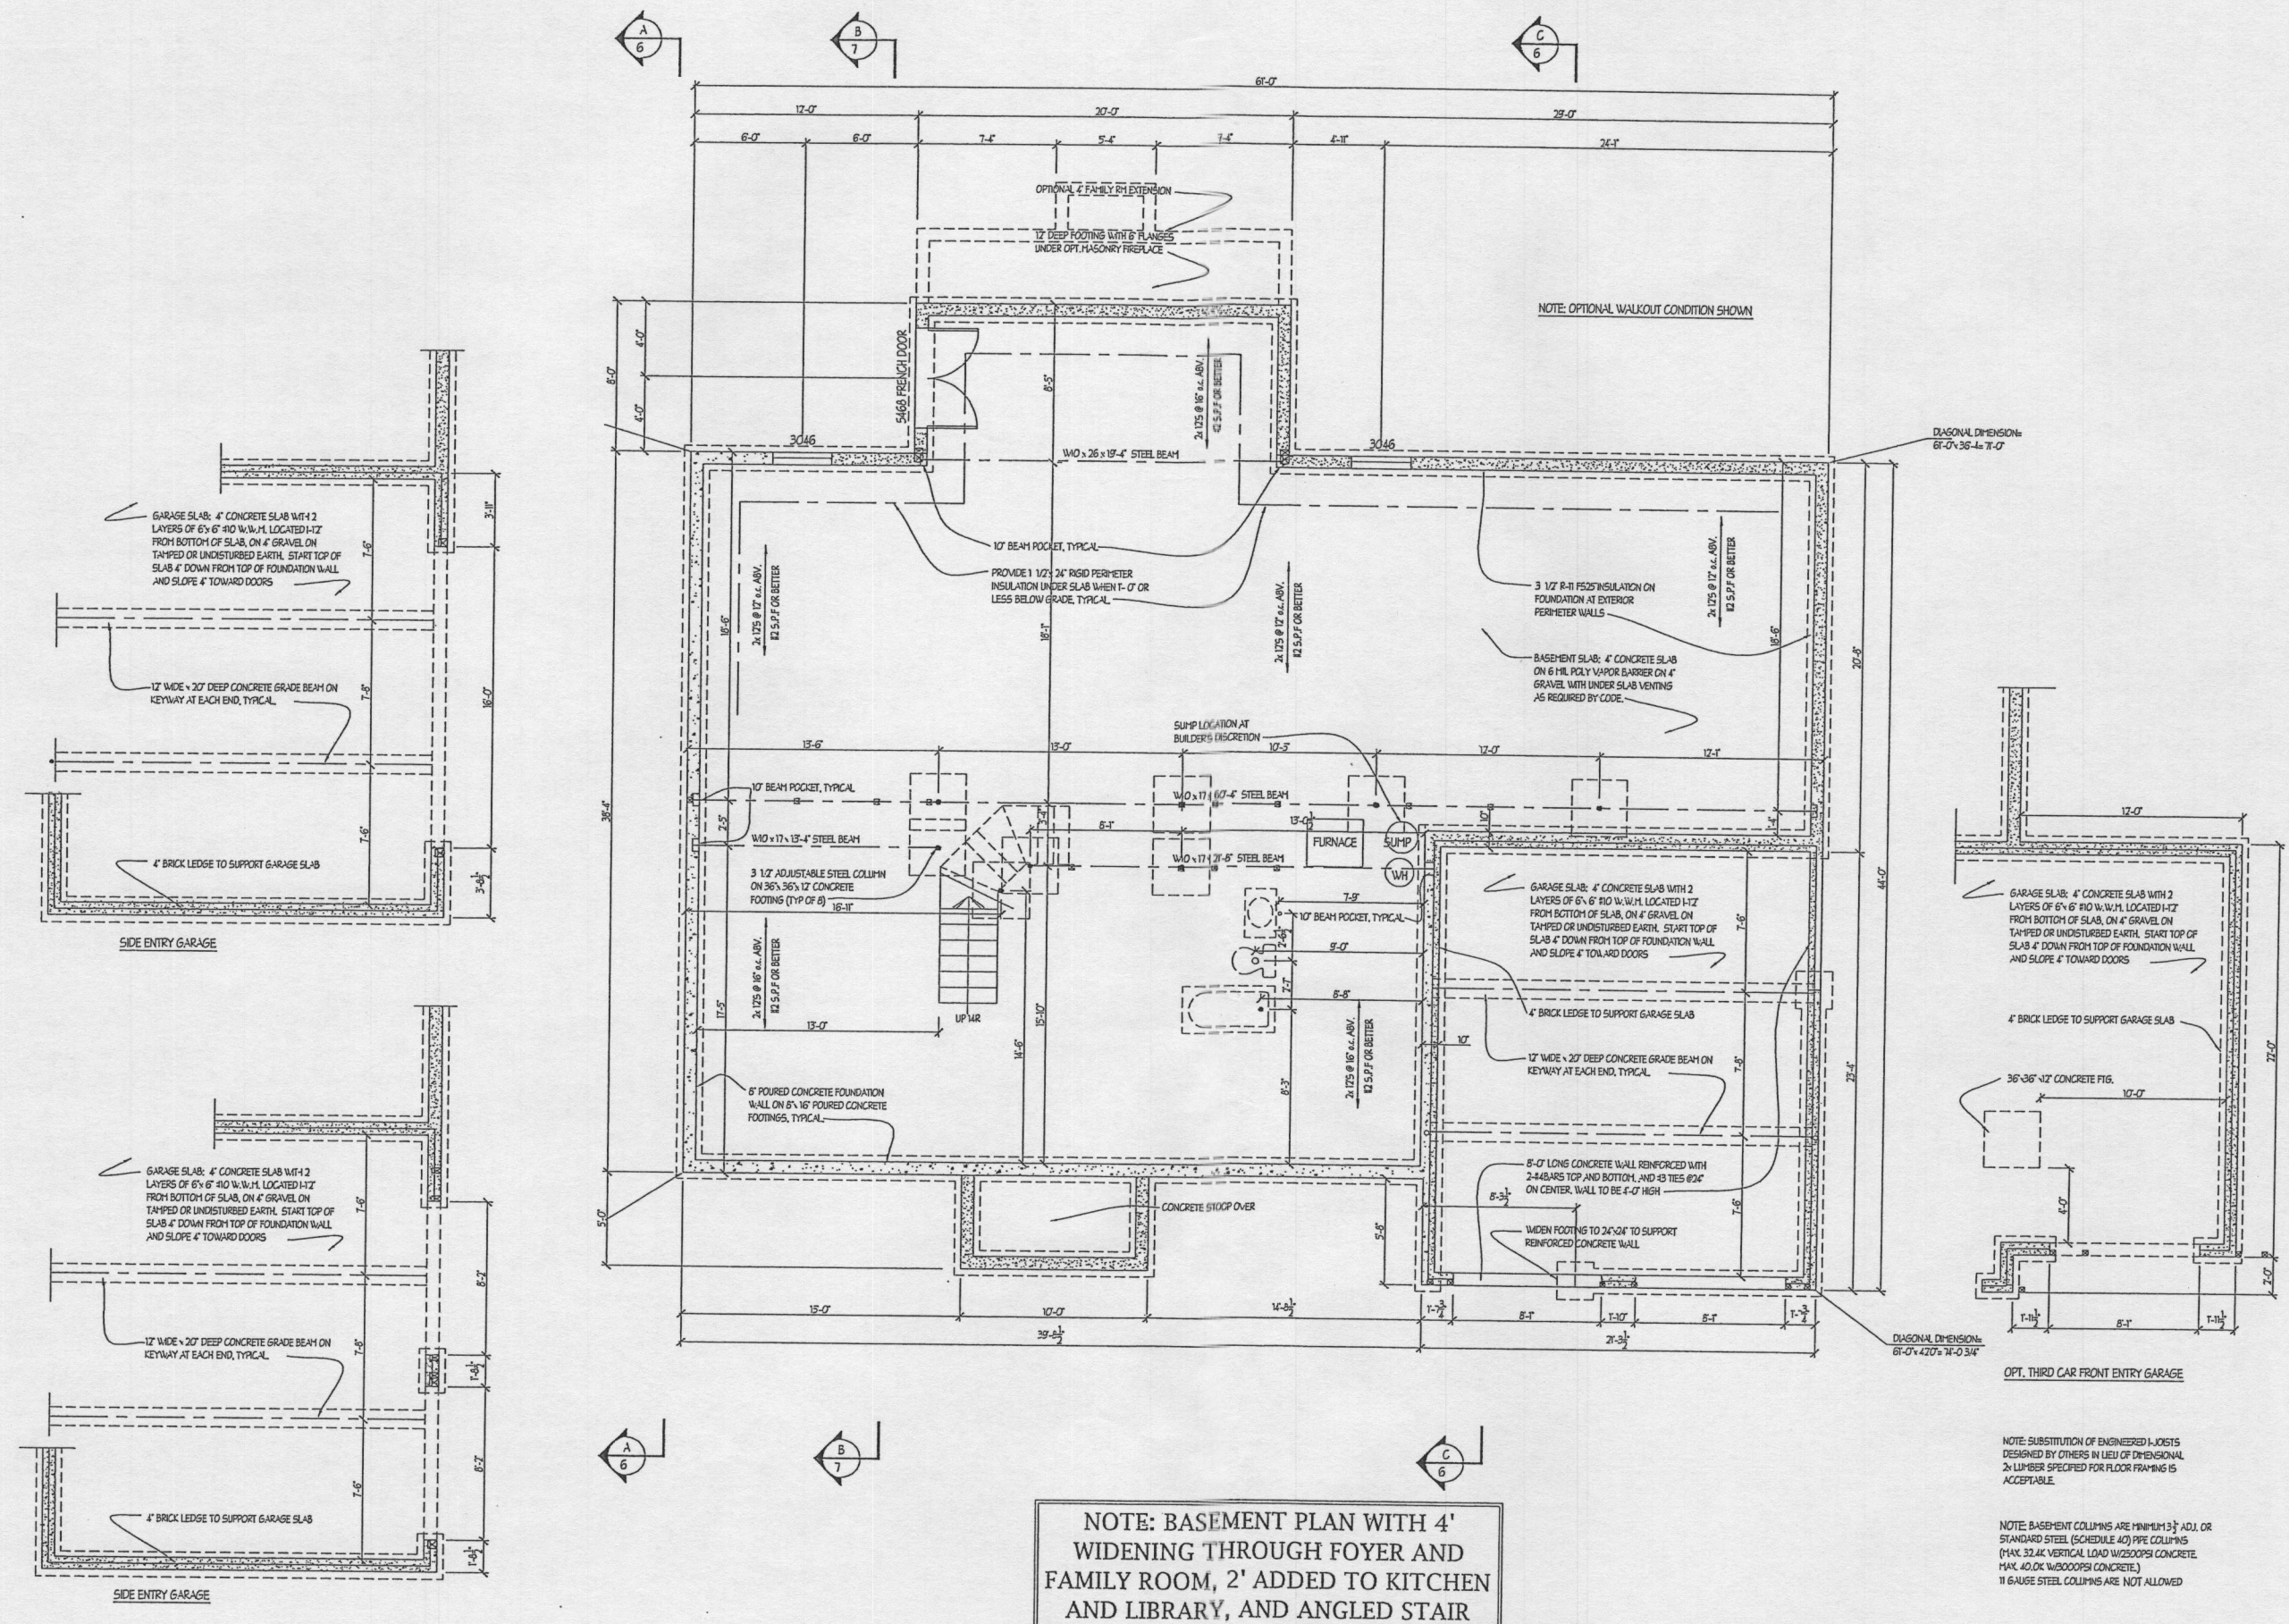


NOTE: BASEMENT PLAN WITH 4' WIDENING THROUGH FOYER AND FAMILY ROOM, 2' ADDED TO KITCHEN AND LIBRARY, AND ANGLED STAIR


NOTE: SUBSTITUTION OF ENGINEERED I-JOISTS DESIGNED BY OTHERS IN LIEU OF DIMENSIONAL 2x LIP-BEAR SPECIFIED FOR FLOOR FRAMING IS ACCEPTABLE.

NOTE: BASEMENT COLUMNS ARE MINIMUM 1 1/2" A.O.I. OR STANDARD STEEL (SCHEDULE 40) PIPE COLUMNS (MAX. 32.4K VERTICAL LOAD W/2500PSI CONCRETE, MAX. 40.0K W/3000PSI CONCRETE). 11 GAUGE STEEL COLUMNS ARE NOT ALLOWED.


REVISED SET 8/12

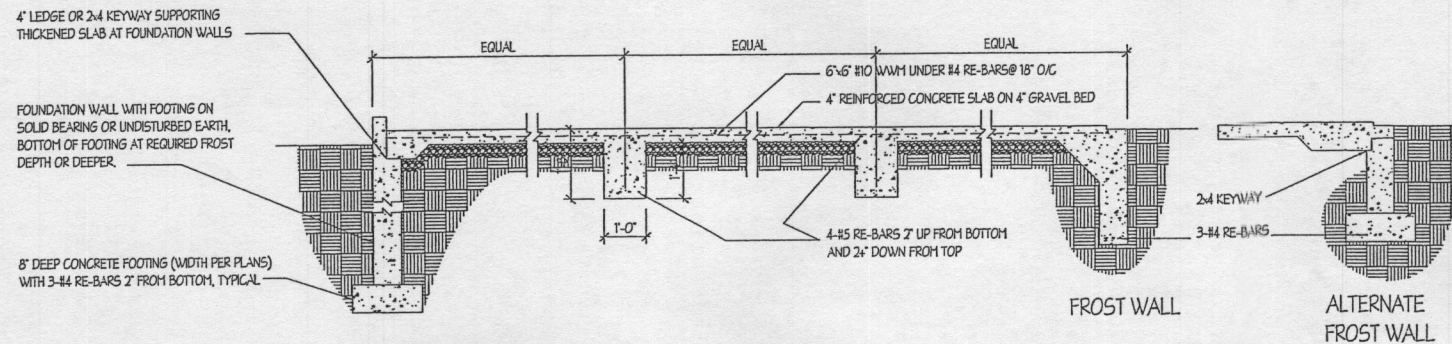

SECTION A
SCALE: 1/2" = 1'-0"

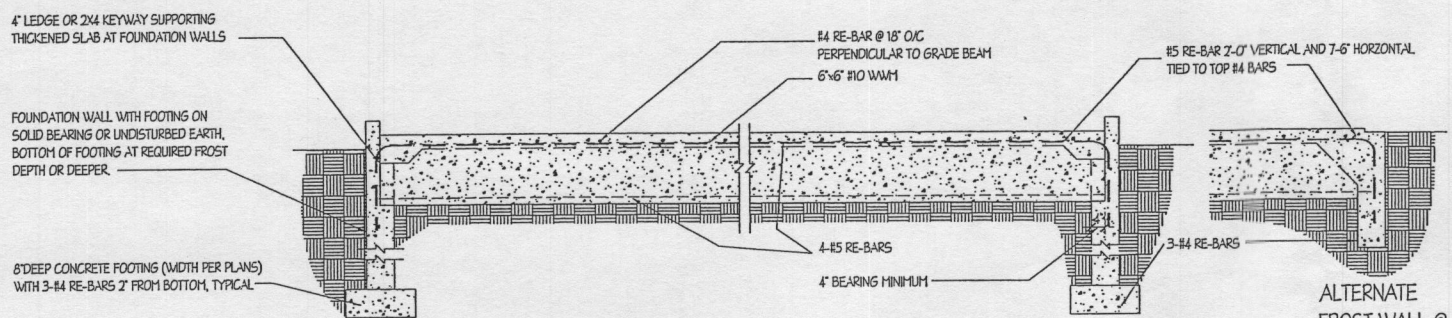


SECTION B
SCALE: 1/2" = 1'-0"

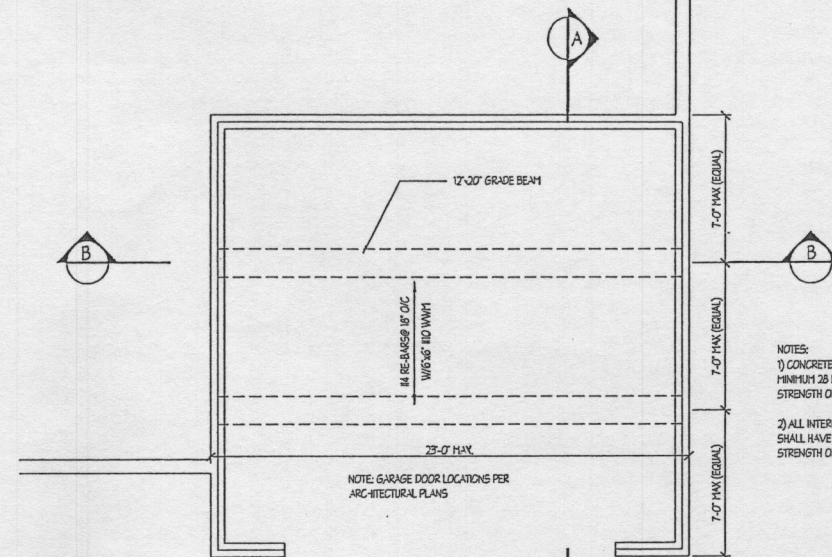

PLAN-2 CAR FRONT LOAD GARAGE
SCALE: 1/4" = 1'-0"

NOTES:
1) CONCRETE FOOTINGS SHALL HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 2500 PSL.
2) ALL INTERIOR CONCRETE SLABS SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSL.

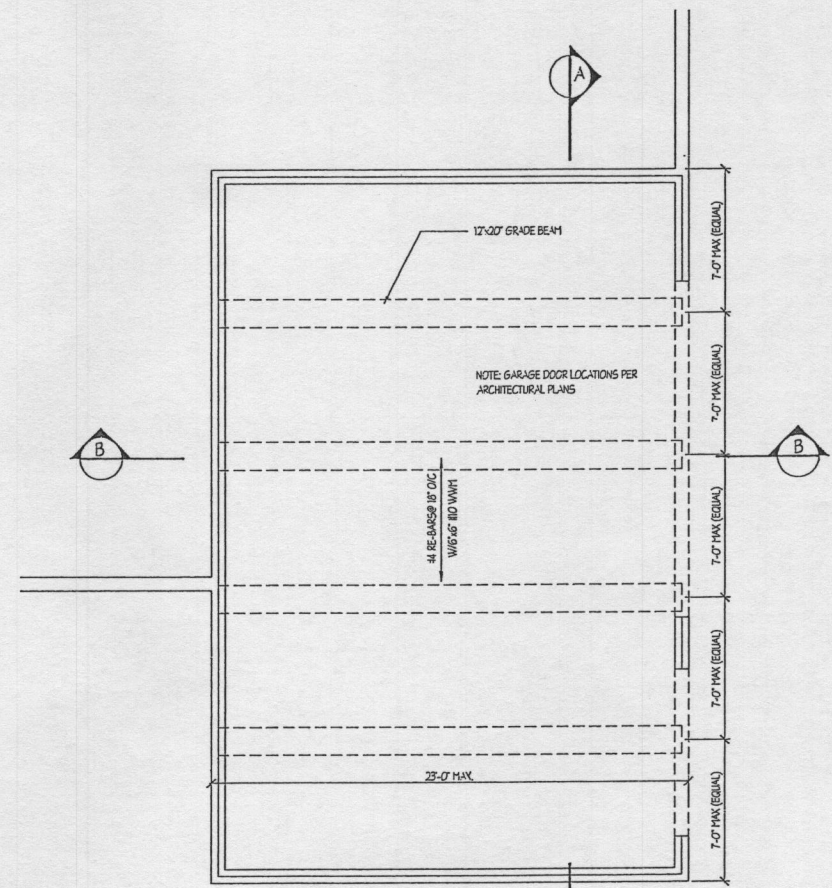

PLAN-3 CAR SIDE LOAD GARAGE
SCALE: 1/4" = 1'-0"

Plymouth Road Architects
640 Plymouth Road, Catonsville, MD 21229 410-788-0281

DATE:	REVISION:
DATE:	REVISION:

Date: 8/10
Scale: NOTED
Drawn: TIM


Drawing: REINFORCED GARAGE SLAB DETAILS
Project: WILLIAMSBURG GROUP
DORCHESTER 4

1067.D4
Project No.

10b

REVISED SET 8/12


A 6 B 7 C 6

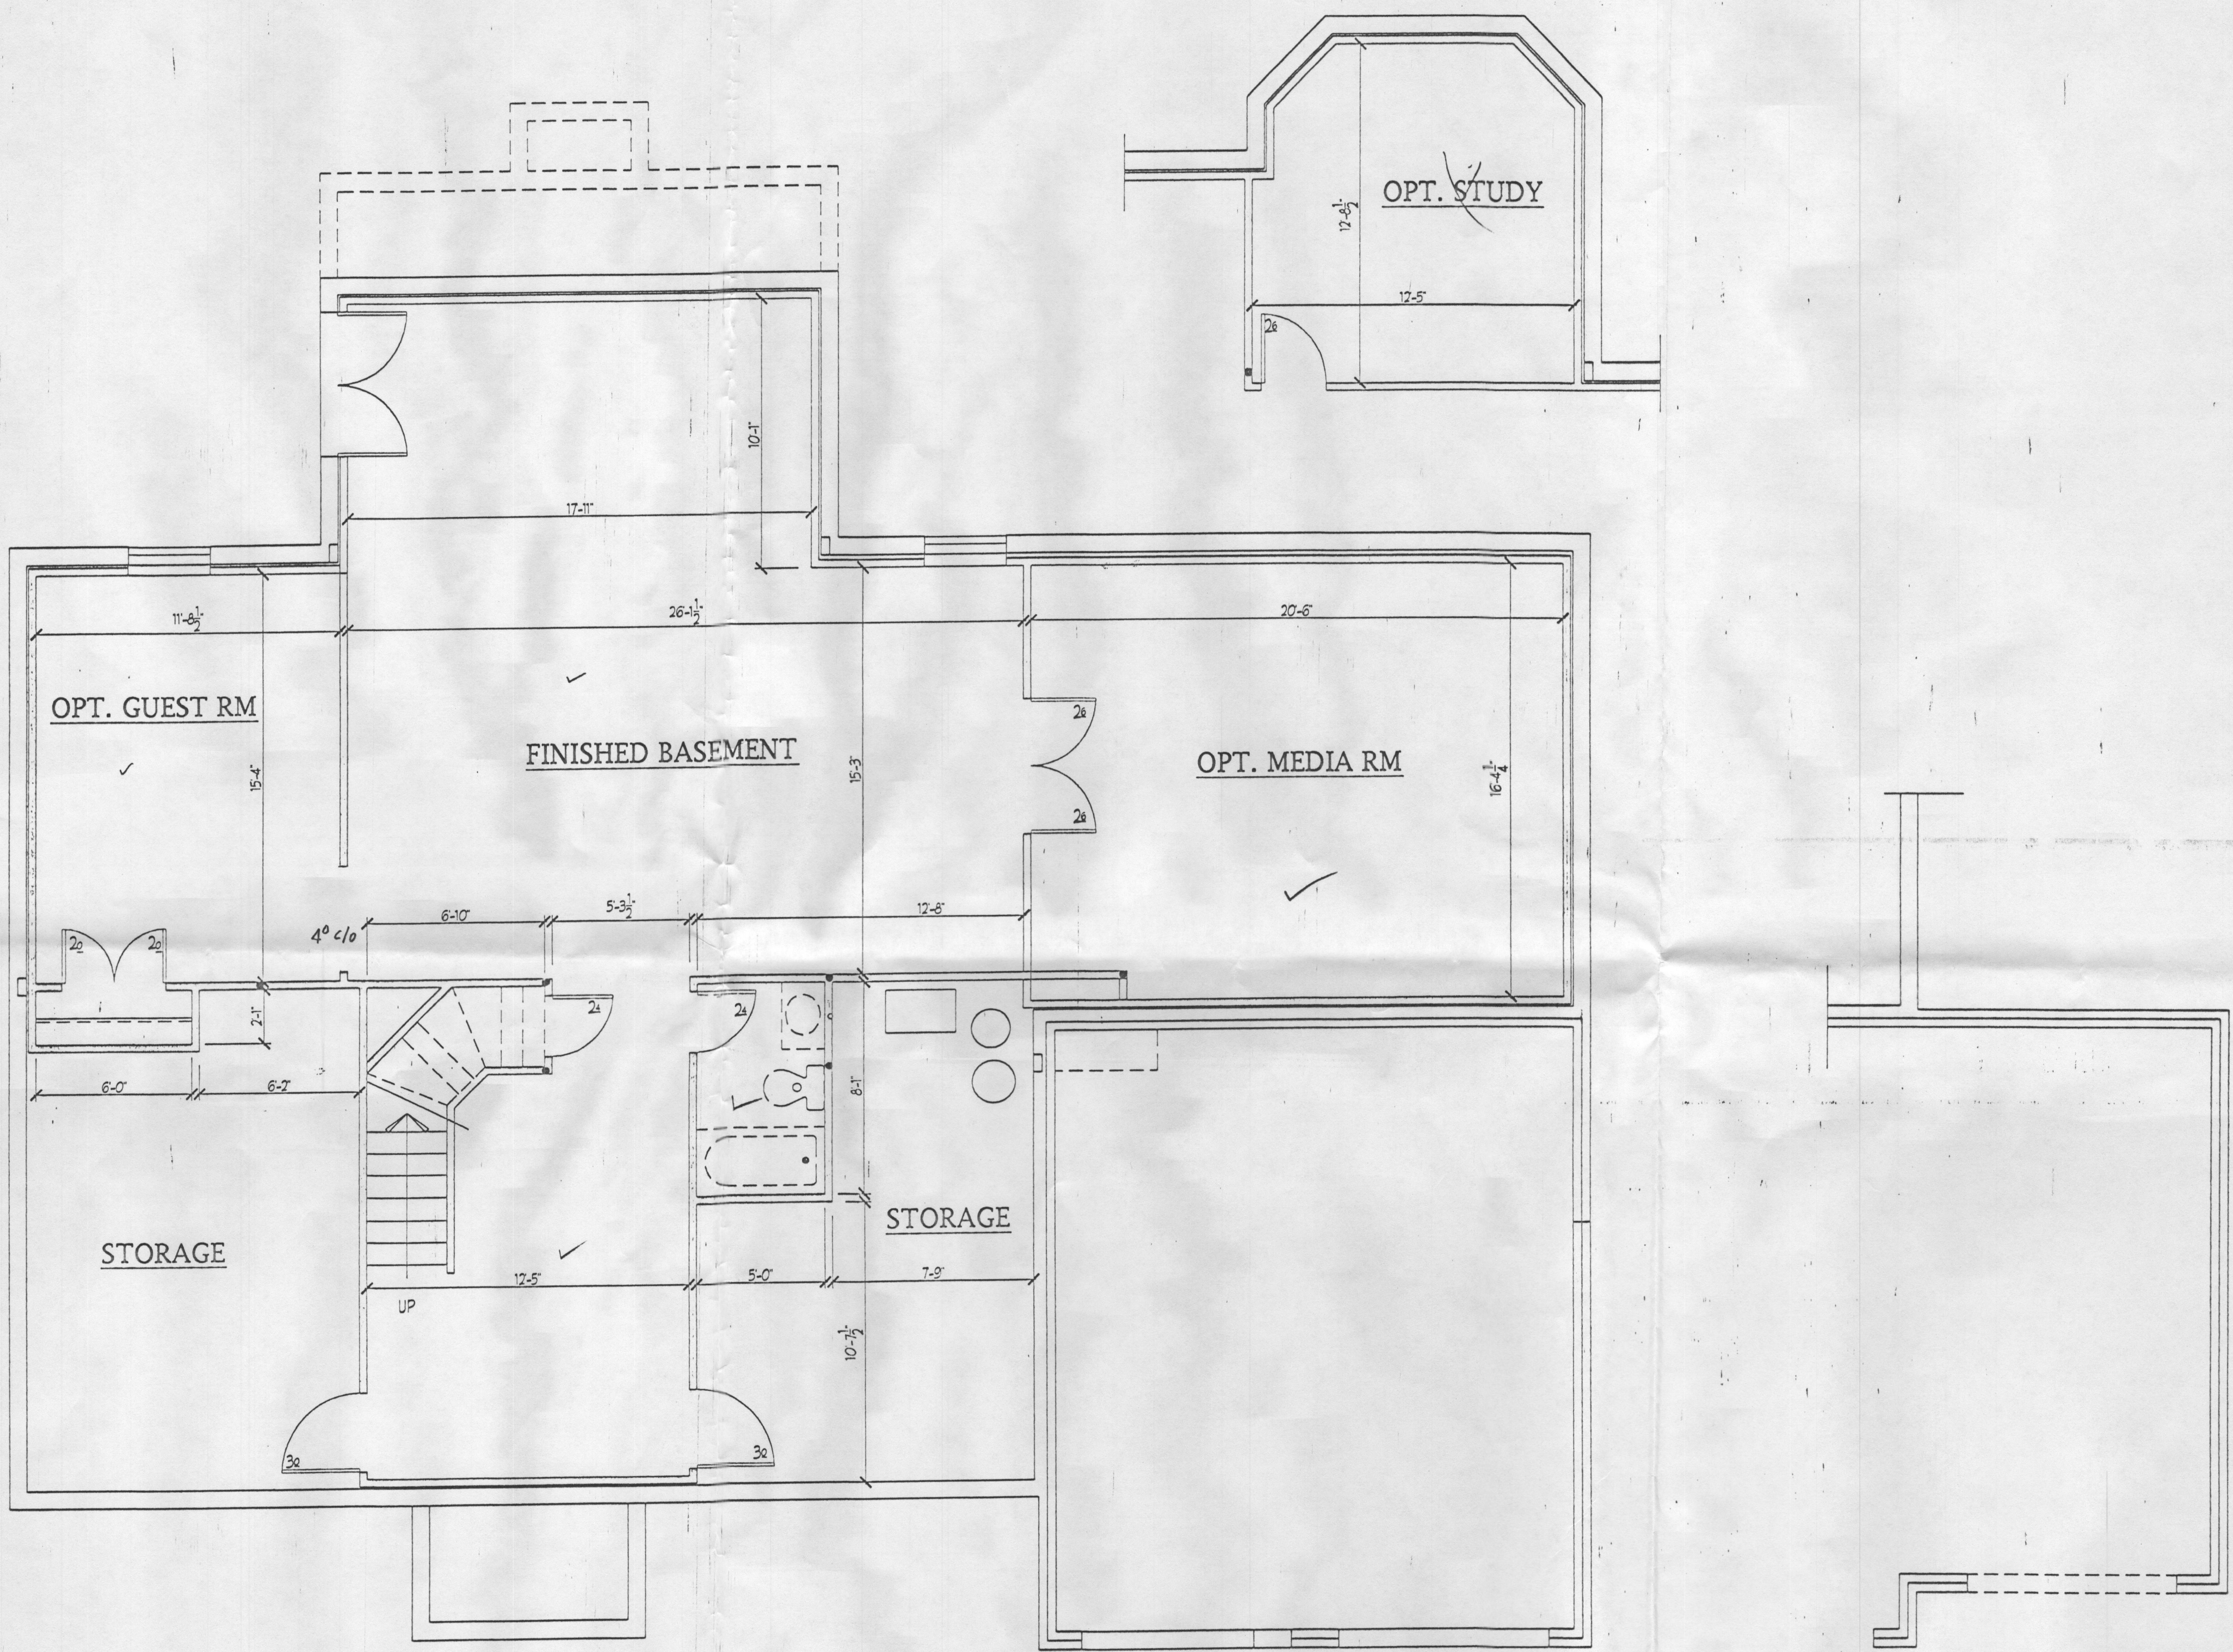

square footage approx 1008

A 6 B 7 C 6

Plan OK
DB 3-4-15

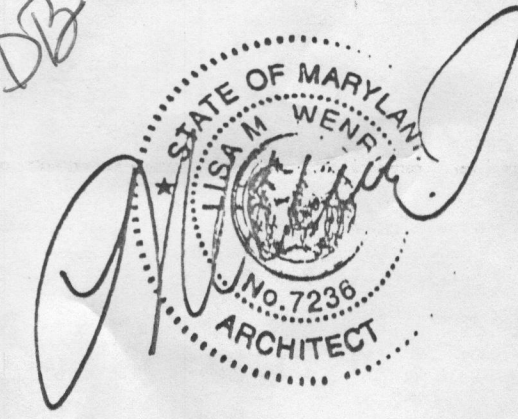

DATE	REVISION	DATE	REVISION
8/10	STAIR REVISIONS		
2/8/11	ADDED FINISHED BSMT PLAN		


Date: 8/10
Scale: 1/4" = 1'-0"
Drawn: TIM

Drawing: STANDARD FINISHED BSMT. PLAN
Project: WILLIAMSBURG GROUP
DORCHESTER 4

1067.D4
Project No.

2aa

REVISED 8/12

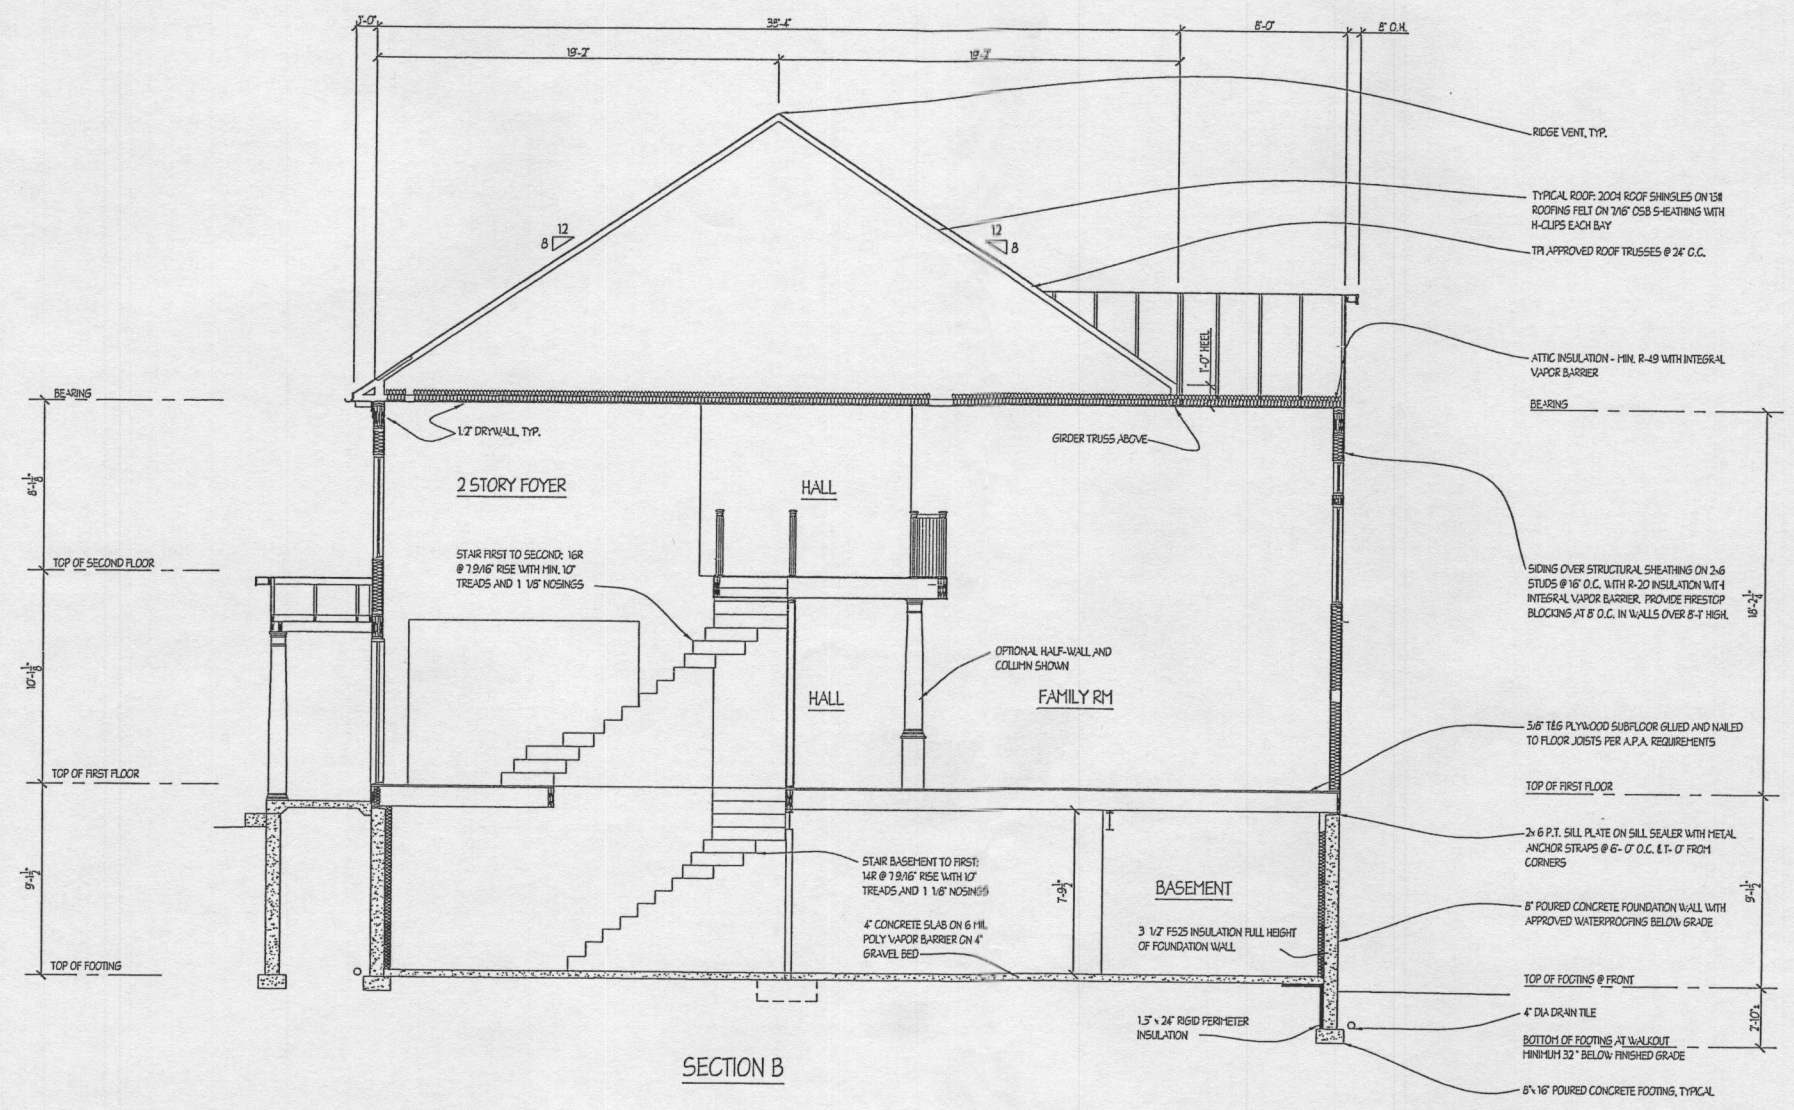

SECTION B



DATE	REVISION
08/20/12	2012 IRC & IECC UPDATES

Date: 8/10
 Scale: 1/4" = 1'-0"
 Drawn: TIM

Drawing: SECTION B
 Project: WILLIAMSBURG GROUP
 DORCHESTER 4

1067.D4
 Project No.

7

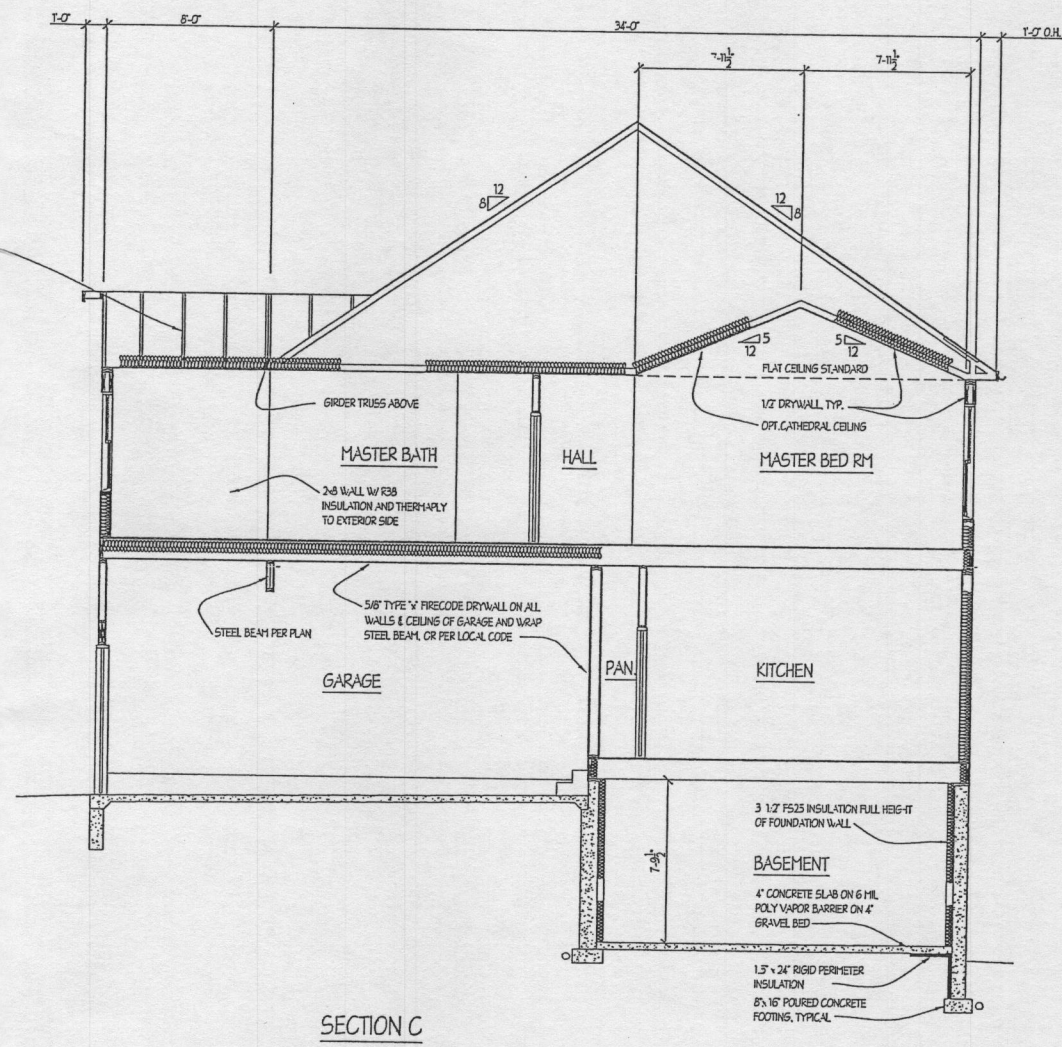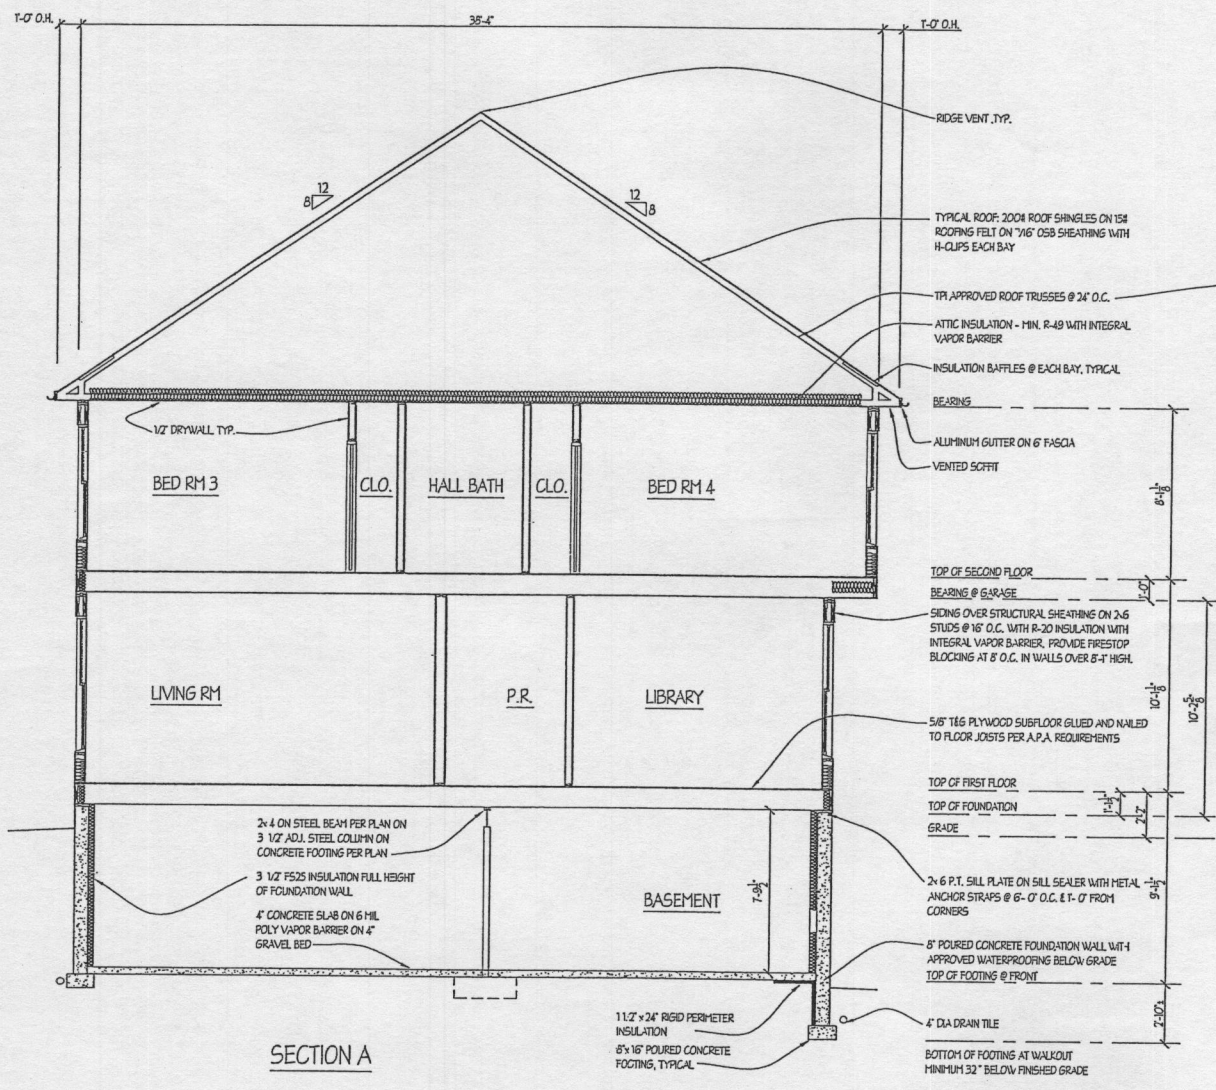




DATE	REVISION	DATE	REVISION
08/20/12	2012 IRC & IECC UPDATES		

Date: 8/10
 Scale: 1/4" = 1'-0"
 Drawn: TIM

Drawing: SECTIONS A&C
 Project: WILLIAMSBURG GROUP
 DORCHESTER 4

1067.D4
 Project No.

6

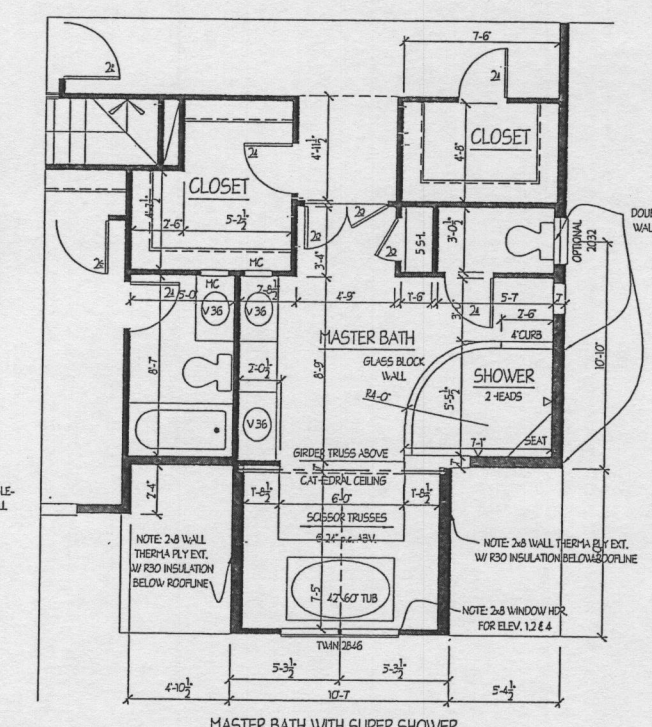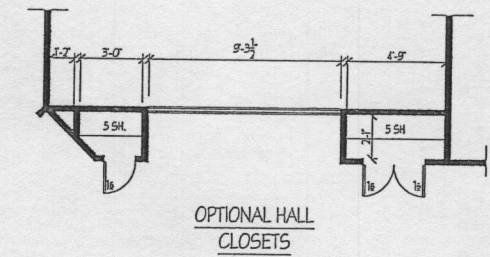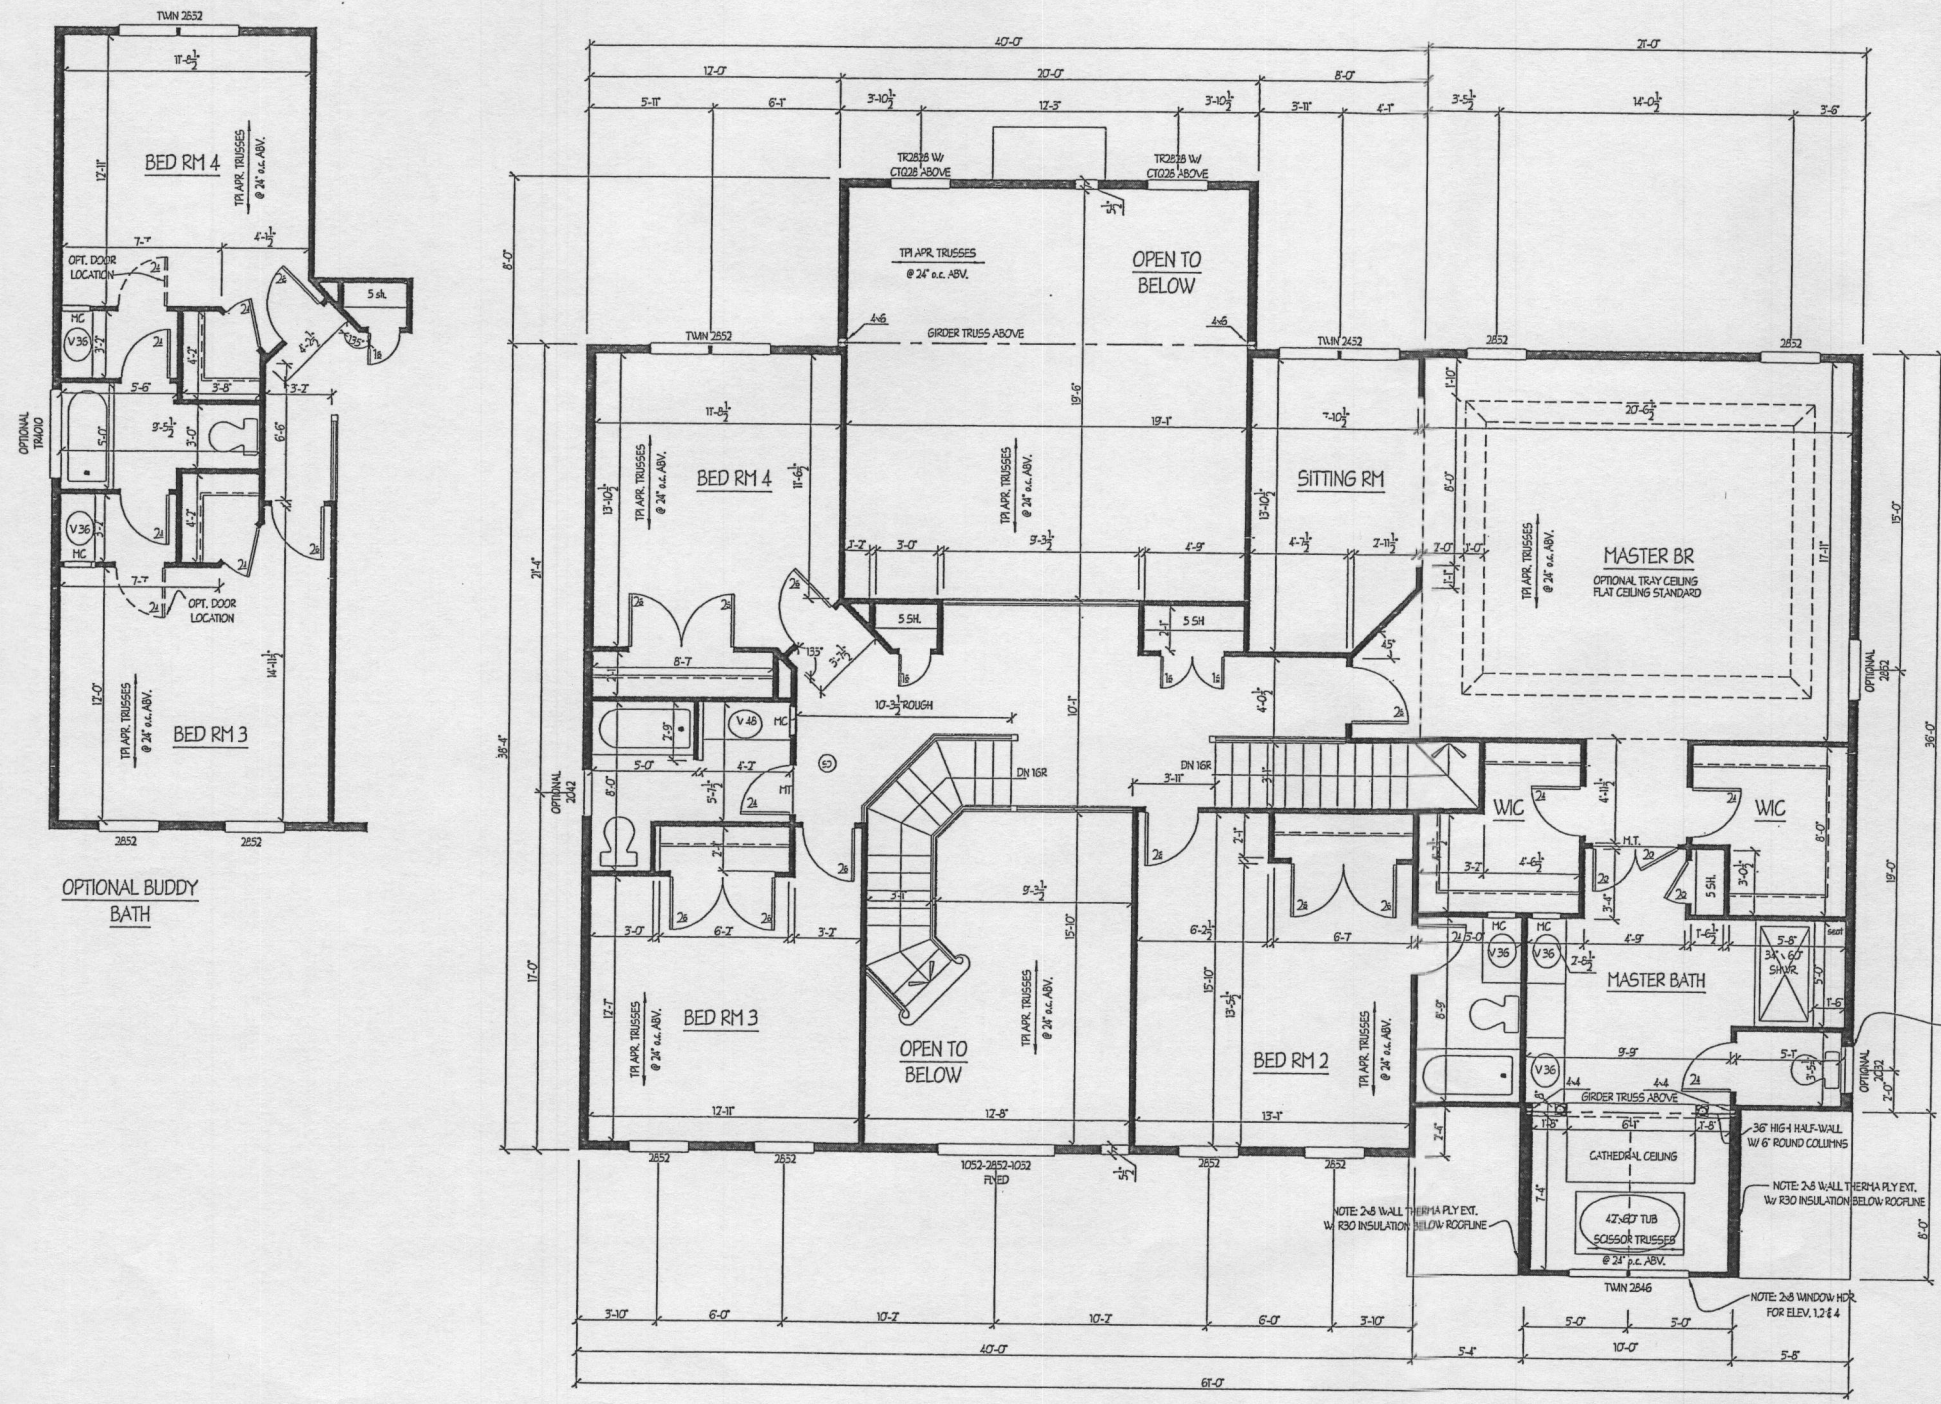

NOTES:
 WINDOW HEADERS ARE 2-2x12S AND ROUND-1 HEAD HEIGHTS ARE AT 7'-10" UNLESS NOTED OTHERWISE.
 ALL HEADERS IN BEARING WALLS ARE 2-2x12S UNLESS NOTED OTHERWISE.
 WOOD COLUMNS SPECIFIED MAY BE BUILT UP OF 2x MEMBERS, FASTENED TOGETHER AS REQUIRED.
 ALL EXTERIOR WALLS TO BE 2-6 @ 16" UNLESS OTHERWISE NOTED.

NOTE: SEE SHEET SA_5B FOR PARTIAL PLANS ON ELEVATIONS 3,4

NOTE: SECOND FLOOR PLAN WITH 4' WIDENING THROUGH FOYER AND FAMILY ROOM, 2' ADDED TO KITCHEN AND LIBRARY, AND ANGLED STAIR

Plymouth Road Architects
 640 Plymouth Road, Catonsville, MD 21229 410-788-0281

DATE:	REVISION:
9/29/10	STAIR REVISIONS

Date: 8/10
 Scale: 1/4" = 1'-0"
 Drawn: TIM

Drawing: SECOND FLOOR PLAN +2'
 Project: WILLIAMSBURG GROUP
 DORCHESTER 4

1067.D4
 Project No.

4b

REVISED SET 8/12