

Bureau of Environmental Health
 8930 Stanford Boulevard, Columbia, MD 21045
 Main: 410-313-2640 | Fax: 410-313-2648
 TDD 410-313-2323 | Toll Free 1-866-313-6300
www.hchealth.org
 Facebook: www.facebook.com/hocohealth

Maura J. Rossman, M.D., Health Officer

RECEIPT DATE: 3/6/2020 **ONSITE SEWAGE DISPOSAL SYSTEM** P 567336B

APPROVAL DATE: 4/7/2020 (S7) **PERMIT: CONSTRUCTION** A _____

PROPERTY ADDRESS: 3655 Paupers Folly Lane

SUBDIVISION: Belvedere Estates LOT: 11 TAX ID: _____

CONTRACTOR: South Carroll Backhoe EMAIL: scbackhoe@comcast.net

CONTRACTOR ADDRESS: 4410 Salem Bottom Road, Westminster, MD 21157 PHONE: 410-596-3618

PROPERTY OWNER: NV Homes EMAIL: _____

OWNER ADDRESS: 9720 Patuxent Woods Drive PHONE: 410.379.5956

SEPTIC TANK SIZE (GALLONS): 2000 TANK MANUFACTURER: Babylon Vault

PUMP MODEL: _____ PUMP SIZE _____ PUMP TANK CAPACITY: _____

DISTRIBUTION SYSTEM: GRAVITY PRESSURE DOSED BEDROOMS: 7 APPLICATION RATE: 1.2

TRENCHES:	LINEAR FEET REQUIRED: <u>110.83 FT</u>	INLET DEPTH: <u>3 FT</u>
	TRENCH WIDTH: <u>3 FT</u>	MAXIMUM BOTTOM DEPTH: <u>8 FT</u>
	MINIMUM SPACE BETWEEN TRENCHES: <u>12 FT</u>	EFFECTIVE AREA BEGINNING DEPTH: <u>3.5 FT</u>
LOCATION:	PER APPROVED SITE PLAN. SEWAGE DISPOSAL AREA AND TANK LOCATIONS MUST BE STAKED BY LICENSED SURVEYOR PRIOR TO PRE-CONSTRUCTION INSPECTION.	
NOTES:	Install 2 Trenches @ 55.42 FT Each	


ISSUED BY: H. Oswald ISSUE DATE: 3/6/2020 EXPIRATION DATE: 3/6/2021

- NOTE: CONTRACTOR MUST SCHEDULE A PRE-CONSTRUCTION INSPECTION PRIOR TO BEGINNING ANY INSTALLATION
- NOTE: CONTRACTOR MUST SCHEDULE AN INSPECTION AND GAIN APPROVAL OF ALL COMPONENTS PRIOR TO COVERING
- NOTE: STONE MUST BE APPROVED BY HEALTH DEPARTMENT AND GRAVEL TICKET MUST BE AVAILABLE FOR REVIEW.
- NOTE: WATERTIGHT TANKS REQUIRED
- NOTE: ALL PARTS OF SEPTIC SYSTEM SHALL BE AT LEAST 100 FEET DOWNGRADE FROM ANY WATER WELL
- NOTE: MANHOLE RISERS REQUIRED ON ALL SEPTIC TANKS AND PUMP CHAMBERS
- NOTE: AN ELECTRICAL PERMIT IS REQUIRED FOR INSTALLATION OF ANY ELECTRICAL COMPONENTS OF THE SYSTEM
- ELECTRICAL PERMIT ISSUED E N/A
- NOTE: MDE RECOMMENDS SEPTIC TANKS, BAT, AND OTHER PRETREATMENT UNITS BE PUMPED AT A FREQUENCY ADEQUATE TO ENSURE THAT SOLIDS ARE NOT DISCHARGED TO THE DISPOSAL AREA

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM. PERMITTEE RESPONSIBLE FOR OBTAINING FINAL APPROVAL ON THIS PERMIT. CALL 410-313-1771 TO SCHEDULE INSPECTIONS.

279189279189

NOT TO SCALE

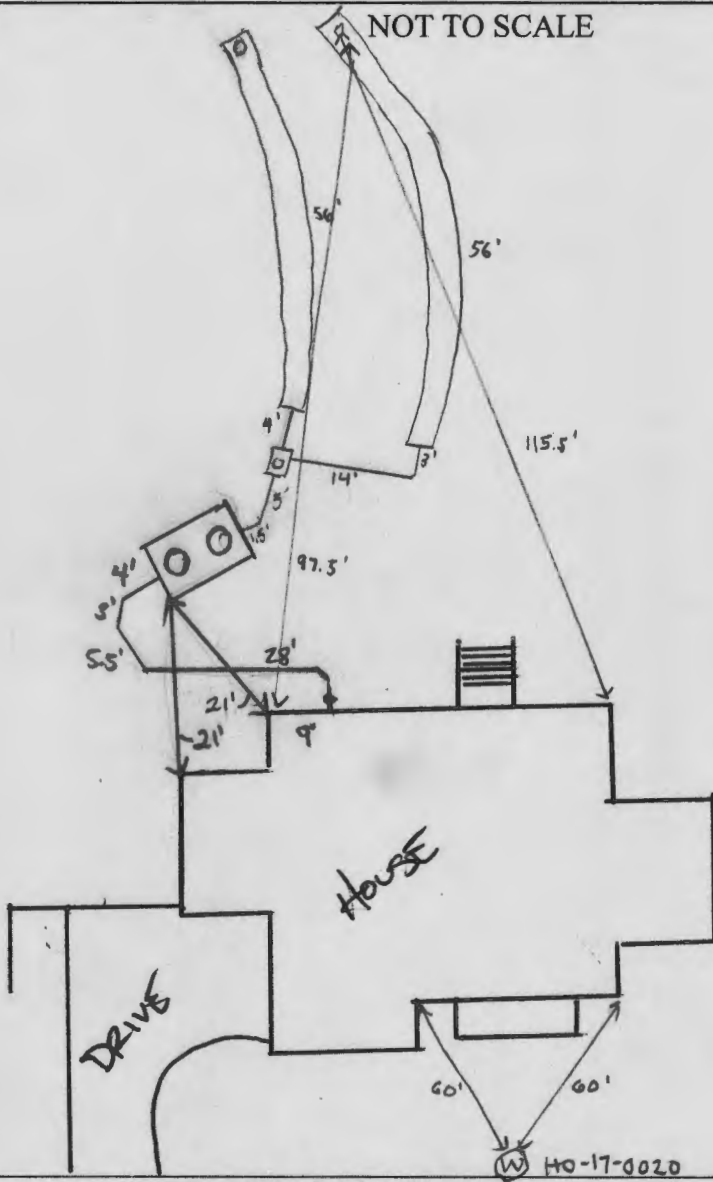

ROAD NAME
PAUPERS FOLLY LANE.

TRENCH/DRAINFIELD DATA

WIDTH	INLET	BOTTOM
3'	3.5'	8'
NUMBER OF TRENCHES		2
TOTAL LENGTH		112'
ABSORPTION AREA		336 sqft + sidewalk
DISTRIBUTION BOX LEVEL		yes
DISTRIBUTION BOX BAFFLE		yes
DISTRIBUTION BOX PORT		yes

PRE-CONSTRUCTION:

SEPTIC TANK DATA

SEPTIC TANK I LEVEL	yes
MANUFACTURER	BABCOCK
CAPACITY	2000 GAL
SEAM LOC	TOP
TANK LID DEPTH	2.5'
BAFFLES	front/back
BAFFLE FILTER	NO
MANHOLE LOC	FRONT/BACK
6" PORT LOC	
WATERTIGHT TEST	-
SLOTTED	YES
DATE ON LID	11/04/19

PUMP/SEPTIC TANK LEVEL

MANUFACTURER	
CAPACITY	GAL
SEAM LOC	
TANK LID DEPTH	
BAFFLES	
BAFFLE FILTER	
MANHOLE LOC	
6" PORT LOC	
WATERTIGHT TEST	
SLOTTED	
DATE ON LID	

4/1/2020 Trenches staked on contour by surveyor. Third trench staked by accident. First trench is 58', second 67'. Contractor will move trenches up during construction. Hung sewer marked to come out below deck. Drew already placed pipe (8T)

INSTALLATION: 04/06/2020 TANK AND SEWER LINE INSTALLED. BUILDER PUT A DECK OVER THE SEWER LINE AND THE INVERT IS DEEPER THAN PLAN. SHC CONFIRMED W/TAR. CONTACT BUILDER + ENG. (8)

4/7/2020 D-box set and trenches constructed. Trench inlet moved down to 3.5'. (8T)

FINAL INSPECTOR

Susan Thomas

DATE OF APPROVAL

4/7/2020

Oswald, Hank

From: Oswald, Hank
Sent: Monday, February 03, 2020 2:28 PM
To: Dave Harward, III
Subject: RE: OSDS Plan_3655 Paupers Folly Lane
Attachments: basement floor plan.pdf

Hi Dave:

Good afternoon. The basement floor plan (see attachment) shows the walk up in a different location than what's shown on the septic plan. Please check with builder and confirm location. If the septic plan is correct, then the builder will need to submit a new basement floor plan to DILP.

Thanks,

Hank

From: Dave Harward, III <DaveH@fcc-eng.com>
Sent: Monday, February 03, 2020 10:39 AM
To: Oswald, Hank <hoswald@howardcountymd.gov>
Subject: RE: OSDS Plan_3655 Paupers Folly Lane

[Note: This email originated from outside of the organization. Please only click on links or attachments if you know the sender.]

Hank,

NV contacted me about this permit again. They are anxious to get this house started, so I wanted to check with you to see if you thought you could approve this soon. We delivered the new plans on the 29th of Jan.

Thanks,
Dave.



From: Dave Harward, III
Sent: Wednesday, January 29, 2020 12:00 PM
To: Oswald, Hank <hoswald@howardcountymd.gov>
Subject: RE: OSDS Plan_3655 Paupers Folly Lane

Thanks for the heads up. You should have new updated plans by now, just wanted to let you know.

Thanks Hank !
Dave.

From: Oswald, Hank <hoswald@howardcountymd.gov>
Sent: Wednesday, January 29, 2020 8:16 AM
To: Tony Fertitta <tonyf@fcc-eng.com>
Cc: Dave Harward, III <DaveH@fcc-eng.com>; 'JIM@DECATURBUILDINGSERVICES.COM' <JIM@DECATURBUILDINGSERVICES.COM>; Cagle, Clint (ccagle@nvrinc.com) <ccagle@nvrinc.com>
Subject: OSDS Plan_3655 Paupers Folly Lane

Hi Tony:

Good morning. I received a revision to B19002751 for a change in house type, 3655 Paupers Folly Lane (Belvedere Estates Lot 11). We will need a revised OSDS Plan for this address.

Thanks,

Hank

Hank Oswald
Licensed Environmental Health Specialist
Howard County Health Department
Bureau of Environmental Health
Well & Septic Program
8930 Stanford Boulevard
Columbia, MD 21045
410.313.1786 (Office)
hoswald@howardcountymd.gov



CONFIDENTIALITY NOTICE

This message and the accompanying documents are intended only for the use of the individual or entity to which they are addressed and may contain information that is privileged, confidential, or exempt from disclosure under applicable law. If the reader of this email is not the intended recipient, you are hereby notified that you are strictly prohibited from reading, disseminating, distributing, or copying this communication. If you have received this email in error, please notify the sender immediately and destroy the original transmission.

