



HEALTH

Building Permit Application
 Howard County Maryland
 Department of Inspections, Licenses and Permits
 3430 Court House Drive
 Permits: 410-313-2455
 www.howardcountymd.gov

Received: 8/10/19
 Permit No.: **B190021e29**

Building Address: 14285 OLD FREDERICK RD.
 City: COOKSVILLE State: MD Zip Code: _____
 Site/Apt. # _____ SDP/WP/BA #: GP 20-007
 Job Division: _____
 Plot: _____ Tax Map: _____ Parcel: 268

Existing Use: VACANT LOT
 Proposed Use: NEW SINGLE FAMILY DWELLING
 Estimated Construction Cost: \$ 705,000
 Description of Work: NEW ONE STORY HOUSE W/ PARTIALLY FIN. BASEMENT
SIX BDRMS., 3 FULL BATHS, 1 PR, THREE CAR GARAGE, FRONT PORCH
REAR SCREEN PORCH, COVERED VERANDA
WOOD BURNING FIREPLACE.

Occupant/Tenant Name: _____
 Was tenant space previously occupied? Yes No
 Contact Name: _____
 Address: _____
 City: _____ State: _____ Zip Code: _____
 Phone: _____ Fax: _____
 Email: _____

Commercial Building Characteristics	Residential Building Characteristics	
Height:	<input checked="" type="checkbox"/> SF Dwelling <input type="checkbox"/> SF Townhouse	
No. of stories:	Depth	Width
Gross area, sq. ft./floor:	1 st floor:	
	2 nd floor:	
Area of construction (sq. ft.):	Basement:	
	<input checked="" type="checkbox"/> Finished Basement	
Use group:	<input type="checkbox"/> Unfinished Basement	
	<input type="checkbox"/> Crawl Space	
	<input type="checkbox"/> Slab on Grade	
Construction type:	No. of Bedrooms:	
<input type="checkbox"/> Reinforced Concrete	Multi-family Dwelling	
<input type="checkbox"/> Structural Steel	No. of efficiency units:	
<input type="checkbox"/> Masonry	No. of 1 BR units:	
<input type="checkbox"/> Wood Frame	No. of 2 BR units:	
<input type="checkbox"/> State Certified Modular	No. of 3 BR units:	
	Other Structure:	
	Dimensions:	
<input checked="" type="checkbox"/> Roadside Tree Project Permit	Footings:	
<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Roof:	
Roadside Tree Project Permit #	<input type="checkbox"/> State Certified Modular	
	<input type="checkbox"/> Manufactured Home	

Property Owner's Name: VICTOR WHITE
 Address: 199 Baughmans Ln.
 City: Frederick State: MD Zip Code: 21702
 Phone: 443-468-6442 Fax: _____
 Email: Vwhite@HoganCompanies.COM

Applicant's Name & Mailing Address, (if other than stated herein)
 Applicant's Name: VICTORIA MEYER
 Address: 1602 Pinnacle Rd.
 City: Towson State: MD Zip Code: 21286
 Phone: 443-250-3690 CELL Fax: _____
 Email: Mdbldgpermits@comcast.net

Contractor Company: C, E. Rensberger & Family Bldg
 Contact Person: _____
 Address: 1 South Main St
 City: WOODSBORO State: MD Zip Code: 21798
 License No.: 6677-MHBR & (MHIC 130129)
 Phone: 301-370-4042 Fax: _____
 Email: JOEL@CERENBERGERBUILDER.COM

Engineer/Architect Company: Benchmark Engineering
 Responsible Design Prof.: J. Chris Ogle
 Address: 8480 Balto. National Pike suite 315
 City: Ellicott City State: MD Zip Code: 21043
 Phone: 410-465-6105 Fax: _____
 Email: _____

Utilities	
Electric:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No
Gas:	<input type="checkbox"/> Yes <input type="checkbox"/> No
Water Supply	
<input type="checkbox"/> Public	
<input checked="" type="checkbox"/> Private	
Sewage Disposal	
<input type="checkbox"/> Public	
<input checked="" type="checkbox"/> Private	
Heating System	
<input type="checkbox"/> Electric <input type="checkbox"/> Oil	
<input type="checkbox"/> Natural Gas <input checked="" type="checkbox"/> Propane Gas	
<input type="checkbox"/> Other:	
Sprinkler System:	
<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Grading Permit Number: <u>619000170</u>	
Building Shell Permit Number:	

HE UNDERSIGNED HEREBY CERTIFIES AND AGREES AS FOLLOWS: (1) THAT HE/SHE IS AUTHORIZED TO MAKE THIS APPLICATION; (2) THAT THE INFORMATION IS CORRECT; (3) THAT HE/SHE WILL COMPLY WITH ALL REGULATIONS OF HOWARD COUNTY WHICH ARE APPLICABLE THERETO; (4) THAT HE/SHE WILL PERFORM NO WORK ON THE ABOVE REFERENCED PROPERTY NOT SPECIFICALLY DESCRIBED IN THIS APPLICATION; (5) THAT HE/SHE GRANTS COUNTY OFFICIALS THE RIGHT TO ENTER ONTO THIS PROPERTY FOR THE PURPOSE OF INSPECTING THE WORK PERMITTED AND POSTING NOTICES.

Applicant's Signature: V. Meyer
 Vdbldgpermits@comcast.net
 Email Address
 agent for Victor White
 Title/Company

Vicky MEYER cell 443-260-3690
 Print Name
 Date: 8/8/19
RECEIVED
AUG 08 2019
 LICENSES & PERMITS DIVISION

Checks Payable to: DIRECTOR OF FINANCE OF HOWARD COUNTY
 PLEASE WRITE NEATLY & LEGIBLY
 -FOR OFFICE USE ONLY-

AGENCY	DATE	SIGNATURE OF APPROVAL
State Highways		
Building Officials		
PSZA (Zoning)		
PSZA (Engineering)		
Health	<u>8/19/19</u>	<u>RB</u>

Sediment control approval required for drainage Yes No
 CONTINGENCY CONSTRUCTION START


DPZ SETBACK INFORMATION	
Front:	
Rear:	
Side:	
Side St.:	
All minimum setbacks met?	<input type="checkbox"/> Yes <input type="checkbox"/> No
Is Entrance Permit Required?	<input type="checkbox"/> Yes <input type="checkbox"/> No
Historic District?	<input type="checkbox"/> Yes <input type="checkbox"/> No
Lot Coverage for New Town Zone:	
SDP/Red-line approval date:	

Filing Fee	\$ <u>100</u>
Permit Fee	\$
Tech Fee	\$
Excise Tax	\$
PSFS	\$
Guaranty Fund	\$ <u>50</u>
Add'l per Fee	\$
Total Fees	\$
Sub-Total Paid	\$
Balance Due	\$
Check	# <u>1322</u>

WHITE RESIDENCE

HEALTH
OK
6 Bedrooms
ref
8/16/19

B19002629

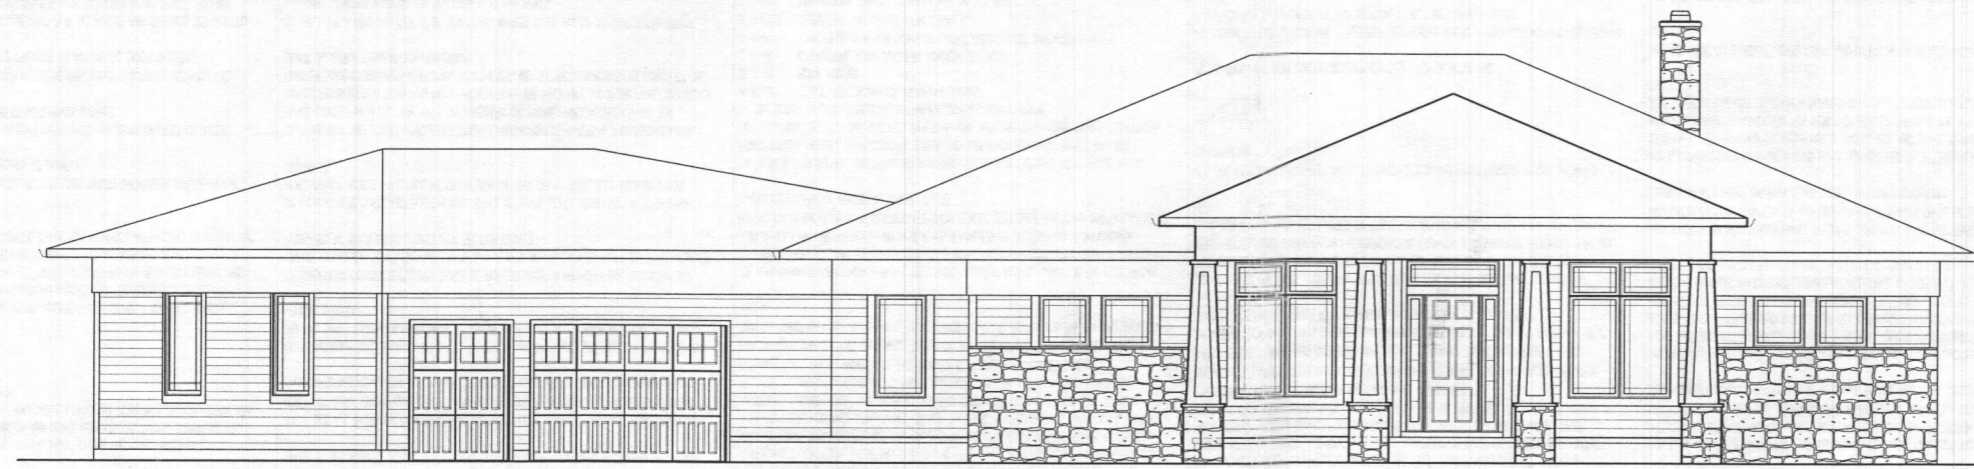

14285 Old Frederick Rd
Cooksville MD

TABLE R301.5 LIVE LOAD MINIMUM UNIFORMLY DISTRIBUTED LIVE LOADS (IN POUNDS PER SQUARE FOOT) SHALL CONFORM TO THE FOLLOWING:

USE	LIVE LOAD	DEAD LOAD	TOTAL
ROOF TRUSSES	30	10 (up to 4000)	50
RAFTERS	30	10	40
ATTICS WITHOUT STORAGE ^a	10	5	15
ATTICS WITH LIMITED STORAGE ^b	20	10	30
HABITABLE ATTICS AND ATTICS SERVED WITH FIXED STAIRS	30	10	40
BALCONIES (EXTERIOR) AND DECKS ^c	40	10	50
FIRE ESCAPES	40	10	50
GUARDRAILS AND HANDRAILS ^d	200 ^e		
GUARDRAIL IN-FILL COMPONENTS ^f	50 ^g		
PASSENGER VEHICLE GARAGES ^h	50	50	100
ROOMS OTHER THAN SLEEPING ROOMS	40 ⁱ	10	50
SLEEPING ROOMS	30	10	40
STAIRS	40 ^j	20	60

ASSUMED SAIL BEARING CAPACITY: 2000 PSF

a. Elevated garage floors shall be capable of supporting a 2000-pound load applied over a 20-square-foot area.

b. Uninhabitable attics without storage are those where the maximum clear height between joists and rafters is less than 42 inches, or where there are not two or more adjacent trusses with web configurations capable of accommodating an assumed rectangle 42 inches high by 24 inches in width or greater, within the plane of the trusses. This live load need not be assumed to act concurrently with any other live load requirements.

c. Individual stair treads shall be designed for the uniformly distributed live load or a 300-pound concentrated load acting over an area of 4 square inches, whichever produces the greater stresses.

d. A single concentrated load applied in any direction at any point along the top.

e. See Section R502.2.2 for decks attached to exterior walls.

f. Guard-in-fill components (all those except the handrail, balusters and panel fillers) shall be designed to withstand a horizontally applied normal load of 50 pounds on an area equal to 1 square foot. This load need not be assumed to act concurrently with any other live load requirement.

g. Uninhabitable attics with limited storage are those where the maximum clear height between joists and rafters is 42 inches or greater, or where there are two or more adjacent trusses with web configurations capable of accommodating an assumed rectangle 42 inches in height by 24 inches in width, or greater, within the plane of the trusses. The live load need only be applied to those portions of the joists or truss bottom chords where all of the following conditions are met:

- The attic area is accessible from an opening not less than 20 inches in width by 30 inches in length that is located where the clear height in the attic is a minimum of 30 inches.
- The slopes of the joists or truss bottom chords are no greater than 2 inches vertical to 12 units horizontal.
- Required insulation depth is less than the joist or truss bottom chord member depth.

The remaining portions of the joists or truss bottom chords shall be designed for a uniformly distributed concurrent live load of not less than 10 lb/ft².

h. Glazing used in handrail assemblies and guards shall be designed with a safety factor of 4. The safety factor shall be applied to each of the concentrated loads applied to the top of the rail, and to the load on the in-fill components. These loads shall be determined independent of one another, and loads are assumed not to occur with any other live load.

ADOPTED CODES

International Building Code, 2015 Edition
 International Residential Code for One and Two Family Dwellings, 2015 Edition
 International Mechanical Code, 2015 Edition
 International Energy Conservation Code, 2015 Edition
 The Life Safety Code, 2015 Edition
 2014 National Electrical Code with Local Amendments (NFPA 70)
 2009 National Standard Plumbing Code Illustrated
 2009 National Fuel Gas Code (NFPA 54)
 International Property Maintenance Code 2006


ENERGY COMPLIANCE: PRESCRIPTIVE APPROACH SEE SHEET A-8A

JULY 15, 2019 - PERMIT SET

TABLE R301.2(1) CLIMATIC AND GEOGRAPHIC DESIGN CRITERIA

GROUND SNOW LOAD	WIND DESIGN				SEISMIC DESIGN CATEGORY	SUBJECT TO DAMAGE FROM			WATER DESIGN TEMP	ICE BARRIER UNDERLAYMENT REQUIRED	FLOOD HAZARD	AIR FREEZING INDEX	MEAN ANNUAL TEMP
	Speed (mph)	Topographic effects	Special wind region	Wind-borne debris zone		Weathering	Frost line depth	Termites					
25	115	NO	NO	NO	A	Severe	30"	Moderate Heavy	20°	Yes	see flood maps	1500	55°

C.E. Rensberger & Family, Builder
 1 South Main Street
 Woodsboro, MD 21798
 301-370-4042
 MHIC#130127/MHBR#6677

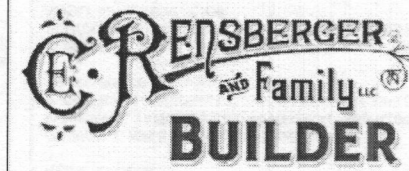

DRAWING INDEX

TITLE	SHEET	TITLE	SHEET
COVER SHEET/SITE PLAN	C5		
CONSTRUCTION NOTES	CN		
FRONT AND RIGHT ELEVATIONS	A-1A		
REAR AND LEFT ELEVATIONS	A-1B		
FOUNDATION PLAN	A-2		
FIRST FLOOR PLAN	A-3		
ROOF PLAN/FRAMING PLAN	A-4		
SECTIONS A-B	A-5A		
SECTIONS C-D	A-5B		
SECTIONS E-F	A-5C		
APA NARROW WALL DETAILS	A-8A		
WALL BRACING PLANS AND CHARTS	A-8B		
FIRST FLOOR WALL BRACING PLAN	A-8C		

SQ. FOOTAGE

FIN. BASEMENT	121
FIRST FLOOR	2980
TOTAL	3101
GARAGE	992

For Health
Floor Dept
Plans



JB HOME DESIGN, LLC

9416 CONCORD COURT
 BALTIMORE, MARYLAND 21234
 OFFICE (410) 599-4587
 FAX (410) 663-4069
 EMAIL: JON@JBHOMEDSIGN.COM

GENERAL

61. ALL NOTES APPLY TO EACH AND EVERY SUBCONTRACTOR. READ AND REVIEW EACH NOTE CAREFULLY FOR ITS APPLICABILITY TO THE WORK.

62. BUILDING CODE REFERENCES HEREINAFTER AND ON THE PLANS REFER TO THE 2015 INTERNATIONAL RESIDENTIAL CODE (IRC) AND OTHER INTERNATIONAL CODES, AS APPLICABLE, UNLESS OTHERWISE NOTED (I.N.O.).

63. CONTRACTOR SHALL PROVIDE THE GENERAL BUILDING PERMIT ONLY. EACH SUBCONTRACTOR SHALL SECURE ALL OTHER REQUIRED PERMITS PRIOR TO COMMENCING ANY WORK AND SHALL BE SOLELY RESPONSIBLE FOR OBTAINING AND PASSING, WITHOUT DELAY TO CONTRACTOR, ALL INSPECTIONS AND APPROVALS REQUIRED BY LAW OR ANY STORM WATER OR DUST CONTROL REQUIREMENTS AND ANY INSPECTIONS AND APPROVALS REQUIRED BY CONTRACTOR OR ANY AGENT OF CONTRACTOR.

64. PERFORM ALL WORK IN COMPLIANCE WITH APPLICABLE LAWS, FREE FROM NONCONFORMANCE, IN A FIRST-CLASS, GOOD, AND WORKMANLIKE MANNER ACCORDING TO THE HIGHEST STANDARDS OF SUBCONTRACTORS TRADE AND IN STRICT CONFORMANCE WITH SUBCONTRACTORS OBLIGATIONS UNDER ITS AGREEMENT.

65. THE CONTRACT DOCUMENTS OUTLINE SALIENT MINIMUM REQUIREMENTS BUT DO NOT SPECIFY ALL LABOR, MATERIAL, TOOLS EQUIPMENT, UTILITIES, SERVICES AND OTHER ITEMS NECESSARY TO PROPERLY AND FULLY EXECUTE THE WORK.

66. WORK NOT SPECIFICALLY COVERED IN THE CONTRACT DOCUMENTS, BUT WHICH IS REASONABLY INFERRABLE FROM OR CUSTOMARILY PERFORMED BY ANY SUBCONTRACTOR OF THE SAME OR SIMILAR TRADE PERFORMING WORK OF THE TYPE SHOWN OR INCLUDED IN THE CONTRACT DOCUMENTS, INCLUDING DETAILS OR ITEMS OF THE WORK WHICH ARE NOT SPECIFICALLY COVERED ON OR IN THE CONTRACT DOCUMENTS, SHALL BE FINISHED AND INSTALLED AT NO EXTRA COST.

67. ALL MATERIAL SUPPLIED SHALL BE NEW, THE BEST OF ITS KIND AND FROM THE SAME MANUFACTURER (AND SAME MANUFACTURING RUN WHERE APPLICABLE). ALL MATERIALS SHALL BE SUITABLE FOR THE USES INTENDED AND CONDITIONS ANTICIPATED. FURNISH HANDLE AND INSTALL MATERIAL IN ACCORDANCE WITH THE TERMS OF ITS LISTING OR APPROVAL, THE MANUFACTURER'S WRITTEN INSTALLATION INSTRUCTIONS, GUIDELINES AND RECOMMENDATIONS AND APPLICABLE LAWS AND STANDARDS.

68. SUBCONTRACTOR SHALL PROTECT THE WORK, PROPERTY AND MATERIAL OF OTHER PERSONS BEFORE PROCEEDING WITH ANY WORK, AND AT ALL TIMES DURING THE PERFORMANCE OF ITS WORK.

69. DRAWN DIMENSIONS TAKE PRECEDENCE OVER DRAWN INFORMATION - DO NOT SCALE DIMENSIONS. ALL DIMENSIONS ARE SHOWN TO FACE OF STUDS. ALL EXTERIOR STUD WALLS ARE 5 1/2" WIDE, ALL INTERIOR STUD WALLS ARE 3 1/2" WIDE (I.N.O.).

70. SUBCONTRACTOR SHALL VERIFY ALL DIMENSIONS BEFORE COMMENCING ANY WORK. BRING ALL ERRORS OR OMISSIONS TO THE IMMEDIATE ATTENTION OF CONTRACTOR BEFORE COMMENCING ANY WORK. SUBCONTRACTOR SHALL BEAR ALL COSTS AND EXPENSES FOR CORRECTING WORK COMMENCED WITHOUT VERIFYING DIMENSIONS OR WITHOUT HAVING A RESOLUTION TO ANY ERROR OR OMISSION.

71. REMOVE ALL WASTE MATERIAL AND TRASH DAILY. CLEAN THE WORK AREA DAILY. IMMEDIATELY AFTER COMPLETING WORK ON ANY HOME, REMOVE ALL TOOLS, EQUIPMENT AND EXCESS OR NONCONFORMING MATERIAL AND SHALL LEAVE THE HOME IN A BROOM CLEAN, NEAT, SAFE, SECURE AND SANITARY CONDITION.

SAFETY

51. EVERY SUBCONTRACTOR AND EACH OF ITS AGENTS SHALL COMPLY WITH ALL HEALTH, SAFETY AND ENVIRONMENTAL LAWS, RULES, REGULATIONS AND REQUIREMENTS. EACH SUBCONTRACTOR UNDERSTANDS AND AGREES THAT SUBCONTRACTOR IS SOLELY LIABLE AND SOLELY RESPONSIBLE FOR THE HEALTH AND SAFETY OF ITS AGENTS AND THAT SUBCONTRACTOR POSSESSES THE AUTHORITY, EXPERTISE, CONTROL AND MEANS TO CARRY OUT SUCH RESPONSIBILITY.

52. CEILING HEIGHTS SHALL COMPLY WITH SECTION R305. WHERE UNFINISHED, CEILING HEIGHTS SHALL ALLOW FOR 1" MINIMUM FOR FINISHES TO COMPLY.

53. PROVIDE TEMPERED GLASS IN LOCATIONS DESIGNATED AS BEING HAZARDOUS UNDER SECTION R308.4 CONFORMING WITH THE REQUIREMENTS THEREIN.

54. PROVIDE A SOLID CORE WOOD DOOR NOT LESS THAN 1-3/8" THICKNESS BETWEEN THE GARAGE AND THE RESIDENCE (R302.5). PROVIDE AN AUTOMATIC DOOR CLOSER.

55. PROVIDE 5/8" TYPE "X" GYPSUM WALLBOARD FOR ALL WALLS AND CEILINGS SEPARATING THE GARAGE AND ANY HABITABLE OR LEASABLE SPACE, INCLUDING ATTIC SPACE, AND THE STRUCTURE SUPPORTING THE SEPARATION (R302). DUCTWORK IN THE GARAGE OR PENETRATING ANY WALL OR CEILING BETWEEN THE GARAGE AND ANY HABITABLE OR LEASABLE SPACE SHALL BE CONSTRUCTED OF NOT LESS THAN 26 GAUGE STEEL.

56. WINDOW WELLS SHALL BE OF GALVANIZED STEEL OR REINFORCED CONCRETE (I.N.O.) AND BE OF SUFFICIENT STRENGTH TO RESIST BACKFILL PRESSURES AND SHALL HAVE MINIMUM HORIZONTAL AREA OF 9 SF. WITH A MINIMUM HORIZONTAL PROJECTION AND WIDTH OF 36" (R301). PROVIDE A PERMANENTLY AFFIXED LADDER WHERE WINDOW WELL EXCEEDS 44". TOP OF WELL SHALL EXTEND NOT LESS THAN 3" ABOVE FINISHED GRADE AND BOTTOM OF WELL SHALL EXTEND NOT LESS THAN 4" BELOW WINDOW SILL. PROVIDE DRAINAGE BY CONNECTING TO THE BUILDING FOUNDATION DRAINAGE SYSTEM OR APPROVED ALTERNATIVE METHOD.

57. STAIRWAYS, RAMPS EXTERIOR EXIT BALCONIES, HALLWAYS AND DOORS SHALL COMPLY WITH THE REQUIREMENTS OF SECTION R011. STAIR TREADS AND RISERS SHALL HAVE MAXIMUM RISER HEIGHT OF 7 3/4" AND MINIMUM TREAD DEPTH OF 10". RISER HEIGHTS AND TREAD DEPTH SHALL NOT VARY MORE THAN 3/8". EACH EXTERIOR DOOR SHALL HAVE A FLOOR OR LANDING ON EACH SIDE. THE LANDING AT ANY EXTERIOR DOOR SHALL NOT BE MORE THAN 1 3/4" BELOW THE TOP OF THE DOOR THRESHOLD PROVIDED THE DOOR DOES NOT SWING OVER THE LANDING.

58. PROVIDE AN INTERCONNECTED SMOKE DETECTOR SYSTEM, HAVING A SMOKE ALARM IN EACH SLEEPING ROOM, OUTSIDE OF EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS AND ON EACH ADDITIONAL STORY INCLUDING EASEMENTS (R304).

59. PROVIDE AN INTERCONNECTED CARBON MONOXIDE (CO) DETECTION SYSTEM, HAVING A CO ALARM WITHIN 10' OF THE ENTRANCE OF EVERY ROOM INTENDED TO BE LAWFULLY USED FOR SLEEPING PURPOSES, TYPICALLY IN A CENTRAL LOCATION SUCH AS A HALLWAY, AND ON EACH FLOOR LEVEL. INTENDED TO BE LAWFULLY USED FOR PURPOSES, INCLUDING THE BASEMENT, THAT DOES NOT HAVE A ROOM INTENDED TO BE LAWFULLY USED FOR SLEEPING PURPOSES. CO ALARMS SHALL HAVE PERMANENT CO SENSOR OR REPLACEABLE CO SENSOR WITH END OF LIFE INDICATOR (R305).

60. PROVIDE A CRAWL SPACE ACCESS OPENING AND PANEL, NOT LESS THAN 18"X24" (R408). SEE SECTION M305.1.4 FOR ACCESS REQUIREMENTS WHERE MECHANICAL EQUIPMENT IS LOCATED UNDER FLOORS.

61. PROVIDE A MINIMUM OF 3" BETWEEN ANY RECESSED LIGHT, FAN OR ANY OTHER HEAT PRODUCING OR EMANATING DEVICE AND COMBUSTIBLE INSULATION, UNLESS APPROPRIATELY LISTED FOR LESS CLEARANCE.

62. PROVIDE DRAFTSTOPPING AND FIREBLOCKING PER THE MOST STRINGENT APPLICABLE REQUIREMENTS HEREINAFTER THE IRC, THE INTERNATIONAL MECHANICAL CODE (IMC), THE INTERNATIONAL PLUMBING CODE (IPC), THE NATIONAL ELECTRICAL CODE (NEC) AND THE INTERNATIONAL ENERGY CONSERVATION CODE (IECC). FIREBLOCKING SHALL BE PROVIDED TO CUT OFF ALL CONCEALED DRAFT OPENINGS (BOTH VERTICAL AND HORIZONTAL) AND TO FORM AN EFFECTIVE FIRE BARRIER BETWEEN STORIES, AND BETWEEN A TOP STORY AND THE ROOF SPACE. FIREBLOCKING SHALL BE SPECIFICALLY PROVIDED AT THE LOCATIONS DESIGNATED IN SECTION R302.11.

63. PROVIDE AN ATTIC ACCESS OPENING AND PANEL, NOT LESS THAN 22" X 30" IN A READILY ACCESSIBLE LOCATION, PREFERABLY A SECONDARY BEDROOM (R307). PROVIDE NOT LESS THAN 30" OF UNOBSTRUCTED HEADROOM ABOVE THE OPENING. PROVIDE GASKET FOR ACCESS PANEL (IECC 402.2.4). REFER TO SECTIONS M305 AND M306 FOR MECHANICAL ACCESS AND CLEARANCE REQUIREMENTS.

CONCRETE AND MASONRY

C1. COMPLY WITH APPLICABLE REQUIREMENTS SET FORTH IN THE IRC.
C2. REFER TO THE STRUCTURAL PLANS FOR STRUCTURAL CONCRETE AND MASONRY REQUIREMENTS.
C3. (I.N.O.) ON THE STRUCTURAL PLANS OR NOTES, THE MINIMUM SPECIFIED 28 DAY COMPRESSIVE STRENGTH FOR CONCRETE COMPONENTS EXPOSED TO MODERATE OR SEVERE WEATHERING POTENTIAL SHALL BE:

PORCHES, PATIOS, DRIVEWAYS, GARAGE FLOOR SLABS AND WALKWAYS EXPOSED TO THE WEATHER - 3500 PSI.
BASEMENT WALLS, FOUNDATION WALLS AND OTHER WALLS EXPOSED TO THE WEATHER - 3000 PSI, AIR ENTRAINED 5 TO 1 PERCENT.
BASEMENT SLABS AND INTERIOR SLABS ON GRADE, EXCEPT GARAGE FLOOR SLABS - 3000 PSI.
REFER TO STRUCTURAL PLANS AND NOTES FOR STRUCTURAL CONCRETE REQUIREMENTS (R402)

C4. SLOPE ALL EXTERIOR CONCRETE SURFACES NOT LESS THAN 1/8" AND NOT MORE THAN 1/4" PER FOOT AWAY FROM HOUSE. SLOPE GARAGE FLOORS APPROXIMATELY 4" REAR TO FRONT TO FACILITATE THE MOVEMENT OF LIQUIDS TOWARD THE MAIN VEHICLE ENTRY DOORWAY (R304.1).

C5. FOUNDATION WALLS SHALL BE CONSTRUCTED IN ACCORDANCE WITH SECTION R404 AND ACI 318 AND SHALL EXTEND A MINIMUM OF 6" ABOVE GRADE AT ALL POINTS, 4" WHERE MASONRY VENEER IS USED.

C6. BASEMENT CONCRETE FLOORS SHALL BE PLACED OVER A MINIMUM 6-MIL POLYETHYLENE VAPOR RETARDER COMPLYING WITH ASTM E 1745, WITH JOINTS LAPPED NOT LESS THAN 12" OVER PREPARED 4" THICK BASE COURSE PER SECTION R506.2

C7. CONCRETE FLOORS AND FOUNDATIONS SHALL BE MADE LEVEL WITHIN 1/2" IN 20' BUT NO MORE THAN 1" ACROSS THE FULL WIDTH OR LENGTH (I.N.O.) OR SPECIFICALLY DESIGNED FOR DRAINAGE.

C8. MASONRY AND STONE VENEER (INCLUDING MANUFACTURED) MATERIAL AND INSTALLATION SHALL COMPLY WITH SECTION T05.1, THE MASONRY OR STONE MANUFACTURER'S WRITTEN INSTALLATION INSTRUCTIONS AND RECOMMENDATIONS, THE MASONRY OR STONE MANUFACTURER'S WRITTEN CODE EVALUATION/APPROVAL DOCUMENTS AND THE REQUIREMENTS SET FORTH BY THE BRICK INDUSTRY ASSOCIATION FOR BRICK.

C9. PROVIDE A MINIMUM 6" BY 4" BY 5/16" GALVANIZED STEEL ANGLE TO SUPPORT EXTERIOR MASONRY VENEERS (I.N.O.) ON THE STRUCTURAL PLANS (R103).

C10. ATTACH EXTERIOR MASONRY VENEER WITH GALVANIZED TIES, SPACED NOT MORE THAN 24" ON CENTER HORIZONTALLY AND VERTICALLY AND SHALL SUPPORT NO MORE THAN 267 SF. OF WALL AREA (R102.1). PROVIDE FLASHING AND KEEPHOLES AS SHOWN IN FIGURE R102.1.

C11. MINIMUM SOIL CAPACITY IS ASSUMED TO BE 2000 PSF AT ALL WALL AND PIER FOOTINGS. IT IS THE OWNER'S RESPONSIBILITY TO VERIFY BEARING CAPACITY AND TO NOTIFY THE DESIGNER IF THE CAPACITY IS LESS THAN 2000 PSF.

WOOD, METAL AND PLASTIC

M1. COMPLY WITH APPLICABLE REQUIREMENTS SET FORTH IN THE IRC.

M2. WOOD MEMBERS AND PRODUCTS SHALL BE IDENTIFIED BY GRADE MARK OR CERTIFICATE OF INSPECTION ISSUED BY THE APPLICABLE AGENCY.

M3. REFER TO THE STRUCTURAL PLANS FOR STRUCTURAL FRAMING AND SHEATHING REQUIREMENTS.

M4. FASTENERS AND CONNECTORS IN CONTACT WITH PRESERVATIVE-TREATED OR FIRE-RETARDANT TREATED WOOD SHALL BE OF HOT DIPPED ZINC-COATED GALVANIZED STEEL, UNLESS OTHERWISE PERMITTED UNDER SECTION R311.3.

M5. DO NOT CUT, SPLICE, NOTCH, OR OTHERWISE ALTER ANY SAWN LUMBER IN EXCESS OF THE LIMITATIONS SET FORTH IN SECTIONS R502, R602 AND R802 WITHOUT THE WRITTEN APPROVAL OF THE ENGINEER OF RECORD.

M6. DO NOT CUT, SPLICE, NOTCH, OR OTHERWISE ALTER ANY ENGINEERED WOOD PRODUCT OR TRUSS WITHOUT THE WRITTEN APPROVAL OF THE MANUFACTURER OR ENGINEER OF RECORD, UNLESS THE EFFECTS OF ANY SUCH PENETRATION IS CONSIDERED IN ITS DESIGN BY THE MANUFACTURER OR ENGINEER OF RECORD (R502 AND R802).

M7. ENDS OF EACH JOIST, SEAM OR GIRDER SHALL BEAR NOT LESS THAN 1/2" ON WOOD OR METAL AND 3" ON CONCRETE (R502 AND R802).

M8. TRUSS SHOP DRAWINGS SHALL COMPLY WITH SECTIONS 502 AND 802 AND SHALL BE PROVIDED TO THE BUILDING OFFICIAL AND ENGINEER OF RECORD AND APPROVED BY BOTH PRIOR TO INSTALLATION BRACE TRUSSES IN ACCORDANCE WITH TPMB (I.N.O.) ON THE SHOP DRAWINGS. TRUSS TO HALL AND TRUSS TO DOWN CONNECTIONS SHALL COMPLY WITH R302. ALL PERMANENT AND TEMPORARY BRACING LOCATIONS SHALL BE PRE-MARKED BY THE TRUSS MANUFACTURER.

M9. WHERE FOUNDATION CRIPPLE WALLS EXCEED 4' IN HEIGHT, FRAME SUCH WALLS WITH STUDS HAVING THE SIZE REQUIRED FOR AN ADDITIONAL STORY (R602).

M10. PROVIDE BACKING AND BLOCKING FOR RAILINGS AT STAIR OPENINGS AND ALONG WALLS WHERE RAILS MAY ATTACH, INCLUDING EXTERIOR RAILINGS, FOR BATHROOM ACCESSORIES, SHOWER DOORS, CLOSET ITEMS, SHELVING, HARDWARE AND OTHER ACCESSORIES, AT OR ALONG CEILING PORCH AND PATIO SOFFITS AND CANTILEVERED FLOORS AND ELSEWHERE AS REQUIRED OR DIRECTED. PROVIDE 3" MINIMUM OF BACKING AROUND DOOR AND WINDOW OPENINGS. PROVIDE DRYWALL BACKINGS ALONG ALL TUBS AND TUB DECKS, SHOWER PANS, AND SHOWER SEATS AND ELSEWHERE AS REQUIRED OR DIRECTED.

M11. SHEATH AND SEAL THE UNDERSIDE OF ALL CANTILEVERED FLOOR AREAS WITH EXTERIOR EXPOSURE RATED SHEATHING. WHERE WOOD SIDING, SHEATHING OR FRAMING IS WITHIN 6' OF GRADE, EACH SHALL BE PROTECTED AGAINST DECAY (R511). INSULATE CANTILEVERED FLOOR AREAS BEFORE CLOSING IN OR PROVIDE OPENING SUFFICIENT TO INSULATE AFTER THE FACT.

M12. FLOORS SHALL BE MADE LEVEL WITHIN 1/4" IN 20' BUT NO MORE THAN 1/2" ACROSS THE FULL WIDTH OR LENGTH.

M13. WOOD, HARDBOARD, FIBER GEMENT AND VINYL SIDING MATERIAL AND INSTALLATION SHALL COMPLY WITH SECTION T023 OR T023.10 AS APPLICABLE, THE SIDING MANUFACTURER'S WRITTEN INSTALLATION INSTRUCTIONS AND RECOMMENDATIONS, THE SIDING MANUFACTURER'S WRITTEN CODE EVALUATION/APPROVAL DOCUMENTS AND APPLICABLE RECOMMENDATIONS SET FORTH BY THE AMERICAN HARDBOARD ASSOCIATION OR THE VINYL SIDING INSTITUTE FOR HARDBOARD. PAINT AND/OR SEAL ALL WOOD AND HARDBOARD EDGES.

M14. FINISH CARPENTRY, MILLWORK AND CABINETRY INSTALLATION SHALL COMPLY WITH THE MILLWORK MANUFACTURER'S WRITTEN INSTALLATION INSTRUCTIONS AND RECOMMENDATIONS AND APPLICABLE ARCHITECTURAL.

THERMAL AND MOISTURE PROTECTION

T1. COMPLY WITH APPLICABLE REQUIREMENTS SET FORTH IN THE IRC, THE IECC, AND THE IMC.

T2. DILIGENTLY SEAL THE BUILDING THERMAL ENVELOPE TO LIMIT INFILTRATION. SEAL ALL JOINTS, SEAMS, AND PENETRATIONS WITH DURABLE CAULKS, SEALANTS OR GASKETS, HEATHERSTRIPS, AIR BARRIERS, FILMS AND/ OR SELF-ADHESIVE FLASHING, EACH AS APPROPRIATE TO THE APPLICABLE CONDITION. THESE INCLUDE JOINTS, SEAMS AND PENETRATIONS THROUGH, BETWEEN, AROUND OR ALONG CONDITIONED AND UNCONDITIONED SPACES WITHIN THE HOUSE, INCLUDING, AT A MINIMUM, GARAGE AND CONDITIONED SPACE, TUBS AND SHOWERS, ATTIC AND CRAWL SPACE, ACCESSES, WINDOW AND DOOR ASSEMBLIES, AND THEIR RESPECTIVE JAMBS AND FRAMING, RECESSED LIGHTS, PLUMBING, HVAC AND ELECTRICAL PENETRATIONS, CHIMNEYS, DROPPED CEILINGS, KNEE WALLS, RIMBOARD, SILL PLATES, BLOCKINGS AND OTHER SOURCES OF INFILTRATION (N102.4 AND IECC 402). REFER TO THERMAL BY-PASS PLANS. VERIFY AIR SEALING THROUGH POST ROUGH-IN TEST OR THROUGH VISUAL INSPECTION (N102.4 AND IECC 402.4).

T3. A PERMANENT CERTIFICATE SHALL BE COMPLETED AND POSTED ON OR IN THE ELECTRICAL DISTRIBUTION PANEL. THIS CERTIFICATE SHOULD NOT COVER OR OBSTRUCT CIRCUIT DIRECTORY AND SHALL LIST THE PREDOMINANT INSULATION R-VALUES OF THE VARIOUS COMPONENTS INSTALLED IN THE HOME. THIS CERTIFICATE SHOULD ALSO LIST THE U-FACTORS AND SOLAR HEAT GAIN COEFFICIENT OF PENETRATION (IECC 401).

T4. FURNISH AND INSTALL THE FOLLOWING MINIMUM INSULATION THERMAL RESISTANCE AS SET FORTH BELOW. INSTALL IN ACCORDANCE WITH THE INSULATION MANUFACTURER'S WRITTEN INSTALLATION INSTRUCTIONS AND RECOMMENDATIONS AND THE RECOMMENDATIONS SET FORTH BY THE NORTH AMERICAN INSULATION MANUFACTURERS ASSOCIATION.
A. R-20 2x6 EXTERIOR WALLS AND RM BOARDS
B. R-41 ROOF AREAS
C. R-41 CATHEDRAL ROOF AND BAY WINDOW CEILINGS
D. R-11 CANTILEVERS AND FLOORS OF LIVING AREAS OVER UNHEATED SPACES
E. R-10/15 BASEMENT AND CRAWL SPACE WALLS
F. R-10 FROST WALL AND WALKOUT (A MIN. OF 24" XPS)
G. 0.25 MAXIMUM U-FACTOR. LOFT-NEEDS

T5. FOR BASEMENT WALLS, WHEN OF CAST-IN-PLACE CONCRETE, THE APPLICATION OF ANY VAPOR RETARDER WITH OR OVER INSULATION SHALL BE DELAYED UNTIL THE WALL HAS CURED AND DRIED. VAPOR RETARDERS USED WITH INSULATION IN SUCH WALLS SHALL BE A CLASS III.

T6. INSULATE ALL SUPPLY DUCTS IN UNCONDITIONED SPACES WITH A MINIMUM R-8. INSULATE ALL OTHER DUCTS WITH A MINIMUM R-6. INSULATING DUCTS COMPLETELY INSIDE THE BUILDING THERMAL ENVELOPE IS NOT REQUIRED (IECC 405).

T7. ANY WATER OR WASTE PIPE INSTALLED IN AN EXTERIOR WALL, ATTIC, OR CRAWL SPACE SHALL BE PROTECTED FROM FREEZING BY INSULATION OR HEAT OR BOTH (P2603). PIPE INSULATION IN ANY ATTIC OR CRAWL SPACE SHALL BE PIPE INSULATION.

T8. BATHROOMS, WATER CLOSET COMPARTMENTS, LAUNDRY ROOMS AND OTHER SIMILAR ROOMS NOT HAVING OPERABLE WINDOWS SHALL BE PROVIDED WITH A MECHANICAL FAN HAVING A VENTILATION RATE IN ACCORDANCE WITH MS01 EXHAUST DIRECTLY TO THE OUTSIDE. REGULATORING FANS ARE PROHIBITED. (R303)

T9. DAMP PROOF FOOTING WALLS THAT RETAIN EARTH AND ENCLOSE HABITABLE SPACE AND CRAWL SPACE WALLS, IN AREAS WHERE A HIGH WATER TABLE OR OTHER SEVERE SOIL-WATER CONDITIONS EXIST, ALL EXTERIOR WALLS SHALL BE WATERPROOFED (R406). DAMPROOF ALL FOUNDATION WALLS THAT ENCLOSE ANY CRAWL SPACES. REFER TO THE PROJECT SOILS REPORT FOR ADDITIONAL REQUIREMENTS.

T10. FULLY COVER THE GROUND SURFACE OF CRAWL SPACES AND UNDER FLOOR SPACES WITH A 10-MIL MINIMUM CLASS 1 VAPOR RETARDER COMPLYING WITH ASTM E 1745, WITH JOINTS LAPPED NOT LESS THAN 12" AND SEALED (HEATING TAPE OR EQUAL) (R408). SEAL AROUND SIMP PITS, COLUMNS, PLUMBING AND OTHER PENETRATIONS. EXTEND UP THE WALL NOT LESS THAN 12" AND ATTACH CONTINUOUSLY.

T11. CRAWL SPACES AND UNDER FLOOR AREAS SHALL BE SUPPLIED WITH A CONDITIONED AIR AND/OR CONTINUOUS MECHANICAL VENTILATION AS SHOWN ON THE PLANS (R408.3). THE GROUND SURFACE SHALL BE COVERED AS NOTED UNDER T2 AND THE WALLS INSULATED AS NOTED UNDER T4.

T12. FULLY REMOVE AND/OR CLEAN ALL DEBRIS, WASTE, VEGETATION AND OTHER MATERIAL FROM BENEATH ANY AT GRADE BELOW GRADE FLOOR AREA OR CRAWL SPACE (R406).

T13. PROVIDE WEATHER-RESISTANT SHEATHING PAPER BENEATH STUCCO, CULTURED STONE, SIDING AND MASONRY AS SET FORTH IN TABLE R102.4. SHEATHING PAPER SHALL BE SINGLE PLY ASPHALT-SATURATED KRAFT GRADE D BREATHER TYPE PAPER, HAVING A 60 MINUTE WATER RESISTANCE RATING UNDER ASTM D 71. PROVIDE 2 LAYERS BEHIND STUCCO AND CULTURED STONE AND 1 LAYER BEHIND SIDING AND MASONRY. APPROVED HOESHPAP MAY BE SUBSTITUTED FOR 1 LAYER ONLY AND SHALL HAVE SHEATHING PAPER PLACED OVER IT WHEN UNDER STUCCO OR MANUFACTURED STONE.

T14. INSTALL EXTERIOR WINDOWS AND DOORS IN STRICT ACCORDANCE WITH THE MANUFACTURER'S WRITTEN INSTALLATION INSTRUCTIONS, GUIDELINES AND RECOMMENDATIONS AND ASTM E 2012. PROVIDE PAN FLASHING FOR ALL EXTERIOR DOORS.

T15. PROVIDE DURABLE WEATHER STRIPPING FOR ALL EXTERIOR DOORS AND WINDOWS.

T16. PROVIDE FLASHING IN SUCH MANNER AS TO PREVENT ENTRY OF WATER INTO THE WALL ASSEMBLY, WALL CAVITY OR ROOF ASSEMBLY, AND PENETRATION OF WATER TO THE BUILDING STRUCTURAL FRAMING COMPONENTS. FLASH AND SEAL ALL EXTERIOR WINDOWS, DOORS, OPENINGS, PENETRATIONS AND JOINTS 50 AS TO PREVENT MOISTURE FROM PASSING THROUGH, BEYOND OR AROUND AND TO MAKE SUCH LEAKPROOF. PROVIDE MANUFACTURED FLASHINGS AT ALL PENETRATIONS. ALL MEMBRANES, BARRIERS, PAPERS, FELTS AND FLASHINGS SHALL BE LAPPED IN A SHEDDING MANNER. PROVIDE FLASHING AS SPECIFICALLY DETAILED IN SECTIONS R103, R103 AND R105.

T17. ROOF ASSEMBLIES SHALL COMPLY WITH THE REQUIREMENTS SET FORTH IN CHAPTER 9. ROOF COVERING MATERIALS AND INSTALLATION SHALL COMPLY WITH THE ROOFING MANUFACTURER'S WRITTEN INSTALLATION INSTRUCTIONS, THE ROOF COVERING MANUFACTURER'S WRITTEN CODE EVALUATION/APPROVAL DOCUMENTS AND RECOMMENDATIONS AND THE REQUIREMENTS SET FORTH BY THE NATIONAL ROOFING CONTRACTORS ASSOCIATION, THE ASPHALT ROOFING MANUFACTURERS ASSOCIATION, AND THE ROOF TILE INSTITUTE FOR EACH APPLICABLE COVERING. UNDERLAMENT SHALL COMPLY WITH SECTION 905 AND WHEN OF ASPHALT SATURATED OR SBS MODIFIED FELT SHALL BE REINFORCED POLYESTER OR FIBERGLASS.

T18. PROVIDE ROOF FLASHING PER SECTION R105 PER TYPE OF COVERING. FOR TILE ROOFS, ROOF VALLEY AND SIDEWALL FLASHINGS SHALL BE DOUBLE RAISED RIBBED. PROVIDE DRIP EDGES AT ROOF EAVES AND RAKES FOR ALL COMPOSITION ROOF COVERINGS AND WHERE REQUIRED OR RECOMMENDED FOR TILE ROOFS BY THE ROOF COVERING MANUFACTURER. PROVIDE KICK-OUT DIVERTER FLASHING AT ALL EAVE TO SIDE WALL JUNCTURES. FLASHING TO DIVERT WATER OFF THE FACE OF ANY SIDE WALL 4" MINIMUM.

T19. PROVIDE ATTIC VENTILATION PER SECTION R061 (CONFIRM MANUFACTURER'S NET FREE AREA). SOFFIT, EAVE, AND GORNICE VENTS SHALL BE PROVIDED WITH A MANUFACTURED WEATHERPROOF INSULATION BARRIER (NONORGANIC) DESIGNED TO PROVIDE A MINIMUM OF 1" FREE SPACE BETWEEN INSULATION BARRIER AND UNDERSIDE OF SHEATHING.

T20. PROVIDE GUTTERS AND DOWN SPOUTS AT ALL LOCATIONS NECESSARY TO PREVENT PREMATURE POINT OR LOCAL WEARING OF ROOFING AND TO EVENLY DISTRIBUTE AND DISCHARGE WATER AWAY FROM THE FOUNDATION. PROVIDE 5" DOWNPOUT EXTENSIONS AT ALL DISCHARGE POINTS UNLESS LIMITED BY PROPERTY BOUNDARIES, IN WHICH CASE NOT LESS THAN 4'.

T21. SEE TABLE R401.1 (SHEET A-B8) FOR INSULATION AND PENETRATION REQUIREMENTS BY COMPONENT.

FINISHES

F1. COMPLY WITH APPLICABLE REQUIREMENTS SET FORTH IN THE IRC.

F2. REFER TO THE STRUCTURAL PLANS FOR LOCATIONS WHERE GYPSUM BOARD MAY BE USED AS A STRUCTURAL COMPONENT OF ANY LATERAL FORCE RESISTING SYSTEM.

F3. GYPSUM BOARD MATERIAL AND INSTALLATION SHALL COMPLY WITH SECTION R102.2.1 ASTM C 830 AND THE GYPSUM ASSOCIATION'S GA-216 RECOMMENDED SPECIFICATION FOR THE APPLICATION AND FINISHING OF GYPSUM BOARD, EACH AS APPLICABLE. FINISH GYPSUM WALLBOARD TO LEVEL 3 FOR AREAS TO RECEIVE HEAVY OR KNOCK DOWN TEXTURES AND LEVEL 4 FOR ALL OTHER AREAS PER GA-214. LEVELS OF GYPSUM BOARD FINISH IN ALL HABITABLE AREAS (I.N.O.).

F4. ALL TIE AND SHOWER AREAS ARE TO RECEIVE MOISTURE-AND MOLD-RESISTANT GYPSUM BACKER INTENDED FOR MOISTURE PRONE AREAS COMPLYING WITH ASTM C 830 AND D 3723. GYPSUM BOARD UTILIZED AS A BASE BACKER FOR ADHESIVE APPLICATION OF TILE OR OTHER NONABSORBENT FINISH MATERIAL SHALL ALSO CONFORM TO ASTM C110 (R102.4.2). THOROUGHLY SEAL ALL PENETRATIONS.

F5. EXTERIOR SEALANTS SHALL COMPLY WITH ASTM C 920, TYPE 5, GRADE NS, CLASS 25. SINGLE-COMPONENT, GOOD UV LIGHT RESISTANCE AND LONG-LIFE EXPECTANCY, NON-SHINK, AND PAINTABLE.

F6. PAINT MATERIAL AND APPLICATION SHALL COMPLY WITH THE PAINT MANUFACTURER'S WRITTEN APPLICATION INSTRUCTIONS AND RECOMMENDATIONS AND THE RECOMMENDATIONS SET FORTH BY THE AMERICAN HARDBOARD ASSOCIATION, THE GYPSUM ASSOCIATION AND THE PAINTING AND DECORATING CONTRACTORS OF AMERICA.

F7. CARPET MATERIAL AND INSTALLATION SHALL COMPLY WITH THE CARPET MANUFACTURER'S WRITTEN INSTALLATION INSTRUCTIONS AND RECOMMENDATIONS AND THE RECOMMENDATIONS SET FORTH BY THE CARPET AND RUG INSTITUTE, APPLICABLE.

F8. RESILIENT FLOOR MATERIAL AND INSTALLATION SHALL COMPLY WITH THE RESILIENT FLOOR COVERING MANUFACTURER'S WRITTEN INSTALLATION INSTRUCTIONS AND RECOMMENDATIONS AND THE REQUIREMENTS SET FORTH BY THE RESILIENT FLOOR COVERING INSTITUTE.

F9. TILE MATERIAL AND INSTALLATION SHALL COMPLY WITH SECTION T02.4, THE TILE MANUFACTURER'S WRITTEN INSTALLATION INSTRUCTIONS AND RECOMMENDATIONS AND THE RECOMMENDATIONS SET FORTH BY THE CERAMIC TILE INSTITUTE OF AMERICA, THE TILE COUNCIL OF NORTH AMERICA, AND/OR THE MARBLE INSTITUTE OF AMERICA, FOR EACH APPLICABLE MATERIAL.

F10. STUCCO AND/OR PLASTER SYSTEMS MATERIAL AND INSTALLATION SHALL COMPLY WITH SECTION 103.6 THE STUCCO MANUFACTURER'S WRITTEN INSTALLATION INSTRUCTIONS AND RECOMMENDATIONS, THE STUCCO MANUFACTURER'S WRITTEN CODE EVALUATION/APPROVAL DOCUMENTS AND THE RECOMMENDATIONS SET FORTH BY THE PORTLAND CEMENT ASSOCIATION, THE STUCCO MANUFACTURERS ASSOCIATION AND THE NORTHWEST WALL AND CEILING BUREAU.

MECHANICAL

M1. COMPLY WITH APPLICABLE REQUIREMENTS SET FORTH IN THE IRC, THE IMC, AND THE IFGC.

M2. ALL MATERIAL SHALL BE PROPERLY LISTED AND LABELED (M303). MANUFACTURER'S INSTALLATION INSTRUCTIONS SHALL BE AVAILABLE ON THE JOB SITE AT ALL TIMES. PROVIDE MAINTENANCE INSTRUCTIONS TO ALL MATERIAL AND SYSTEMS THAT REQUIRE PREVENTATIVE MAINTENANCE AND PLACE IN A CLEAR PLASTIC SLEEVE AFFIX TO THE APPLICABLE ITEM.

M3. PROVIDE LEVEL WORKING SPACE IN FRONT OF THE CONTROL SIDE OF ANY APPLIANCE OF NOT LESS THAN 30" IN WIDTH OR DEPTH. MAINTAIN MINIMUM WORKING SPACE OF 3" ON ALL SIDES, BACK AND TOP OF ANY APPLIANCE. APPLIANCES IN ATTICS AND IN CRAWL SPACES OR UNDER FLOOR AREAS MUST MEET ADDITIONAL PASSAGEWAY AND CLEARANCE REQUIREMENTS (M303).

M4. APPLIANCES LOCATED IN ATTICS AND IN CRAWL SPACES OR UNDER FLOOR AREAS SHALL BE PROVIDED WITH AN OPENING AND A CLEAR AND UNOBSTRUCTED PASSAGEWAY LARGE ENOUGH TO ALLOW REMOVAL OF THE LARGEST APPLIANCE BUT NOT LESS THAN 30" HIGH AND 22" WIDE WITH 24" WIDE CONTINUOUS SOLID FLOORING RAISED SUCH THAT PREVENTS DAMAGING OR COMPROMISING INSULATION AND/OR LEVEL GRADE FOR NOT MORE THAN 20" IN LENGTH. PROVIDE RAISED SOLID FLOORING AND/OR LEVEL SERVICE SPACE OF NOT LESS THAN 30" IN WIDTH OR DEPTH ALONG ALL SIDES WHERE ACCESS IS REQUIRED (M303, N1023.23 AND IECC 402.2.3).

M5. EQUIPMENT AND APPLIANCES HAVING AN IGNITION SOURCE SHALL BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS NOT LESS THAN 18" ABOVE THE FLOOR IN HAZARDOUS LOCATIONS AND GARAGES (M307, G2404 AND G2408). ELEVATION OF THE IGNITION SOURCE IS NOT REQUIRED FOR APPLIANCES LISTED AS FLAMMABLE VAPOR RESISTANT AND FOR INSTALLATION WITHOUT ELEVATION.

M6. UNLESS OTHERWISE PREDETERMINED ON ANY MECHANICAL PLAN, SUBCONTRACTOR SHALL SIZE ALL HEATING AND COOLING EQUIPMENT IN ACCORDANCE WITH ACCA MANUAL 5 BASED ON BUILDING LOADS CALCULATED IN ACCORDANCE WITH ACCA MANUAL J OR THE ASHRAE HANDBOOK OF FUNDAMENTALS (M401 AND IECC 403).

M7. UNLESS OTHERWISE PREDETERMINED ON ANY MECHANICAL PLAN, SUBCONTRACTOR SHALL SIZE, FABRICATE, AND LAYOUT DUCT SYSTEMS IN ACCORDANCE WITH ACCA MANUAL D AND FABRICATE IN ACCORDANCE WITH CHAPTER 16 AND THE INTERNATIONAL MECHANICAL CODE. UNDER NO CIRCUMSTANCE SHALL STUD WALL CAVITIES OR SPACES AND JOIST SPACE PLANNING BE USED FOR SUPPLY OR RETURN AIR.

M8. SEAL ALL FIELD-MADE JOINT, JOINTS, SEAMS, FLANGES, CONNECTIONS, AND THE LIKE WITH MELTS, GASKETS, OR MASTICS ONLY. SEAL ALL FACTORY-MADE DUCT IN ACCORDANCE WITH DUCT MANUFACTURER'S RECOMMENDATIONS. VERIFY DUCT TIGHTNESS THROUGH POST-CONSTRUCTION OR ROUGH-IN TEST (M601, N103.2, AND IECC 403.2).

M9. PROVIDE ROOF FLASHING PER SECTION R105 PER TYPE OF COVERING. FOR TILE ROOFS, ROOF VALLEY AND SIDEWALL FLASHING SHALL BE DOUBLE RAISED RIBBED. PROVIDE DRIP EDGES AT ROOF EAVES AND RAKES FOR ALL COMPOSITION ROOF COVERINGS AND WHERE REQUIRED OR RECOMMENDED FOR TILE ROOFS BY THE ROOF COVERING MANUFACTURER. PROVIDE KICK-OUT DIVERTER FLASHING AT ALL EAVE TO SIDE WALL JUNCTURES. FLASHING TO DIVERT WATER OFF THE FACE OF ANY SIDE WALL 4" MINIMUM.

M10. GAS-FIRED APPLIANCES SHALL RECEIVE COMBUSTION AIR AND SHALL BE VENTED IN ACCORDANCE WITH CHAPTER 24. COMBUSTION AIR OPENINGS SHALL BE UNOBSTRUCTED FOR NOT LESS THAN 6" (M402), OR IN ACCORDANCE WITH CITY AMENDMENTS.

M11. CLOTHES DRYER EXHAUST DUCTS SHALL NOT EXCEED 25' IN LENGTH, WITH REDUCTIONS IN LENGTH AS SET FORTH IN SECTIONS M502 AND G2435, AND SHALL TERMINATE ON THE OUTSIDE WITH BACKDRAFT DAMPER. DO NOT VENT VERTICALLY THROUGH THE ATTIC SPACE OR ROOF. DO NOT CONNECT EXHAUST DUCTS WITH SCREENS OR OTHER FASTENERS WHICH EXTEND INTO THE DUCT.

M12. PROVIDE COMBUSTION, VENTILATION, AND DILUTION AIR IN ACCORDANCE WITH SECTION G2401.

M13. FUEL GAS PIPING IS PROHIBITED FROM BEING INSTALLED BENEATH ANY HOME OR THROUGH OR BENEATH ANY FOUNDATION UNLESS ENCASED IN A PROTECTIVE SLEEVE DESIGNED TO WITHSTAND THE LOADS (G2445).

M14. WHERE VENTS PASS THROUGH INSULATED ASSEMBLIES, PROVIDE AN INSULATION SHIELD OF NOT LESS THAN 20 GAUGE SHEET METAL FOR CLEARANCE AS SPECIFIED BY VENT MANUFACTURER. TERMINATE SHIELD AT LEAST 2" ABOVE INSULATION AND SECURE (G2426).

M15. UNINSULATED SINGLE-WALL METAL PIPE SHALL NOT BE USED FOR VENTING GAS APPLIANCES (G2421).

PLUMBING

P1. COMPLY WITH APPLICABLE REQUIREMENTS SET FORTH IN THE IRC, THE IPC, AND THE IFGC.

P2. TEST PIPING AND PLUMBING FOR POTENTIAL LEAKAGE IN ACCORDANCE WITH SECTIONS G2441 AND P2503, AND IN ACCORDANCE WITH CITY AMENDMENTS.

P3. PROTECT PIPING WITH SHIELD PLATES WHERE PIPING IS LESS THAN 15" FROM THE NEAREST EDGE OF ANY WOOD MEMBER (P2603).

P4. PIPING PASSING THROUGH OR UNDER FOOTINGS OR FOUNDATION WALLS SHALL BE PROVIDED WITH A RELIEVING ARCH, OR PROVIDE A PIPE SLEEVE BUILT IN THE FOUNDATION WALL 2 PIPE SIZES GREATER THAN THE PIPE PASSING THROUGH THE WALL (P2603). FULLY AND PERMANENTLY SEAL ANY PENETRATIONS THROUGH THE FOUNDATION WALL.

P5. PROVIDE ADEQUATE VALVES AND DEVICES, TO INCLUDE SERVICE, RELIEF, CHECK, PRESSURE-REDUCING, BACKFLOW PREVENTION, THERMAL AND FLOW CONTROL, TRAPPING, ETC., AS REQUIRED OR OTHERWISE NECESSARY OR RECOMMENDED.

P6. THE WATER SERVICE AND WATER DISTRIBUTION SYSTEMS SHALL BE DESIGNED AND PIPE SIZES SHALL BE SELECTED SUCH THAT UNDER CONDITIONS OF PEAK DEMAND, THE CAPACITIES AT THE POINT OF OUTLET DISCHARGE SHALL NOT BE LESS THAN SHOWN IN TABLE P2403.1.


P7. WATER SERVICE MAINS, BRANCH MAINS AND RISERS SHALL BE DETERMINED ACCORDING TO WATER SUPPLY DEMAND, AVAILABLE WATER PRESSURE AND FRICTION LOSS DUE TO THE WATER METER AND DEVELOPED LENGTH OF PIPE, INCLUDING EQUIVALENT LENGTH OF FITTINGS (P2503).

P8. THE MAXIMUM LENGTH OF INDIVIDUAL DISTRIBUTION LINES SHALL BE 60' (P2503).


P9. WATER SERVICE PIPING IS PROHIBITED IN CONTAMINATED OR CORROSIVE SOILS WITHOUT USE OF APPROVED ALTERNATE MATERIALS OR METHODS (P2403). SUBCONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR SECURING WRITTEN APPROVAL FROM THE BUILDING OFFICIAL AS TO ACCEPTABILITY OF MATERIALS OR METHODS PRIOR TO COMMENCING ANY WORK. REFER TO THE PROJECT SOILS REPORT FOR ADDITIONAL REQUIREMENTS.




FRONT ELEVATION
 SCALE: 1/4"=1'-0"

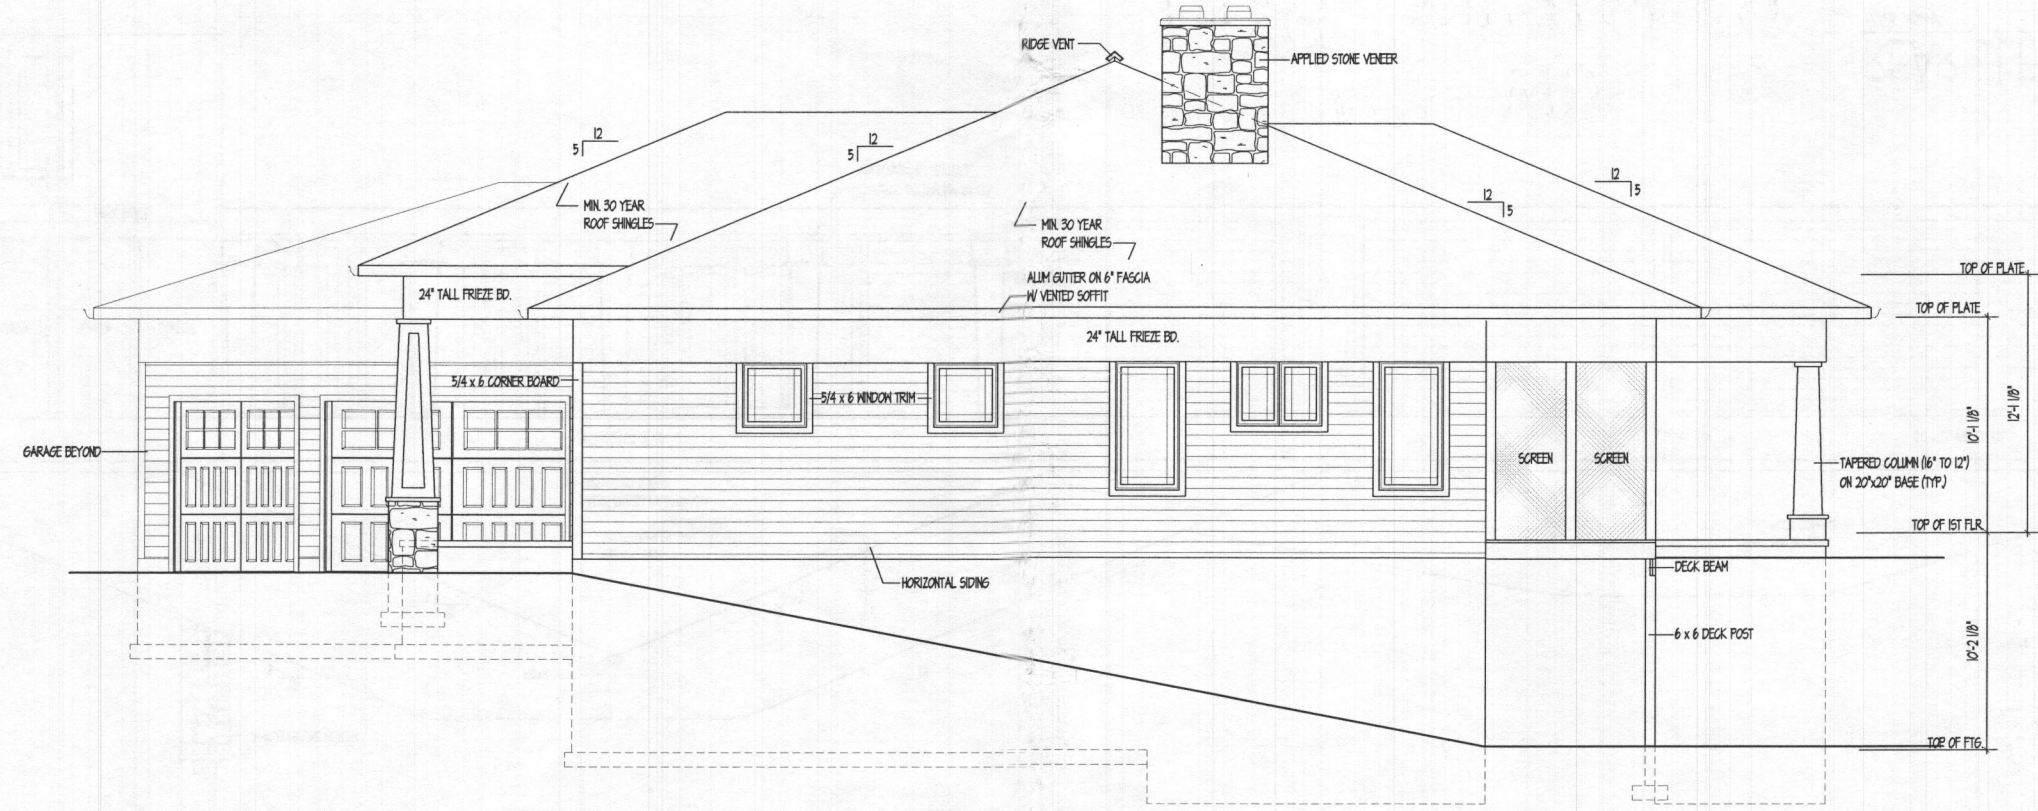

RIGHT SIDE ELEVATION
 SCALE: 1/4"=1'-0"

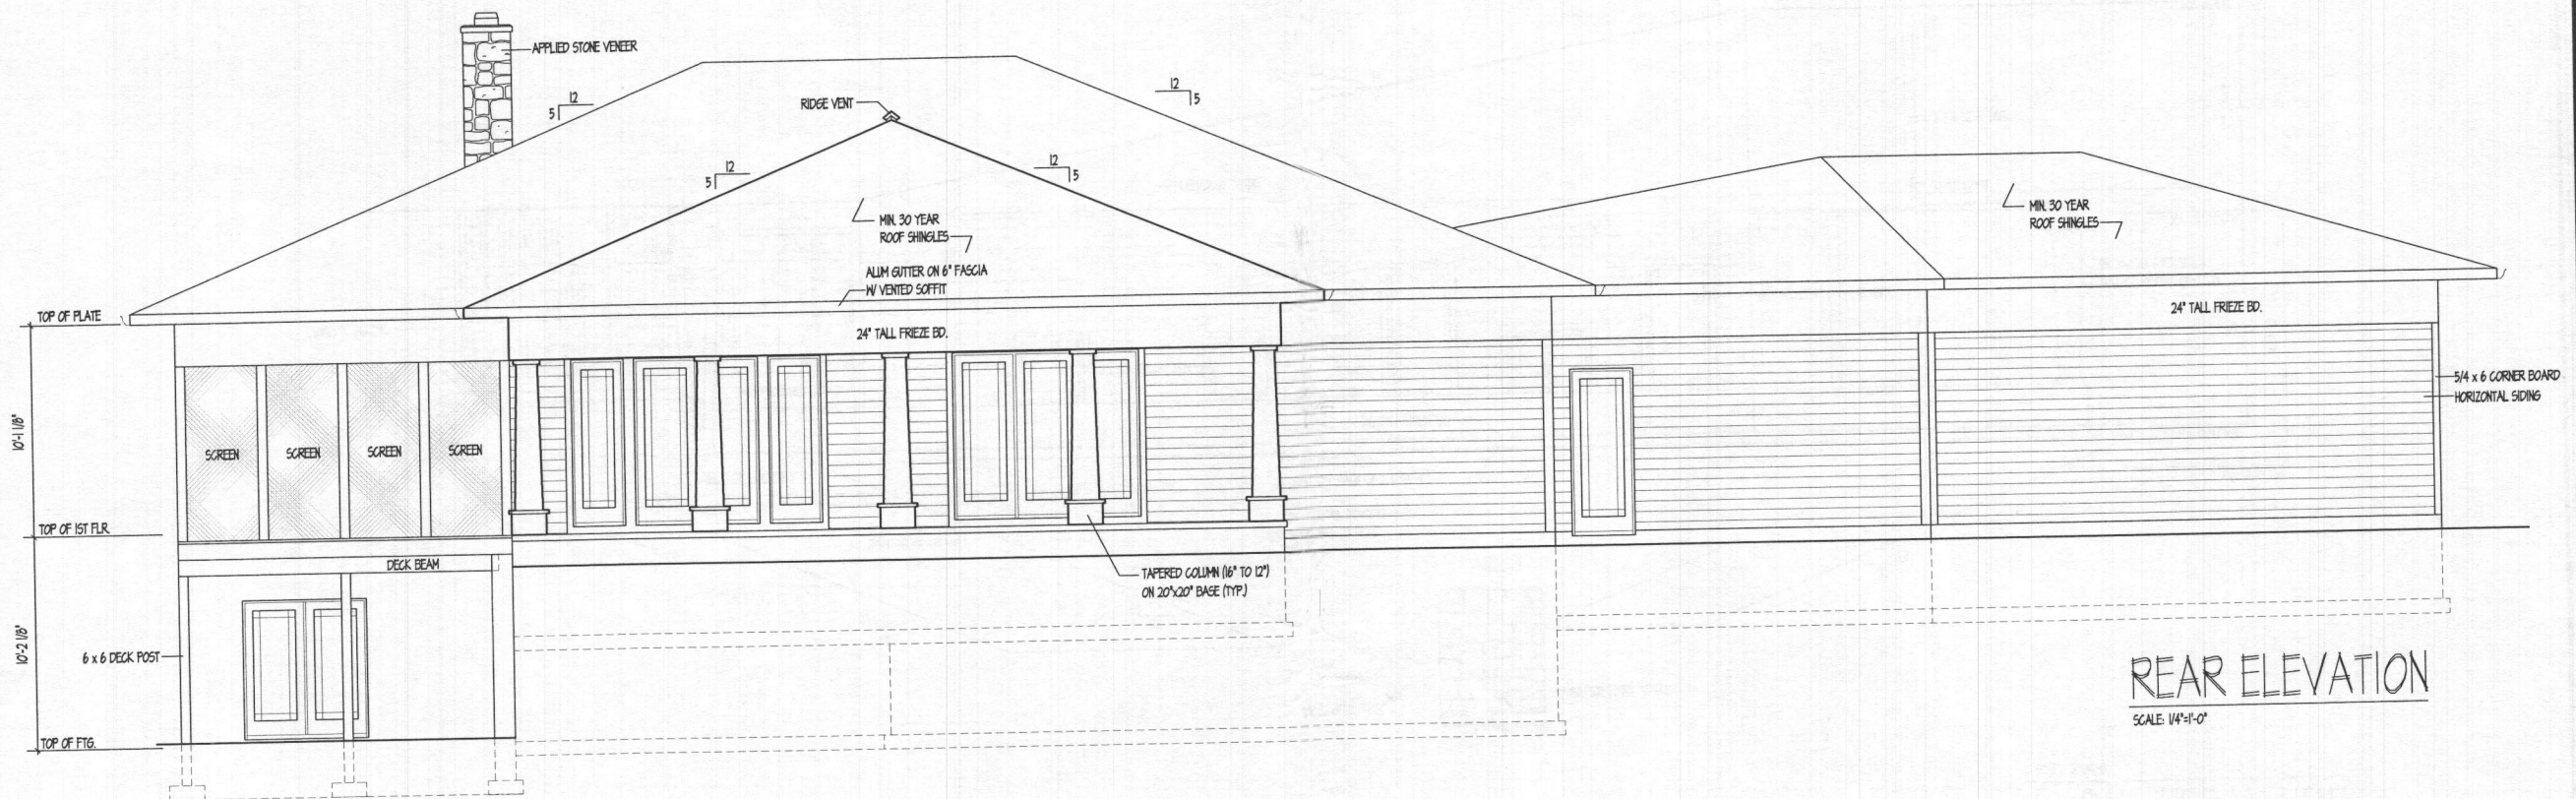


REAR ELEVATION
SCALE: 1/4"=1'-0"

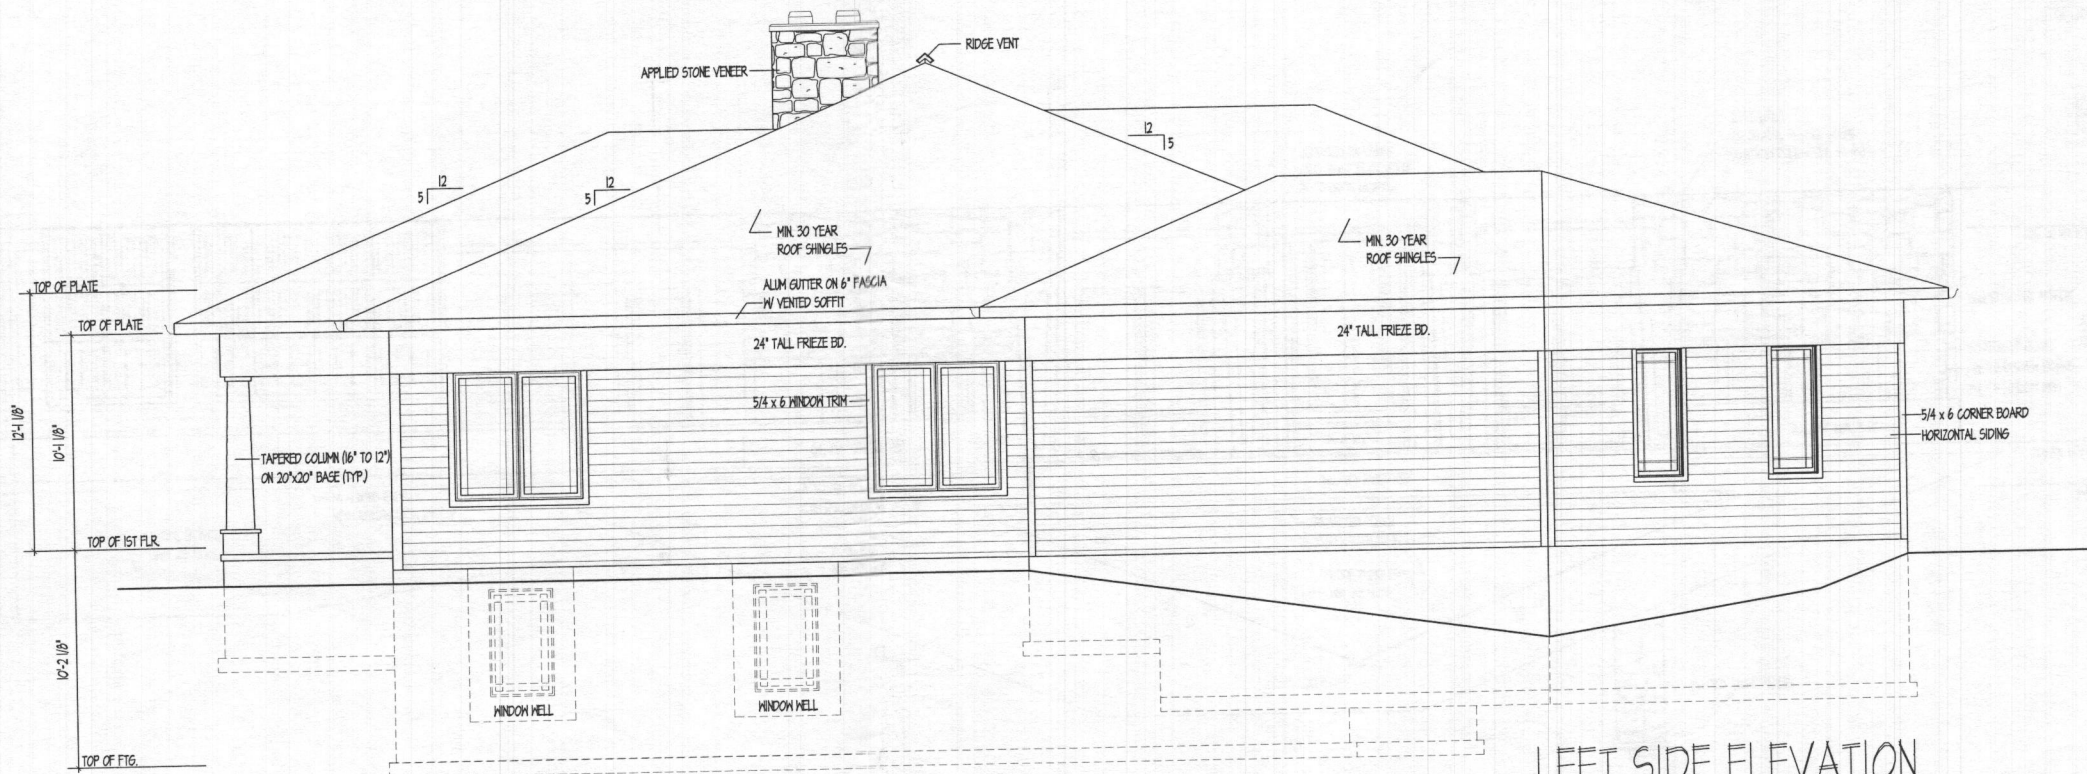

LEFT SIDE ELEVATION
SCALE: 1/4"=1'-0"

JB HOME DESIGN, LLC
446 CONCORD COURT
BALTIMORE, MARYLAND 21284
OFFICE (410) 594-4551
FAX (410) 463-4094
EMAIL: JWB@JBDESIGN.COM
home design

C.E. Rensberger & Family, Builder
1 South Matt Street
Woodboro, MD 21798
301-370-4042

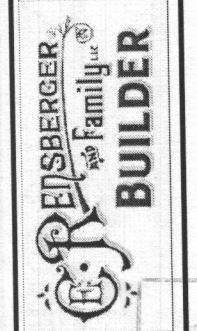


REAR AND LEFT SIDE ELEVATIONS

WHITE RESIDENCE
DATE: 07/09/19
DRAWN: [blank]
PROJECT NO: [blank]

SHEET NO: A-B

RECEIVED
AUG 14 2019
HOWNY COUNTY HEALTH DEPT.
HOWNY COUNTY SANITATION PROGRAM

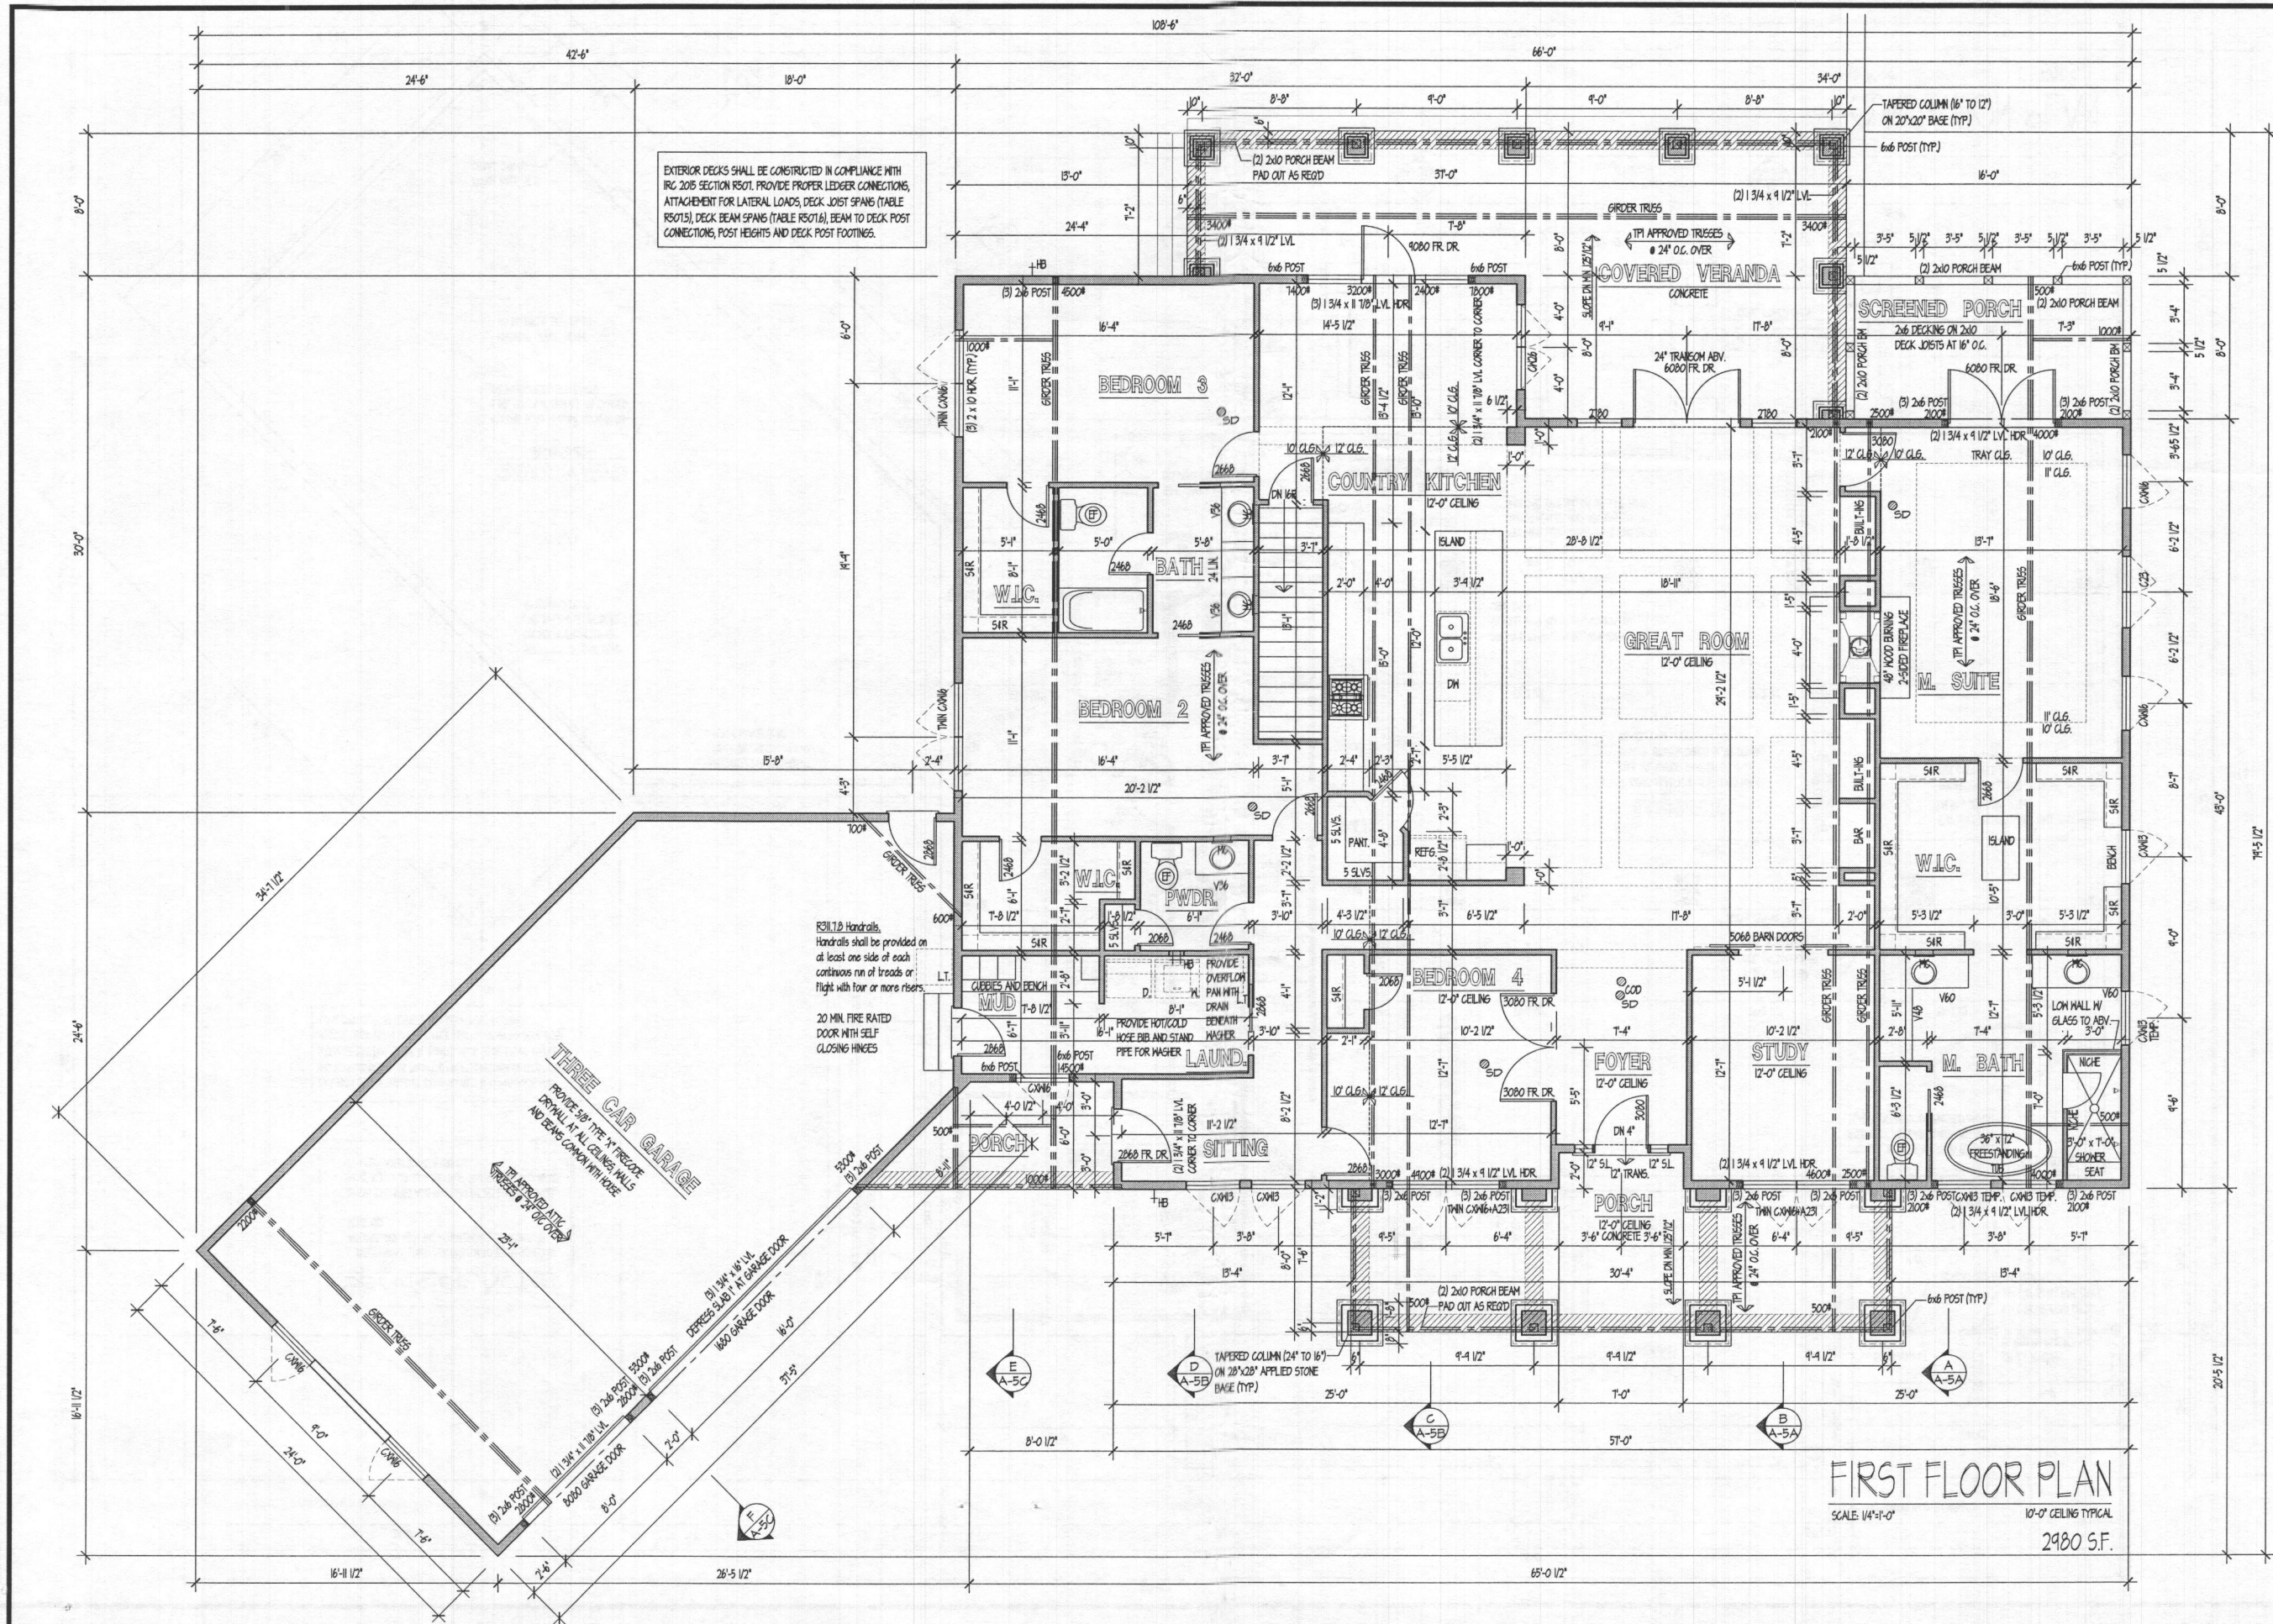

FIRST FLOOR PLAN
 SCALE: 1/4" = 1'-0"
 10'-0" CEILING TYPICAL
 2980 S.F.

JB HOME DESIGN, LLC
 446 CONCORD COURT
 BALTIMORE, MARYLAND 21284
 OFFICE (410) 994-6861
 FAX (410) 662-4064
 EMAIL: JON@JBHOMEDSIGN.COM
 HOME DESIGN


C.E. Rentsberger & Family, Builder
 1 South Main Street
 Woodsboro, MD 21798
 301-370-4042



FIRST FLOOR PLAN
 WHITE RESIDENCE
 DATE: 07/15/18
 DRAWN: PRJ:J.M.D.
 PROJECT TITLE:

SHEET NO:
A-3

AUG 14 2019
 HOWARD COUNTY HEALTH DEPT.
 FOOD PROTECTION PROGRAM

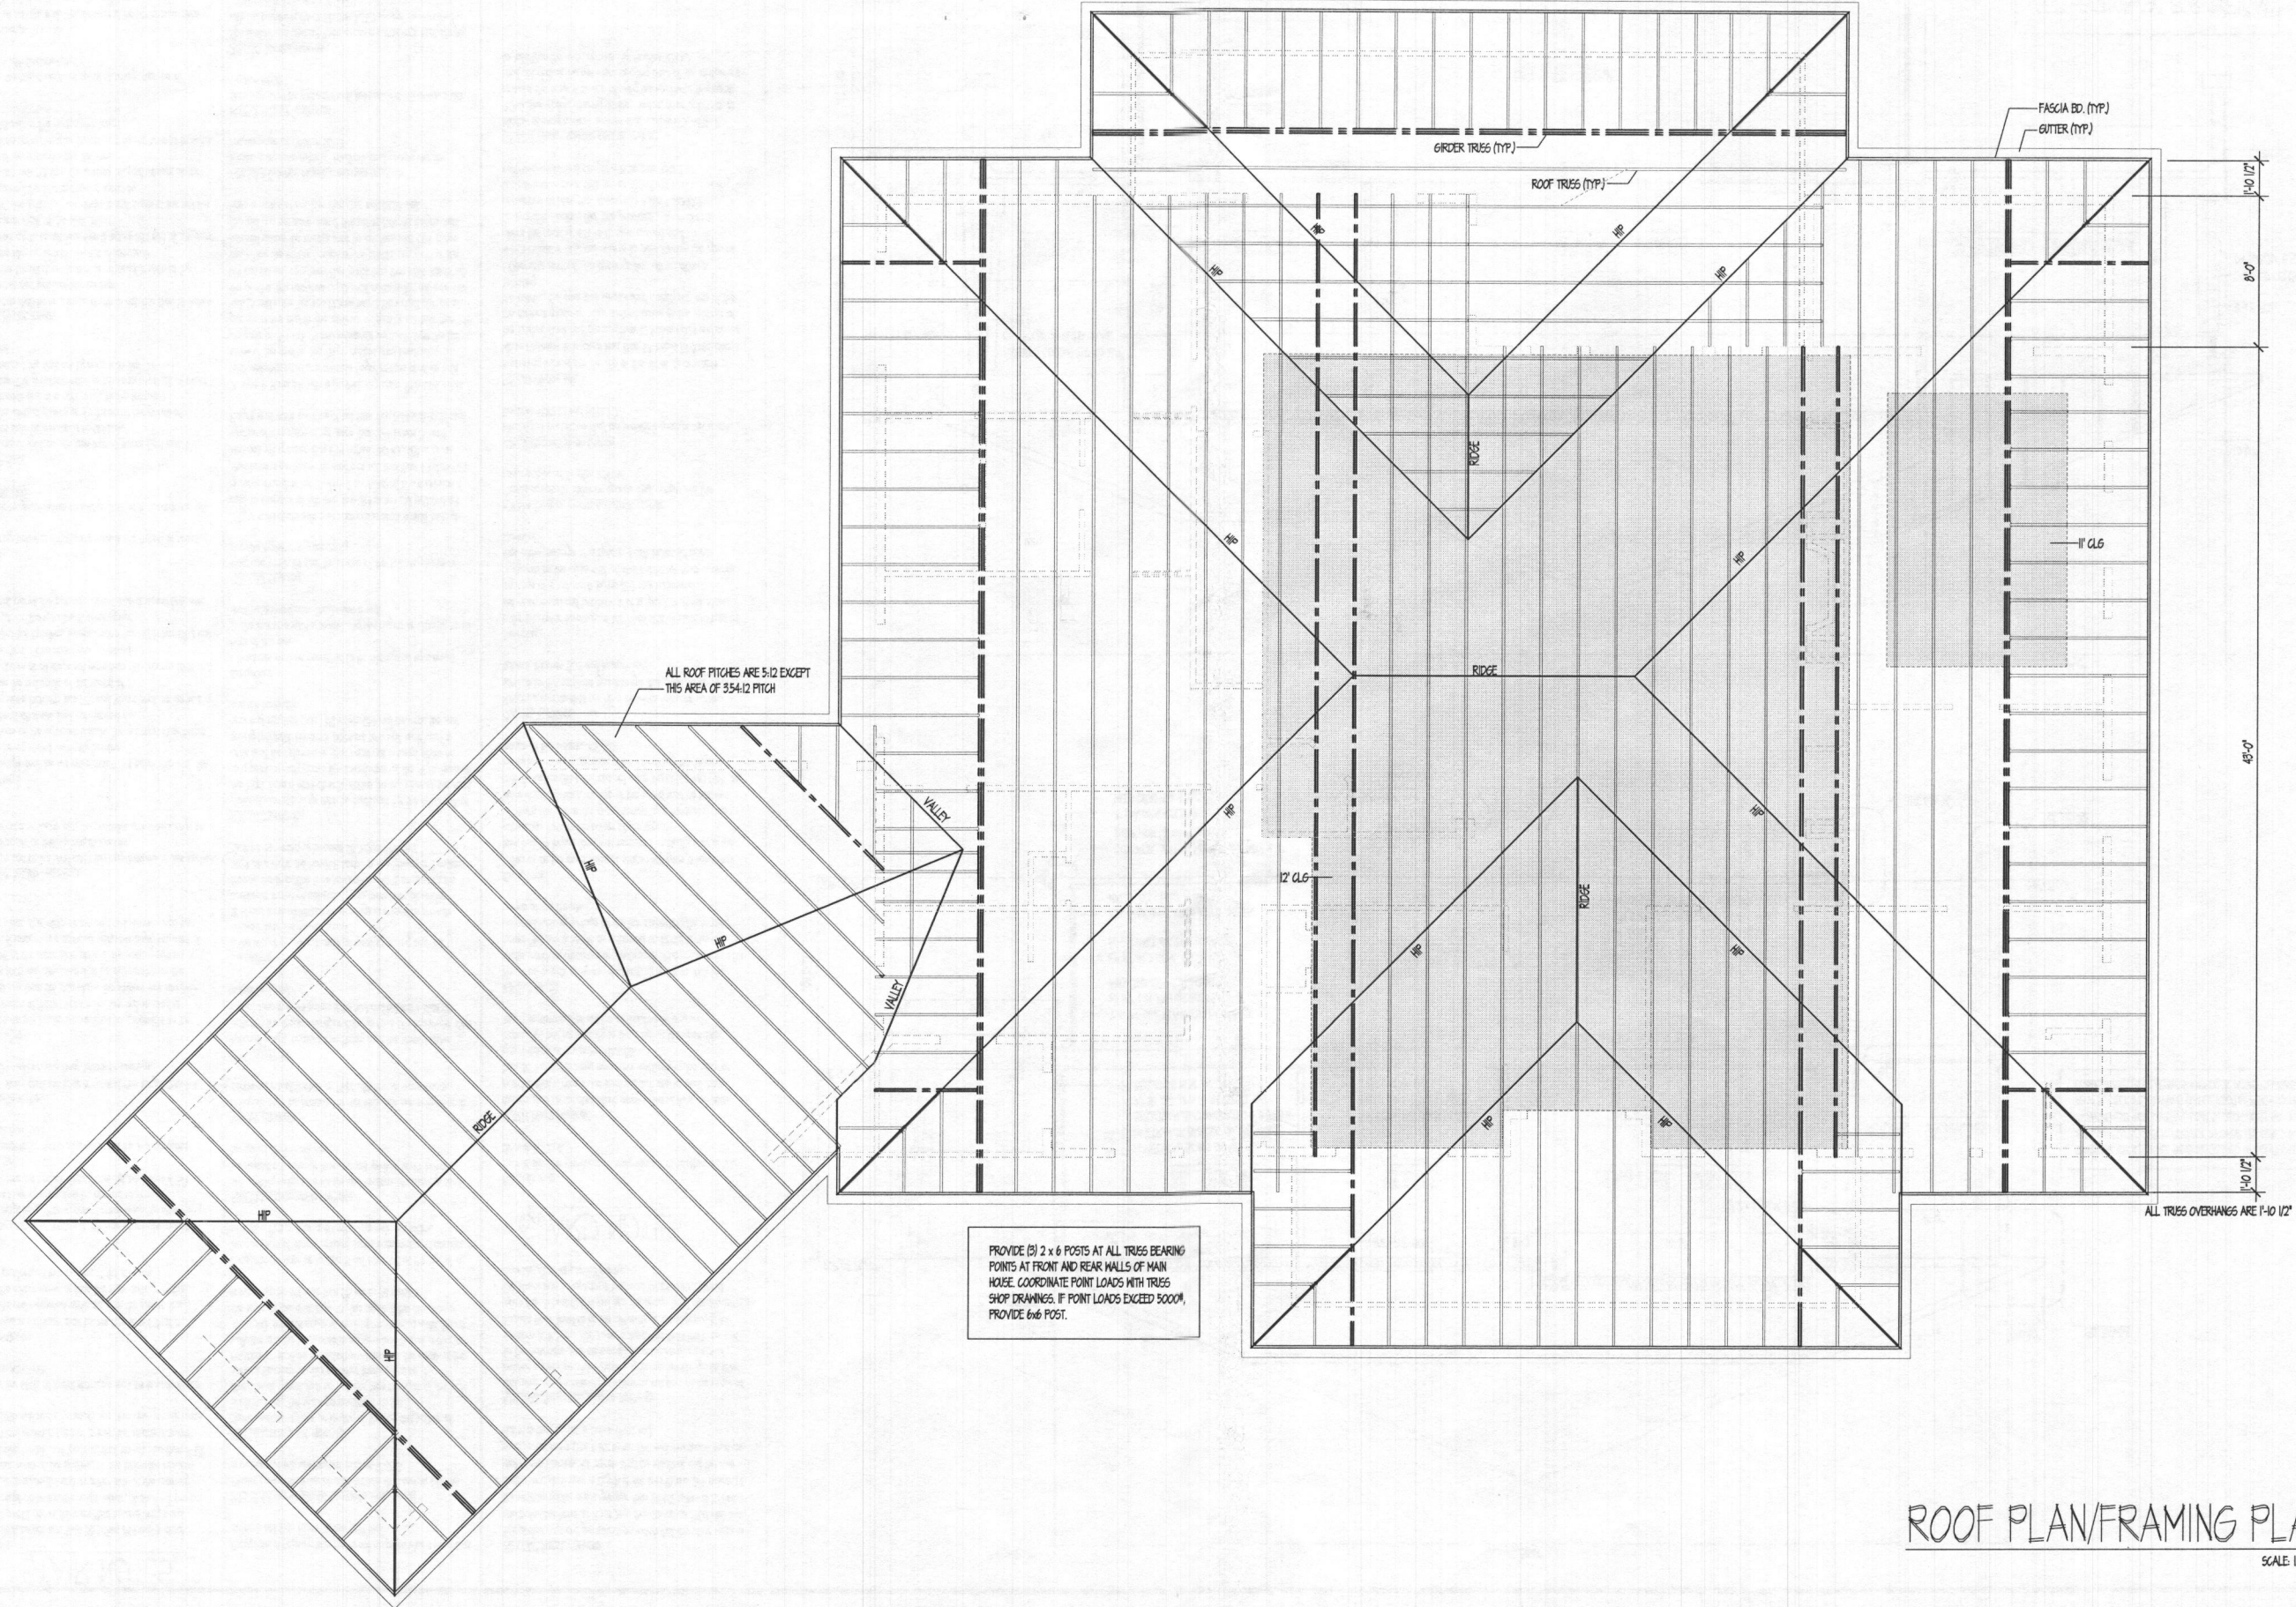

ROOF PLAN/FRAMING PLAN
SCALE: 1/4" = 1'-0"

JB HOME DESIGN, LLC
 446 CONROD COURT
 BALTIMORE, MARYLAND 2124
 OFFICE (410) 594-8301
 FAX (410) 662-0064
 EMAIL: JON@JBDESIGN.COM

C.E. Rensberger & Family, Builder
 1 South Main Street
 Woodshoro, MD 21798
 301-370-4042

RENSBERGER & FAMILY BUILDER

CONTENTS	DATE: 07/09	DRWN:	PRJ. NO.:
SCALE: 1/4" = 1'-0"	PROJECT TITLE:		
ROOF PLAN/FRAMING PLAN			
WHITE RESIDENCE			

SHEET NO.
A=4

STAIR NOTES:

R310.1.1 Width
Stairways shall be not less than 36 inches (914 mm) in clear width at all points above the permitted handrail height and below the required headroom height. Handrails shall not project more than 4 1/2 inches (114 mm) on either side of the stairway and the clear width of the stairway at and below the handrail height, including treads and landings, shall be not less than 31 1/2 inches (797 mm) where a handrail is installed on one side and 27 inches (686 mm) where handrails are provided on both sides.

Exception: The width of spiral stairways shall be in accordance with Section R310.1.1.1.

R310.1.2 Headroom

The headroom in stairways shall be not less than 6 feet 8 inches (2052 mm) measured vertically from the sloped line adjoining the tread nosing or from the floor surface of the landing or platform on that portion of the stairway.

Exceptions:

- Where the nosings of treads at the side of a flight extend under the edge of a floor opening through which the stair passes, the floor opening shall be allowed to project horizontally into the required headroom not more than 4 3/4 inches (121 mm).
- The headroom for spiral stairways shall be in accordance with Section R310.1.1.1.

R310.1.3 Vertical rise

A flight of stairs shall not have a vertical rise larger than 147 inches (3734 mm) between floor levels or landings.

R310.1.4 Walkline

The walkline across winder treads shall be concentric to the curved direction of travel through the turn and located 12 inches (305 mm) from the side where the winders are narrower. The 12-inch (305 mm) dimension shall be measured from the widest point of the clear stair width at the walking surface of the winder. If winders are adjacent within the flight, the point of the widest clear stair width of the adjacent winders shall be used.

R310.1.5 Stair treads and risers

Stair treads and risers shall meet the requirements of this section. For the purposes of this section, dimensions and dimensioned surfaces shall be exclusive of carpets, rugs or runners.

R310.1.5.1 Risers

The riser height shall be not more than 7 3/4 inches (196 mm). The riser shall be measured vertically between leading edges of the adjacent treads. The greatest riser height within any flight of stairs shall not exceed the smallest by more than 3/8 inch (9.5 mm). Risers shall be vertical or sloped from the underside of the nosing of the tread above at an angle not more than 30 degrees (10.51 rad) from the vertical. Open risers are permitted provided that the openings, located more than 30 inches (762 mm), as measured vertically to the floor or grade below do not permit the passage of a 4-inch-diameter (102 mm) sphere.

Exceptions:

- The opening between adjacent treads is not limited on spiral stairways.
- The riser height of spiral stairways shall be in accordance with Section R310.1.1.1.

R310.1.5.2 Treads

The tread depth shall be not less than 10 inches (254 mm). The tread depth shall be measured horizontally between the vertical planes of the foremost projection of adjacent treads and at a right angle to the treads' leading edge. The greatest tread depth within any flight of stairs shall not exceed the smallest by more than 3/8 inch (9.5 mm).

R310.1.5.2.1 Winder treads

Winder treads shall have a tread depth of not less than 10 inches (254 mm) measured between the vertical planes of the foremost projection of adjacent treads at the intersections with the walkline. Winder treads shall have a tread depth of not less than 6 inches (152 mm) at any point within the clear width of the stair. Within any flight of stairs, the largest winder tread depth at the walkline shall not exceed the smallest winder tread by more than 3/8 inch (9.5 mm). Consistently shaped winders at the walkline shall be allowed within the same flight of stairs as rectangular treads and do not have to be within 3/8 inch (9.5 mm) of the rectangular tread depth.

Exception: The tread depth at spiral stairways shall be in accordance with Section R310.1.1.1.

R310.1.5.3 Nosing

The radius of curvature at the nosing shall be not greater than 9/16 inch (14 mm) and not more than 1 1/4 inches (32 mm) shall be provided on stairways with solid risers. The greatest nosing projection shall not exceed the smallest nosing projection by more than 3/8 inch (9.5 mm) between two stories, including the nosing at the level of floors and landings. Beveling of nosings shall not exceed 1/2 inch (12.7 mm).

Exception: A nosing projection is not required where the tread depth is not less than 11 inches (279 mm).

R310.1.5.4 Exterior plastic composite stair treads

Plastic composite exterior stair treads shall comply with the provisions of this section and Section R507.3.

R310.1.6 Landings for stairways

There shall be a floor or landing at the top and bottom of each stairway. The width perpendicular to the direction of travel shall be not less than the width of the flight served. Landings of shapes other than square or rectangular shall be permitted provided that the depth at the walk line and the total area is not less than that of a quarter circle with a radius equal to the required landing width. Where the stairway has a straight run, the depth in the direction of travel shall be not less than 36 inches (914 mm).

Exception: A floor or landing is not required at the top of an interior flight of stairs, including stairs in an enclosed garage, provided that a door does not swing over the stairs.

R310.1.7 Stairway walking surface

The walking surface of treads and landings of stairways shall be sloped not steeper than one unit vertical in 48 inches horizontal (2-percent slope).

R310.1.8 Handrails

Handrails shall be provided on not less than one side of each continuous run of treads or flight with four or more risers.

R310.1.8.1 Height

Handrail height, measured vertically from the sloped plane adjoining the tread nosing or finish surface of ramp slope, shall be not less than 34 inches (864 mm) and not more than 38 inches (965 mm).

Exceptions:

- The use of a volute, turnout or starting easing shall be allowed over the lowest tread.
- Where handrail fittings or bendings are used to provide continuous transition between flights, transitions at winder treads, the transition from handrail to guard, or used at the start of a flight, the handrail height at the fittings or bendings shall be permitted to exceed 38 inches (965 mm).

R310.1.8.2 Continuity

Handrails for stairways shall be continuous for the full length of the flight, from a point directly above the top riser of the flight to a point directly above the lowest riser of the flight. Handrail ends shall be returned or shall terminate in novel posts or safety terminals. Handrails adjacent to a wall shall have a space of not less than 1 1/2 inches (38 mm) between the wall and the handrails.

Exceptions:

- Handrails shall be permitted to be interrupted by a novel post at the turn.
- The use of a volute, turnout, starting easing or starting novel post shall be allowed over the lowest tread.

R310.1.8.3 Grip-size

Required handrails shall be of one of the following types or provide equivalent graspability:

- Type I. Handrails with a circular cross section shall have an outside diameter of not less than 1 1/4 inches (32 mm) and not greater than 2 inches (51 mm). If the handrail is not circular, it shall have a perimeter dimension of not less than 4 inches (102 mm) and not greater than 6 1/4 inches (160 mm) with a cross section of dimension of not more than 2 1/4 inches (57 mm). Edges shall have a radius of not less than 0.01 inch (0.25 mm).

- Type II. Handrails with a perimeter greater than 6 1/4 inches (160 mm) shall have a graspable finger recess area on both sides of the profile. The finger recess shall begin within a distance of 3/4 inch (19 mm) measured vertically from the tallest portion of the profile and achieve a depth of not less than 5/16 inch (8 mm) within 1 1/8 inch (22 mm) below the widest portion of the profile. This required depth shall continue for not less than 1 1/8 inch (30 mm) to a level that is not less than 1 3/4 inches (45 mm) below the tallest portion of the profile. The width of the handrail above the recess shall be not less than 1 1/4 inches (32 mm) and not more than 2 3/4 inches (70 mm). Edges shall have a radius of not less than 0.01 inch (0.25 mm).

R310.1.8.4 Exterior plastic composite handrails

Plastic composite exterior handrails shall comply with the requirements of Section 507.3.

R507.3 R310.1.4 Illumination

Stairways shall be provided with illumination in accordance with Section R302.1.

R310.1.10 Special stairways

Spiral stairways and bulkhead enclosure stairways shall comply with the requirements of Section R310.1 except as specified in Sections R310.1.1.1 and R310.1.1.2.

GUARD NOTES:

R312.1 Guards

Guards shall be provided in accordance with Sections R312.1.1 through R312.1.4.

R312.1.1 Where required

Guards shall be located along open-sided walking surfaces, including stairs, ramps and landings, that are located more than 30 inches (762 mm) measured vertically to the floor or grade below at any point within 36 inches (914 mm) horizontally to the edge of the open side. Insect screening shall not be considered as a guard.

R312.1.2 Height

Required guards at open-sided walking surfaces, including stairs, porches, balconies or landings, shall be not less than 36 inches (914 mm) in height as measured vertically above the adjacent walking surface or the line connecting the leading edges of the treads.

Exceptions:

- Guards on the open sides of stairs shall have a height not less than 34 inches (864 mm) measured vertically from a line connecting the leading edges of the treads.
- Where the top of the guard serves as a handrail on the open sides of stairs, the top of the guard shall be not less than 34 inches (864 mm) and not more than 38 inches (965 mm) as measured vertically from a line connecting the leading edges of the treads, R312.1.3.

Opening limitations

Required guards shall not have openings from the walking surfaces to the required guard height that allow passage of a sphere 4 inches (102 mm) in diameter.

Exceptions:

- The triangular openings at the open side of stair, formed by the riser, tread and bottom rail of a guard, shall not allow passage of a sphere 6 inches (153 mm) in diameter.
- Guards on the open side of stairs shall not have openings that allow passage of a sphere 4 3/8 inches (111 mm) in diameter.

R312.1.4 Exterior plastic composite guards

Plastic composite exterior guards shall comply with the requirements of Section R312.1.4.

R312.2 Window fall protection

Window fall protection shall be provided in accordance with Sections R312.2.1 and R312.2.2.


R312.2.1 Window sills

In dwelling units, where the top of the sill of an operable window opening is located less than 24 inches (610 mm) above the finished floor and greater than 12 inches (305 mm) above the finished grade or other surface below on the exterior of the building, the operable window shall comply with one of the following:


- Operable windows with openings that will not allow a 4-inch-diameter (102 mm) sphere to pass through the opening where the opening is in its largest opened position.
- Operable windows that are provided with window fall prevention devices that comply with ASTM F 2090.
- Operable windows that are provided with window opening control devices that comply with Section R312.2.2.

R312.2.2 Window opening control devices

Window opening control devices shall comply with ASTM F 2090. The window opening control device, after operation to release the control device allowing the window to fully open, shall not reduce the net clear opening area of the window unit to less than the area required by Section R312.2.1.

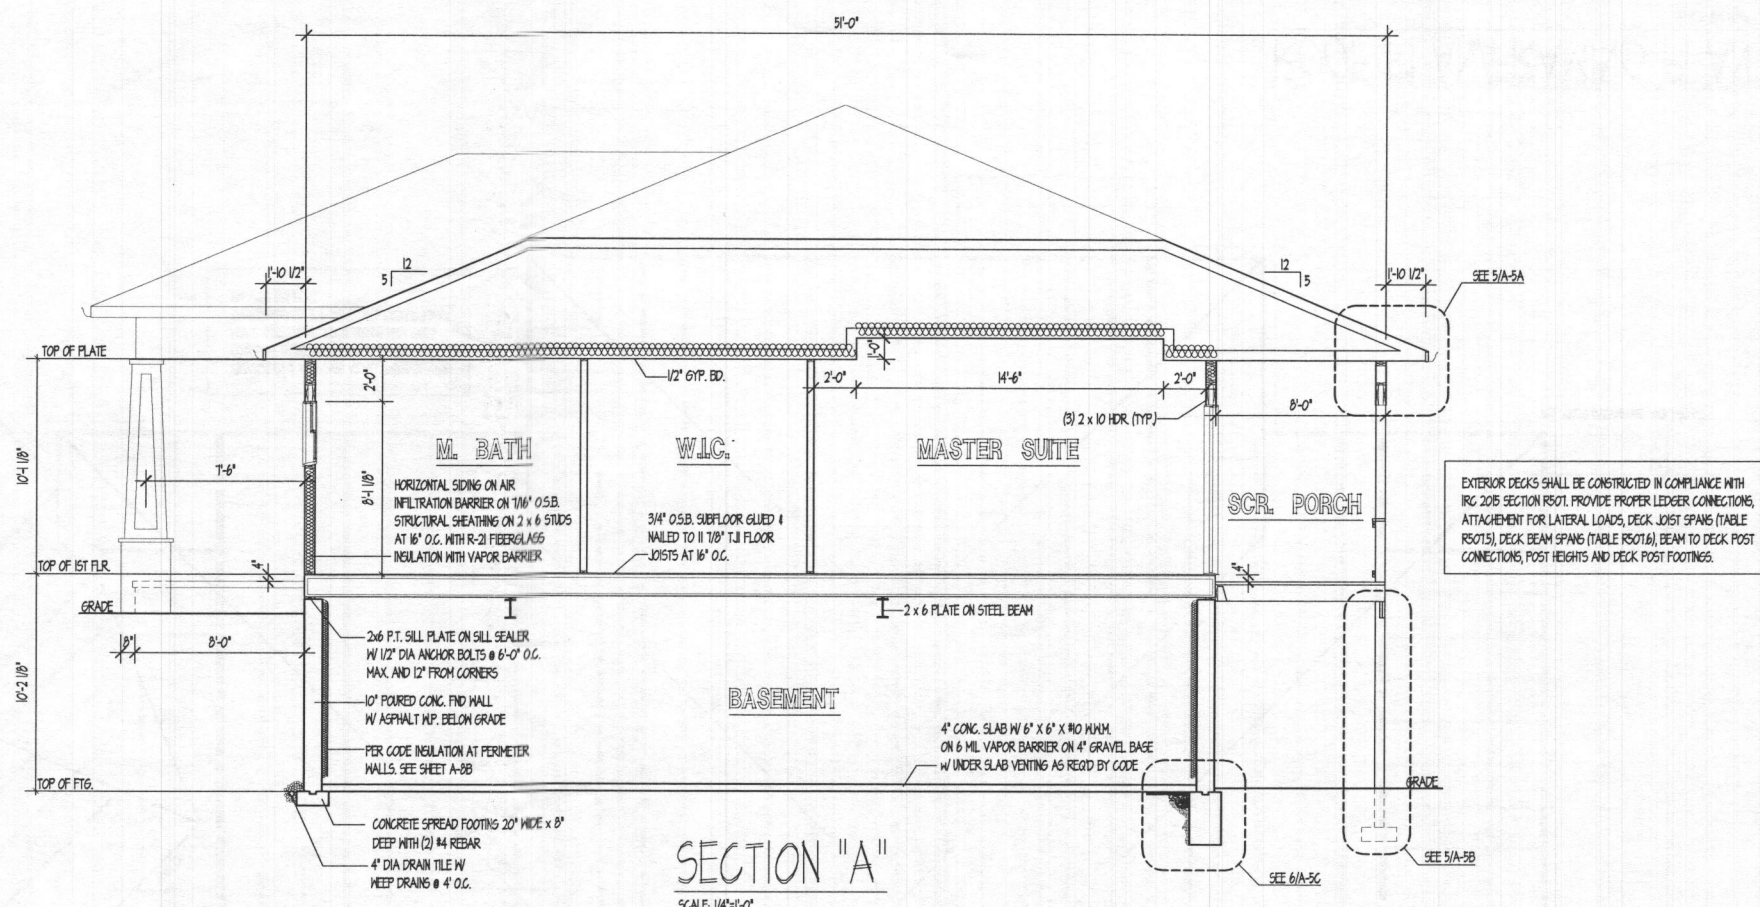

SECTION "A"
SCALE: 1/4"=1'-0"

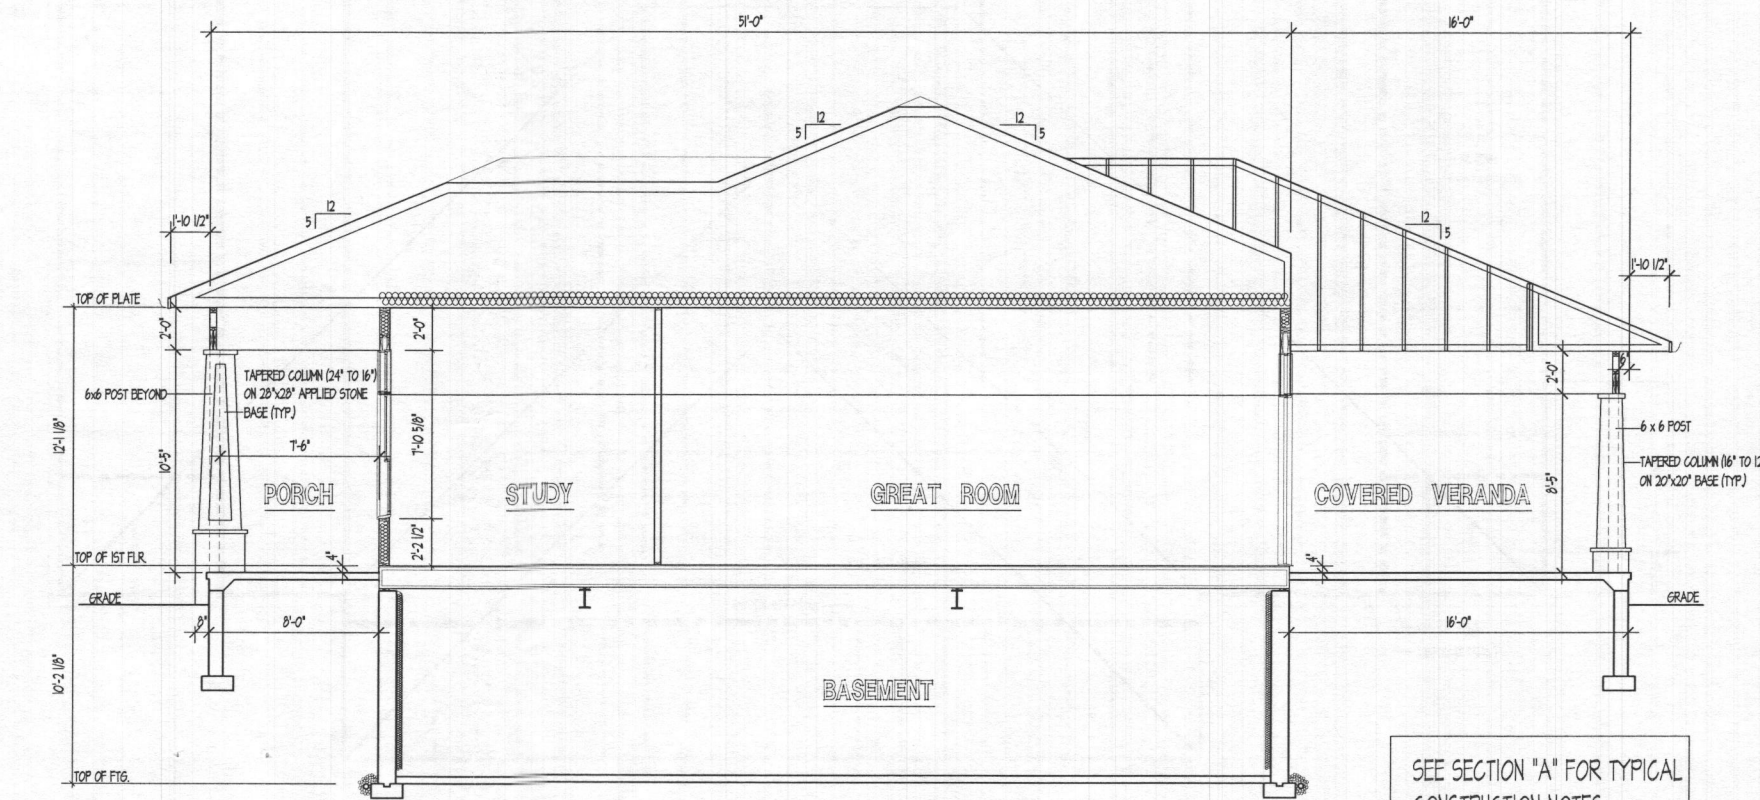

SECTION "B"
SCALE: 1/4"=1'-0"

EXTERIOR DECKS SHALL BE CONSTRUCTED IN COMPLIANCE WITH IRC 2015 SECTION R507. PROVIDE PROPER LEDGER CONNECTIONS, ATTACHMENT FOR LATERAL LOADS, DECK JOIST SPANS (TABLE R507.5), DECK BEAM SPANS (TABLE R507.6), BEAM TO DECK POST CONNECTIONS, POST HEIGHTS AND DECK POST FOOTINGS.

SEE SECTION "A" FOR TYPICAL CONSTRUCTION NOTES

JB HOME DESIGN, LLC
446 CONCORD COURT
BALTIMORE, MARYLAND 21284
OFFICE: (410) 944-6561
FAX: (410) 663-4064
EMAIL: JLD@JBHOMEDSIGN.COM


C.E. Rensberger & Family, Builder
1 South Main Street
Woodstock, MD 21798
301-370-4042

RENSBERGER & Family, LLC
BUILDER


RECEIVED
AUG 14 2019
HOWARD COUNTY HEALTH DEPT

SECTIONS A-B
DATE: 07/09/18
PROJECT TITLE:
WHITE RESIDENCE


CONTENTS: 1/4" = 1'-0"
SHEET NO: A-5A

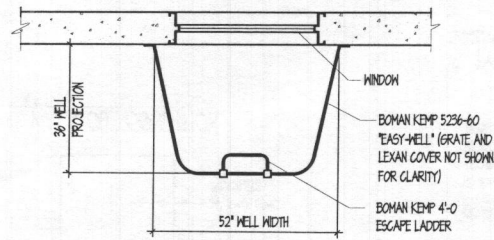


1. PLAN AT WINDOW WELL
SCALE: 1/2"=1'-0"

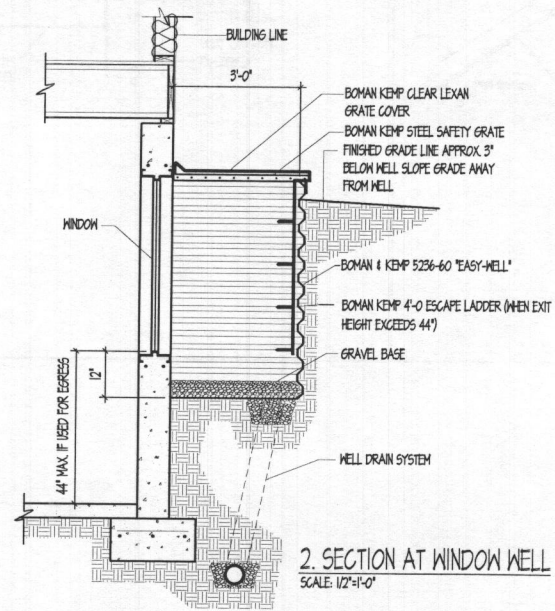

2. SECTION AT WINDOW WELL
SCALE: 1/2"=1'-0"

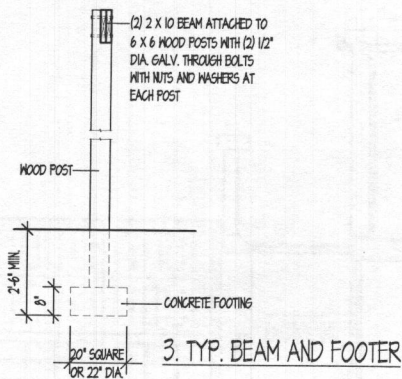


3. TYP. BEAM AND FOOTER

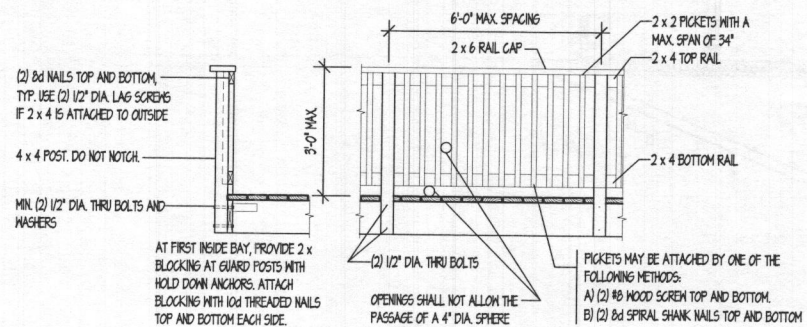

4. TYP. GUARDRAIL


DECK DETAILS

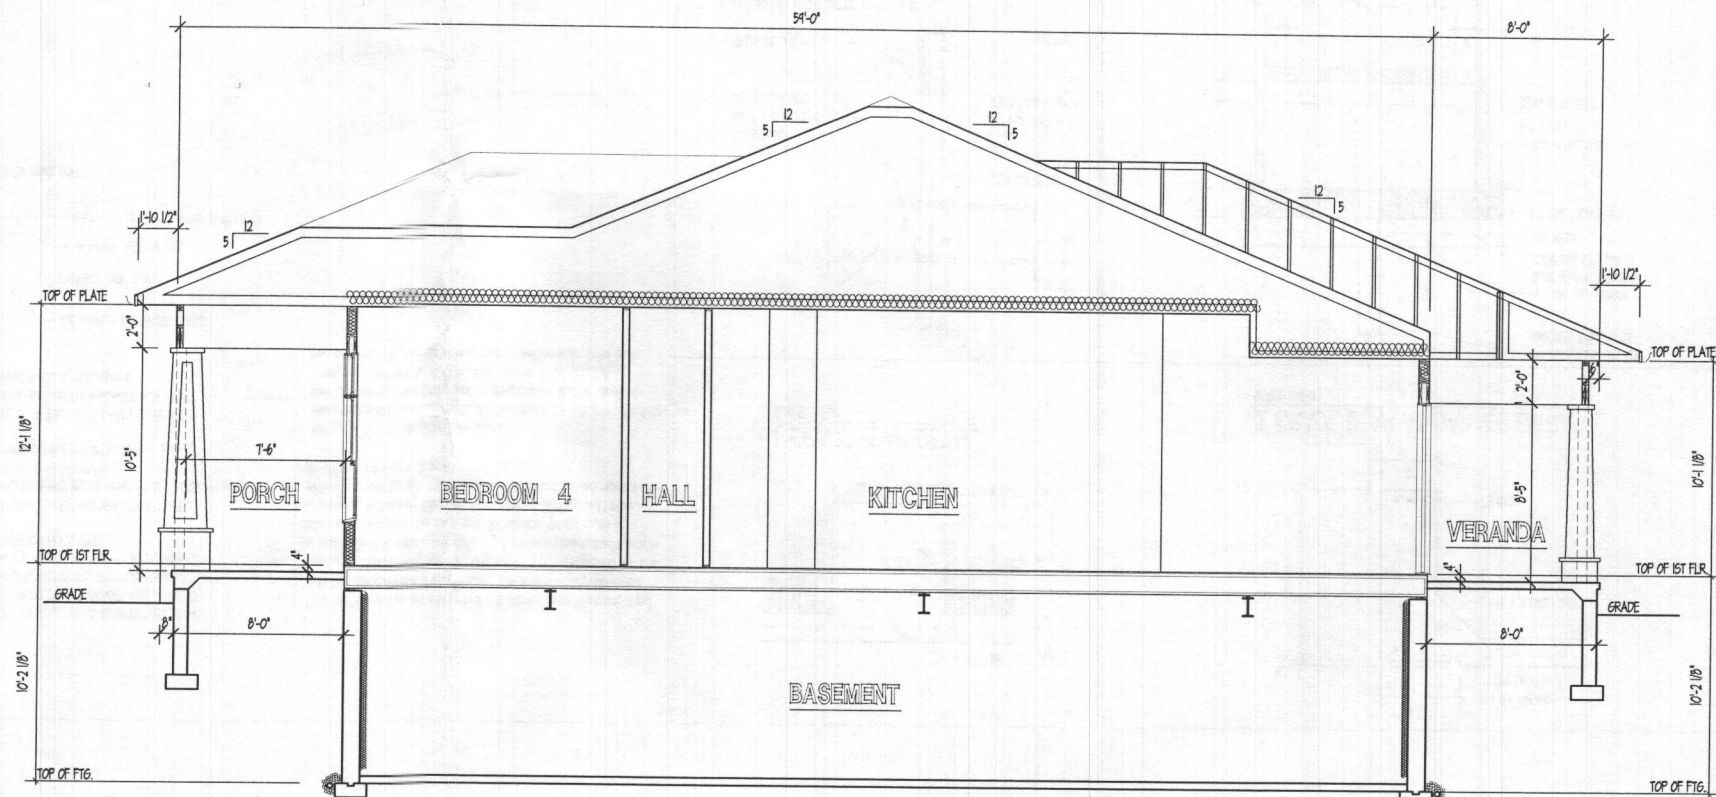

SECTION "C"

SCALE: 1/4"=1'-0"

SEE SECTION "A" FOR TYPICAL
CONSTRUCTION NOTES

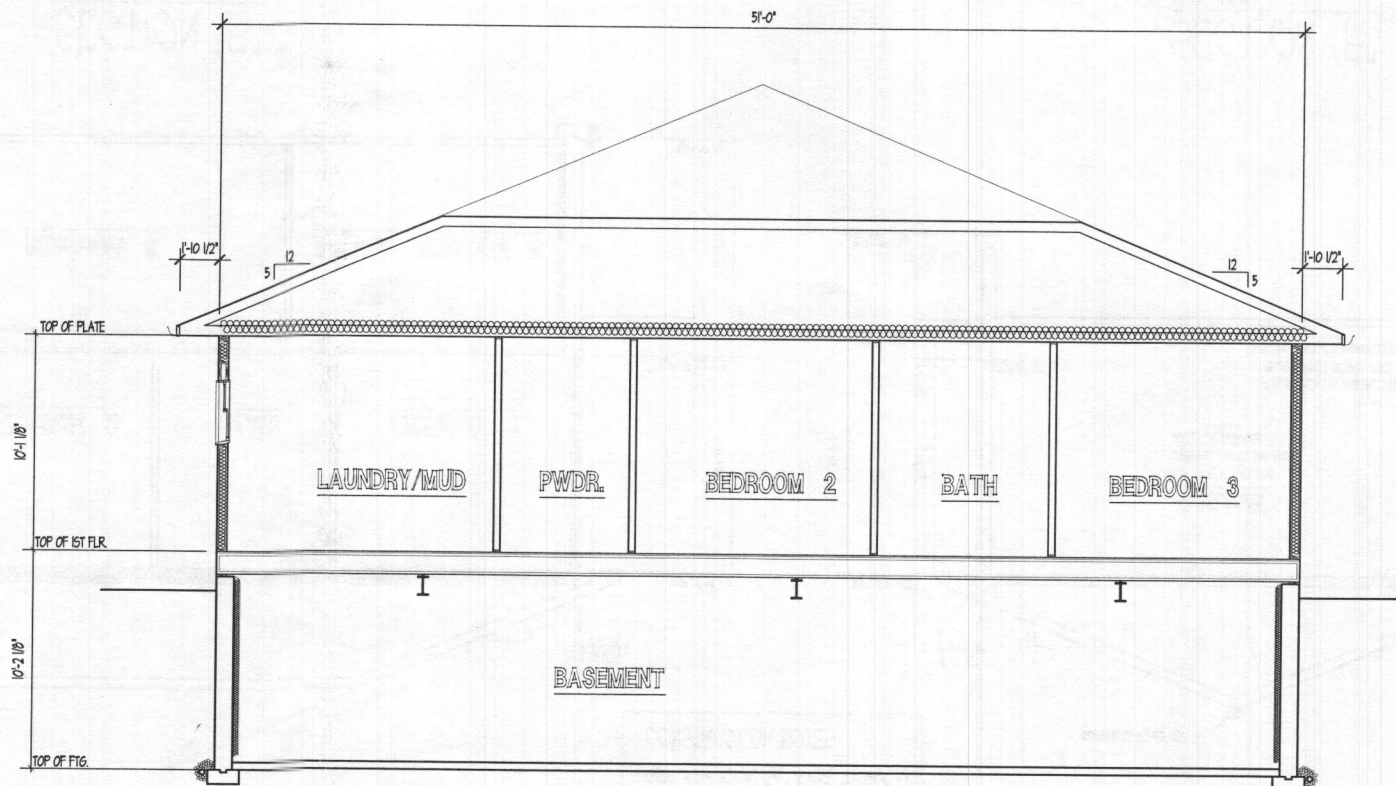

SECTION "D"

SCALE: 1/4"=1'-0"

JB HOME DESIGN, LLC



C.E. Rensberger & Family, Builder
1 South Main Street
Woodstock, MD 21798
301-370-4042



SECTIONS G-F
DATE: 07/09
SCALE: 1/4"=1'-0"


WHITE RESIDENCE

SHEET NO.

A-5B


AUG 14 2019

HOWARD COUNTY HEALTH DEPT.
 FOOD PROTECTION PROGRAM

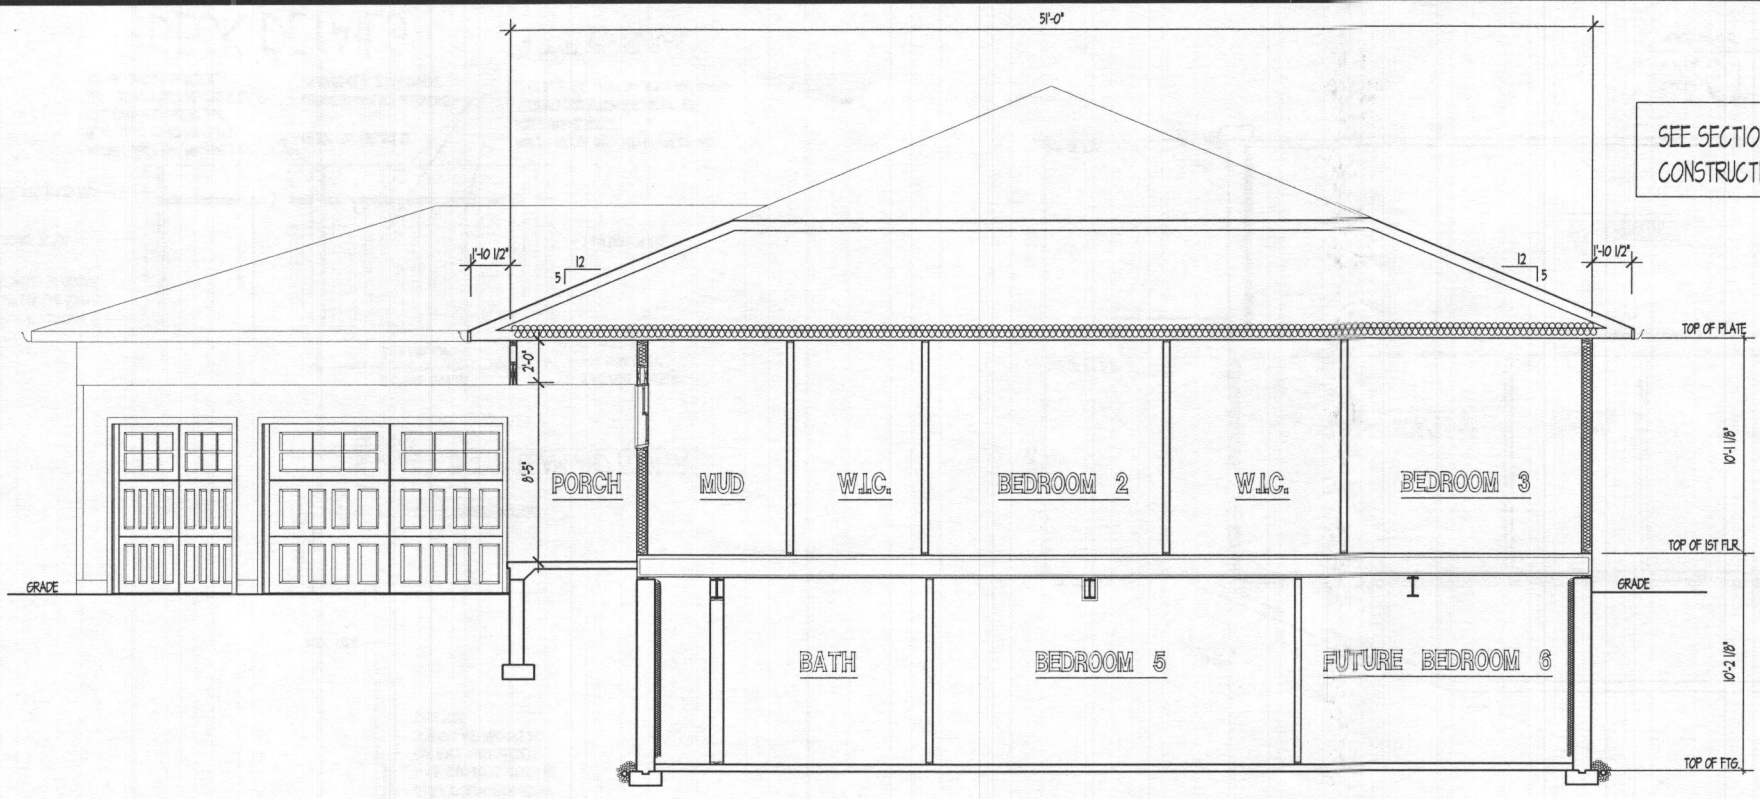


SECTION "E"
 SCALE: 1/4" = 1'-0"


SEE SECTION "A" FOR TYPICAL CONSTRUCTION NOTES

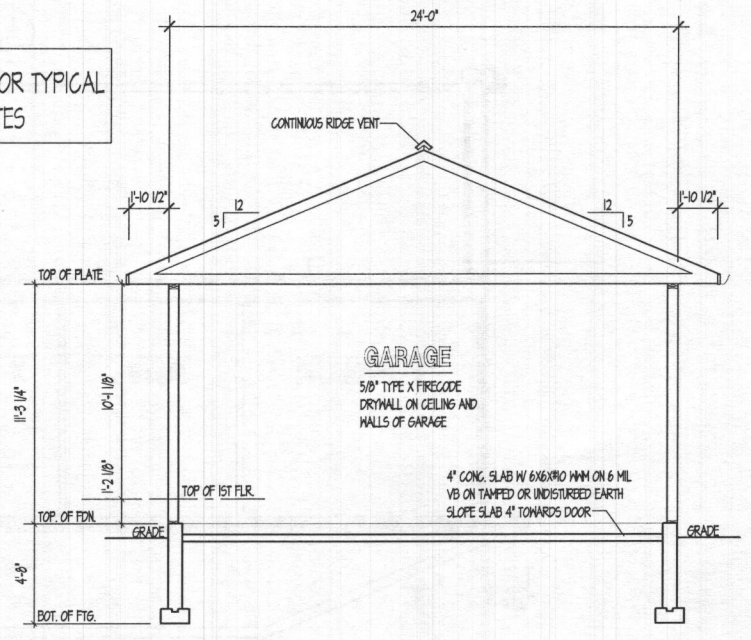

SECTION "F"
 SCALE: 1/4" = 1'-0"

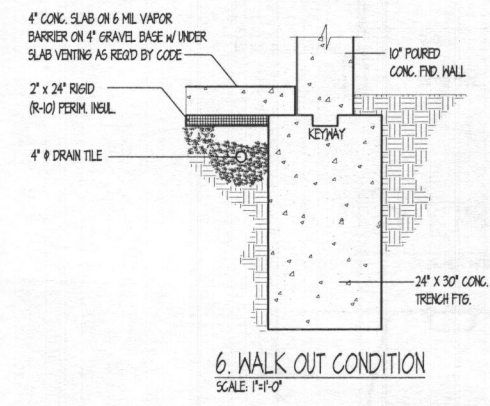

6. WALK OUT CONDITION
 SCALE: 1" = 1'-0"

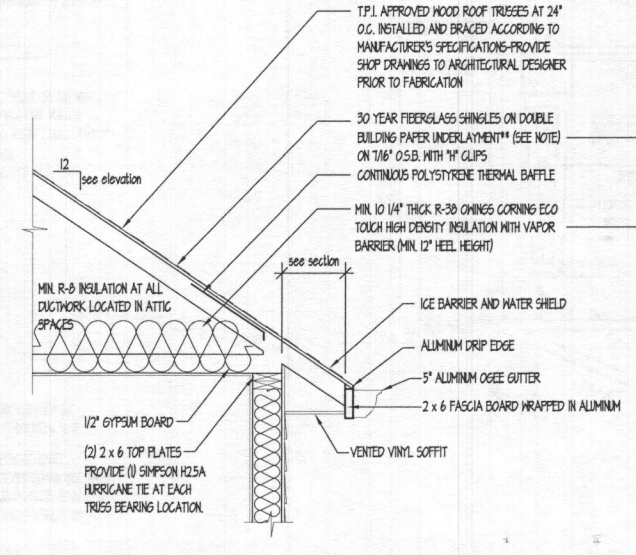

5. TYP. EAVE DETAIL
 SCALE: 1" = 1'-0"

T.P.I. APPROVED WOOD ROOF TRUSSES AT 24" O.C. INSTALLED AND BRACED ACCORDING TO MANUFACTURER'S SPECIFICATIONS-PROVIDE SHOP DRAWINGS TO ARCHITECTURAL DESIGNER PRIOR TO FABRICATION

30 YEAR FIBERGLASS SHINGLES ON DOUBLE BUILDING PAPER UNDERLAYMENT** (SEE NOTE) ON 1/16" O.S.B. WITH 1" CLIPS

CONTINUOUS POLYSTYRENE THERMAL BAFFLE

MIN. 10 1/4" THICK R-38 OWINGS CORNING ECO TOUCH HIGH DENSITY INSULATION WITH VAPOR BARRIER (MIN. 12" HEEL HEIGHT)

ICE BARRIER AND WATER SHIELD

ALUMINUM DRIP EDGE

5" ALUMINUM OEGEE GUTTER

2 x 6 FASCIA BOARD WRAPPED IN ALUMINUM


VENTED VINYL SOFFIT

1/2" GYPSUM BOARD


(2) 2 x 6 TOP PLATES PROVIDE (1) SIMPSON H25A HURRICANE TIE AT EACH TRUSS BEARING LOCATION

**For roof slopes from two units vertical in 12 units horizontal (17-percent slope), up to four units vertical in 12 units horizontal (33-percent slope), underlayment shall be two layers applied in the following manner. Apply a 14-inch (483 mm) strip of underlayment felt parallel to and starting at the eaves, fastened sufficiently to hold in place. Starting at the eaves, apply 36-inch-wide (914 mm) sheets of underlayment, overlapping successive sheets 14 inches (483 mm), and fastened sufficiently to hold in place. Distortions in the underlayment shall not interfere with the ability of the shingles to seal.


NI02.21 (R402.2.1) Ceilings with attic spaces. Where Section R102.1.2 would require R-44 insulation in the ceiling, installing R-38 over 100 percent of the ceiling area requiring insulation shall be deemed to satisfy the requirement for R-44 insulation wherever the full height of uncompressed R-38 insulation extends over the wall top plate at the eaves.

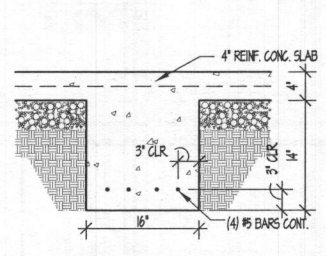


1. GRADE BEAM DETAIL
 SCALE: 1" = 1'-0"

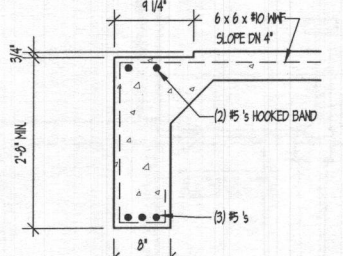

2. GRADE BEAM AT GARAGE ENTRANCE
 SCALE: 1" = 1'-0"

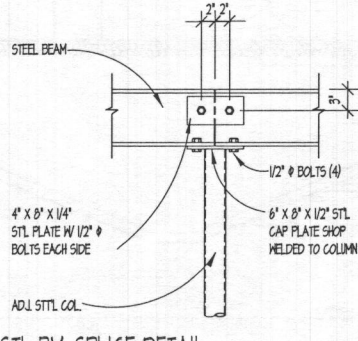

3. STL. BM. SPLICE DETAIL
 SCALE: 1" = 1'-0"

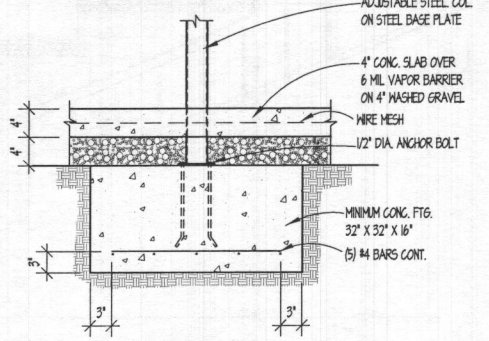

4. ADJ. COL. AND FTG. DETAIL
 SCALE: 1" = 1'-0"

TABLE R602.10.4
INTERMITTENT BRACING METHODS

METHOD	MATERIAL	MINIMUM THICKNESS	FIGURE	CONNECTION CRITERIA	
				Fasteners	Spacing
LIB	Let-in bracing	1 x 4 wood or approved metal straps at 45° to 60° angles for maximum 16" stud spacing		Wood: 2-Bd common nails or 3-Bd (2 1/2" long x 1/3 dia.) nails Metal strap: per manufacturer	Wood: per stud and top and bottom plates Metal: per manufacturer
DNB	Diagonal wood boards	3/4" (1" nominal) for maximum 24" stud spacing		2-Bd (2 1/2" long x 1/3 dia.) nails or 2-1 3/4" long staples	Per stud
MEP	Wood structural panel (See Section R604)	3/8"		Exterior sheathing per Table R602.3(3) Interior sheathing per Table R602.3(1) or R602.3(2)	6" edges 12" field Varies by fastener
BV-MEP (e)	Wood structural panels with stone or masonry veneer (See Section R602.10.6.5)	7/16"	See Figure R602.10.6.5	8d (2 1/2" long x 1/3 dia.) common nails	4" at panel edges 12" at intermediate supports 4" at braced wall panel end posts
SFP	Structural fiberboard sheathing	1/2" or 25/32" for maximum 16" stud spacing		1 1/2" long x 12" dia. (for 1/2" thick sheathing) 1 3/4" long x 12" dia. (for 25/32" sheathing) galvanized roofing nails or 8d common (2 1/2" long x 1/3" dia.) nails	3" edges 6" field
EB	Gypsum board	1/2"		Nails or screws per Table R602.3(1) for exterior locations Nails or screws per Table R102.3.5 for interior locations	For all braced wall panel locations: 7" edges (including top and bottom plates) 7" field
PEB	Particleboard sheathing (See Section R605)	3/8" or 1/2" for maximum 16" stud spacing		For 3/8" Bd common (2" long x 1/3 dia.) nails For 1/2" Bd common (2 1/2" long x 1/3 dia.) nails	3" edges 6" field
PCP	Portland cement plaster	See Section R103.6 For maximum 16" stud spacing		1 1/2" long, 1/8" gage, 7/16" dia. head nails or 7/8" long, 1/8" gage staples	6" o.c. on all framing members
HPS	Hardboard panel siding	7/16" For maximum 16" stud spacing		1/4" dia., 22# dia. nails with length to accommodate 1 1/2" penetration into studs	4" edges 6" field
AMB	Alternate braced wall	See Section R602.10.3.2		See section R602.10.6.1	See section R602.10.6.1
FFH	Intermittent portal frame	See Section R602.10.3.3		See section R602.10.6.2	See section R602.10.6.2
FFG	Intermittent portal frame at garage	See Section R602.10.3.4		See section R602.10.6.3	See section R602.10.6.3

TABLE R602.10.4
CONTINUOUS SHEATHING METHODS

METHOD	MATERIAL	MINIMUM THICKNESS	FIGURE	CONNECTION CRITERIA	
				Fasteners	Spacing
CS-MEP	Wood structural panel	3/8"		Exterior sheathing per Table R602.3(3) Interior sheathing per Table R602.3(1) or R602.3(2)	6" edges 12" field Varies by fastener
CS-G (b,c)	Wood structural panel adjacent to garage openings and supporting roof load only	3/8"		See method CS-MEP	See method CS-MEP
CS-PF	portal frame	7/16"		See Section R602.10.6.4	See Section R602.10.6.4
CS-SFP (d)	Structural fiberboard	1/2" or 25/32" for maximum 16" stud spacing		1 1/2" long x 12" dia. (for 1/2" thick sheathing) 1 3/4" long x 12" dia. (for 25/32" sheathing) galvanized roofing nails or 8d common (2 1/2" long x 1/3" dia.) nails	3" edges 6" field

- a. Adhesive attachment of wall sheathing, including Method EB, shall not be permitted in Seismic Design Categories C, D0, D1 and D2.
 b. Applies to panels next to garage door opening when supporting gable end wall or roof load only. May only be used on one wall of the garage. In Seismic Design Categories D0, D1 and D2, roof covering dead load may not exceed 3 psf.
 c. Garage openings adjacent to a Method CS-G panel shall be provided with a header in accordance with Table R502.5(1). A full height clear opening shall not be permitted adjacent to a Method CS-G panel.
 d. Method CS-SFP does not apply in Seismic Design Categories D0, D1 and D2 and in areas where the wind speed exceeds 100 mph.
 e. Method applies to detached one- and two-family dwellings in Seismic Design Categories D0 through D2 only.

R602.10.1 Braced wall lines. For the purpose of determining the amount and location of bracing required in each story level of a building, braced wall lines shall be designated as straight lines in the building plan placed in accordance with this section.

R602.10.1.1 Length of a braced wall line. The length of a braced wall line shall be the distance between its ends. The end of a braced wall line shall be the intersection with a perpendicular braced wall line, an angled braced wall line as permitted in Section R602.10.1.4 or an exterior wall as shown in Figure R602.10.1.1.

R602.10.1.2 Offsets along a braced wall line. All exterior walls parallel to a braced wall line shall be offset not more than 4 feet (1219 mm) from the designated braced wall line location as shown in Figure R602.10.1.1. Interior walls used as bracing shall be offset not more than 4 feet (1219 mm) from a braced wall line through the interior of the building as shown in Figure R602.10.1.1.

R602.10.1.3 Spacing of braced wall lines. The spacing between parallel braced wall lines shall be in accordance with Table R602.10.1.3. Intermediate braced wall lines through the interior of the building shall be permitted.

R602.10.1.4 Angled walls. Any portion of a wall along a braced wall line shall be permitted to angle out of plane for a maximum diagonal length of 8 feet (2438 mm). Where the angled wall occurs at a corner, the length of the braced wall line shall be measured from the projected corner as shown in Figure R602.10.1.4. Where the diagonal length is greater than 8 feet (2438 mm), it shall be considered a separate braced wall line and shall be braced in accordance with Section R602.10.1.

R602.10.2 Braced wall panels. Braced wall panels shall be full-height sections of wall that shall have no vertical or horizontal offsets. Braced wall panels shall be constructed and placed along a braced wall line in accordance with this section and the bracing methods specified in Section R602.10.4.

R602.10.2.1 Braced wall panel uplift load path. The bracing lengths in Table R602.10.3(1) apply only when uplift loads are resisted in accordance with Section R602.3.5.

R602.10.2.2 Locations of braced wall panels. A braced wall panel shall begin within 10 feet (3048 mm) from each end of a braced wall line as determined in Section R602.10.1.1. The distance between adjacent edges of braced wall panels along a braced wall line shall be no greater than 20 feet (6096 mm) as shown in Figure R602.10.2.2.

R602.10.2.3 Minimum number of braced wall panels. Braced wall lines with a length of 16 feet (4877 mm) or less shall have a minimum of two braced wall panels of any length or one braced wall panel equal to 48 inches (1219 mm) or more. Braced wall lines greater than 16 feet (4877 mm) shall have a minimum of two braced wall panels.

R602.10.3 Required length of bracing. The required length of bracing along each braced wall line shall be determined as follows:

- All buildings in Seismic Design Categories A and B shall use Table R602.10.3(1) and the applicable adjustment factors in Table R602.10.3(2).
- Detached buildings in Seismic Design Category C shall use Table R602.10.3(1) and the applicable adjustment factors in Table R602.10.3(2).
- Townhouses in Seismic Design Category C shall use the greater value determined from Table R602.10.3(1) or R602.10.3(3) and the applicable adjustment factors in Table R602.10.3(2) or R602.10.3(4) respectively.
- All buildings in Seismic Design Categories D0, D1 and D2 shall use the greater value determined from Table R602.10.3(1) or R602.10.3(3) and the applicable adjustment factors in Table R602.10.3(2) or R602.10.3(4) respectively. Only braced wall panels parallel to the braced wall line shall contribute toward the required length of bracing of that braced wall line. Braced wall panels along an angled wall meeting the minimum length requirements of Tables R602.10.5 and R602.10.5.2 shall be permitted to contribute its projected length toward the minimum required length of bracing for the braced wall line as shown in Figure R602.10.1.4. Any braced wall panel on an angled wall at the end of a braced wall line shall contribute its projected length for only one of the braced wall lines at the projected corner. Exception: The length of wall bracing for dwellings in Seismic Design Categories D0, D1 and D2 with stone or masonry veneer installed per Section R103.1 and exceeding the first-story height shall be in accordance with Section R602.10.6.5.

R602.10.4 Construction methods for braced wall panels. Intermittent and continuously sheathed braced wall panels shall be constructed in accordance with this section and the methods listed in Table R602.10.4.

R602.10.4.1 Mixing methods. Mixing of bracing methods shall be permitted as follows:
 1. Mixing intermittent bracing and continuous sheathing methods from story to story shall be permitted.

2. Mixing intermittent bracing methods from braced wall line to braced wall line within a story shall be permitted. Within Seismic Design Categories A, B and C or in regions where the basic wind speed is less than or equal to 100 mph (45 m/s), mixing of intermittent bracing and continuous sheathing methods from braced wall line to braced wall line within a story shall be permitted.

3. Mixing intermittent bracing methods along a braced wall line shall be permitted in Seismic Design Categories A and B, and detached dwellings in Seismic Design Category C provided the length of required bracing in accordance with Table R602.10.3(1) or R602.10.3(3) is the highest value of all intermittent bracing methods used.

4. Mixing of continuous sheathing methods CS-MEP, CS-G and CS-PF along a braced wall line shall be permitted.

5. In Seismic Design Categories A and B, and for detached one- and two-family dwellings in Seismic Design Category C, mixing of intermittent bracing methods along the interior portion of a braced wall line with continuous sheathing methods CS-MEP, CS-G and CS-PF along the exterior portion of the same braced wall line shall be permitted. The length of required bracing shall be the highest value of all intermittent bracing methods used in accordance with Table R602.10.3(1) or R602.10.3(3) as adjusted by Tables R602.10.3(2) and R602.10.3(4), respectively. The requirements of Section R602.10.7 shall apply to each end of the continuously sheathed portion of the braced wall line.

R602.10.4.2 Continuous sheathing methods. Continuous sheathing methods require structural panel sheathing to be used on all sheathable surfaces on one side of a braced wall line including areas above and below openings and gable end walls and shall meet the requirements of Section R602.10.1.


R602.10.6.4 Method CS-PF: Continuously sheathed portal frame. Continuously sheathed portal frame braced wall panels shall be constructed in accordance with Figure R602.10.6.4 and Table R602.10.6.4. The number of continuously sheathed portal frame panels in a single braced wall line shall not exceed four.

R602.10.7 Ends of braced wall lines with continuous sheathing. Each end of a braced wall line with continuous sheathing shall have one of the conditions shown in Figure R602.10.7.

R602.10.8 Braced wall panel connections. Braced wall panels shall be connected to floor framing or foundations as follows:
 1. Where joists are perpendicular to a braced wall panel above or below, a rim joist, band joist or blocking shall be provided along the entire length of the braced wall panel in accordance with Figure R602.10.8(1). Fastening of top and bottom wall plates to framing, rim joist, band joist and/or blocking shall be in accordance with Table R602.3(1).

2. Where joists are parallel to a braced wall panel above or below, a rim joist, end joist or other parallel framing member shall be provided directly above and below the braced wall panel in accordance with Figure R602.10.8(2). Where a parallel framing member cannot be located directly above and below the panel, full-depth blocking at 16-inch (406 mm) spacing shall be provided between the parallel framing members to each side of the braced wall panel in accordance with Figure R602.10.8(2). Fastening of blocking and wall plates shall be in accordance with Table R602.3(1) and Figure R602.10.8(2).

3. Connections of braced wall panels to concrete or masonry shall be in accordance with Section R403.1.6.

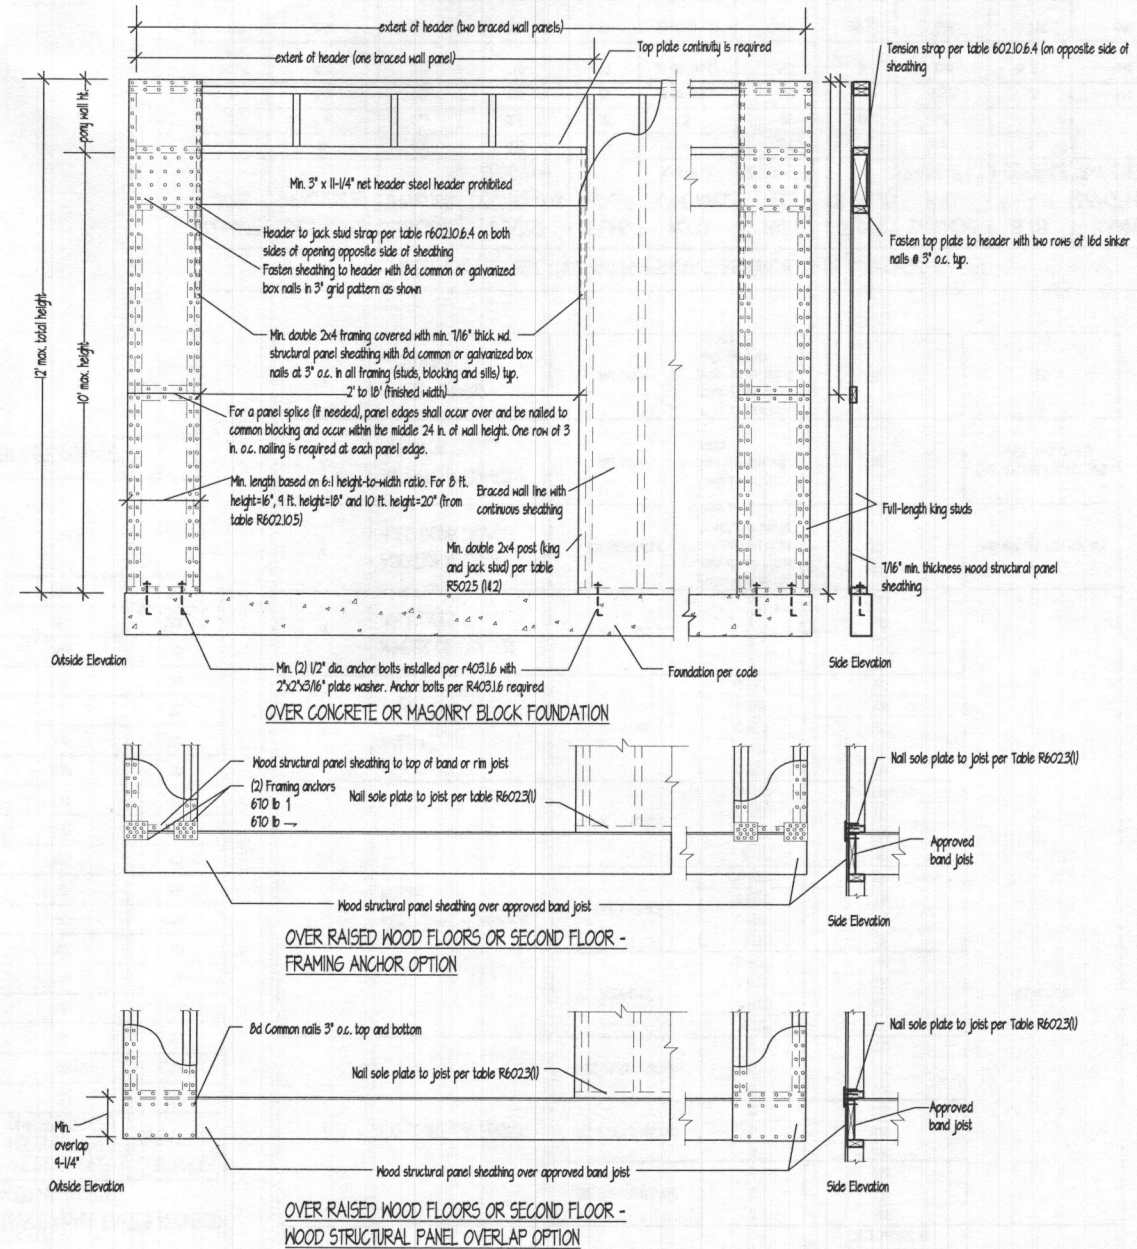

1 METHOD CS-PF:CONT. PORTAL FRAME PANEL CONSTRUCTION
PER IRC 2015 figure R602.10.6.4.

JB HOME DESIGN, LLC
446 CONCORD COURT
BALTIMORE, MARYLAND 21284
OFFICE (410) 541-4581
FAX (410) 663-4044
EMAIL: JOW@JBHOMEDSIGN.COM



C.E. Rensberger & Family, Builder
1 South Main Street
Woodsboro, MD 21798
301-370-4042



APA NARROW WALL DETAILS
DATE: 07/01/14
SCALE: 1/4" = 1'-0"
PROJECT TITLE: WHITE RESIDENCE

SHEET NO.

A-8A

TABLE R602.105
LENGTH REQUIREMENTS FOR BRACED WALL PANELS WITH CONTINUOUS SHEATHING

METHOD	ADJACENT CLEAR OPENING HEIGHT	WALL HEIGHT				
		8'	9'	10'	11'	12'
CS-WSP CS-SFB	64"	24"	21"	30"	33"	36"
	68"	26"	21"	30"	33"	36"
	72"	28"	21"	30"	33"	36"
	76"	30"	24"	30"	33"	36"
	80"	32"	30"	30"	33"	36"
	84"	35"	32"	32"	33"	36"
	88"	38"	35"	33"	33"	36"
	92"	43"	37"	35"	35"	36"
	96"	48"	41"	38"	36"	36"
	100"		44"	40"	38"	38"
	104"		44"	43"	40"	39"
	108"		54"	46"	43"	41"
	112"			50"	45"	43"
	116"			54"	48"	45"
	120"			60"	52"	48"
	124"				56"	51"
128"				61"	54"	
132"				66"	58"	
136"					62"	
140"					66"	
144"					72"	
CS-G	120"	24"	21"	30"	33"	36"
CS-PT	120"	16"	18"	20"	22"	24"

TABLE R602.103 (1)
BRACING REQUIREMENTS BASED ON WIND SPEED

EXPOSURE CATEGORY B, 30 FT MEAN ROOF HEIGHT, 10 FT EAVE TO RIDGE HEIGHT 10 FT WALL HEIGHT 2 BRACED WALL LINES		MINIMUM TOTAL LENGTH (feet) OF BRACED WALL PANELS REQUIRED ALONG EACH BRACED WALL LINES				
BASIC WIND SPEED (mph)	STORY LOCATION	BRACED WALL LINE SPACING (feet)	METHOD LIB	METHOD GB (double sided)	METHODS DMB, WSP, SFB, PCP, HFS, DMB, PFS, CS-SFB	CONTINUOUS SHEATHING
< 115 MPH		10	35	35	2.0	2.0
		20	7.0	7.0	4.0	3.5
		30	4.5	4.5	5.5	5.0
		40	3.5	3.5	7.0	6.0
		50	2.8	2.8	8.5	7.5
		60	2.3	2.3	10.0	9.0
		10	7.0	7.0	4.0	3.5
		20	3.5	3.5	5.5	6.5
		30	2.3	2.3	7.0	9.0
		40	1.8	1.8	8.5	12.0
		50	1.4	1.4	10.0	14.5
		60	1.1	1.1	11.5	17.0
		10	NP	10.5	6.0	5.0
		20	NP	14.0	11.0	4.5
		30	NP	17.5	15.5	13.5
		40	NP	21.0	20.5	11.5
		50	NP	24.5	25.0	21.5
		60	NP	28.0	30.0	25.5

TABLE R602.103 (2)
WIND ADJUSTMENT FACTORS TO THE REQUIRED LENGTH OF WALL BRACING

ITEM NUMBER	ADJUSTMENT BASED ON	STORY/SUPPORTING	CONDITION	ADJUSTMENT FACTOR MULTIPLY BY LENGTH IN TABLE R602.103(1)	APPLICABLE METHODS		
1	EXPOSURE CATEGORY	ONE STORY STRUCTURE	B	1.00	ALL METHODS		
			C	1.20			
			D	1.50			
		TWO STORY STRUCTURE	B	1.00			
			C	1.30			
			D	1.60			
		THREE STORY STRUCTURE	B	1.00			
			C	1.40			
			D	1.70			
2	ROOF EAVE-TO-RIDGE HEIGHT	ROOF ONLY	5 FEET	.70	ALL METHODS		
			10 FEET	1.00			
			15 FEET	1.30			
		ROOF + 1 FLOOR	5 FEET	.85			
			10 FEET	1.00			
			15 FEET	1.15			
		ROOF + 2 FLOORS	5 FEET	1.30			
			10 FEET	1.00			
			15 FEET	1.10			
		3	WALL HEIGHT ADJUSTMENT	ANY STORY		2 FEET	1.00
						4 FEET	.75
						6 FEET	1.00
8 FEET	1.05						
10 FEET	1.10						
12 FEET	1.10						
4	NUMBER OF BRACED WALL LINES	ANY STORY	2	1.00			
			3	1.30			
			4	1.45			
			5	1.60			
			6	1.75			
5	ADDITIONAL 800# HOLD DOWN DEVICE	TOP STORY ONLY	Fastened to the end studs of each braced wall panel and to the foundation or framing below.	.80	DMB, HEP, SFB, PFS, PCP, HFS		
			Omitted from inside face of braced wall panels.	1.40	DMB, HEP, SFB, PFS, PCP, HFS, CS-HEP, CS-G, CS-SFB		
6	INT. GYPSUM BOARD FINISH (OR EQUAL)	ANY STORY	4" o.c. at panel edges, including top and bottom plates, and all horizontal joints blocked.	.70	GB		
				7	GYPSUM BOARD FASTENING	ANY STORY	4" o.c. at panel edges, including top and bottom plates, and all horizontal joints blocked.

2015 IRC RESIDENTIAL ENERGY EFFICIENCY CEILING CONDITIONS

NI0221 (R402.2.1) Ceilings with attic spaces. Where Section NI0221.2 would require R-38 insulation in the ceiling, installing R-30 over 100 percent of the ceiling area requiring insulation shall be deemed to satisfy the requirement for R-38 wherever the full height of uncompressed R-30 insulation extends over the wall top plate at the eaves. Similarly, where Section NI0221.2 would require R-44 insulation in the ceiling, installing R-38 over 100 percent of the ceiling area requiring insulation shall be deemed to satisfy the requirement for R-44 insulation wherever the full height of uncompressed R-38 insulation extends over the wall top plate at the eaves. This reduction shall not apply to the U-factor alternative approach in Section NI021.4 and the total UA alternative in Section NI021.5.

NI0222 (R402.2.2) Ceilings without attic spaces. Where Section NI0221.2 would require insulation levels above R-30 and the design of the roof/ceiling assembly does not allow sufficient space for the required insulation, the minimum required insulation for such roof/ceiling assemblies shall be R-30. This reduction of insulation from the requirements of Section NI0221.2 shall be limited to 500 square feet (46 m²) or 20 percent of the total insulated ceiling area, whichever is less. This reduction shall not apply to the U-factor alternative approach in Section NI021.4 and the total UA alternative in Section NI021.5.

NI0223 (R402.2.3) Eave baffles. For air-permeable insulations in vented attics, a baffle shall be installed adjacent to soffit and eave vents. Baffles shall maintain an opening equal or greater than the size of the vent. The baffle shall extend over the top of the attic insulation. The baffle shall be permitted to be any solid material.

2015 IRC RESIDENTIAL ENERGY EFFICIENCY BASEMENT/FOUNDATION CONDITIONS

NI0224 (R402.2.4) Basement walls. Walls associated with conditioned basements shall be insulated from the top of the basement wall down to 10 feet (3048 mm) below grade or to the basement floor, whichever is less. Walls associated with unconditioned basements shall meet this requirement unless the floor overhead is insulated in accordance with Sections NI021.2 and NI022.8.

NI02210 (R402.2.10) Slab-on-grade floors. Slab-on-grade floors with a floor surface less than 12 inches (305 mm) below grade shall be insulated in accordance with Table NI021.2. The insulation shall extend downward from the top of the slab on the outside or inside of the foundation wall. Insulation located below grade shall be extended the distance provided in Table NI021.2 by any combination of vertical insulation extending under the slab or insulation extending out from the building. Insulation extending away from the building shall be protected by pavement or by not less than 10 inches (254 mm) of soil. The top edge of the insulation installed between the exterior wall and the edge of the interior slab shall be permitted to be cut at a 45-degree (0.71 rad) angle away from the exterior wall. Slab-edge insulation is not required in jurisdictions designated by the building official as having a very heavy termite infestation.

NI02211 (R402.2.11) Crawl space walls. As an alternative to insulating floors over crawl spaces, crawl space walls shall be permitted to be insulated when the crawl space is not vented to the outside. Crawl space wall insulation shall be permanently fastened to the wall and extend downward from the floor to the finished grade level and then vertically and/or horizontally for at least an additional 24 inches (610 mm). Exposed earth in unvented crawl space foundations shall be covered with a continuous Class I vapor retarder in accordance with this code. All joints of the vapor retarder shall overlap by 6 inches (153 mm) and be sealed or lapped. The edges of the vapor retarder

2015 IRC RESIDENTIAL ENERGY EFFICIENCY CHAPTER II SECTION 402

RA02.1 General (Prescriptive). The building thermal envelope shall meet the requirements of Sections RA02.1.1 through RA02.1.4.

RA02.2 Specific insulation requirements (Prescriptive). In addition to the requirements of Section RA02.1, insulation shall meet the specific requirements of Sections RA02.2.1 through RA02.2.12.

RA02.3 Fenestration (Prescriptive). In addition to the requirements of Section RA02.1, fenestration shall comply with Sections RA02.3.1 through RA02.3.6.

RA02.4 Air leakage (Mandatory). The building thermal envelope shall be constructed to limit air leakage in accordance with the requirements of Sections RA02.4.1 through RA02.4.4.

RA02.4.1 Building thermal envelope. The building thermal envelope shall comply with Sections RA02.4.1.1 and RA02.4.1.2. The sealing methods between dissimilar materials shall allow for differential expansion and contraction.

RA02.4.1.1 Installation. The components of the building thermal envelope as listed in Table RA02.4.1.1 shall be installed in accordance with the manufacturer instructions and the criteria listed in Table RA02.4.1.1, as applicable to the method of construction. Where required by the code official, an approved third party shall inspect all components and verify compliance.

RA02.4.1.2 Testing. The building or dwelling unit shall be tested and verified as having an air leakage rate of not exceeding 5 air changes per hour in Climate Zones 1 and 2, and 3 air changes per hour in Climate Zones 3 through 8. Testing shall be conducted with a blower door at a pressure of 0.2 inches w.g. (5.0 Pascals). Where required by the code official, testing shall be conducted by an approved third party. A written report of the results of the test shall be signed by the party conducting the test and provided to the code official. Testing shall be performed at any time after creation of all penetrations of the building thermal envelope.

During testing:

1. Exterior windows and doors, fireplace and stove doors shall be closed, but not sealed, beyond the intended weatherstripping or other infiltration control measures;
2. Dampers including exhaust, intake, makeup air, backdraft and fire dampers shall be closed, but not sealed beyond intended infiltration control measures;
3. Interior doors, if installed at the time of the test, shall be open;
4. Exterior doors for continuous ventilation systems and heat recovery ventilators shall be closed and sealed;
5. Heating and cooling systems, if installed at the time of the test, shall be turned off; and
6. Supply and return registers, if installed at the time of the test, shall be fully open.

RA02.4.2 Fireplaces. New wood-burning fireplaces shall have light-fitting fire dampers and outdoor combustion air.

RA02.4.3 Fenestration air leakage. Windows, skylights and sliding glass doors shall have an air infiltration rate of no more than 0.3 cfm per square foot (1.5 L/s/m²), and swinging doors no more than 0.5 cfm per square foot (2.6 L/s/m²), when tested according to NFRC 400 or AAMA/WDMA/CSA 1011.5/2/AH40 by an accredited, independent laboratory and listed and labeled by the manufacturer. Exception: Site-built windows, skylights and doors.

RA02.4.4 Recessed lighting. Recessed luminaires installed in the building thermal envelope shall be sealed to limit air leakage between conditioned and unconditioned spaces. All recessed luminaires shall be IC-rated and labeled as having an air leakage rate not more than 2.0 cfm (0.944 L/s) when tested in accordance with ASTM E 283 at a 151 psf (75 Pa) pressure differential. All recessed luminaires shall be sealed with a gasket or caulk between the housing and the interior wall or ceiling covering.

RA02.5 Maximum fenestration U-factor and SHGC (Mandatory). The area-weighted average maximum fenestration U-factor permitted using tradeoffs from Section RA02.1.4 or RA05 shall be 0.48 in Climate Zones 4 and 5 and 0.40 in Climate Zones 6 through 8 for vertical fenestration, and 0.75 in Climate Zones 4 through 8 for skylights. The area-weighted average maximum fenestration SHGC permitted using tradeoffs from Section RA05 in Climate Zones 1 through 3 shall be 0.50.

2015 IRC RESIDENTIAL ENERGY EFFICIENCY CHAPTER II SECTION 403

- SEE SECTION 403 FOR SYSTEM REQUIREMENTS INCLUDING:
1. Programmable thermostat.
 2. Duct insulation and sealing.
 3. Verification of duct tightness.
 4. Air handler sealing.
 5. Mechanical system piping insulation and protection.
 6. Hot water systems.
 7. Hot water pipe insulation.
 8. Mechanical ventilation.
 9. Equipment sizing.
 10. Snow melt system controls.
- II. In ground pools and spas.

2015 IRC RESIDENTIAL ENERGY EFFICIENCY CHAPTER II SECTION 404

SEE SECTION 404 FOR ELECTRICAL POWER AND LIGHTING REQUIREMENTS

2015 IRC RESIDENTIAL ENERGY EFFICIENCY CHAPTER II SECTION 405

- SEE SECTION 405 FOR SIMULATED PERFORMANCE ALTERNATIVES (PERFORMANCE) INCLUDING:
1. Mandatory requirements.
 2. Performance-based compliance.
 3. Documentation.
 4. Calculation procedures.
 5. Calculation software, approved software and input values.

TABLE R402.1.2 INSULATION AND FENESTRATION REQUIREMENTS BY COMPONENT

CLIMATE ZONE	FENESTRATION U-FACTOR (b)	SKYLIGHT U-FACTOR	GLAZED FENESTRATION SHGC (b,c)	CEILING R-VALUE	WOOD FRAME WALL R-VALUE	MASS WALL R-VALUE (i)	FLOOR R-VALUE	BASEMENT WALL R-VALUE (c)	SLAB R-VALUE & DEPTH (d)	CRAWL SPACE WALL R-VALUE (c)
1	NR	0.75	0.25	30	B	3/4	B	0	0	0
2	0.40	0.65	0.25	36	B	4/6	B	0	0	0
3	0.35	0.55	0.25	36	20 OR 13/5 (h)	8/13	M	5/13 (f)	0	5/13
4 EXCEPT MARINE	0.35	0.55	0.40	44	20 OR 13/5 (h)	8/13	M	10/13	10, 2 FT.	10/13
5 AND MARINE 4	0.32	0.55	NR	44	20 OR 13/5 (h)	13/11	30 (g)	15/11	10, 2 FT.	15/11
6	0.32	0.55	NR	44	20+5 OR 13+10 (h)	15/20	30 (g)	15/11	10, 4 FT.	15/11
7 & 8	0.32	0.55	NR	44	20+5 OR 13+10 (h)	14/21	30 (g)	15/11	10, 4 FT.	15/11

For SI: 1 foot = 304.8 mm.
a. R-values are minimum. U-factors and SHGC are maximum. When insulation is installed in a cavity which is less than the label or design thickness of the insulation, the installed R-value of the insulation shall not be less than the R-value specified in the table.
b. The fenestration U-factor values exclude skylights. The SHGC column applies to all glazed fenestration.
c. Exception: Skylights may be excluded from glazed fenestration SHGC requirements in Climate Zones 1 through 3 where the SHGC for each skylight does not exceed 0.50.
d. SHGC means R-5 continuous insulation on the interior or exterior of the home or R-4 continuous insulation at the interior of the basement wall. SHGC shall be permitted to be met with R-5 cavity insulation on the interior of the basement wall plus R-5 continuous insulation on the interior or exterior of the home. SHGC means R-10 continuous insulation on the interior or exterior of the home or R-5 cavity insulation at the interior of the basement wall.
e. R-5 shall be added to the required slab edge R-values for heated slabs. Insulation depth shall be the depth of the footing or 2 feet, whichever is less in Zones 1 through 3 for heated slabs.
f. There are no SHGC requirements in the Marine Zone.
g. Basement wall insulation is not required in warm-humid locations as defined by Figure NI010 and Table NI010.2.
h. Or insulation sufficient to fill the framing cavity R-4 minimum.
i. The R-value is cavity insulation, the second value is continuous insulation, no R-5 means R-5 cavity insulation plus R-5 continuous insulation.
j. The second R-value applies when more than half the insulation is on the interior of the mass wall.

TABLE R402.1.4 EQUIVALENT U-FACTORS

CLIMATE ZONE	FENESTRATION U-FACTOR	SKYLIGHT U-FACTOR	CEILING U-FACTOR	FRAME WALL U-FACTOR	MASS WALL U-FACTOR (b)	FLOOR U-FACTOR	BASEMENT WALL U-FACTOR	CRAWL SPACE WALL R-VALUE (c)
1	0.50	0.75	0.025	0.082	0.141	0.064	0.360	0.471
2	0.40	0.65	0.030	0.082	0.165	0.064	0.360	0.471
3	0.35	0.55	0.030	0.051	0.098	0.041	0.091 (c)	0.136
4 EXCEPT MARINE	0.35	0.55	0.026	0.051	0.098	0.041	0.054	0.065
5 AND MARINE 4	0.32	0.55	0.026	0.051	0.082	0.033	0.050	0.055
6	0.32	0.55	0.026	0.048	0.060	0.033	0.050	0.055
7 & 8	0.32	0.55	0.026	0.048	0.051	0.028	0.050	0.055

NOTES
a. Nonfenestration U-factors shall be obtained from measurement, calculation or an approved source.
b. When more than half the insulation is on the interior, the mass wall U-factors shall be a maximum of 0.17 in Zone 1, 0.14 in Zone 2, 0.12 in Zone 3, 0.081 in Zone 4 except Marine, 0.065 in Zone 5 and Marine 4, and 0.051 in Zones 6 through 8.
c. Basement wall U-factor of 0.360 in warm-humid locations as defined by Figure NI010 (R301) and Table NI010 (R301).

JB HOME DESIGN, LLC
446 CONCORD COURT
BALTIMORE, MARYLAND 21284
OFFICE (410) 594-4801
FAX (410) 463-4094
EMAIL: JLD@JBHOMEDSIGN.COM


C.E. Rensberger & Family, Builder
1 South Main Street
Woodsboro, MD 21798
301-370-4042

RENSBERGER & Family, BUILDER

WALL BRACING/IECC NOTES AND CHARTS
DATE: 07/04/19
SCALE: 1/4" = 1'-0"
PROJECT TITLE: WHITE RESIDENCE
RECEIVED
AUG 14 2019
HOWARD COUNTY HEALTH DEPT. FOOD PROTECTION PROGRAM
SHEET NO: A-8B

CS-WSP CONTINUOUS SHEATHING BRACED WALL PANELS
BRACED WALL LINE INFORMATION - 1ST FLOOR (WALLS ARE 10/12 FEET TALL)

BRACED WALL LINE MARK AND LENGTH	WALL PANEL METHOD	LENGTH OF PANELS REQUIRED	LENGTH OF PANELS PROVIDED
1 30'-0"	CS-WEP	8'-0"	16'-4"
2 32'-0"	CS-WEP	8'-6"	23'-0"
3 8'-0"	CS-FF	1'-8"	1'-8"
4 34'-0"	CS-WEP	9'-0"	15'-4"
5 43'-0"	CS-WEP	11'-6"	25'-0"
6 57'-0"	CS-WEP	15'-0"	26'-4"
7 6'-0"	CS-FF	1'-8"	1'-8"
8 8'-0"	CS-WEP	2'-6"	5'-0"
9 37'-5"	CS-FF	1'-8"	2'-6 1/2'-0"
10 24'-0"	CS-WEP	7'-0"	10'-0"
11 34'-8"	CS-WEP	9'-6"	34'-8"
12 14'-4"	CS-WEP	4'-6"	14'-4"

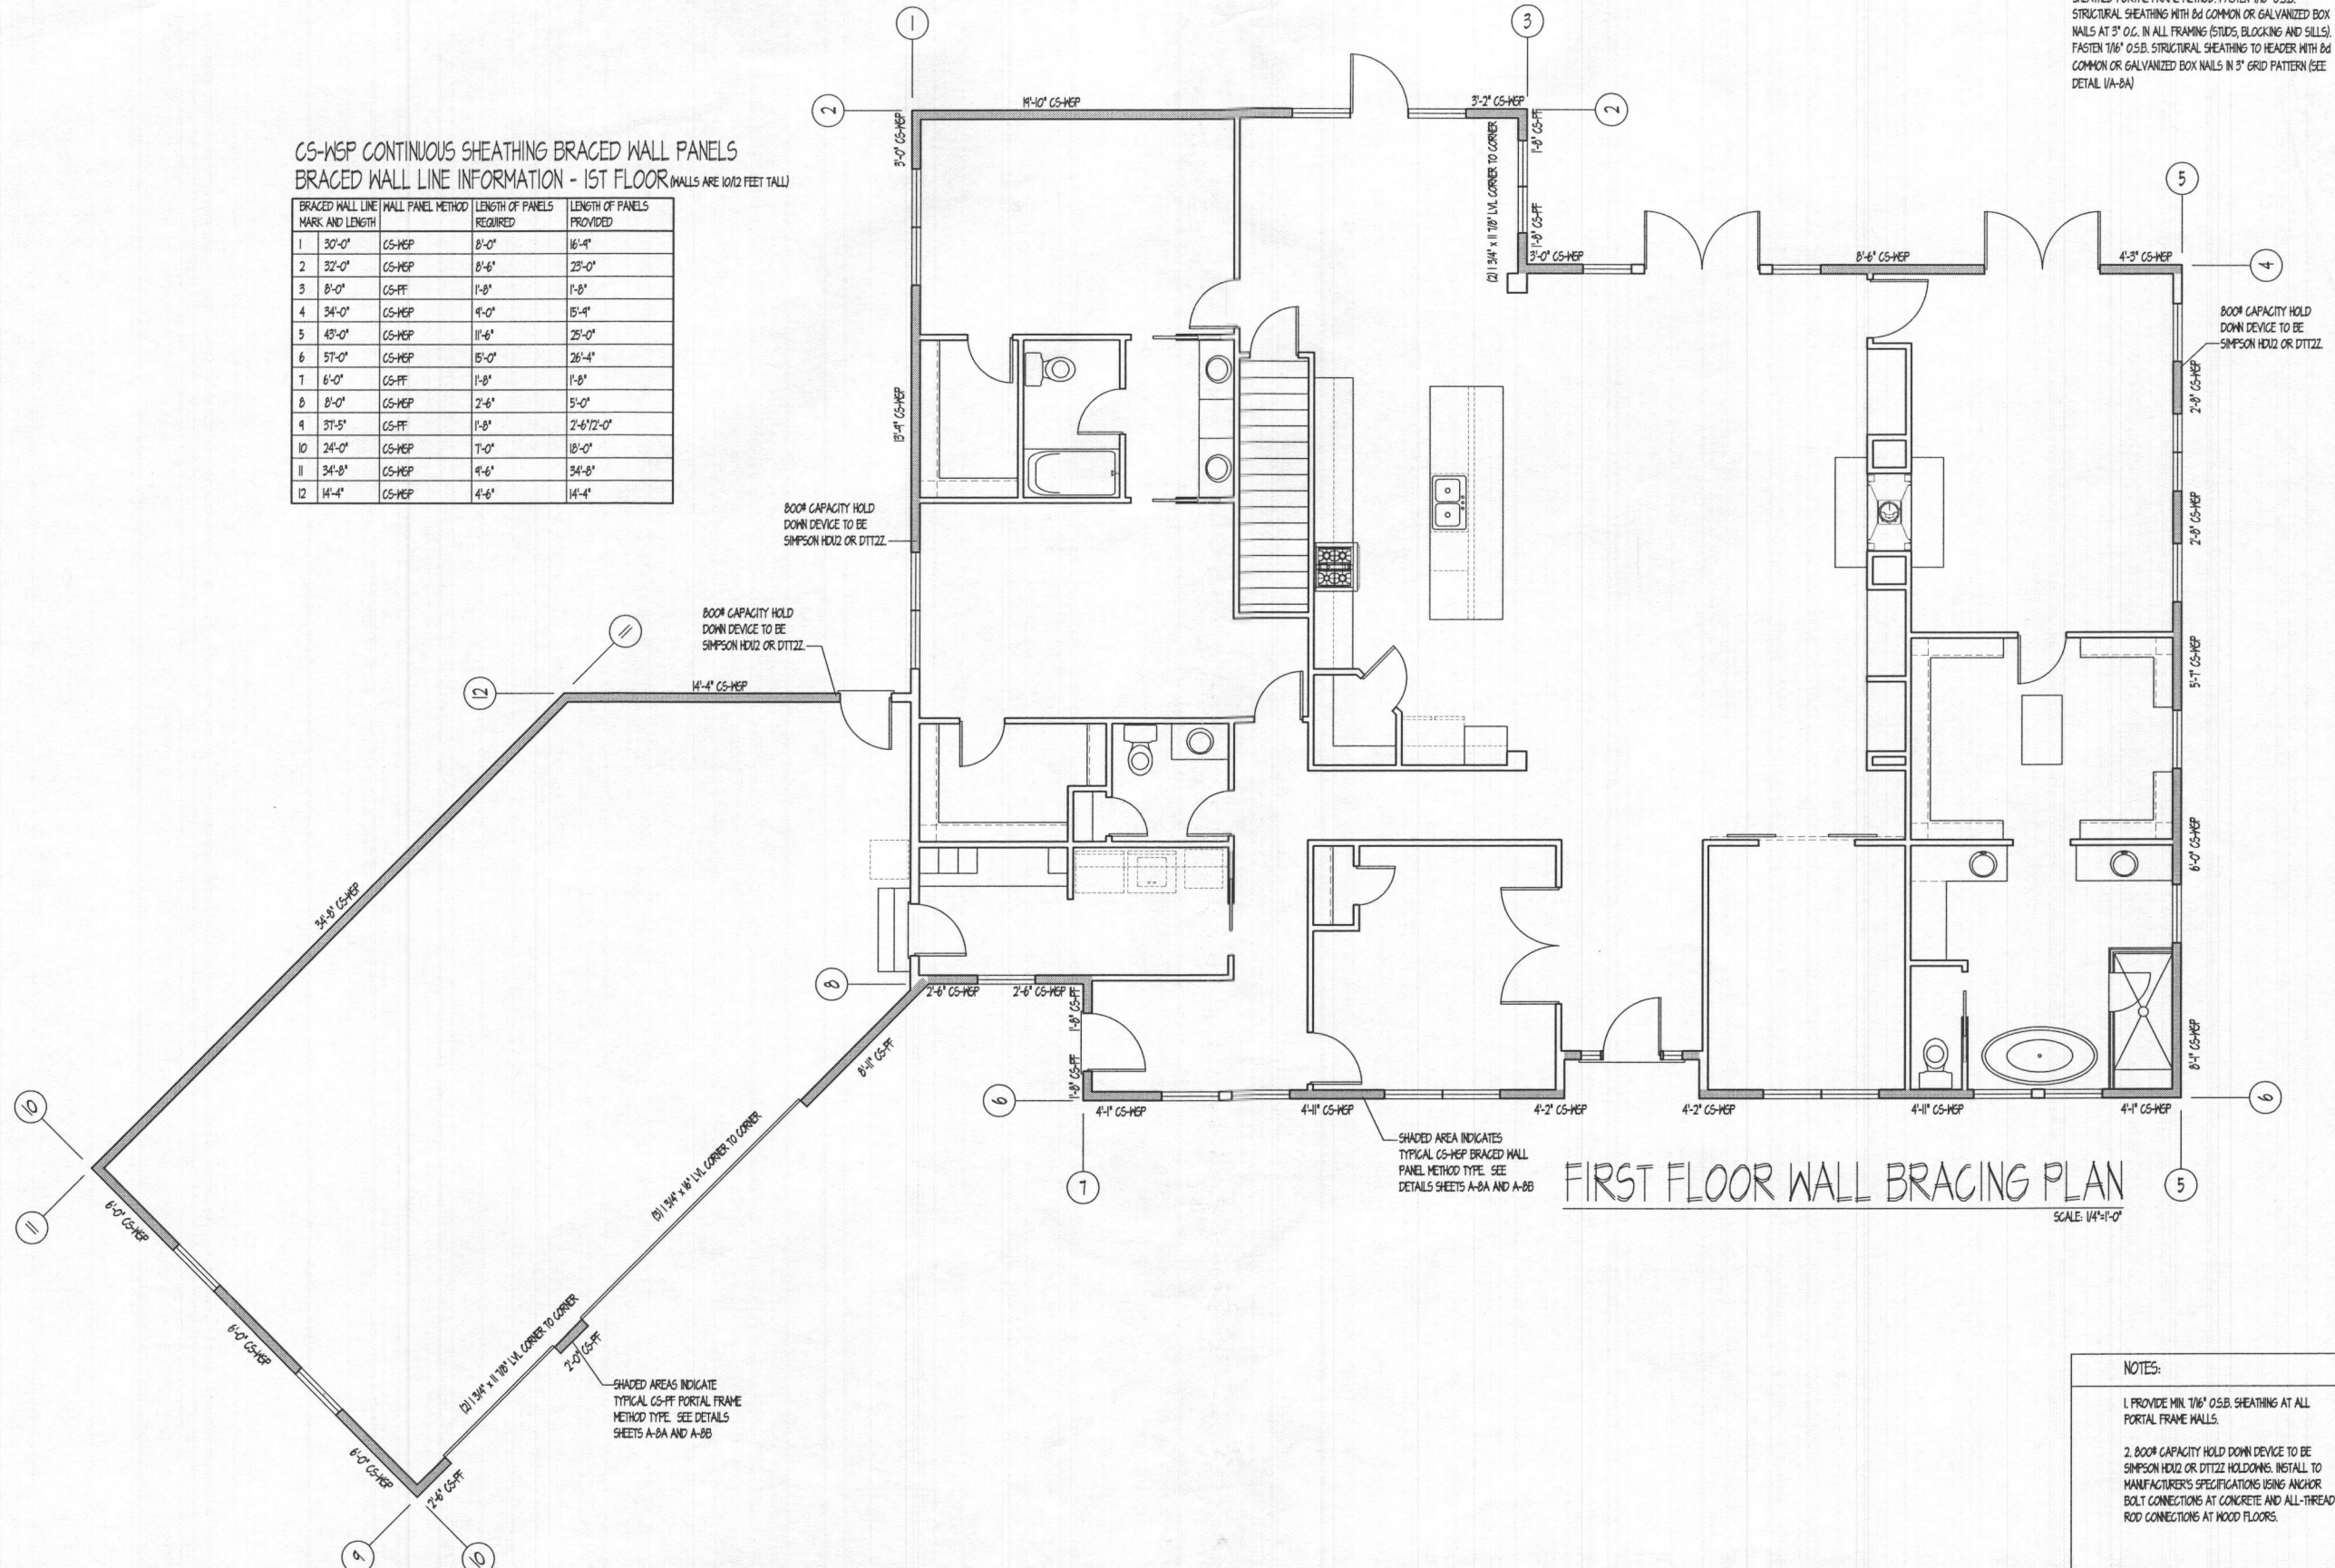

FIRST FLOOR WALL BRACING PLAN
SCALE: 1/4"=1'-0"

ALL NEW EXTERIOR WALLS (UNLESS NOTED OTHERWISE) SHALL BE CONSTRUCTED IN ACCORDANCE TO THE CONTINUOUSLY SHEATHED WOOD STRUCTURAL PANEL (CS-WEP) METHOD. FASTEN 1/8" OSB. STRUCTURAL SHEATHING WITH 8d COMMON OR GALVANIZED BOX NAILS 6" O.C. AT PANEL EDGES AND 12" O.C. IN THE FIELD.

IF WALL IS IDENTIFIED AS A PORTAL FRAME WALL THEN IT SHALL BE CONSTRUCTED IN ACCORDANCE TO THE CONTINUOUSLY SHEATHED PORTAL FRAME METHOD. FASTEN 1/8" OSB. STRUCTURAL SHEATHING WITH 8d COMMON OR GALVANIZED BOX NAILS AT 3" O.C. IN ALL FRAMING (STUDS, BLOCKING AND SILLS). FASTEN 1/8" OSB. STRUCTURAL SHEATHING TO HEADER WITH 8d COMMON OR GALVANIZED BOX NAILS IN 3' GRID PATTERN (SEE DETAIL VA-8A)

- NOTES:
1. PROVIDE MIN 1/8" OSB. SHEATHING AT ALL PORTAL FRAME WALLS.
 2. BOOM CAPACITY HOLD DOWN DEVICE TO BE SIMPSON HDU2 OR DTTZZ HOLDINGS. INSTALL TO MANUFACTURER'S SPECIFICATIONS USING ANCHOR BOLT CONNECTIONS AT CONCRETE AND ALL-THREAD ROD CONNECTIONS AT WOOD FLOORS.




JB HOME DESIGN, LLC
9416 CONCORD COURT
BALTIMORE, MARYLAND 21284
OFFICE (410) 994-6871
FAX (410) 662-4464
EMAIL: JON@JBDESIGN.COM
VOICE DESIGN

C.E. Rentsberger & Family, Builder
1 South Main Street
Woodsboro, MD 21798
301-370-4042


RENTSBERGER & FAMILY BUILDER

FIRST FLOOR WALL BRACING PLAN
DATE: OTHER
SCALE: 1/4" = 1'-0"
PROJECT TITLE: WHITE RESIDENCE

SHEET NO. A-8C

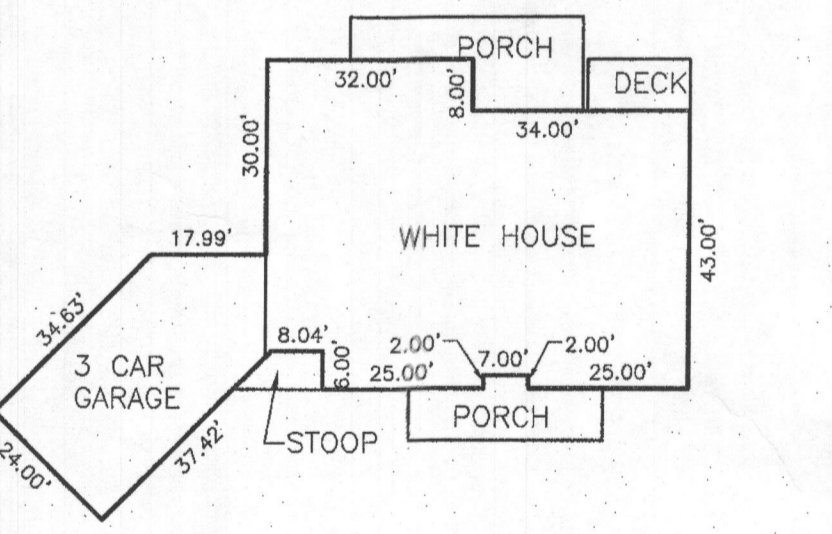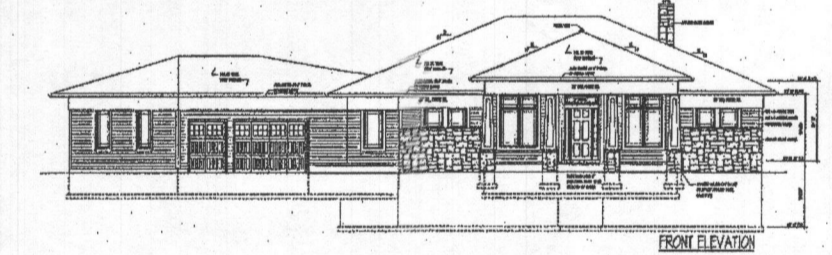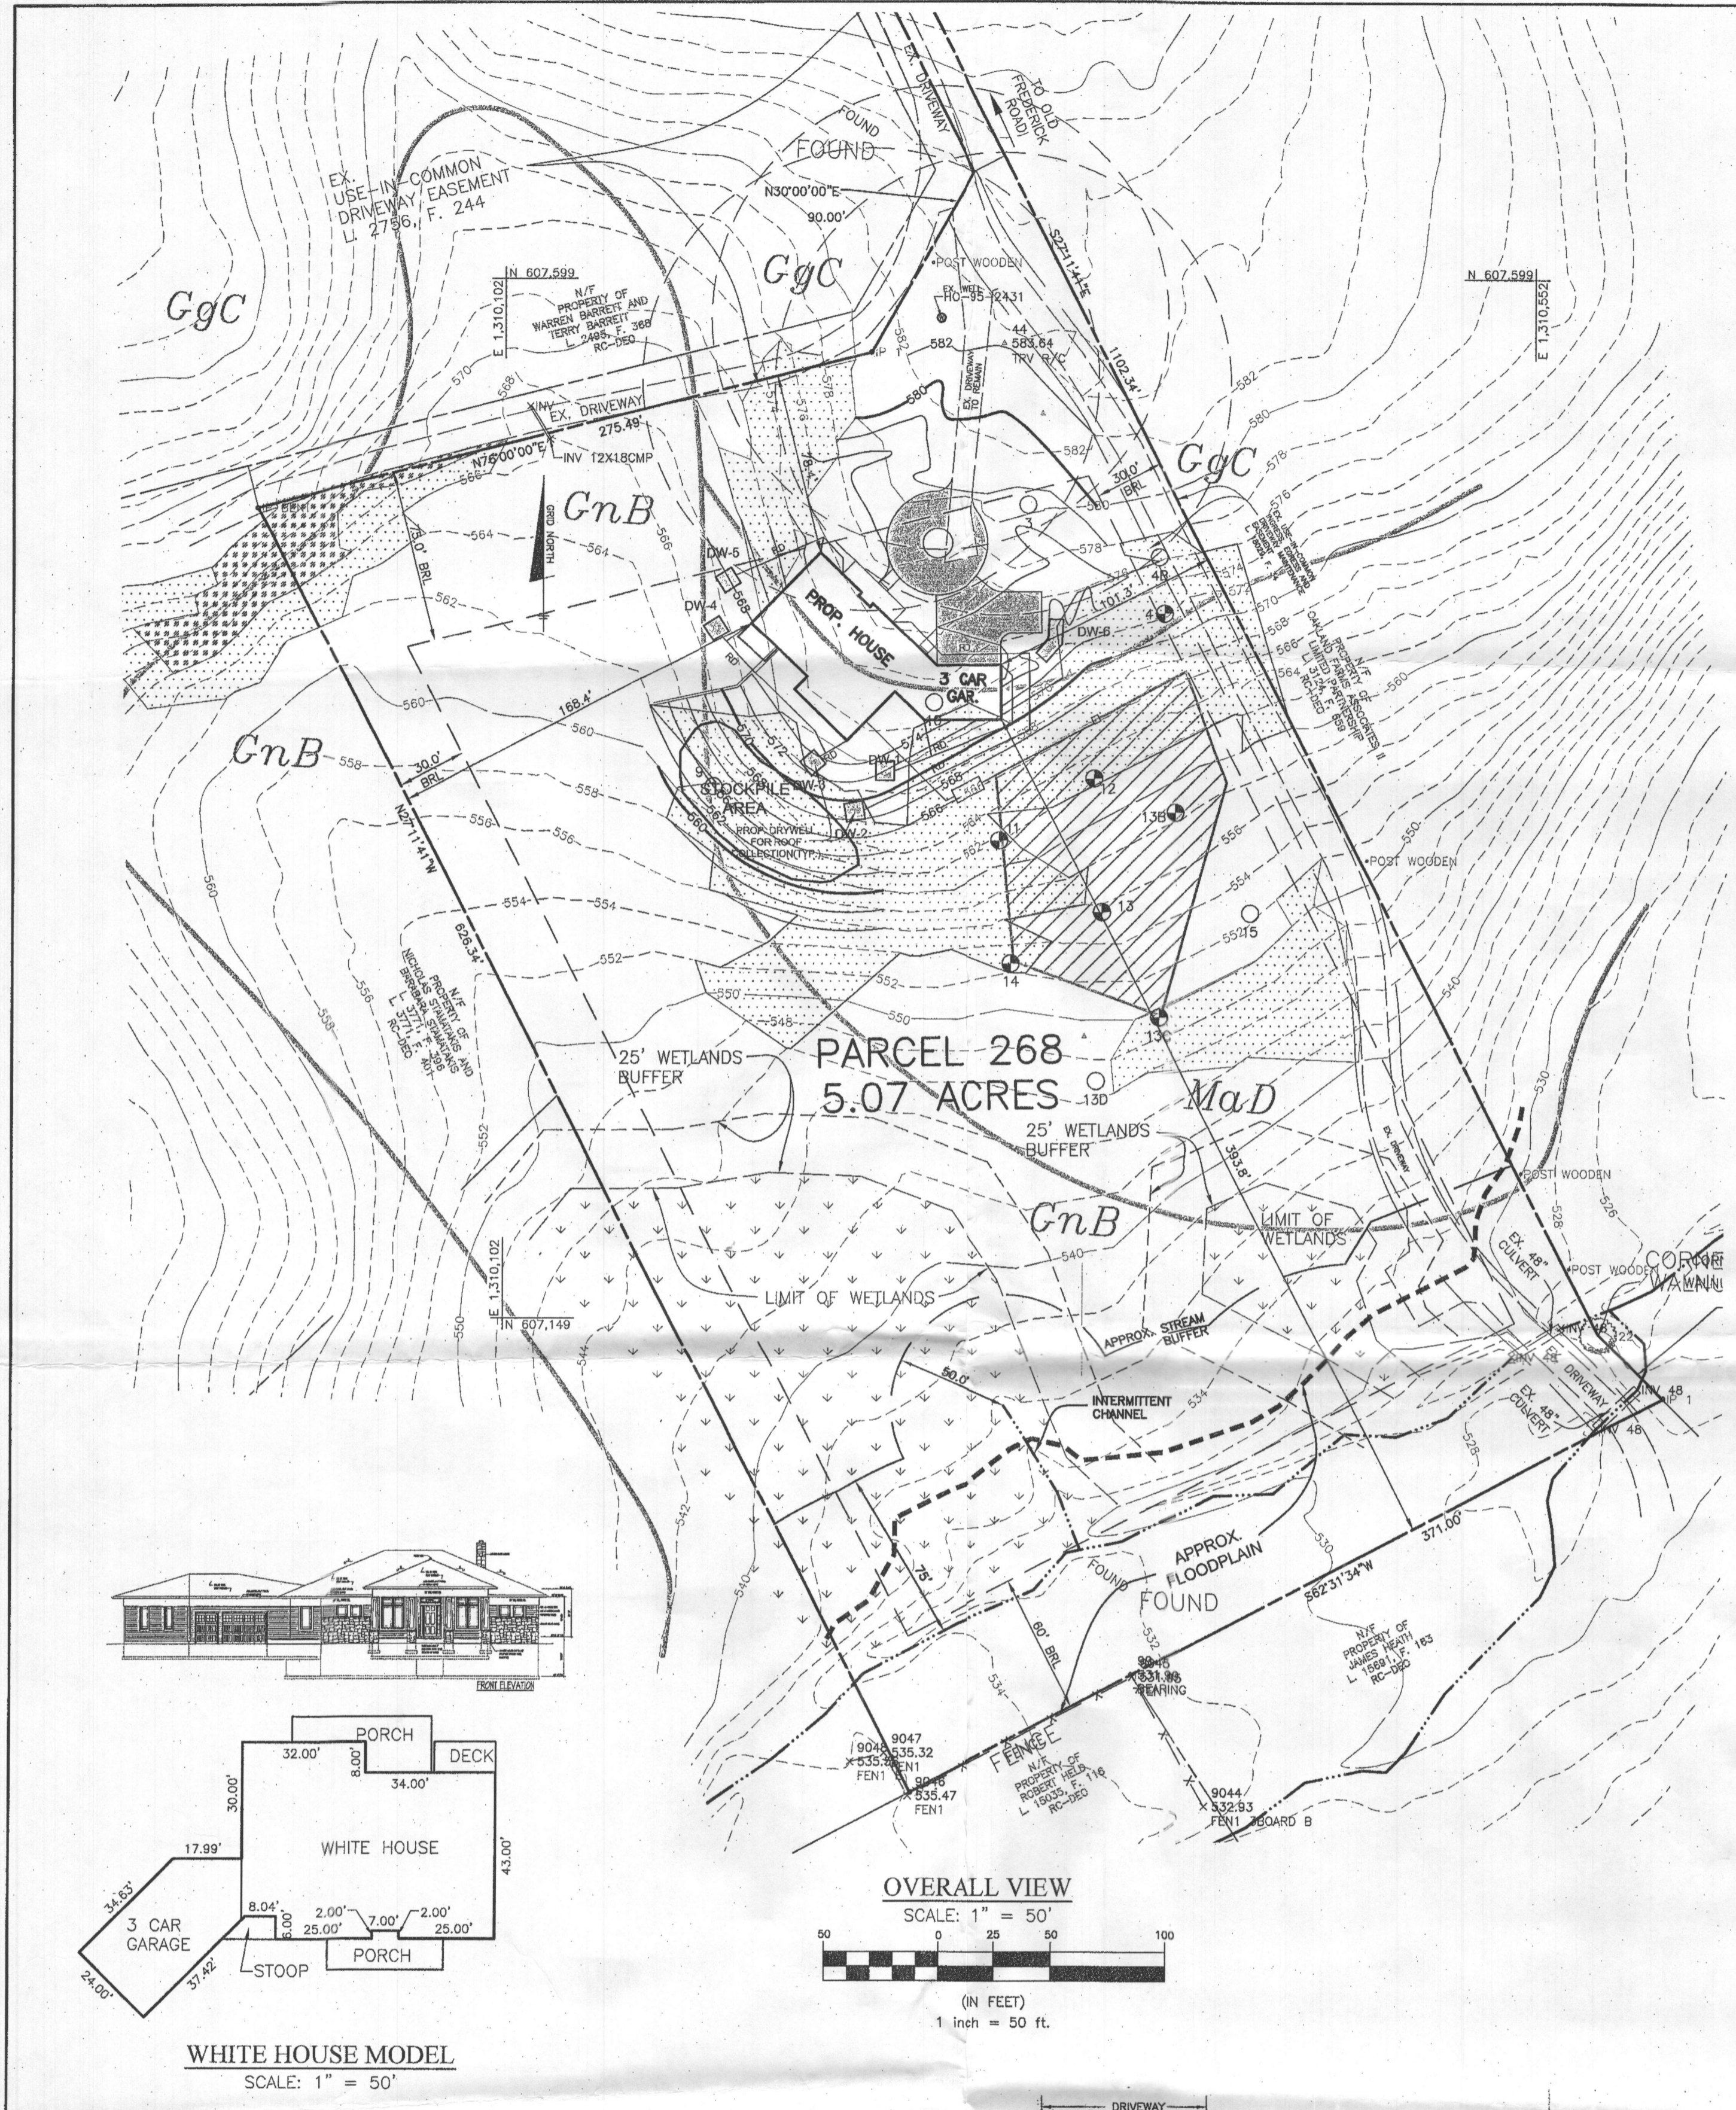

WHITE HOUSE MODEL
SCALE: 1" = 50'

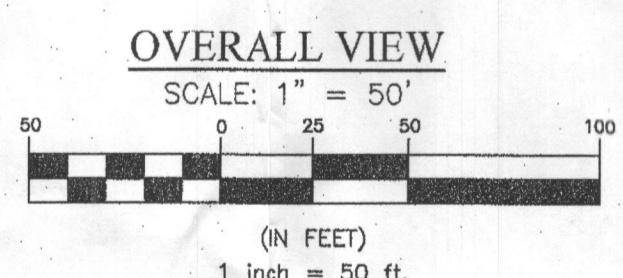


OVERALL VIEW
SCALE: 1" = 50'

ENGINEER'S CERTIFICATE
I CERTIFY THAT THIS PLAN FOR SEDIMENT AND EROSION CONTROL REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON MY PERSONAL KNOWLEDGE OF THE SITE CONDITIONS AND THAT IT WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT.
Al Malaga 7/30/19
ENGINEER DATE


DEVELOPER'S CERTIFICATE
I/WE CERTIFY THAT ALL DEVELOPMENT AND CONSTRUCTION WILL BE DONE ACCORDING TO THIS PLAN FOR SEDIMENT AND EROSION CONTROL, AND THAT ALL RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF THE ENVIRONMENT APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTION BY THE HOWARD SOIL CONSERVATION DISTRICT.
John K. Roberts 7/31/2019
DEVELOPER DATE

THIS DEVELOPMENT PLAN IS APPROVED FOR SOIL EROSION AND SEDIMENT CONTROL BY THE HOWARD SOIL CONSERVATION DISTRICT.
John K. Roberts 8/1/19
HOWARD SOIL CONSERVATION DISTRICT DATE

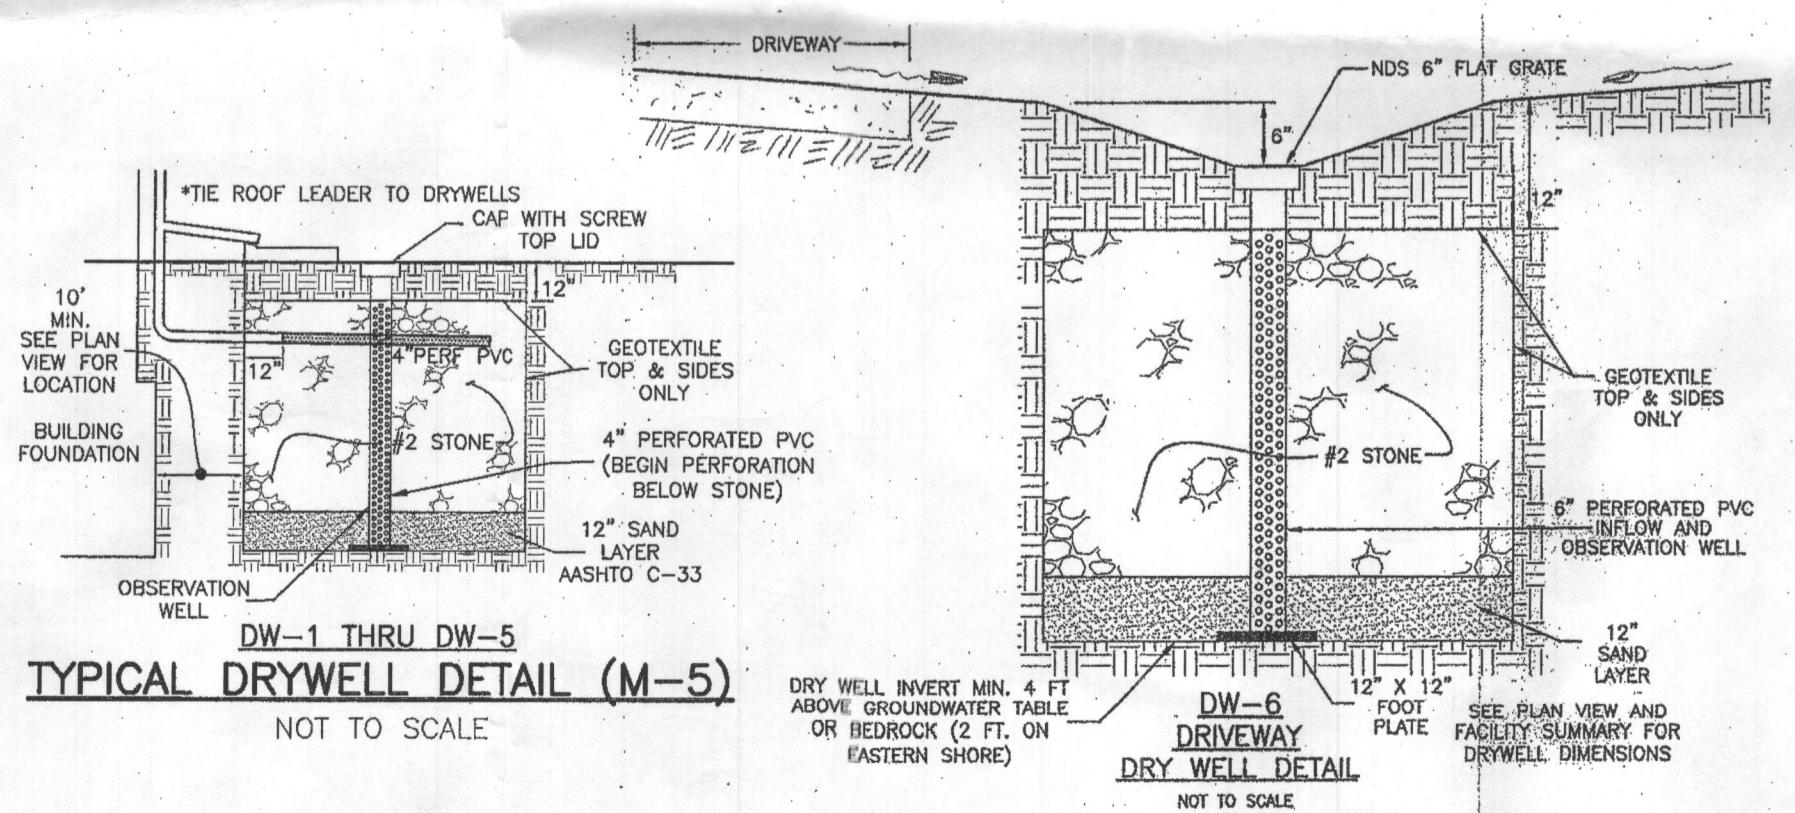

TYPICAL DRYWELL DETAIL (M-5)
NOT TO SCALE

DW-6 DRIVEWAY DRYWELL DETAIL
NOT TO SCALE

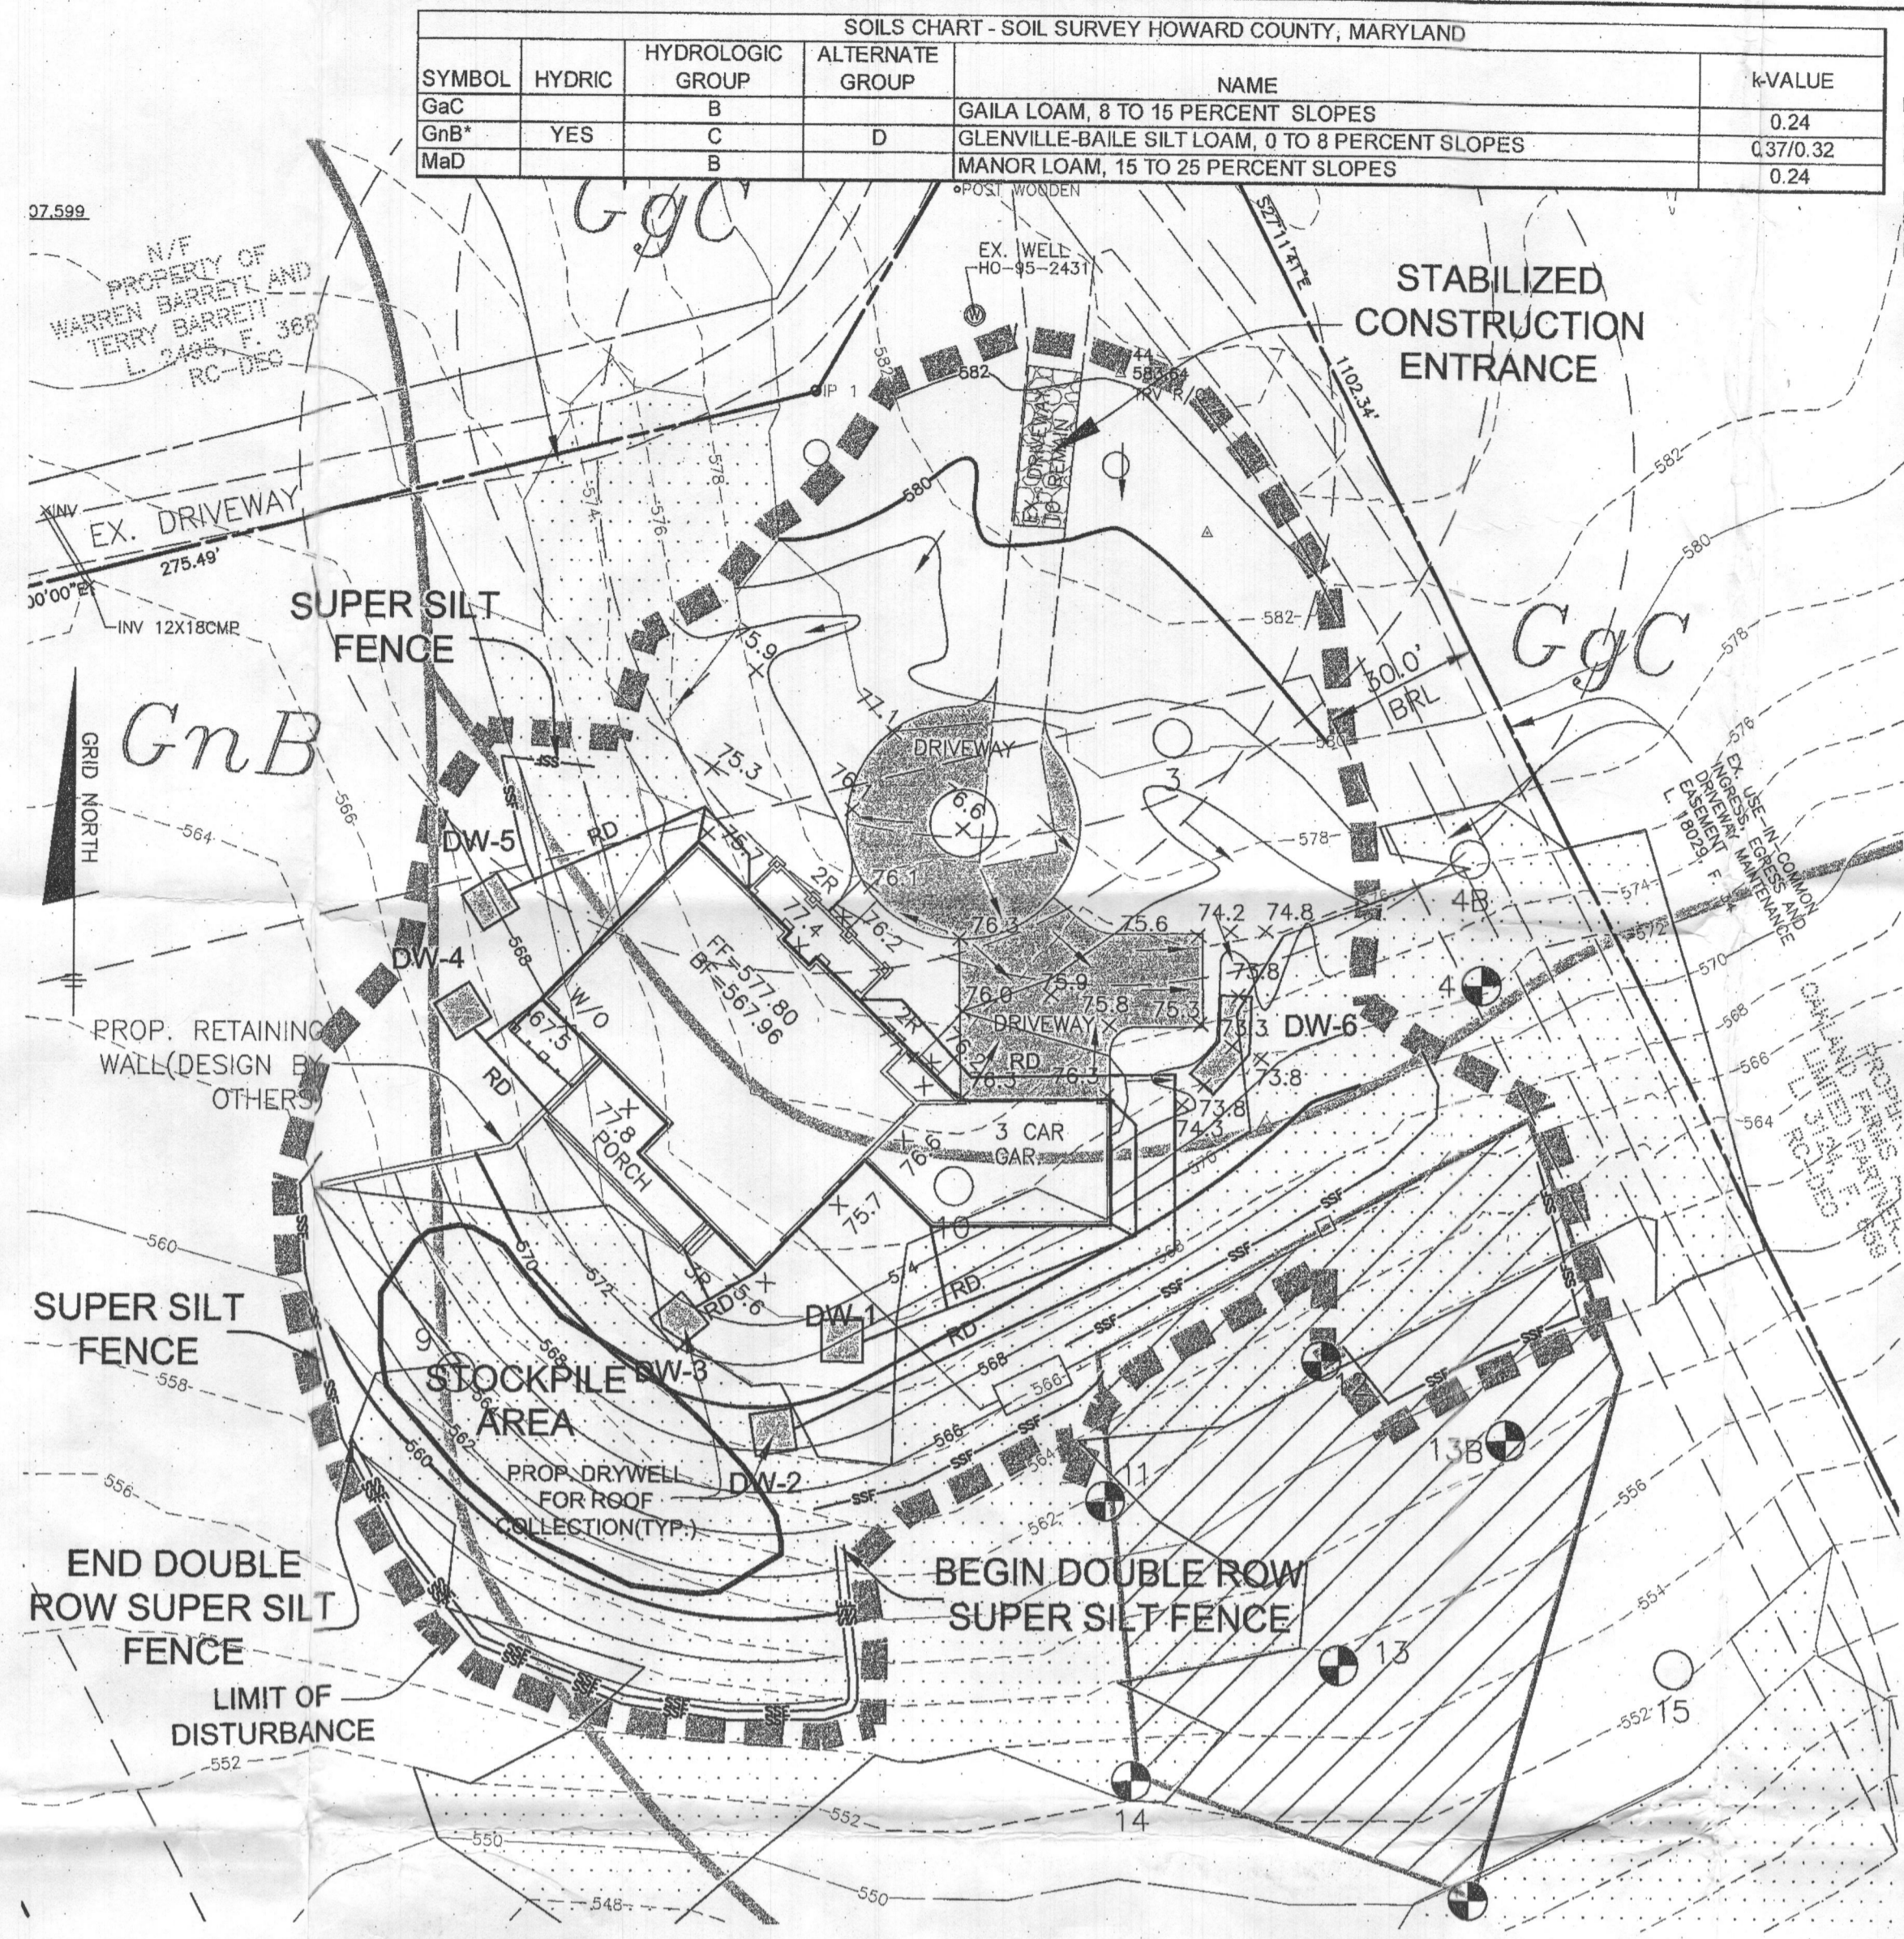

GRADING PLAN
SCALE: 1" = 30'


Approved Septic System
Howard County Health Department
6-Bed room Floor Plan
8/19/19
B19002629

STORMWATER MANAGEMENT PRACTICES			
ADDRESS	DRYWELLS(#)	ROOF TOP DISCONNECTS	NON-ROOF TOP DISCONNECTS
14285 OLD FREDERICK ROAD	YES(6)	0	1

PROPOSED ESD PRACTICES

Drywell Designation	Length (ft)	Width (ft)	Depth (ft)	Grade Low End	Top of Stone	Bottom of Stone
DW-1	8.00	8.00	4.00	569.8	568.8	564.8
DW-2	8.00	8.00	4.00	567.7	566.7	562.7
DW-3	8.00	8.00	4.00	572.0	571.0	567.0
DW-4	8.00	8.00	4.00	566.5	565.5	561.5
DW-5	8.00	8.00	4.00	567.6	566.6	562.6
DW-6	19.00	6.00	4.00	573.3	572.3	568.3

NON-ROOFTOP DISCONNECTS				
FACILITY	Disconnect Area	Receiving Area	Pe Treated	Volume Treated
N-2	962	1216	1"	80
TOTAL:				80/CF

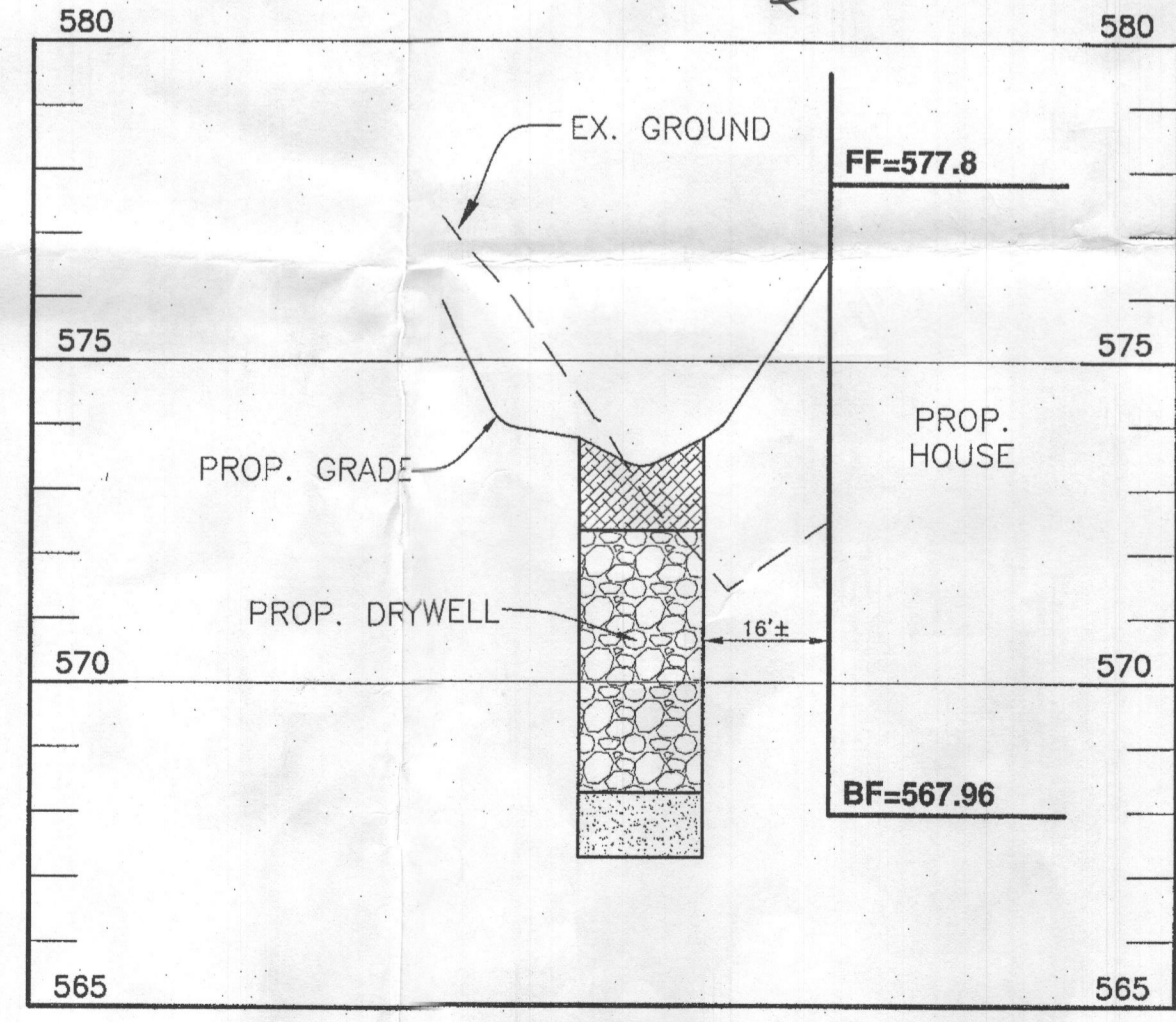


DW-6 PROFILE
SCALE: HOR: 1" = 30'
VERT: 1" = 3'

OPERATION AND MAINTENANCE SCHEDULE FOR PRIVATELY OWNED AND MAINTAINED STORMWATER DRY WELLS (M-5)

- The monitoring wells and structures shall be inspected on a quarterly basis and after every large storm event.
- Water levels and sediment build up in the monitoring wells shall be recorded over a period of several days to assess trends drainage.
- A log book shall be maintained to determine the rate at which dry wells drain.
- When the facility becomes clogged so that it does not drain down within the 72 hour time period, corrective action shall be taken.
- The maintenance log book shall be available to Howard County for inspection to insure compliance with operation and maintenance criteria.
- Once the performance characteristics of the infiltration facility have been verified, the monitoring schedule can be reduced to an annual basis unless the performance data indicates that a more frequent schedule is required.

OPERATION AND MAINTENANCE SCHEDULE FOR PRIVATELY OWNED AND MAINTAINED DISCONNECT OF ROOF TOP RUNOFF (N-1), DISCONNECT OF NON-ROOFTOP RUNOFF (N-2)

- Maintenance of areas receiving disconnected runoff is generally no different than that required for other lawn or landscaped areas. The Owner shall ensure the areas receiving runoff are protected from future occupation or development of impervious areas. In commercial areas, foot traffic should be discouraged as well.

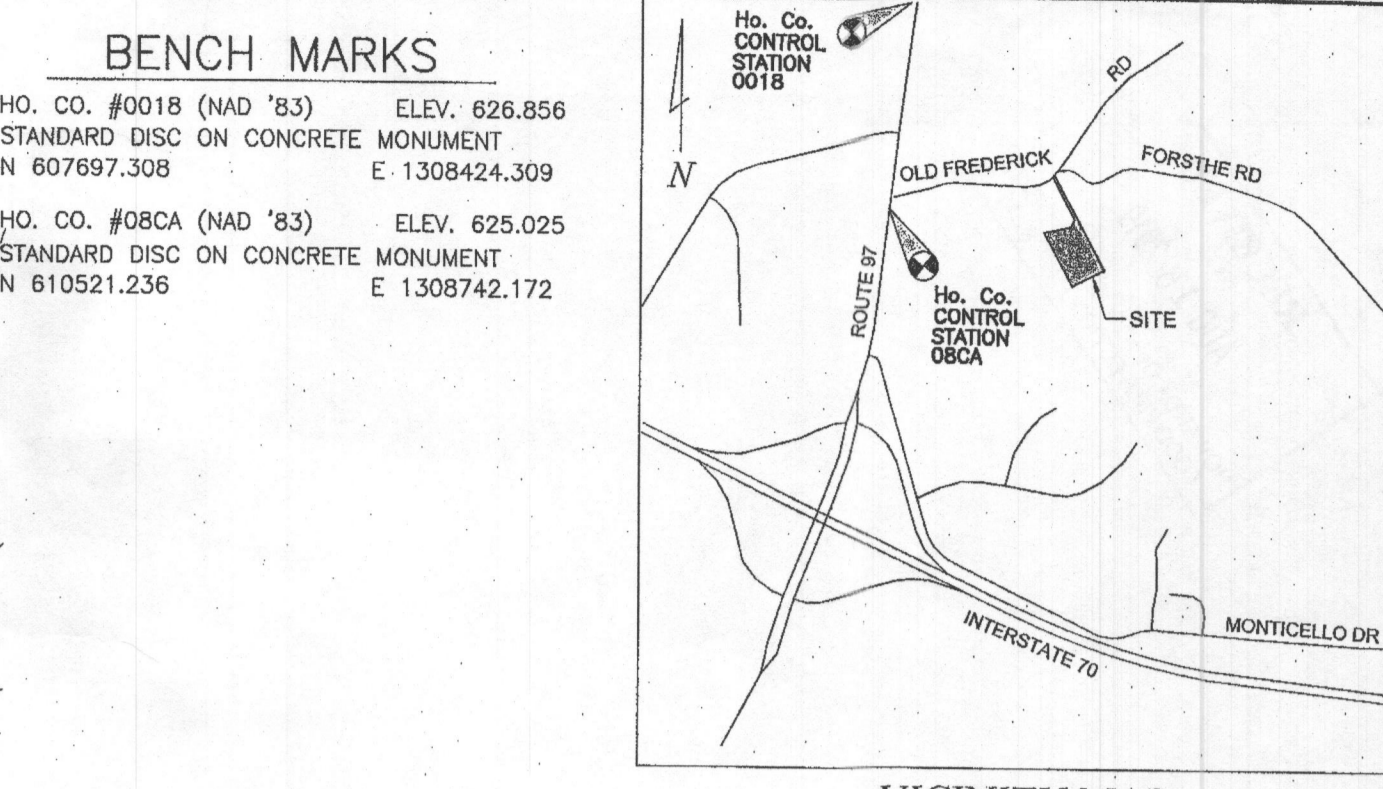

VICINITY MAP
SCALE: 1" = 2000'
ADC MAP 10 GRID C-6

GENERAL NOTES

- THE LOTS SHOWN HEREON COMPLY WITH THE MINIMUM OWNERSHIP WIDTH AND LOT AREA AS REQUIRED BY THE MARYLAND STATE DEPARTMENT OF THE ENVIRONMENT.
- COORDINATES BASED ON NAD 83 MARYLAND COORDINATE SYSTEM AS PROJECTED BY HOWARD COUNTY GEODETIC CONTROL STATIONS 09HA AND 09DB.
- SUBJECT PROPERTY ZONED RC-DEO PER THE 10-06-13 COMPREHENSIVE ZONING PLAN.
- THE BOUNDARY IS BASED ON A FIELD RUN BOUNDARY SURVEY PERFORMED ON OR ABOUT APRIL 2018 BY BENCHMARK ENGINEERING, INC.
- TOPOGRAPHY SHOWN IS BASED ON A FIELD SURVEY PERFORMED BY SHANABERGER & LANE DATED MARCH 2010, AND HOWARD COUNTY GIS.
- THERE ARE NO WETLANDS OR FLOODPLAIN LOCATED IN THE AREA OF DEVELOPMENT BASED ON A FIELD INVESTIGATION.
- FOREST STAND DELINEATION FOR THE AREA OF DEVELOPMENT WAS PREPARED BY BENCHMARK ENGINEERING, INC. DATED MAY, 2019. THERE ARE NO FOREST RESOURCES IN THE AREA OF DEVELOPMENT.
- THE STORMWATER MANAGEMENT SHOWN IS CONCEPTUAL. ADDITIONAL STORMWATER MANAGEMENT, IF REQUIRED FOR THE PROPOSED UNIT WILL BE PROVIDED WITH THE BUILDING PERMIT PLAN.
- THE FOREST CONSERVATION OBLIGATIONS WILL BE FULFILLED BY CLEARING LESS THAN 20,000SF OF FOREST. A DECLARATION OF INTENT (DOI) HAD BEEN EXECUTED BY THE OWNER.
- APPROXIMATE FLOODPLAIN LIMITS ARE BASED ON A "NON-CRITICAL" ANALYSIS.
- SWM TEST PITS PROVIDED BY OTHERS.
- WETLANDS SHOWN ARE BASED ON A DELINEATION PREPARED BY ECO-SCIENCE PROFESSIONALS, INC. DATED JULY 1, 2019.
- PER SECTION 16.116(c)-NO GRADING, REMOVAL OF VEGETATIVE COVER AND TREES, PAVING AND NO NEW STRUCTURES SHALL BE PERMITTED IN THE WETLANDS OR STREAM OR THEIR BUFFERS. THE EXISTING DRIVEWAY PER-DATES THE WETLANDS DELINEATION REPORT AND SHALL NOT BE EXPANDED WITHIN THE WETLANDS, STREAM OR THE BUFFERS.
- DRIVEWAYS SHALL BE PROVIDED PRIOR TO RESIDENTIAL OCCUPANCY TO ENSURE SAFE ACCESS FOR FIRE AND EMERGENCY VEHICLE PER THE FOLLOWING MINIMUM REQUIREMENTS:
 - WIDTH - 12 FEET (16 FEET SERVING MORE THAN ONE RESIDENCE);
 - SURFACE - 6 INCHES OF COMPACTED CRUSHER RUN BASE WITH TAR AND CHIP COATING (1-1/2" MINIMUM);
 - GEOMETRY - MAXIMUM 15% GRADE, MAXIMUM 10% GRADE CHANGE AND 45 FOOT TURNING RADIUS;
 - STRUCTURES (CULVERTS/BRIDGES) - CAPABLE OF SUPPORTING 25 GROSS TONS (125 TONS);
 - DRAINAGE ELEMENTS - CAPABLE OF SAFELY PASSING 100-YEAR FLOOD WITH NO MORE THAN 1 FOOT DEPTH OVER SURFACE;
 - STRUCTURE CLEARANCE - MINIMUM OF 12 FEET;
 - MAINTENANCE - SUFFICIENT TO ENSURE ALL WEATHER USE.

LEGEND

- EXISTING CONTOURS: 352, 350
- LIMIT OF DISTURBANCE: [Symbol]
- EX. SEPTIC EASEMENT: [Symbol]
- ESD DRAINAGE DIVIDES: [Symbol]
- PROPOSED HOUSE: [Symbol]
- NEW DRIVEWAY: [Symbol]
- PROPOSED DRYWELLS: [Symbol]
- WETLANDS: [Symbol]
- STEEP SLOPES-25% OR GREATER: [Symbol]
- SOIL BOUNDARY: [Symbol]
- SOILS DELINEATION: GnA
- SUPER SILT FENCE: [Symbol]

BENCHMARK ENGINEERING, INC.
ENGINEERS, LAND SURVEYORS, PLANNERS
8480 BALTIMORE NATIONAL PIKE SUITE 315 ELLCOTT CITY, MARYLAND 21043
(P) 410-465-6105 (F) 410-465-6644
WWW.BEI-CIVILENGINEERING.COM

Professional Certification: I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 32198 (Date: 6-30-2021).

OWNER: VICTOR WHITE, 199 BAUGHMANS LANE, FREDERICK, MARYLAND 21702, 443.468.6442

DEVELOPER: VICTOR WHITE, 199 BAUGHMANS LANE, FREDERICK, MARYLAND 21702, 443.468.6442

14285 OLD FREDERICK ROAD PROPERTY

TAX MAP: 8 - GRID: 17 - PARCEL: 268
ZONED: RC-DEO
ELECTION DISTRICT NO. 4 - HOWARD COUNTY, MARYLAND

GRADING AND BUILDING PERMIT PLAN

DATE: JULY 2019 | BEI PROJECT NO. 2900
SCALE: AS SHOWN | SHEET 1 OF 2