

**COMPLETE THIS FORM WHEN DROPPING OFF ANY  
CORRESPONDENCE AND/OR PLANS TO THE HOWARD COUNTY  
DEPARTMENT OF INSPECTIONS, LICENSES AND PERMITS COUNTER:**

Date: 8/11/2022       ONLINE SUBMITTAL       PAPER SUBMITTAL

To: PLAN REVIEW (Reviewer/Requestor's Name)      (Division)

From: JIM BRUMSTED (Your Name, Company Name)      410-977-5705 (Phone Number)

Subject: Project name PALOS-SUCIU ADDITION  
 Project site address 6570 PRESTWICK DRIVE HIGHLAND MD.  
 Permit # B22002917      SDP # \_\_\_\_\_  
 Other information pertinent to this project \_\_\_\_\_

Please check the attachments below that you are submitting with this transmittal:

- Letter of response to address plan review comment letter
- Revised plans and/or revised details: When submitting for a complete re-review, **duplicate sets shall be submitted.**
- Letter Summarizing Changes
- Energy conservation calculations
- Copies of (3) SITE PLANS (3) BLD PLANS (be specific).
- Health Department Request       DPZ/ DED Request       Applicant's Request
- Two sets of single-family model plans to be placed on permanent file: Model name and/or # \_\_\_\_\_
- Other \_\_\_\_\_


**Contact Person Information: (Required)**

JIM BRUMSTED      Telephone No: 410 977 5705  
 Please Print Name      E-Mail Address: Jim@AllanHomes.com

**PLEASE ASSURE ALL DOCUMENTS AND/OR REVISIONS ARE APPROPRIATELY SIGNED AND SEALED, IF NECESSARY, BY A LICENSED ARCHITECT OR ENGINEER. PLEASE BE ADVISED THAT INSUFFICIENT INFORMATION MAY RESULT IN THE DELAY OF REVIEW BY THE PLANS EXAMINER. THE DEPARTMENT OF INSPECTIONS, LICENSES AND PERMITS WILL CONTACT YOU IF THERE IS A PROBLEM. IN ADDITION, ONCE THE BUILDING PERMIT IS APPROVED BY THE PLAN REVIEW DIVISION AND ALL OTHER REQUIRED SIGNATORY AGENCIES, AND THE BUILDING PERMIT IS READY FOR ISSUANCE, THE PERMIT DIVISION WILL NOTIFY THE APPROPRIATE CONTACT PERSON FOR PERMIT PICK UP. ALL PERMIT STATUS INQUIRIES SHALL BE DIRECTED TO THE PERMIT DIVISION AT 410-313-2455 OPTION #4 OR BY VISITING MYHOWARD.INFO. CODE RELATED QUESTIONS AND PLAN REVIEW INQUIRIES SHALL BE DIRECTED TO THE PLAN REVIEW DIVISION AT 410-313-2436. PLEASE ALLOW A MINIMUM OF FIVE (5) WORKING DAYS FOR ANY PLAN SUBMITTALS TO BE REVIEWED. THANK YOU.**

Received by JA  
 White-Plan Review / Yellow-Applicant / Pink-Permit Division  
 t:\Operations\Updated forms\HoCoTransmittalForm05.2022

*CC: Health Dept*  
 2022 AUG 11 10:05

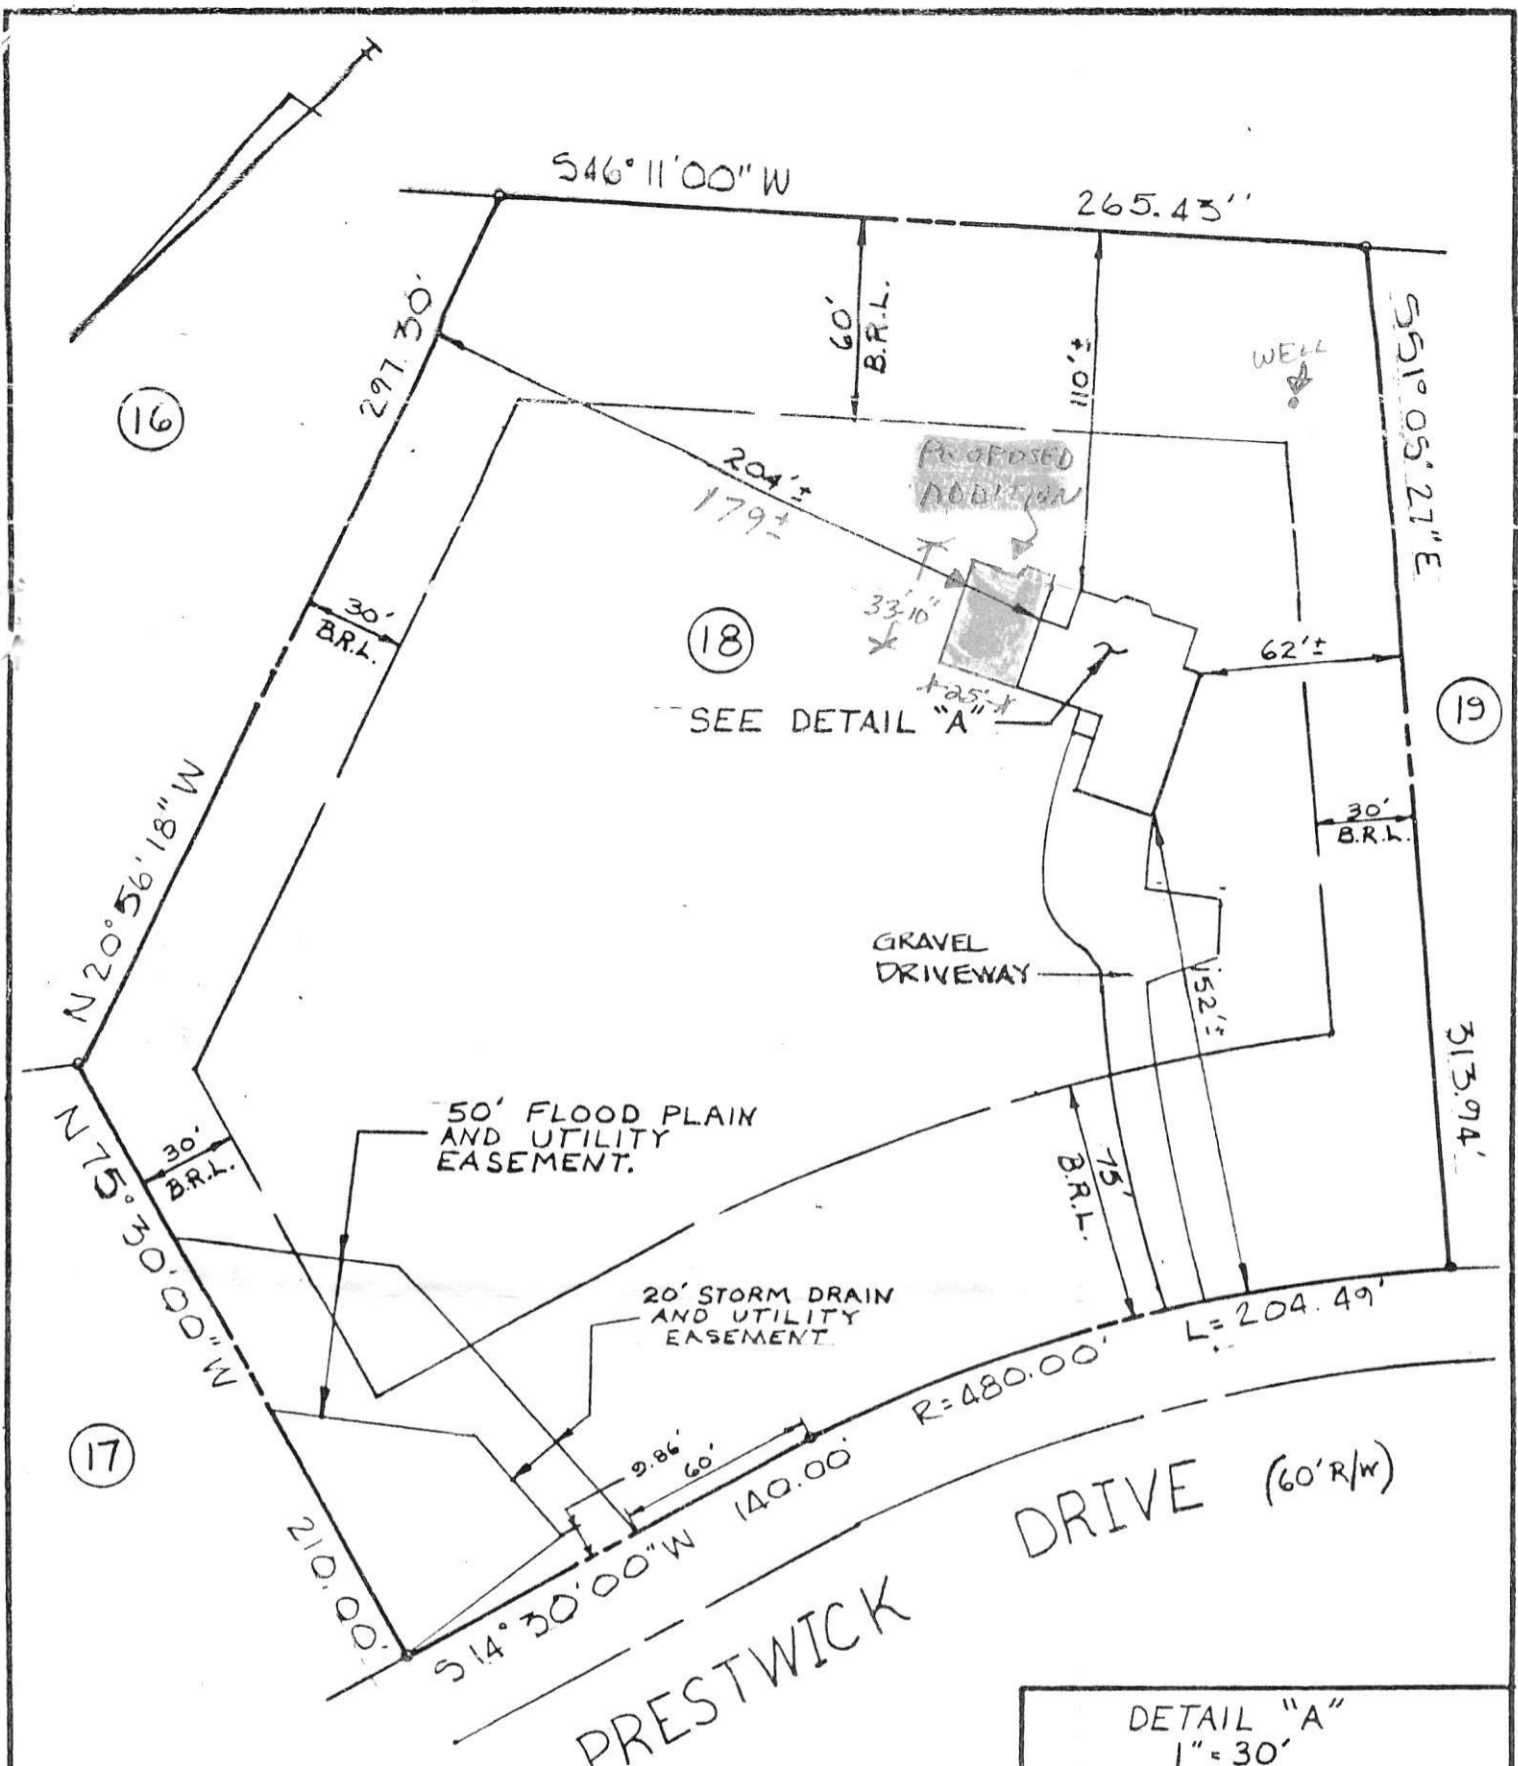


I hereby certify that I have made a survey of this lot for the purpose of locating the improvements thereon and that they are located as shown.

This plat is not intended for use in establishing property lines.

12/17/87  
Date

*J. W. McKee*  
JAMES W. MCKEE Reg. #9012

DEED REF: 1487/239  
LOT 18 SEC. 1  
"GREENE FIELDS"  
Δ 6672  
5TH ELECT. DIST.  
HOWARD Co., MD.

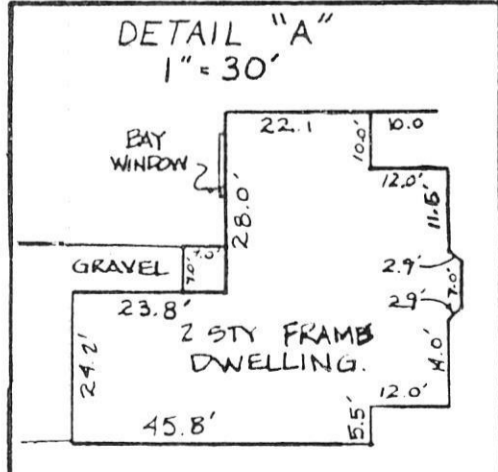

drawn by E.M.T. checked by JG

**LOCATION SURVEY**  
LOT 18 PRESTWICK DRIVE

**MCKEE & ASSOCIATES, INC.**

CIVIL ENGINEERS • LAND SURVEYORS  
5 SHAWAN ROAD HUNT VALLEY, MD 21030  
252-5820

scale:  
1" = 60'

date:  
12/17/87

job no:  
M-505

# 2021 IECC CODE COMPLIANCE

R301.1 Climate zone 4A

R401.2 Compliance Method: Mandatory and Prescriptive Provisions

R402.1.1 Vapor Retarder: Wall assemblies in the building thermal envelope shall comply with vapor retarder requirements of Section R702.7 of the International Residential Code, 2015 Edition.

R402.1.2 Attic Insulation: Raised Heel Trusses R-49 R-38

R402.1.2 Wood Frame Wall: R-20 or R13 + R5 continuous insulation.

R402.1.2 Basement Wall Insulation: R-13/R-10 Foil Faced Continuous, uninterrupted Balts Full Height

R402.1.2 Crawl Space Wall Insulation: R-13/R-10 Foil faced Continuous Balts Full Height extending from floor above to finishgrade level and then vertically or horizontally an additional 2'-0".

R402.1.2 Floor Insulation over Unconditioned Space: R-19 batt insulation.

R402.1.2 Window U-Value/SHGC .35 (U-Value)/.40 (SHGC)

R402.2.10 Slab on Grade Floors Less Than 12" Below Grade: R-10 Rigid Foam Board Under Slab Extending Either 2'-0" Horizontally or 2'-0" Vertically

R402.2.4 Attic Access: Attic access scuttle will be weatherstripped and insulated R-49

R402.4 Building Thermal Envelope (air leakage): Exterior walls and penetrations will be sealed per this section of the 2015 IECC with caulk, gaskets, weatherstripping or an air barrier of suitable material. Sealing methods between dissimilar materials shall allow sealing for differential expansion and contraction.

R402.4.1.2 Building Thermal Envelope Tightness Test: Building envelope shall be tested and verified as having an air leakage rate of not exceeding 3 air changes per hour. Testing shall be conducted in accordance with ASTM E779 or ASTM E 1827 with (blower door) at a pressure of 0.2 inches w.g. (50 pascals). Testing shall be conducted by an approved third party. A written report of the results of the test shall be signed by the party conducting the test and provided to the building inspector. 7/15

R402.4.2 Fireplaces: New wood burning fireplaces will have tight-fitting flue dampers or doors, and outdoor combustion air. Fireplace doors shall be listed and labeled in accordance with UL 127 (factory built fireplace) and UL 907 (masonry fireplace).

R402.4.4 Rooms containing fuel-burning appliances where open combustion air ducts provide combustion air to open combustion fuel burning appliances, the appliances and combustion air shall be located outside the building thermal envelope or enclosed in a room isolated from inside the thermal envelope. Exceptions: 1. Direct vent appliances with both intake and exhaust pipes installed continuous to the outside. 2. Fireplaces and stoves complying with Section R402.4.2 and Section R1006 of the IRC. ++++

R402.4.5 Recessed Lighting: Recessed luminaires installed in the building thermal envelope shall be sealed to limit air leakage.

R403.1.1 Thermostat: All dwelling units will have at least (1) programmable thermostat for each separate heating and cooling system per 2015 IECC Section 403.1.1.

R403.1.2 Where a Heat pump system having supplementary electric resistance heat is used the thermostat shall prevent the supplementary heat from coming on when heat pump can meet heating load.

R403.3.1 Mechanical Duct Insulation: Supply and Return Ducts in Attic R-8 minimum, R-6 when less than 3 inches. Supply and Return Ducts outside of conditioned spaces R-8 minimum. All other ducts except those located completely inside the building thermal envelope R-6 minimum. Ducts located under concrete slabs must be R-6 minimum.

R403.3.2 Duct Sealing: All ducts, air handlers, filter boxes will be sealed. Joints and seams will comply with section M1601.4.1 of the IRC. A duct tightness test ("Duct Blaster" duct total leakage test) will be performed on all homes and shall be verified by either a post construction test or a rough-in test. Duct tightness test is not required if the air handler and all ducts are located within the conditioned space.

R403.6 Mechanical Ventilation: Outdoor (make-up and exhausts) air ducts to be provided with automatic or gravity damper that close when the ventilation system is not operating.

R403.6.1 Whole-house mechanical ventilation system fan efficiency to comply with TABLE R403.6.1.

R403.7 Equipment Sizing shall comply with R403.7.

R404.1 Lighting Equipment: A minimum of 75% of all lamps (lights) must be high-efficacy lamps. This contractor also responsible for generating Certificate of Compliance and affixing to electrical panel or within 6 feet of the electrical panel and be readily visible.



*Matthew W. Anderson*  
6/21/2022

Note: PE Seal is for Structural Design Only.

Professional Certification: I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 31582 Expiration 04/04/2023

## GENERAL FRAMING NOTES

DOUBLE ALL FLOOR JOISTS UNDER WALLS ABOVE, THAT ARE FRAMED PARALLEL TO FLOOR FRAMING UNLESS NOTED OTHERWISE ON THE PLANS.

ALL FLOOR JOISTS, CEILING JOISTS & RAFTERS ARE TO BE S.P.F.

ALL BEAMS, GIRDERS AND HEADERS ARE TO BE DOUG. FIR LARCH #2 OR BETTER WITH A FB RATING OF 875 AND MODULUS OF ELASTICITY OF 1,600,000 MIN. UNLESS OTHERWISE NOTED.

ALL LAMINATED VENEER LUMBER (LVL) BEAMS, GIRDERS AND HEADERS LABELED ON THE PLANS, TO HAVE A FB RATING OF 2,950 AND MODULUS OF ELASTICITY OF 2,000,000 MIN. UNLESS OTHERWISE NOTED. STRUCTURAL LAMINATED BEAMS TO BE INSTALLED AS PER MANUFACTURERS SPECIFICATIONS.

ALL STRUCTURAL OPENINGS TO RECEIVE MIN. 3-2x10 HEADERS W/ 1/2" RIGID INSULATION FILLER & 1 JACK STUD EACH END UNLESS NOTED OTHERWISE.

PROVIDE SOLID 2x10 BLOCKING TO BE LOCATED BETWEEN FLOOR JOISTS WHERE POSTS, FROM ABOVE, CARRYING STRUCTURAL HEADERS LAND BETWEEN FLOOR JOIST BELOW. BLOCKING TO BE BUILT UP TO THE SAME WIDTH AS POST IT IS CARRYING ABOVE.

PROVIDE ADEQUATE CLEARANCE @ PLUMBING STACKS AS REQ.

ALL DIMENSIONS MUST BE VERIFIED IN THE FIELD BY THE CONTRACTOR BEFORE START OF CONSTRUCTION. ANY DISCREPANCIES ON THE PLANS, OR SPECIFICATIONS, MUST BE REPORTED TO THE ARCHITECT OR ENGINEER PRIOR TO THE START OF CONSTRUCTION.

ANY VARIATION FROM THESE PLANS THAT WILL REQUIRE CHANGES TO THE STRUCTURAL MEMBERS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT IMMEDIATELY.

WHERE APPLICABLE, REFER TO ENGINEERED LUMBER MFR'S SPECIFICATIONS FOR MULTI-MEMBER INSTALLATION & CONNECTION REQUIREMENTS

FASTEN MULTIPLE MEMBER JACKS TOGETHER W/ MIN. 10d NAILS @ 8" O.C. STAGGERED ALONG ENTIRE LENGTH OF MEMBERS. PROVIDE NAILING W/IN 3" OF TOP OR BOTTOM OF MEMBERS.

FASTEN MULTIPLE MEMBER BEAMS TOGETHER W/ MIN 16d NAILS @ 12" O.C. STAGGERED ALONG ENTIRE LENGTH OF MEMBERS. TWO ROWS REQUIRED FOR DEPTHS UP TO 12". THREE ROWS REQUIRED FOR DEPTHS OF 12-18". PROVIDE NAILING W/IN 22" OF EACH END OF MEMBERS. FOR BEAMS 7" OR GREATER IN WIDTH PROVIDE BOLTED CONNECTION W/ ASTM GRADE A-307 (OR BETTER) 1/2" DIA. BOLTS IN TWO ROWS 3" FROM EACH END OF BEAM @ 24" O.C. STAGGERED.

## DESIGN CRITERIA

CLIMATE AND GEOGRAPHIC DESIGN CRITERIA - table 301.2 (1)

GROUND SNOW LOAD (lbs./s.f.)	40	
WIND PRESSURE (pounds per square foot)	17 +/- ( 90 m.p.h.)	
SEISMIC CONDITION BY ZONE	B	
SUBJECT TO DAMAGE	WEATHERING	SEVERE
	FROST LINE DEPTH	30
	TERMITE	MODERATE
	DECAY	MODERATE
WINTER DESIGN TEMP. FOR HEAT. FACILITIES	13'	
RADON RESISTANT CONSTRUCTION REQ		
FLOOD ZONE		

## DRAWING LIST

0.01	COVER SHEET
0.02	GENERAL INFO
0.03	SIMPLIFIED PLANS
0.51	DEMO-FOUNDATION
1.01	ELEVATIONS
1.02	ELEVATIONS
2.01	FOUNDATION
3.01	FLOOR PLANS
3.02	FLOOR PLANS
3.03	FRAMING DETAILS
3.52	WALL BRACING DETAILS
4.01	ROOF PLAN
4.02	ROOF DETAILS
5.01	SECTIONS
5.02	SECTIONS
E3.01	ELECTRICAL PLANS

## AREA INFO

FLOOR	ADDITIONAL S.F.
BASEMENT	0 s.f.
FIRST FLOOR	872 s.f.
SECOND FLOOR	463 s.f.

## CODE INFORMATION

2021 International Residential Code  
2021 International Energy Conservation Code  
2021 International Mechanical Code  
2018 International Plumbing Code  
2021 NFPA 101 Life Safety Code  
2020 National Electrical Code (NFPA 70)  
2009 National Fuel Gas Code (NFPA 54)

- Contractor, sub-contractor or supplier shall verify all job conditions and measurements prior to commencing work or ordering materials. Discrepancies between dimensions shown on drawings and actual field conditions should be brought to the Architect and Owner's attention immediately for clarification prior to proceeding with work. These plans are not to be scaled for construction purposes. Written dimensions and notes supersede all scaled reference. If there are any conflicts, discrepancies or ambiguity with dimensioning the Contractor shall notify the Architect immediately for clarification. Field verify ALL proposed dimensions

- As a matter of record, JRArchitecture, LLC shall not be responsible for construction means and methods or omissions by the contractor, sub-contractor or any other persons performing work in accordance with these drawings.

- On this Project, the Contractor shall have sole supervision over, and exclusive responsibility for: demolition and temporary construction; construction means, methods, techniques, sequences, procedures, safety precautions and safety programs in connection with all demolition and construction work; and protection of persons and property during construction until final completion is attained. Services performed by Architect or its consultants during construction, if any, are intended to promote the goal that, in general, the construction work, when fully completed, will be consistent with the design intent reflected in the permit or construction drawings. Means and methods responsibility always shall be the exclusive responsibility of the Contractor and Contractor shall separately engage specialty engineers or other consultants as required to fulfill this responsibility.



PROFESSIONAL CERTIFICATION I certify that these documents were prepared or approved by me, and that I am a duly licensed professional architect under the laws of the State of Maryland, License Number #14678 Expiration Date: 6/30/2022

WARNING: THIS DOCUMENT IS AN INSTRUMENT OF PROFESSIONAL SERVICE PREPARED BY JONATHAN RIVERA ARCHITECT. ALTERATION OF THIS DOCUMENT BY ANY PARTY OTHER THAN JONATHAN RIVERA ARCHITECT IS A VIOLATION OF LAW THAT WILL BE PROSECUTED TO THE FULLEST EXTENT.  
Copyright © 2020 Jonathan Rivera Architect All Rights Reserved

Designed by:  
Jonathan Rivera  
70728080844

## PROPOSED RESIDENCE

PALOS-SUCIU RESIDENCE

6570 Prestwick Drive  
Highland, Maryland 20777

ARCHITECT

Jonathan Rivera AIA, NCARB  
Howard County, Maryland

443.226.5745  
jrivara@jonathandrivara.com

STRUCTURAL ENGINEER

Spint1 Engineering  
68 West Main Street  
New Market, Maryland

(240) 822-3016  
info@spint1.com

ISSUE DATES:

6-28-19 REVIEW SET

SCALE: 1/4" = 1'-0"

INFO SHEET

0.01

PRINT DATE:  
Tuesday, June 21, 2022

# MASONRY

- Maximum vertical distance of unbalanced fill measured from the top of the lower level slab to outside finished grade shall not exceed the following, for unreinforced walls where unstable soil or ground water conditions do not exist.

Type of Wall	Height of Fill
8" C.M.U.	4'-0"
12" C.M.U. (hollow)	6'-0"
12" C.M.U. (solid)	7'-0"
8" Poured Concrete	7'-0"
10" Poured Concrete	8'-0"

- Masonry veneer shall be installed over 15# felt or approved water repellent sheathing. Through-wall flashing and weeps shall be provided at any location where interior space projects beyond the face of the veneer, i.e. bay windows, Off-set chimneys, etc..

- Masonry veneer shall be attached 16" o.c. each way and anchored in accordance with the local code requirements.

- Walls over 7'-0" or on unstable soil shall be engineered and certified by a registered professional engineer.

- Concrete masonry units shall meet ASTM C-90 Grade A solid block or ASTM C-145 Grade B Standards and be 28 DAYS OLD before installation. Minimum net compression strength of block to be 1500 psi.

- Parging over CMU walls to be not less than 3/8" Portland cement parging from footing to finished grade. Parging and poured concrete walls shall be covered with a coat of approved bituminous material applied at the recommended rate below grade.

- MASONRY LINTELS: Provide lightweight pre-cast lintels for all openings and recesses in CMU walls. Provide (1) 4x8 lintel for each 4" of wall thickness. Reinforce each lintel with two #4 bars at top and bottom and with #2 ties spaced 9" O.C., unless noted otherwise. Precast lintel to have minimum 8" bearing at each end. Such lintels shall not support any superimposed loads.

- Use Type "M" mortar for masonry below grade in contact with earth.

- Use Type "N" mortar for exterior above-grade load bearing and non-load bearing walls, and for other applications where another type is not indicated.

# CONCRETE

- Concrete works shall conform to American Concrete Institute Standard 318-83

- Bottom of all footings shall be located a minimum of 30", (or as per local code) below finished grade. Steps or depth of footing / foundation may vary according to local site or frost conditions.

- All interior concrete slabs will be reinforced 6"x6"xW2.0xW2.0 WWF or control joints. Monolithic turned down slabs for townhouses shall have a control joint between units.

- Concrete used in exposed areas implicit to freezing and thawing (both during construction and service life) shall be air-entrained in accordance with local code. Exterior flat-work shall be coated with an approved curing compound.

- Foundation walls of habitable rooms located below grade will be dampproofed or water proofed using materials/methods approved by local building jurisdiction.

- All work shall comply to local code.

Type of Concrete Construction	Minimum Specified Compressive Strength
- Footings	3500 PSI
- Interior Basement Slabs	3600 PSI
- Foundation Walls	3500 PSI
- Garage and Exterior Slabs	3500 PSI
- Rat Slabs	2500 PSI

(or as per local code)

- REINFORCING BARS: ASTM A-615 and A-305, MESH: ASTM A-185.

- All interior slabs of 30 FEET or more in any dimension shall have WWF and Control Joints.

- Vapor barrier under all slabs EXCEPT garages: 7 MIL Polyethylene, Lap all edges 6", Lay over 4" Gravel bed.

- Exterior Concrete Slabs: 5% to 7% Air Entrained

# WOOD

- Wall bracing shall be installed as per local code.

- All roof trusses and floor systems shall be braced and installed per manufacturer's specifications and as per local code. See manufacturer's plans for exact layout and construction.

- All trusses are to be stamped and certified by a registered engineer and meet TPI manufacturers minimum requirement.

- See drawings for plywood.

- Tongue and groove floor decking glued and nailed (8d nails) on floor joists at 6" o.c. and 4" edge spacing maximum to meet the American Plywood Association Sturd-I-Floor system.

- Tongue and groove floor decking glued nailed (8d nails) on pre-engineered floor joists at 6" o.c. and 4" edge spacing maximum to meet the American Plywood Association Sturd-I-Floor system.

- Fire-stopping shall be provided to cut-off concealed draft openings and to form an effective fire barrier between stories as per local code.

- All LVL's will be microlams will be manu. by Trus Joist McMillan (or equiv)

- Structural sawn lumber shall be SPF #1 or #2

- All exterior walls are 2x6 stud #16" centers, minimum SPF stud grade unless otherwise noted.

- All interior walls are 2x4 stud #16" centers, minimum SPF stud grade unless otherwise noted.

- All opening headers to be 3-2x10's w/ 3/4" plywood filler bearing on min. 2-2x6's studs, unless noted otherwise

- Joist hangers to be installed as required.

- All wood less than 8" from grade shall be pressure treated. All sole plates on slabs shall be pressure treated.

- Provide bearing at all structural members as required by local code.

- All materials shall be installed per manufacturer's specifications and as per applicable building codes.

- All multiple beam members will be glued together with liquid nails and screwed using 3" Deck Mate screw at 16" o.c. staggered 2" from the top and bottom of the depth of the beam.

- All work shall comply to local code.

# METAL

- Strap anchors or anchor bolts shall be local code and building inspector approved: Minimum 2 straps/bolts per section of plating 12" Max. from each end and with intermediate strap/bolts at 6'-0" o.c. maximum. (or as per local code)

- Galvanized metal brick veneer ties shall be installed 16" o.c. each way.

- All steel shall conform to ASTM Specs for A-36 Steel.

- Metal Joist hangers (Standard wood ledger) shall be used where required at joist without direct bearing and be min.18 GA. galvanized steel. Use all nails specified by the manufacturer.

- Steel lintels for all opening and recesses in brick or Brick Faced Masonry wall not specifically detailed: Provide (1) steel angle for each 4" of wall thickness. Steel angles to have minimum 6" bearing at each end. Horizontal leg shall be 3 1/2", unless noted otherwise.

- LINTEL SCHEDULE (UNLESS NOTED OTHERWISE ON PLANS):

LOOSE LINTELS (STEEL AND PRECAST)

1. Provide loose lintels over penetrations in new masonry walls (and new penetrations in existing masonry walls) at doors, windows, mechanical and electrical services and equipment, etc...u.n.o.

2. Provide a steel angle for each 4" of masonry thickness bearing 6" minimum on a full mortar bed as follows:

OPENINGS UP TO 3'	L3-1/2x3-1/2x5/16
OPENINGS >3' TO 5'	L4x3-1/2x5/16, (LLV)
OPENINGS >5' TO 8'	L6x3-1/2x5/16, (LLV)

3. Where required for architectural reasons, or as noted, provide precast concrete lintels bearing 8" min. on a full mortar bed as follows.

4" WALLS (8" max open.)	4"x8", Reinforced W/ 1#3 top & 1#5 bottom
6" WALLS (8" max open.)	6"x8", Reinforced W/ 1#3 top & 1#5 bottom
8" WALLS (8" max open.)	8"x8", Reinforced W/ 2#3 top & 2#5 bottom

4. When walls are present that are thicker than 8" use a combination of 4", 6" and 8" precast concrete lintels.

- Lintels shown shall not support any superimposed loads.

- All steel angles in masonry walls are to be flashed and painted.

- Paint all exterior ferrous or galvanized metals EXCEPT completely pre-finished factory items.

- All work shall comply to local code.

# SITWORK

- GENERAL: These drawings do not cover sitework, grading or landscaping

- Building foundations have been designed based on an assumed soil bearing capacity of 1500 PSF. Additional engineering is required if soil bearing capacity is less than 1500 PSF.

- Provide continuous perimeter foundation drainage in accordance with local code requirements. Where both interior and exterior drains are required, provide minimum 1 1/2" dia. bleeder pipes through mid line of footing at max 8" o.c. Typically, drains shall lead to sump pits or to positive daylight discharge points.

- Slope all stoops, porches, walks and exterior slabs away from building 1/8" minimum per foot.

- All work shall comply to local code.

# WEATHER/THERMAL

- Insulation for slab on grade construction shall begin at the inside intersection of the slab and the foundation wall and shall extend for a minimum distance of 24" down the inside face of the foundation wall and horizontally 24" under the slab. For unheated slabs a material with an R-value of 42 is required; for heated slabs an R-value of 63 is required (or as per local code)

- Sill Sealer-compressible material shall be installed under all mud plates (foundation wall and wood floor systems) and sole plates (slab on grade)

R-Value	Thickness	Location
R-11 FS25	3 1/2"	Basement Walls
R-21	5 1/2"	2x6 Walls (exterior)
R-38	9"	Crawl Space
R-38	'	Floors exposed to unheated condition
R-49 Batt.	12"	Roof
R-49 Blown	'	Apply blown insulation as required by manufacturer's specifications

- Provide vents as per local code.

- Flashing: Prefinished aluminum or equal, at all roof offsets, chimneys, roof openings, hips, valleys, ridges, dormers and where roof intersects wall.

- Contractor shall maintain in all circumstances proper fire, sound and insulation ratings when penetrating through walls, floors, ceilings and roofs.

- All miscellaneous penetrations during construction shall be patched and repaired according to manufacturer's specifications and as per code.

- All exterior joints between windows, doors and other surfaces shall be caulked and sealed appropriately.

- DAMPPROOFING: Apply (1) coat of asphalt emulsion to exterior of all below grade walls at basement conditions. When habitable space occurs below grade, provide waterproofing membrane, aqueous based elastomeric, vinyl acrylic mastic, 35 MIL. min. thickness or other approved equal.

- SLAB VAPOR BARRIER: 7 MIL. polyethylene sheet where noted on drawings. Overlay all edges 6".

- SILL SEALER: 1/2" x 5 1/2" compressible fiberglass beneath all exterior sill plates or other approved sill sealer.

- Provide approved corrosion-resistive flashing at the intersections of masonry and wood frame construction; over projecting wood trim; where decks, porches etc. attach to wood frame construction; at wall and roof intersection; at chimney and roof intersections; in roof valleys; at all roof penetrations; and at wall openings as recommended by window and door manufacturers.

- Slab perimeters exposed to outside or within 30" of grade; 4.5x24", either vertical or horizontal from slab intersection.

- ROOFING: unless noted otherwise, roofing shall be min 200# Class "C" Fiberglass based asphalt shingles over 15 pound felt. Eave flashing to a point 24" inside of interior face of wall line may be also installed at the owner discretion.

- WALL SHEATHING: As shown on drawings and installed in accordance with MANUFACTURER'S RECOMMENDATIONS.

- GUTTERS AND LEADERS: .032" Prefinished aluminum gutters with .024" prefinished aluminum leaders. Lead to splashblocks or collector as required.

# DOORS and WINDOWS

- Provide safety glazing as required by local code.

- All doors and windows shall be installed in accordance with manufacturer's specifications, and as per local code.

# GENERAL NOTES

- All work shall comply to all applicable local codes.

- All construction shall be classified as and comply to either of the following:

-- Use Group R-4 under the 2021 International Residential Code. & Howard County Code

- Contractor is responsible for bracing all framing/walls during construction

- These plans and notes are the property and sole responsibility of JRArchitecture, Inc. Use of these plans without the written consent of JRArchitecture, Inc. is prohibited.

- These plans are subject to modification as necessary to meet code requirements and or facilitate mechanical/plumbing installations or to incorporate design improvements. The Architect and the Owner reserves the right to make any changes, for any reason, at any time, providing they comply with the code.

- The Sub-Contractor shall compare and coordinate all drawings. When a discrepancy or an error or omission exists, he shall comply with the code and contact the Architect and the Owner in writing for proper adjustment.

- These plans are not to be scaled for Construction purposes. Written dimensions and notes supersede all scaled reference.

- In the event certain features of Construction are not fully shown on the drawings, their construction shall be of the same character as for similar conditions that are shown or noted.

- Field verify ALL existing dimensions

# DESIGN - LIVE LOADS

RECOMMENDED MINIMUMS:	ROOF:
- Ground Snow Load	30 psf
- Roof	40 psf
- Sleeping Floors	30 psf
- Living Floors	40 psf
- Exterior Decks	60 psf
- Stairs	100 psf
- Garage Slabs	50 psf
- Wind Load	17 psf
- Dead Load	10 psf
- Guardrails	200'

Ground Snow Load, Pg = 40 psf  
Dead Roof  
- 17 psf for pitched  
- 20 psf for flat roof

FLOOR:  
Floor Live  
- 40 psf  
- 30 psf in sleeping rooms  
Dead = 15 psf

WIND:  
Wind Speed (ultimate), Vult = 115 mph

# STAIR CRITERIA

- INTERIOR and EXTERIOR STAIRS

- All stairs shall comply with all local codes.

- Minimum finish width: 36"  
- Minimum finished headroom height: 6'-8"  
- Maximum riser height: 7 3/4"  
- Minimum tread depth: 11"  
- Maximum space between balusters: 4"  
- Handrail height shall not be less than 34" or greater than 38" and may not project more than 3 1/2" into stair width.

- Provide a minimum of 1 1/2" space between handrail and wall.

- Stair winder shall have a minimum inside width of 6" and a minimum of a 9" tread when measured 12" from inside corner.

- Stair landings shall be a minimum of 36" x 36"

- Stairways with 3 or more risers are required to have a handrail.

# MECH. PLUMB. ELEC.

- Mechanical contractor is responsible for the design and installation of mechanical systems including duct sizes, trunk and register size for air conditioning and heating. Systems shall be installed per manufacturer's specifications and recommendations and as per all applicable building codes.

- Plumbing contractor is responsible for the design and installation of plumbing and piping. All plumbing, piping and fixtures shall be installed per manufacturer's specifications and recommendations and as per all applicable codes.

- Electrical contractor is responsible for the design and installation of all electrical systems. All electrical work shall meet the requirements of the National Electric Code, the local power company and all applicable codes. Fixtures and apparatus are selected by the builder and shall be UL approved.

- Smoke & Carbon Monoxide detectors - Provide a minimum of one ceiling mounted fixture per floor, hard wired to a nearby circuit and interconnected for simultaneous activation with battery backup. Provide detectors at each sleeping room if required by local code. Provide detectors outside each sleeping area within 10'-0" of each door.

- Fire suppression systems shall be installed as per local building code.

- All work shall comply to local code.

# PROPOSED RESIDENCE

## PALOS-SUCIU RESIDENCE

6570 Prestwick Drive  
Highland, Maryland 20777

ARCHITECT  
Jonathan Rivera AIA, NCARB  
Howard County, Maryland

443.226.5745  
jrvera@jonathanrivera.com

STRUCTURAL ENGINEER  
Spain11 Engineering  
68 West Main Street  
New Market, Maryland

(240) 822-3016  
info@spain11.com

### ISSUE DATES:

6-28-19 REVIEW SET

### SCALE:

## GENERAL INFO

# 0.02

PRINT DATE:  
Tuesday, June 21, 2022



*Matthew W. Anderson*  
6/21/2022  
Note: PE Seal is for Structural Design Only.

Professional Certification: I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 31582 Expiration 04/04/2023

**PROFESSIONAL CERTIFICATION**  
 I certify that these documents were prepared or approved by me, and that I am a duly licensed professional architect under the laws of the State of Maryland, License Number #14678, Expiration Date: 6/30/2022

WARNING: THIS DOCUMENT IS AN INSTRUMENT OF PROFESSIONAL SERVICE PREPARED BY JONATHAN RIVERA ARCHITECT. VIOLATION OF THIS DOCUMENT BY ANY PARTY OTHER THAN JONATHAN RIVERA ARCHITECT IS A VIOLATION OF LAW THAT WILL BE PROSECUTED TO THE FULLEST EXTENT.

Copyright © 2020  
 Jonathan Rivera Architect  
 All Rights Reserved

Designed by  
*Jonathan Rivera*  
 7073BAND0300044

**PROPOSED RESIDENCE**

**PALOS-SUCIU RESIDENCE**

6570 Prestwick Drive  
 Highland, Maryland 20777

**ARCHITECT**  
 Jonathan Rivera AIA, NCARB  
 Howard County, Maryland

443.226.5745  
 jrvera@jonathanrivera.com

**STRUCTURAL ENGINEER**  
 Spoin11 Engineering  
 68 West Main Street  
 New Market, Maryland

(240) 822-3016  
 info@spoin11.com


**ISSUE DATES:**  
 6-28-19 REVIEW SET

**SCALE:** N.T.S.


**SIMPLIFIED PLANS**

**10.03**


PRINT DATE:  
 Tuesday, June 21, 2022

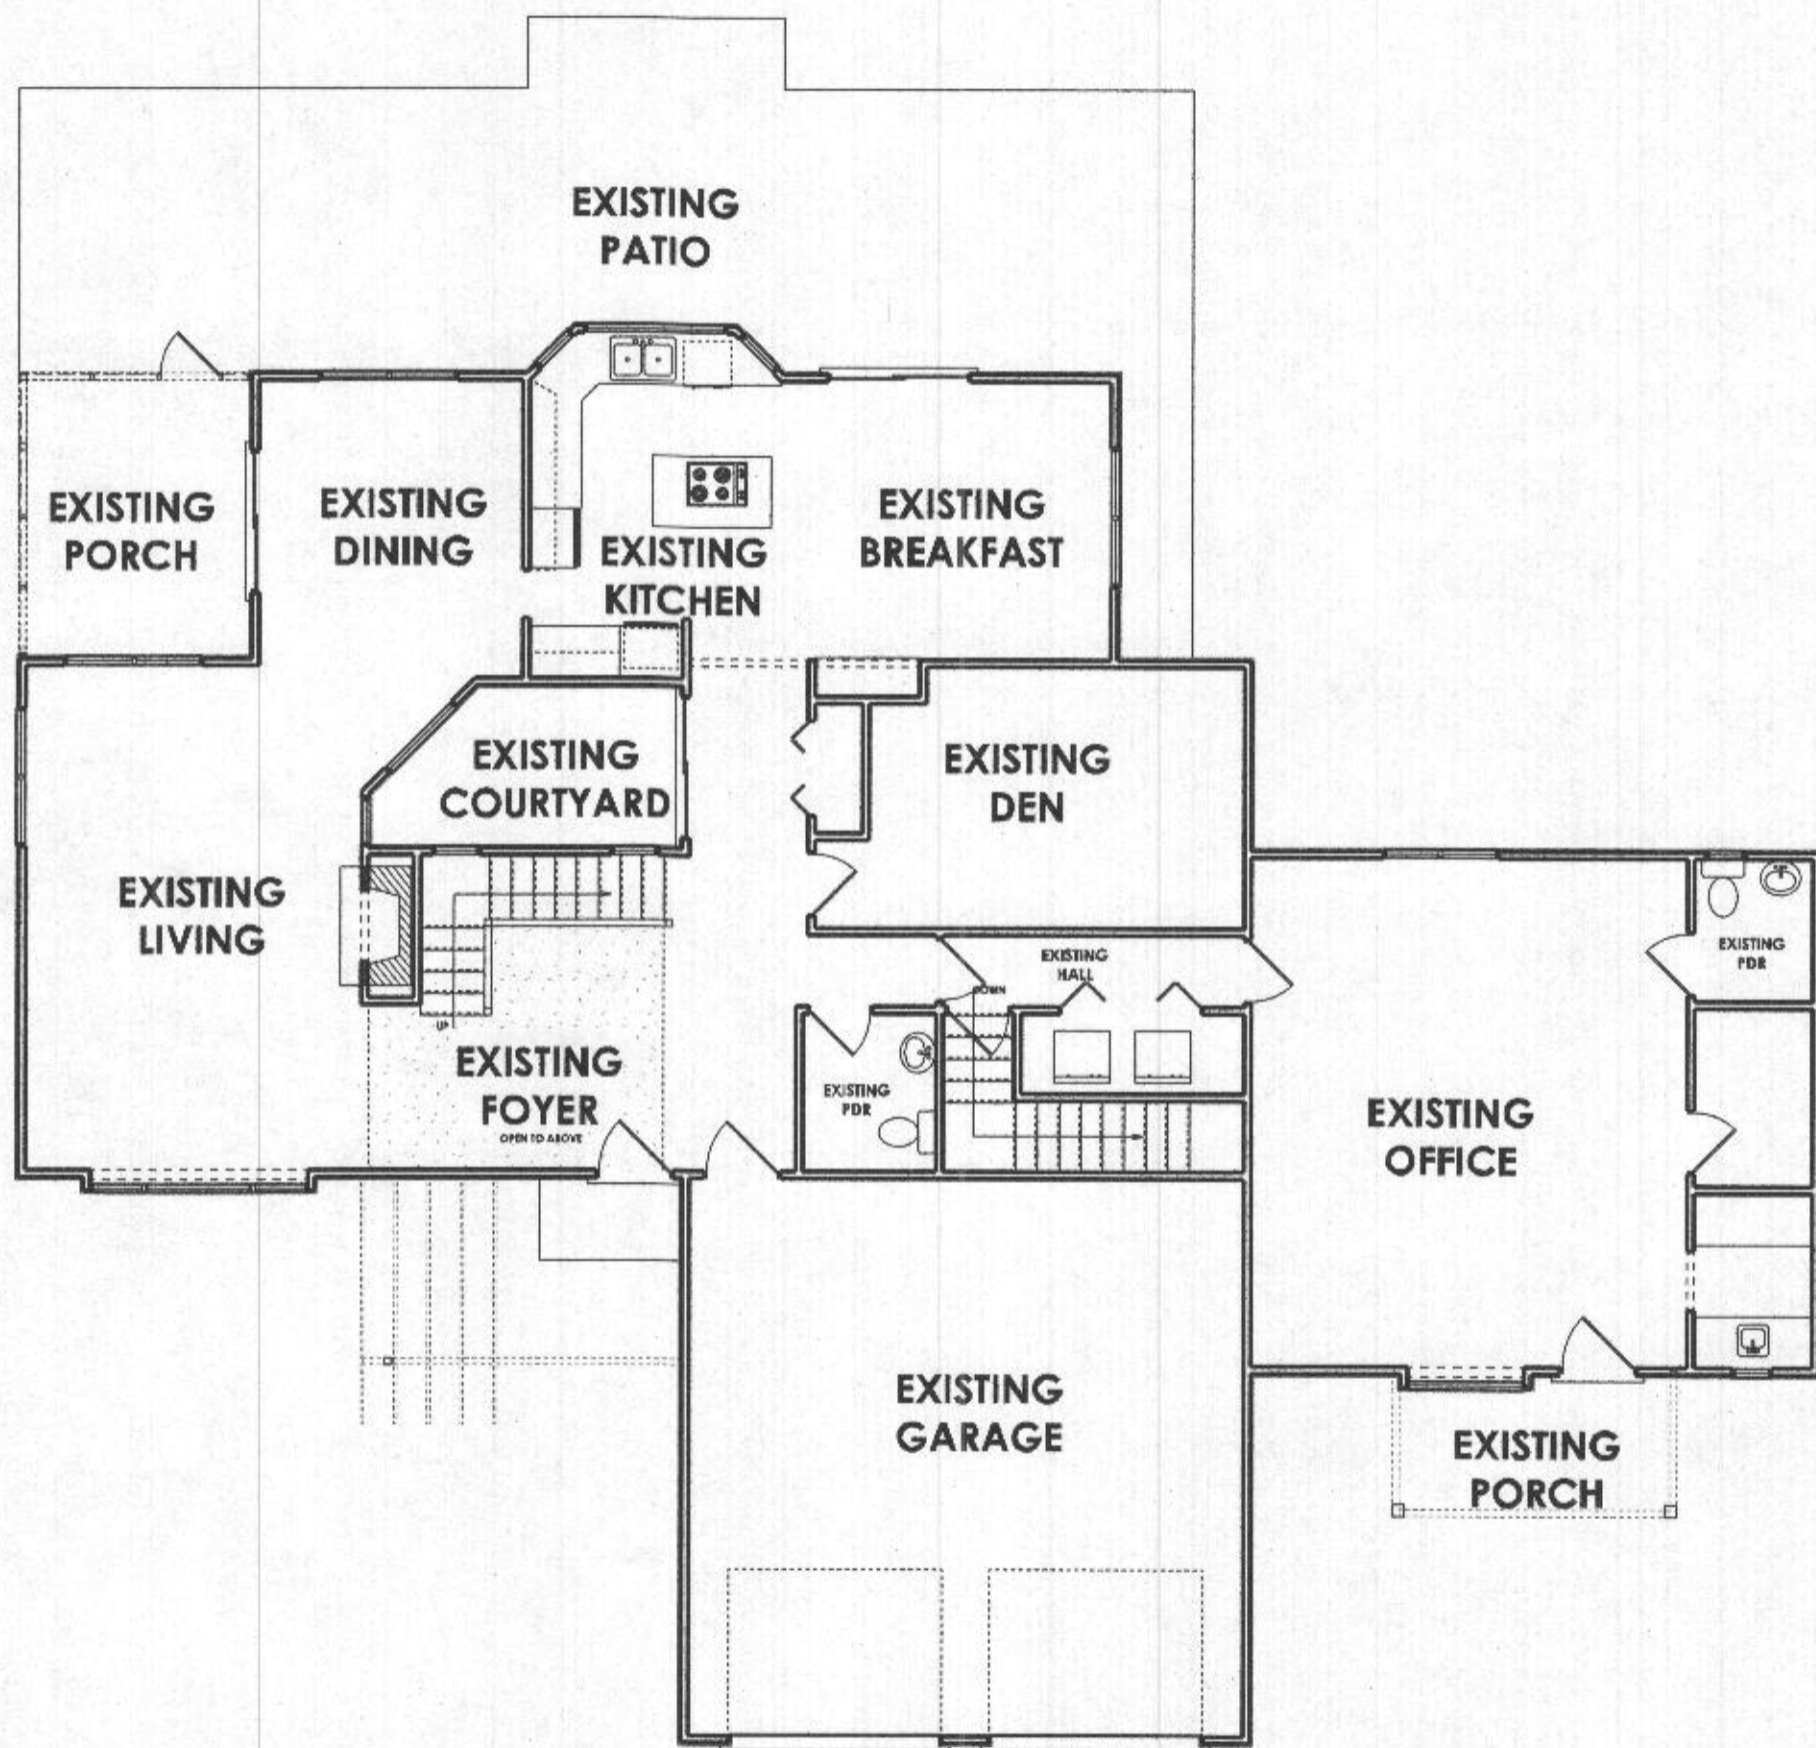

**EXISTING FIRST FLOOR PLAN**

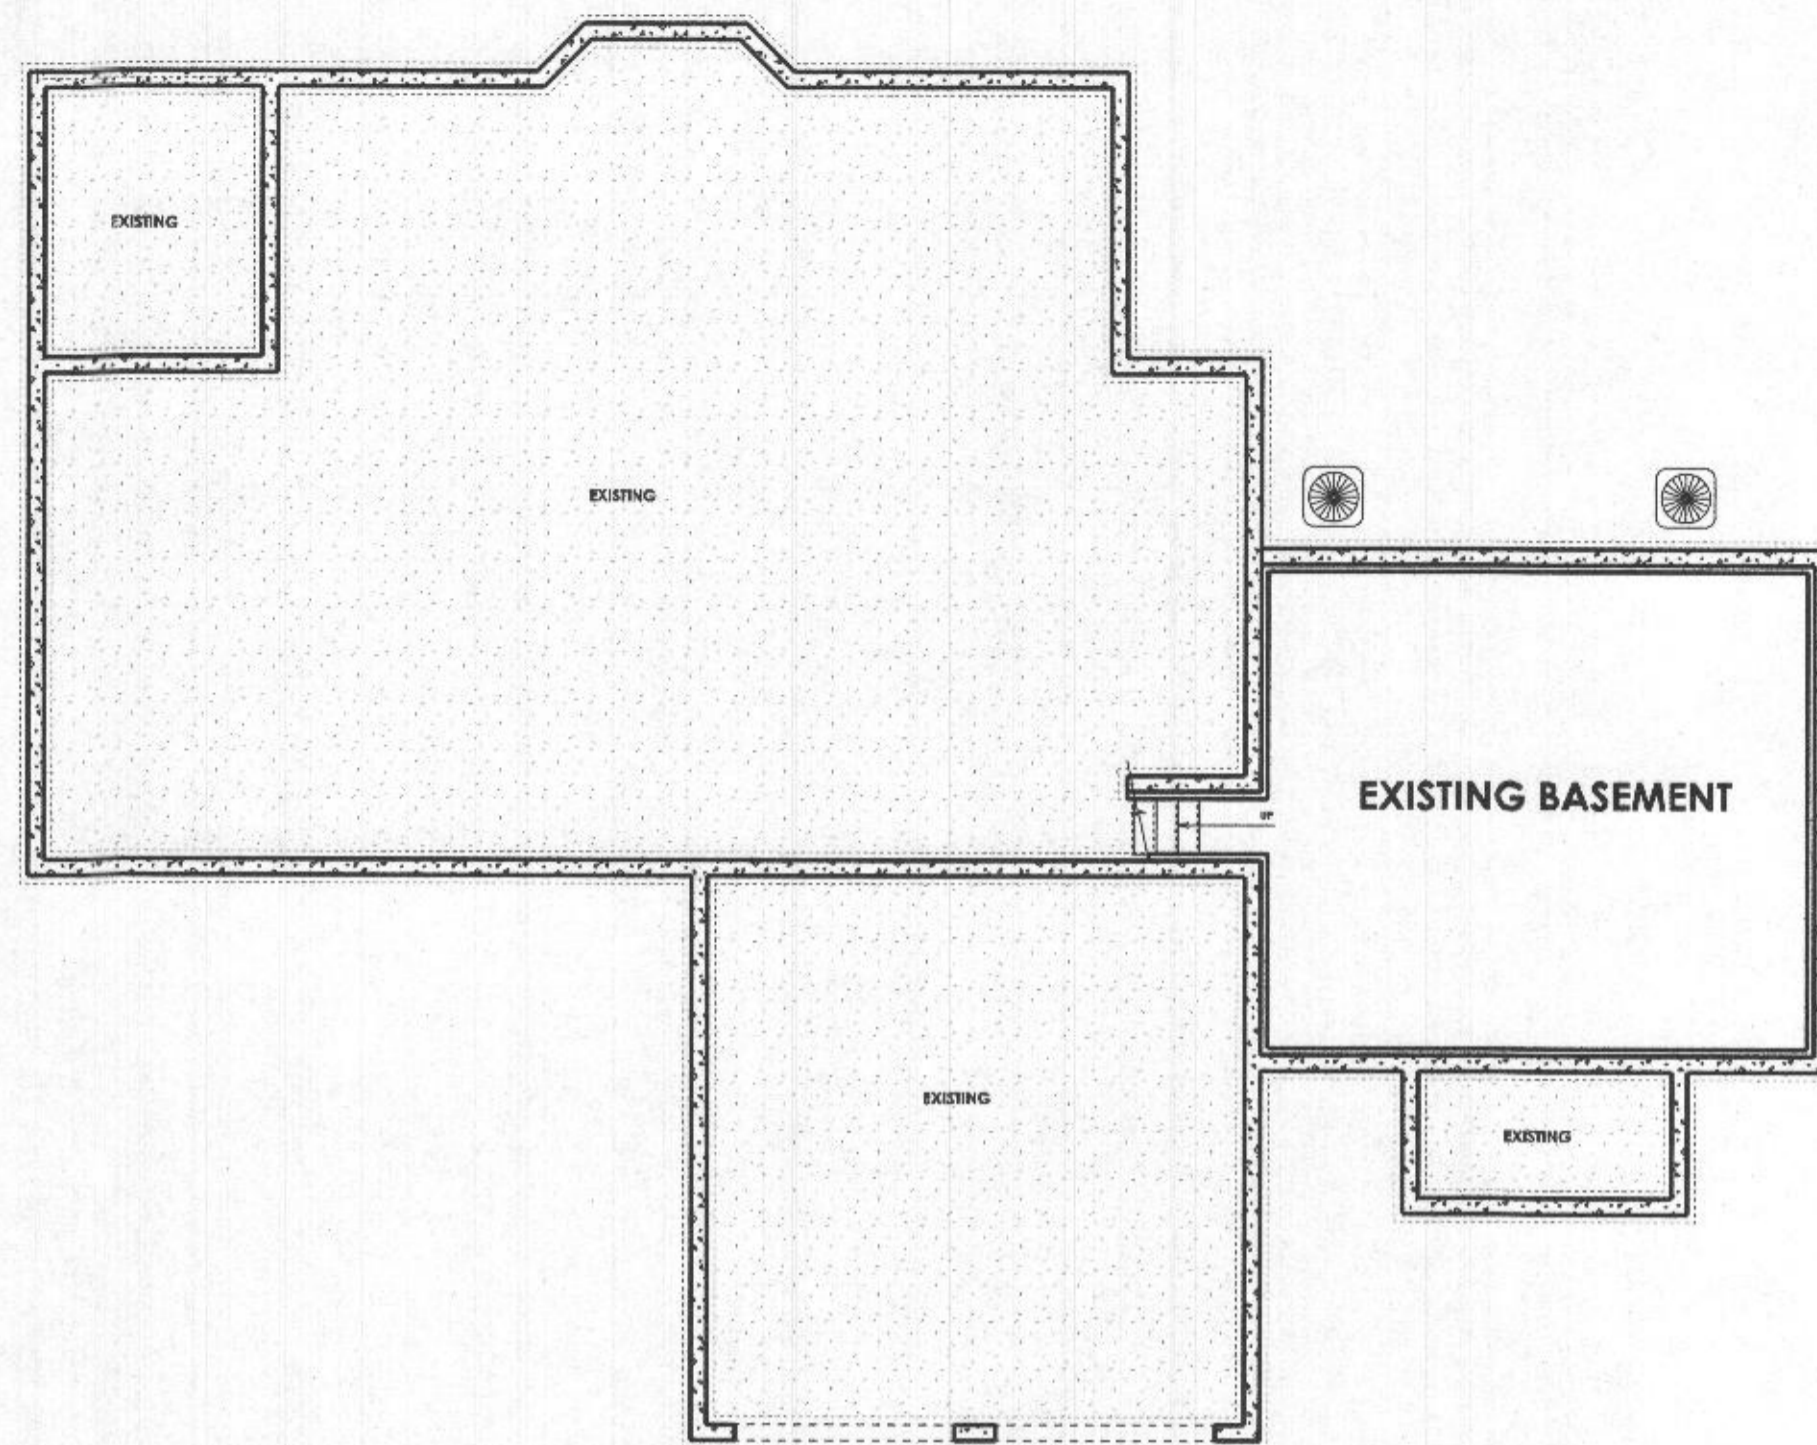

**EXISTING BASEMENT PLAN**

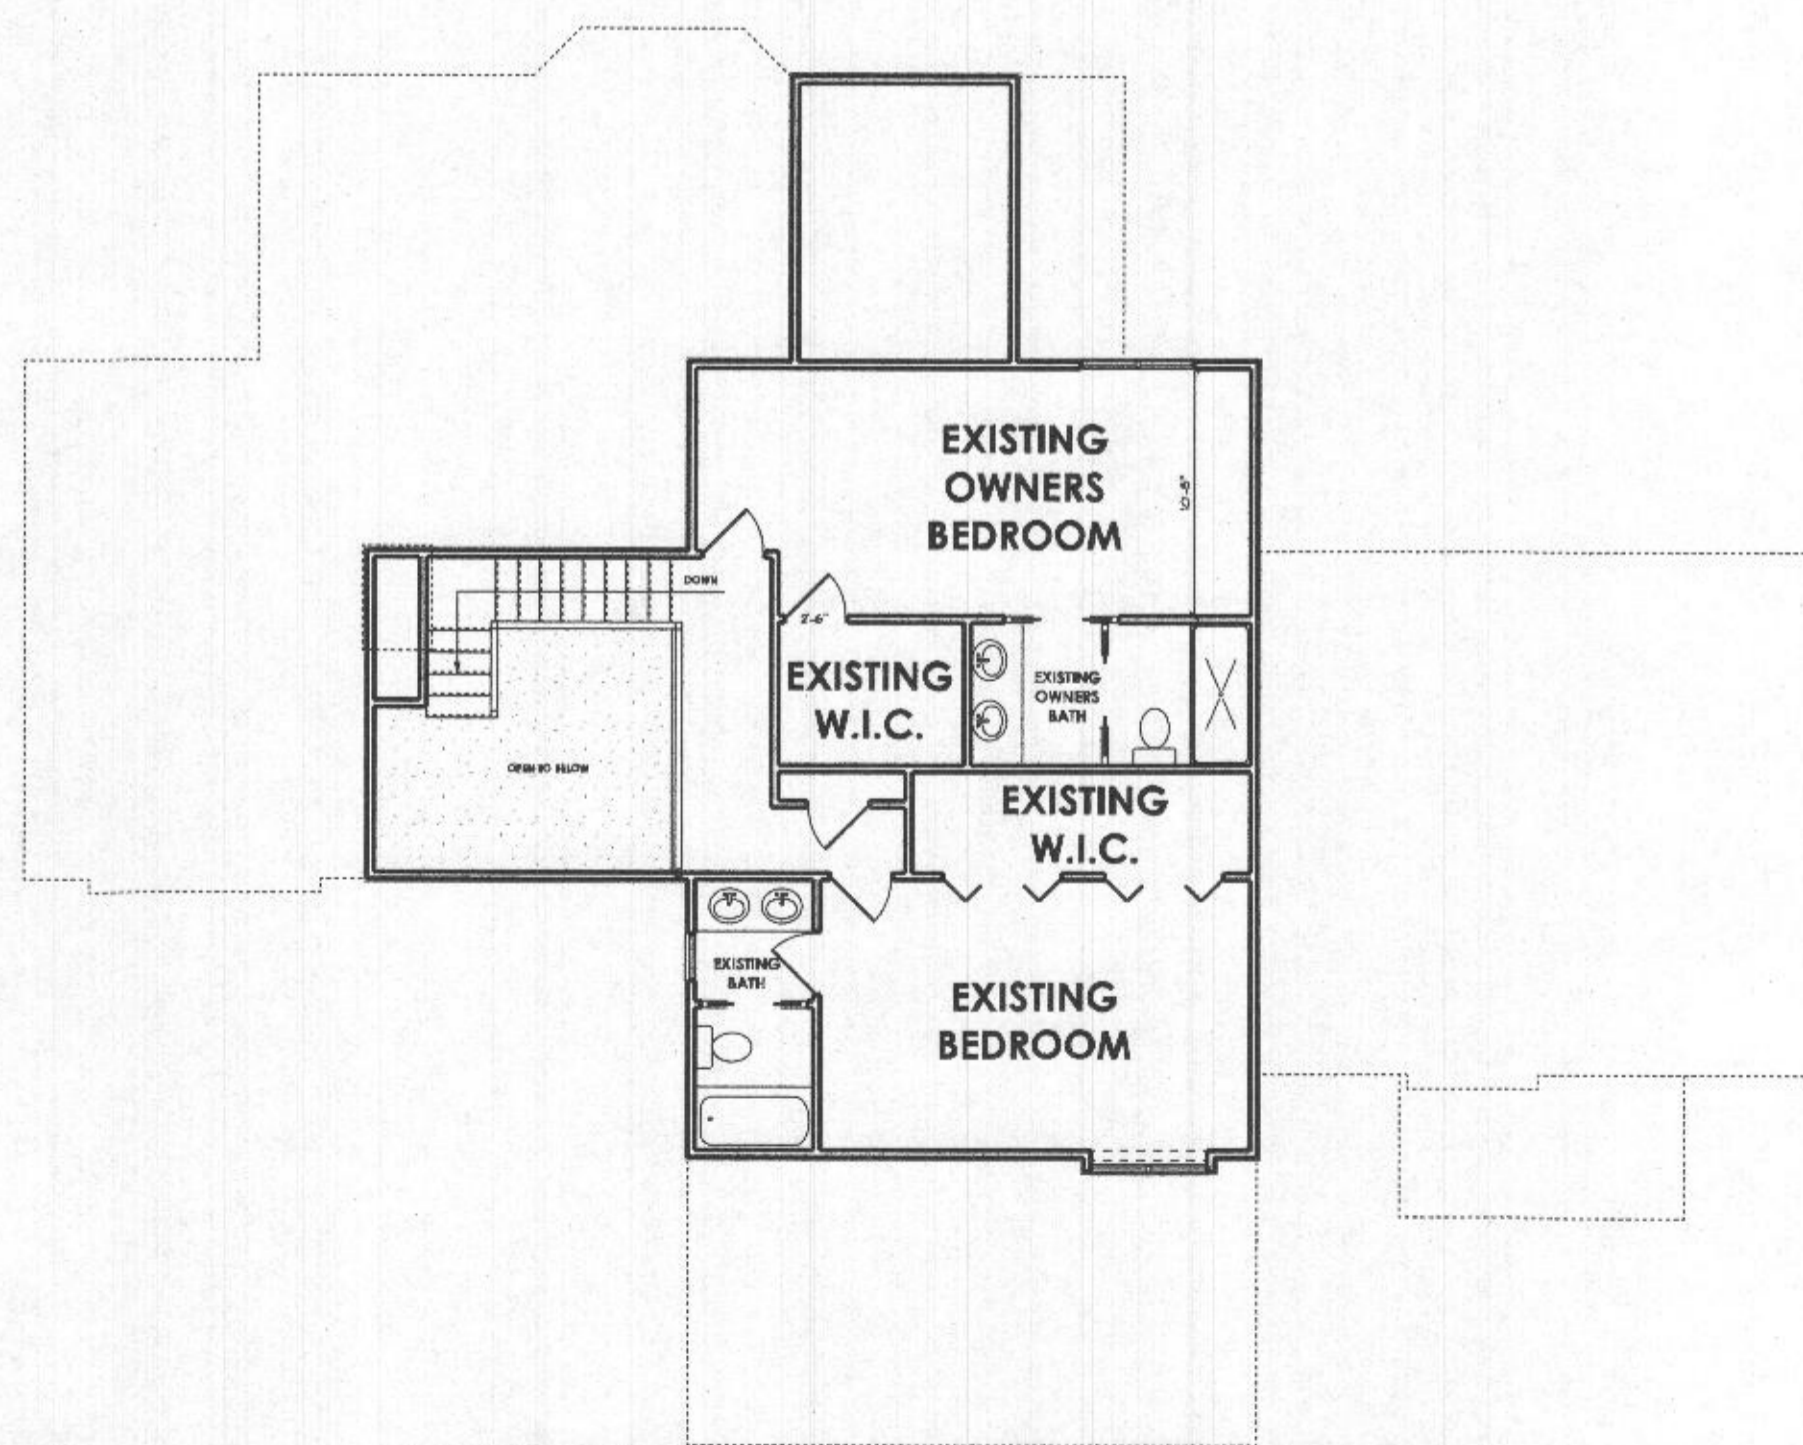

**EXISTING SECOND FLOOR PLAN**



*Matthew W. Anderson*  
 6/21/2022

Note: PE Seal is for Structural Design Only.

Professional Certification: I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 31582, Expiration 04/04/2023

PROFESSIONAL CERTIFICATION  
 I certify that these documents were prepared or approved by me, and that I am a duly licensed professional architect under the laws of the State of Maryland.  
 License Number #14678  
 Expiration Date: 6/30/2022

WARNING:  
 THIS DOCUMENT IS AN INSTRUMENT OF PROFESSIONAL SERVICE PREPARED BY JONATHAN RIVERA, ARCHITECT. ALTERATION OF THIS DOCUMENT BY ANY PARTY OTHER THAN JONATHAN RIVERA, ARCHITECT IS A VIOLATION OF LAW THAT WILL BE PROSECUTED TO THE FULLEST EXTENT.

Copyright © 2020  
 Jonathan Rivera Architect  
 All Rights Reserved

Designed by  
*Jonathan Rivera*  
 ESTABLISHED 2011

**PROPOSED RESIDENCE**

**PALOS-SUCIU RESIDENCE**

6570 Prestwick Drive  
 Highland, Maryland 20777

ARCHITECT  
 Jonathan Rivera AIA, NCARB  
 Howard County, Maryland

443.226.5745  
 jrvera@jonathanrivera.com

STRUCTURAL ENGINEER  
 Spoin1 Engineering  
 68 West Main Street  
 New Market, Maryland

(240) 822-3016  
 info@spoin1.com


ISSUE DATES:  
 6-28-19 REVIEW SET

SCALE: 1/4" = 1'-0"

DEMO PLANS

**0.51**

PRINT DATE:  
 Tuesday, June 21, 2022

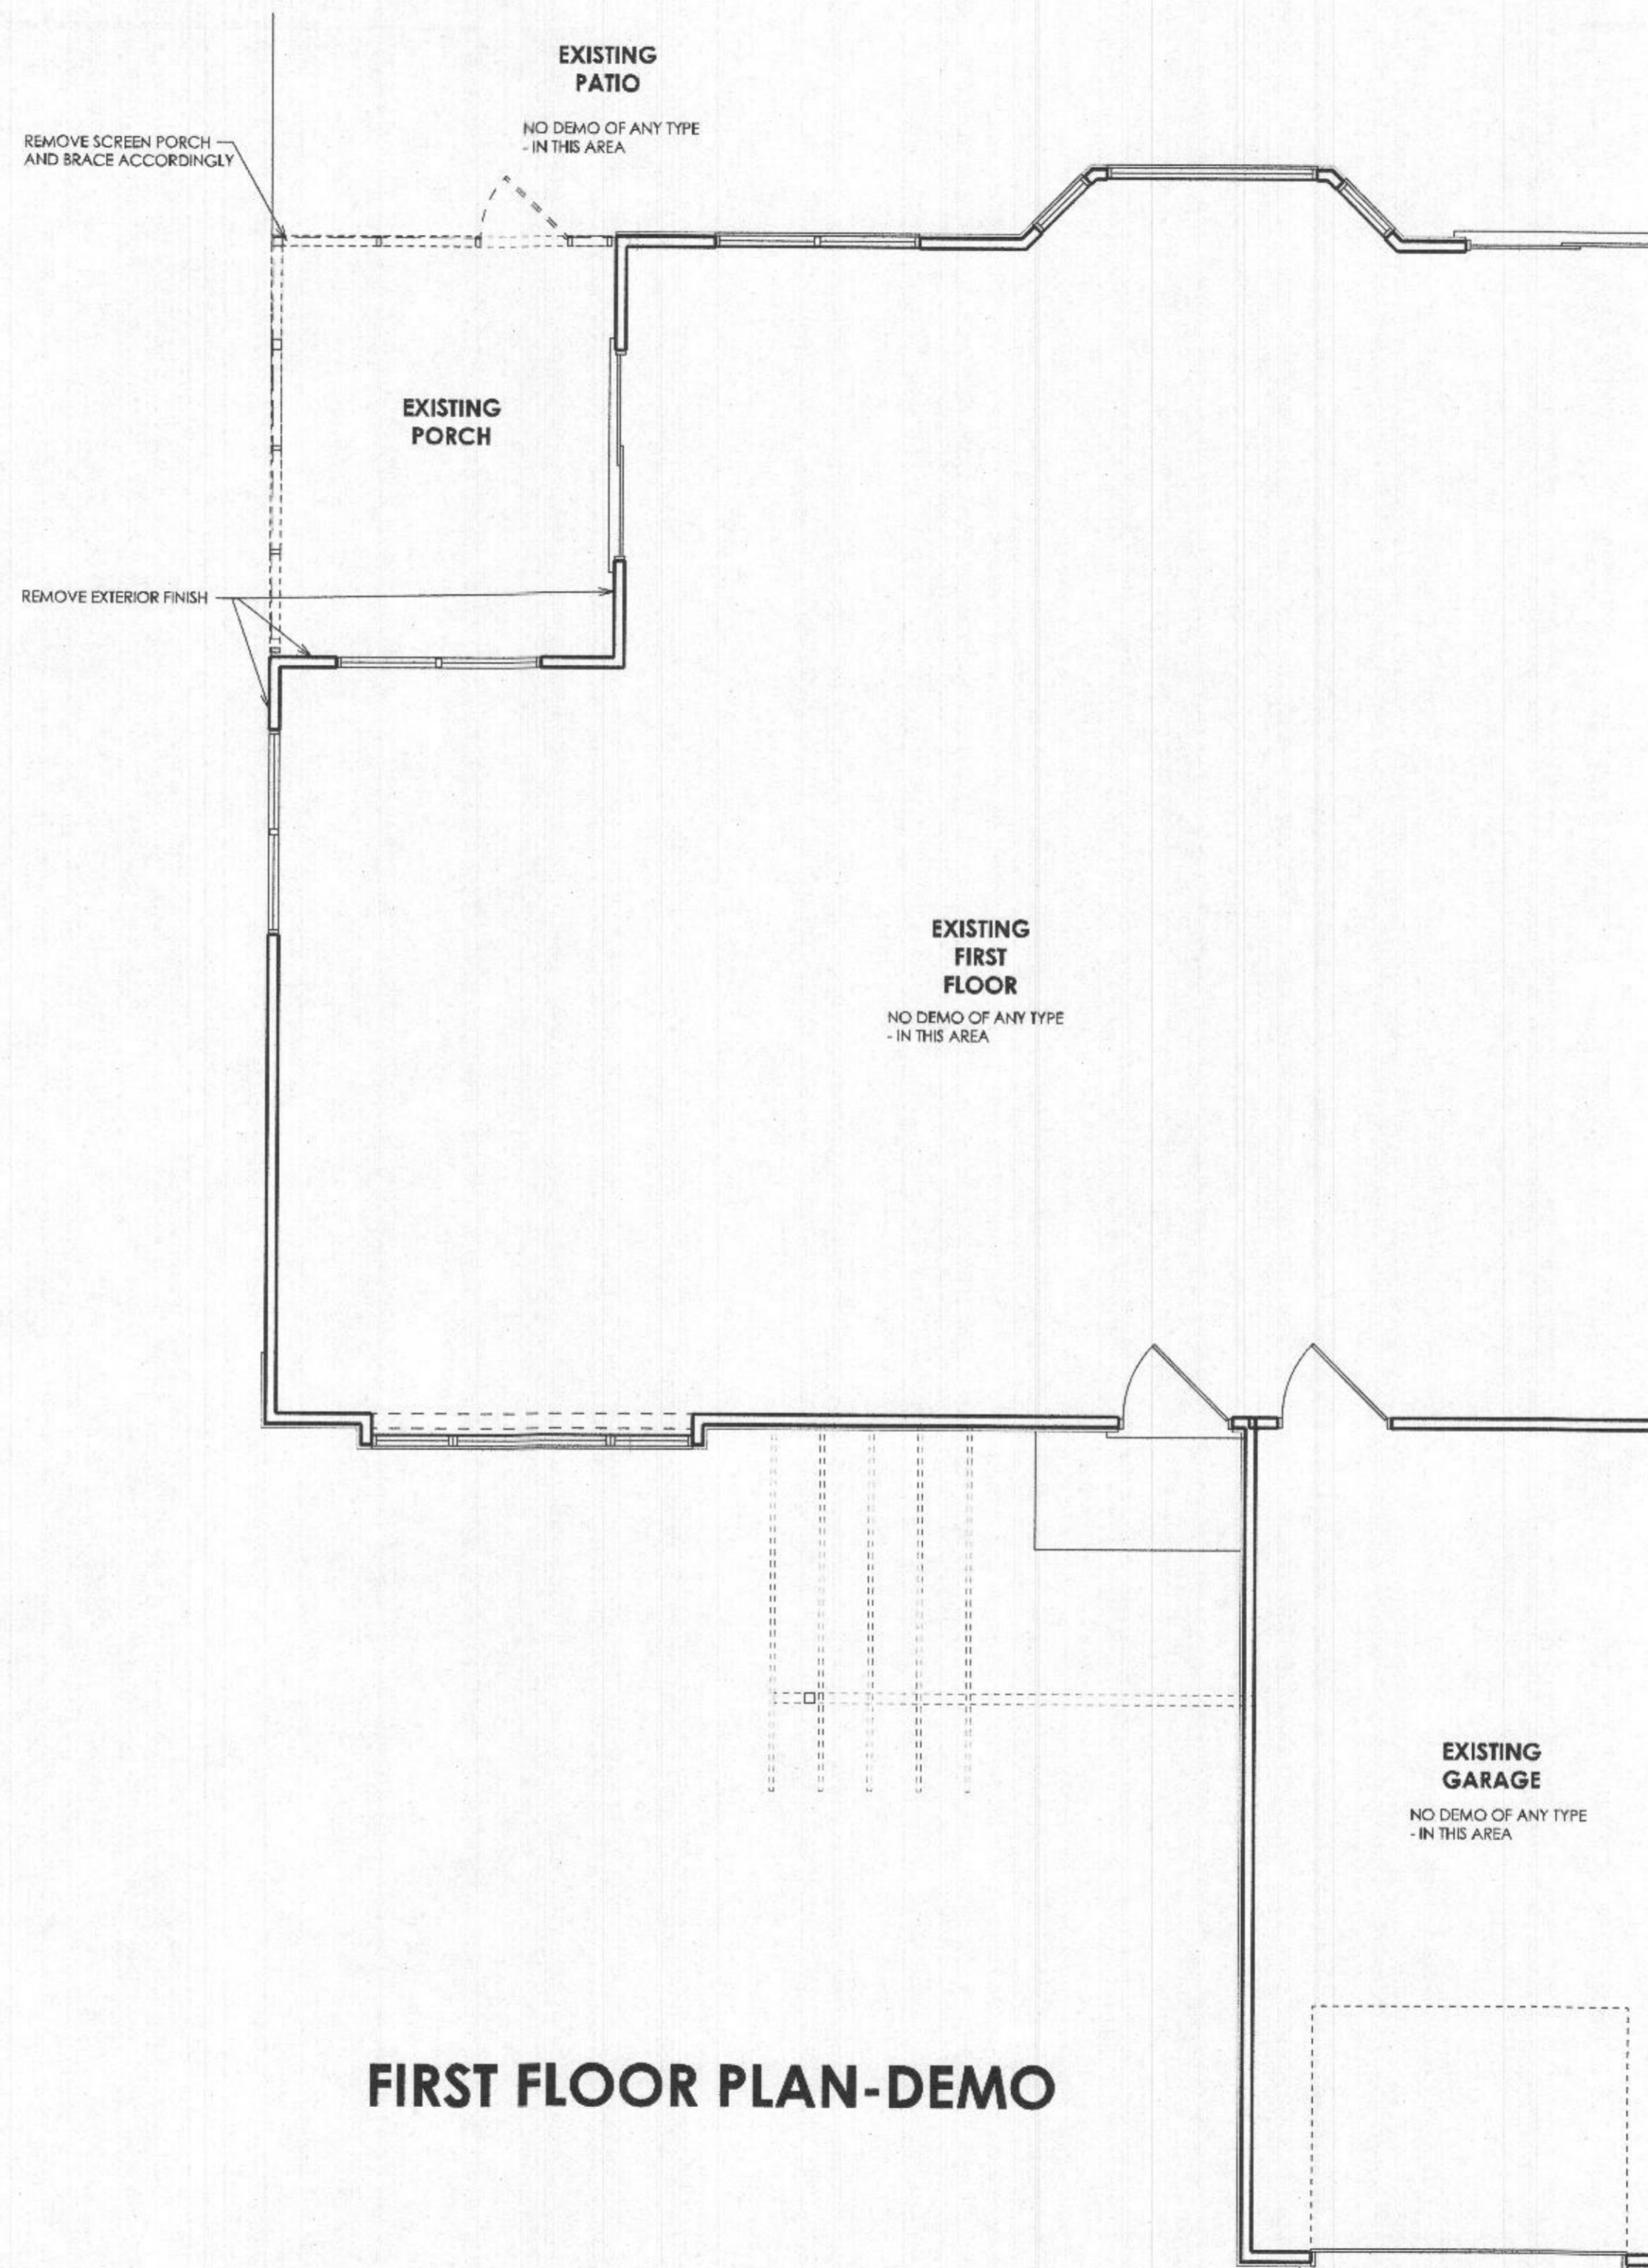

**FIRST FLOOR PLAN-DEMO**



*Matthew W. Anderson*  
 6/21/2022

Note: PE Seal is for Structural Design Only.

Professional Certification: I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 31582 Expiration 04/04/2023

PROFESSIONAL CERTIFICATION  
 I certify that these documents were prepared or approved by me, and that I am a duly licensed professional architect under the laws of the State of Maryland, License Number #14678, Expiration Date: 6/30/2022

WARNING: THIS DOCUMENT IS AN INSTRUMENT OF PROFESSIONAL SERVICE PREPARED BY JONATHAN RIVERA ARCHITECT. ALTERATION OF THIS DOCUMENT BY ANY PARTY OTHER THAN JONATHAN RIVERA ARCHITECT IS A VIOLATION OF LAW THAT WILL BE PROSECUTED TO THE FULLEST EXTENT.  
 Copyright © 2020  
 Jonathan Rivera Architect  
 All Rights Reserved

Designed by:  
*Jonathan Rivera*  
 7172642826@444

**PROPOSED RESIDENCE**

**PALOS-SUCIU RESIDENCE**  
 6570 Prestwick Drive  
 Highland, Maryland 20777

**ARCHITECT**  
 Jonathan Rivera AIA, NCARB  
 Howard County, Maryland  
 443.226.5745  
 jrvera@jonathanrivera.com

**STRUCTURAL ENGINEER**  
 Spoint1 Engineering  
 68 West Main Street  
 New Market, Maryland  
 (240) 822-3016  
 info@spoint1.com

**ISSUE DATES:**  
 6-28-19 REVIEW SET

**SCALE:** 1/4" = 1'-0"


**ELEVATIONS**

**1.01**

PRINT DATE:  
 Tuesday, June 21, 2022



**FRONT ELEVATION**

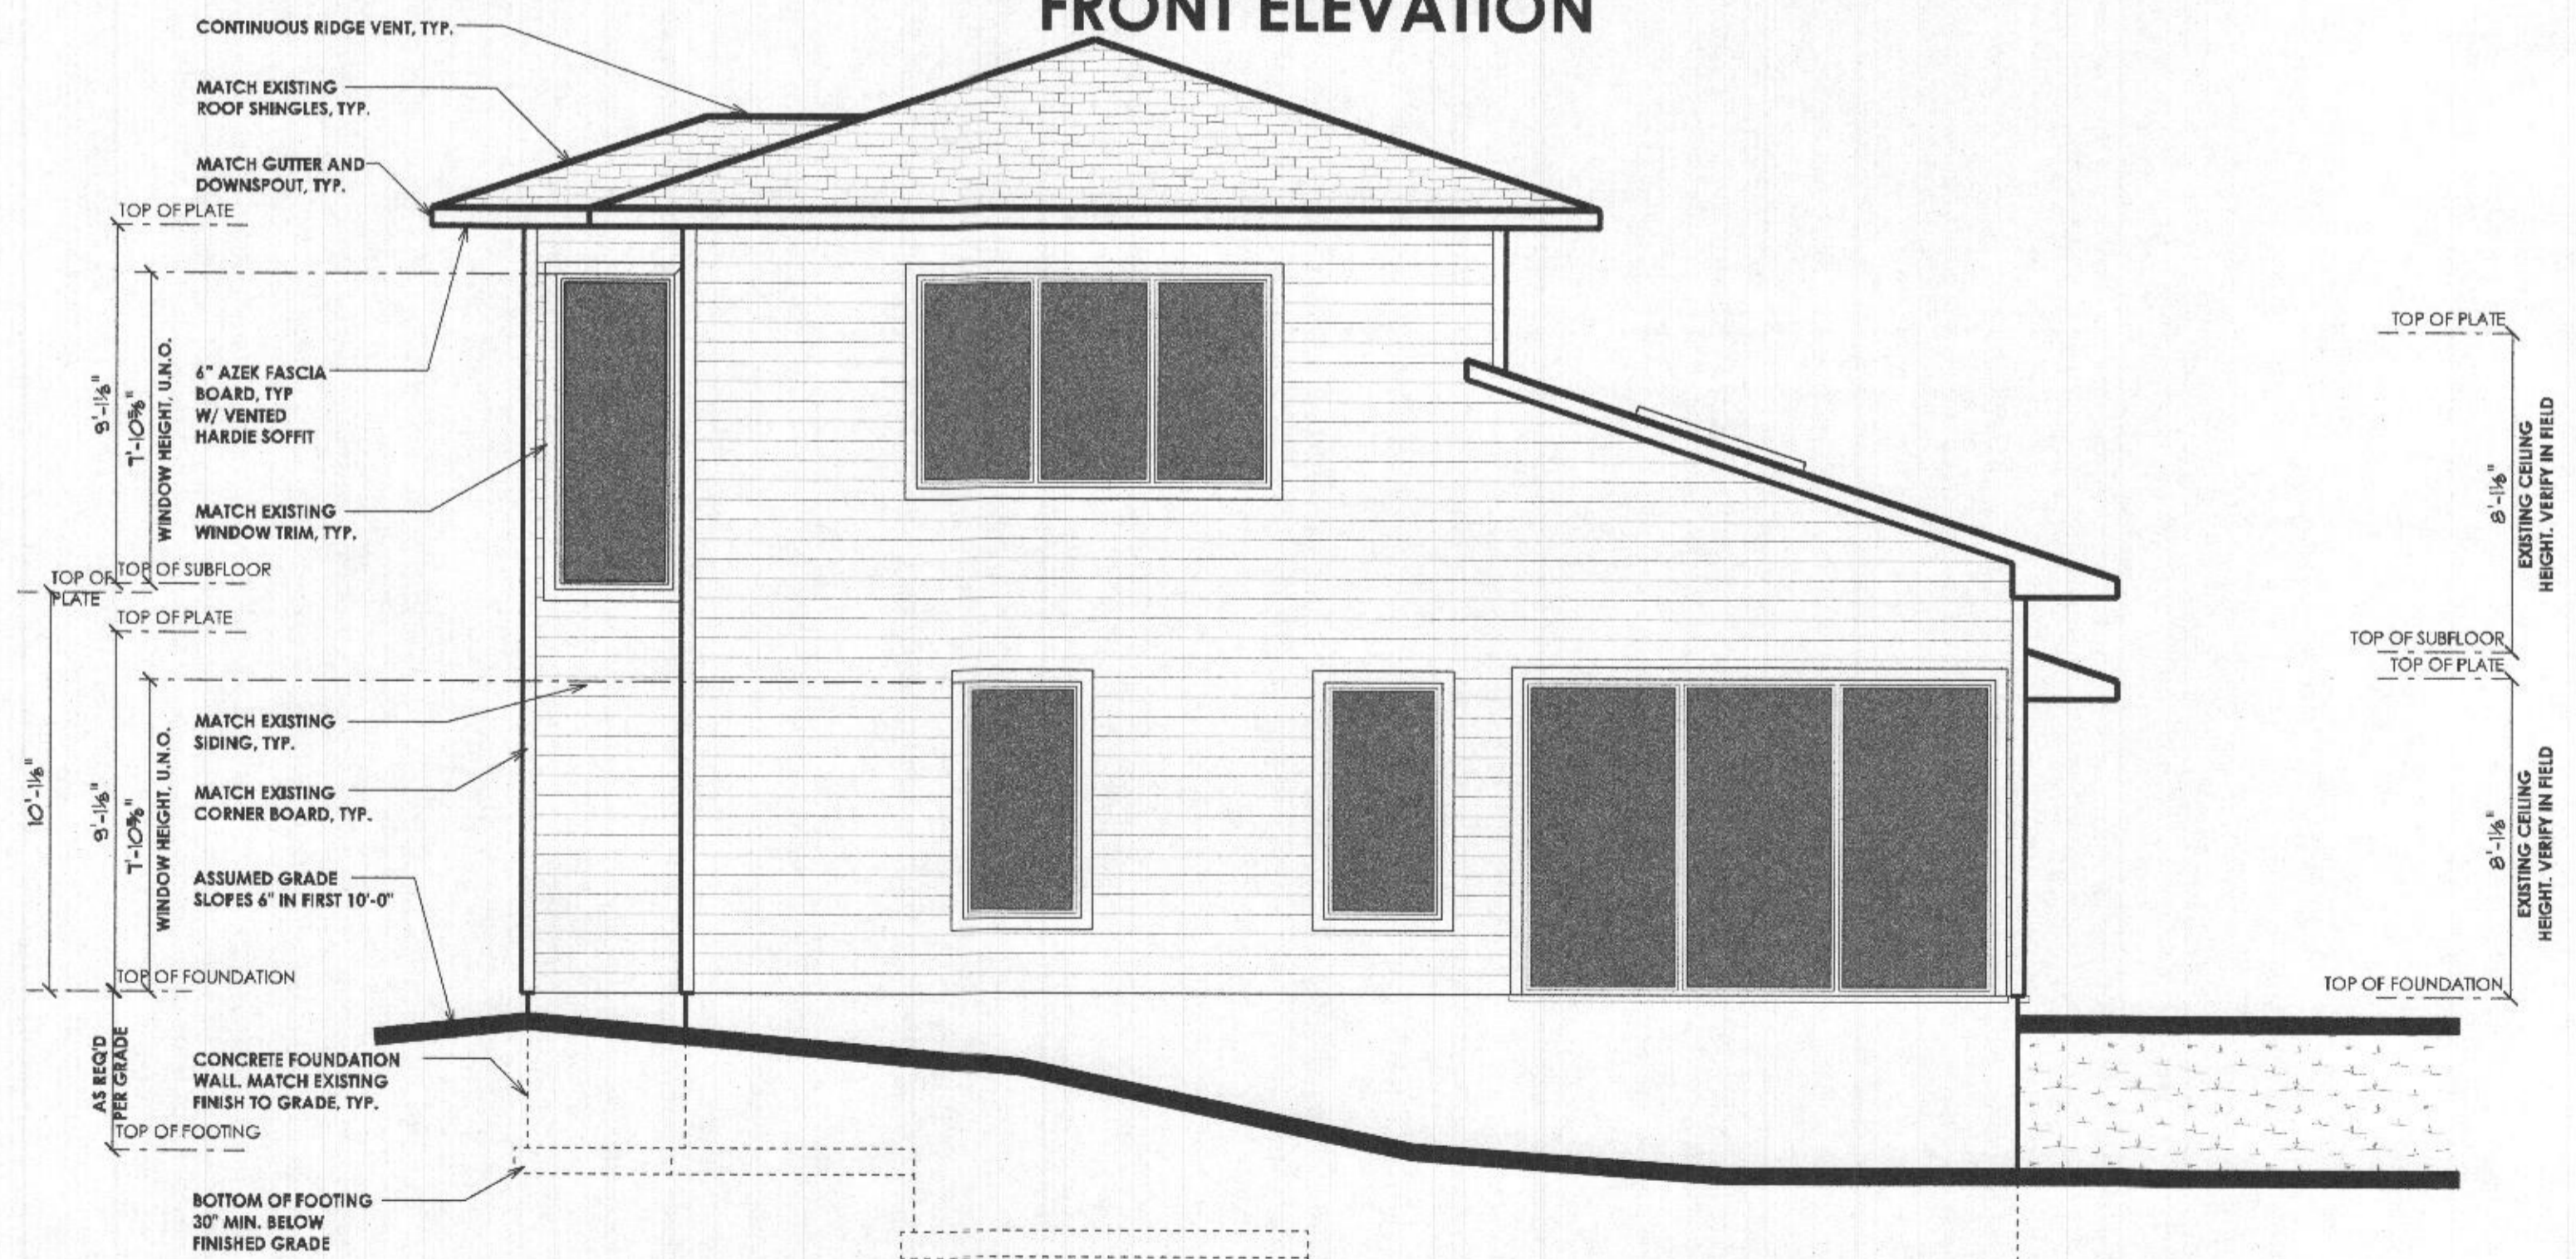

**LEFT ELEVATION**



*Matthew W. Anderson*  
 6/21/2022  
 Note: PE Seal is for Structural Design Only.

Professional Certification: I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 31582, Expiration 04/04/2023

**PROFESSIONAL CERTIFICATION**  
 I certify that these documents were prepared or approved by me, and that I am a duly licensed professional architect under the laws of the State of Maryland, License Number #14678  
 Expiration Date: 6/30/2022

WARNING: THIS DOCUMENT IS AN INSTRUMENT OF PROFESSIONAL SERVICE PREPARED BY JONATHAN RIVERA ARCHITECT. ALTERATION OF THIS DOCUMENT BY ANY PARTY OTHER THAN JONATHAN RIVERA ARCHITECT IS A VIOLATION OF LAW THAT WILL BE PROSECUTED TO THE FULLEST EXTENT.  
 Copyright © 2020  
 Jonathan Rivera Architect  
 All Rights Reserved

Designed by:  
*Jonathan Rivera*  
 78228A0800444

**PROPOSED RESIDENCE**

**PALOS-SUCIU RESIDENCE**

6570 Prestwick Drive  
 Highland, Maryland 20777

**ARCHITECT**  
 Jonathan Rivera AIA, NCARB  
 Howard County, Maryland

443.226.5745  
 jrivera@jonathanrivera.com

**STRUCTURAL ENGINEER**  
 Spoint1 Engineering  
 68 West Main Street  
 New Market, Maryland

(240) 822-3016  
 info@spoint1.com

**ISSUE DATES:**  
 6-28-19 REVIEW SET

**SCALE:** 1/4" = 1'-0"


**ELEVATIONS**

**1.02**

PRINT DATE:  
 Tuesday, June 21, 2022



**REAR ELEVATION**

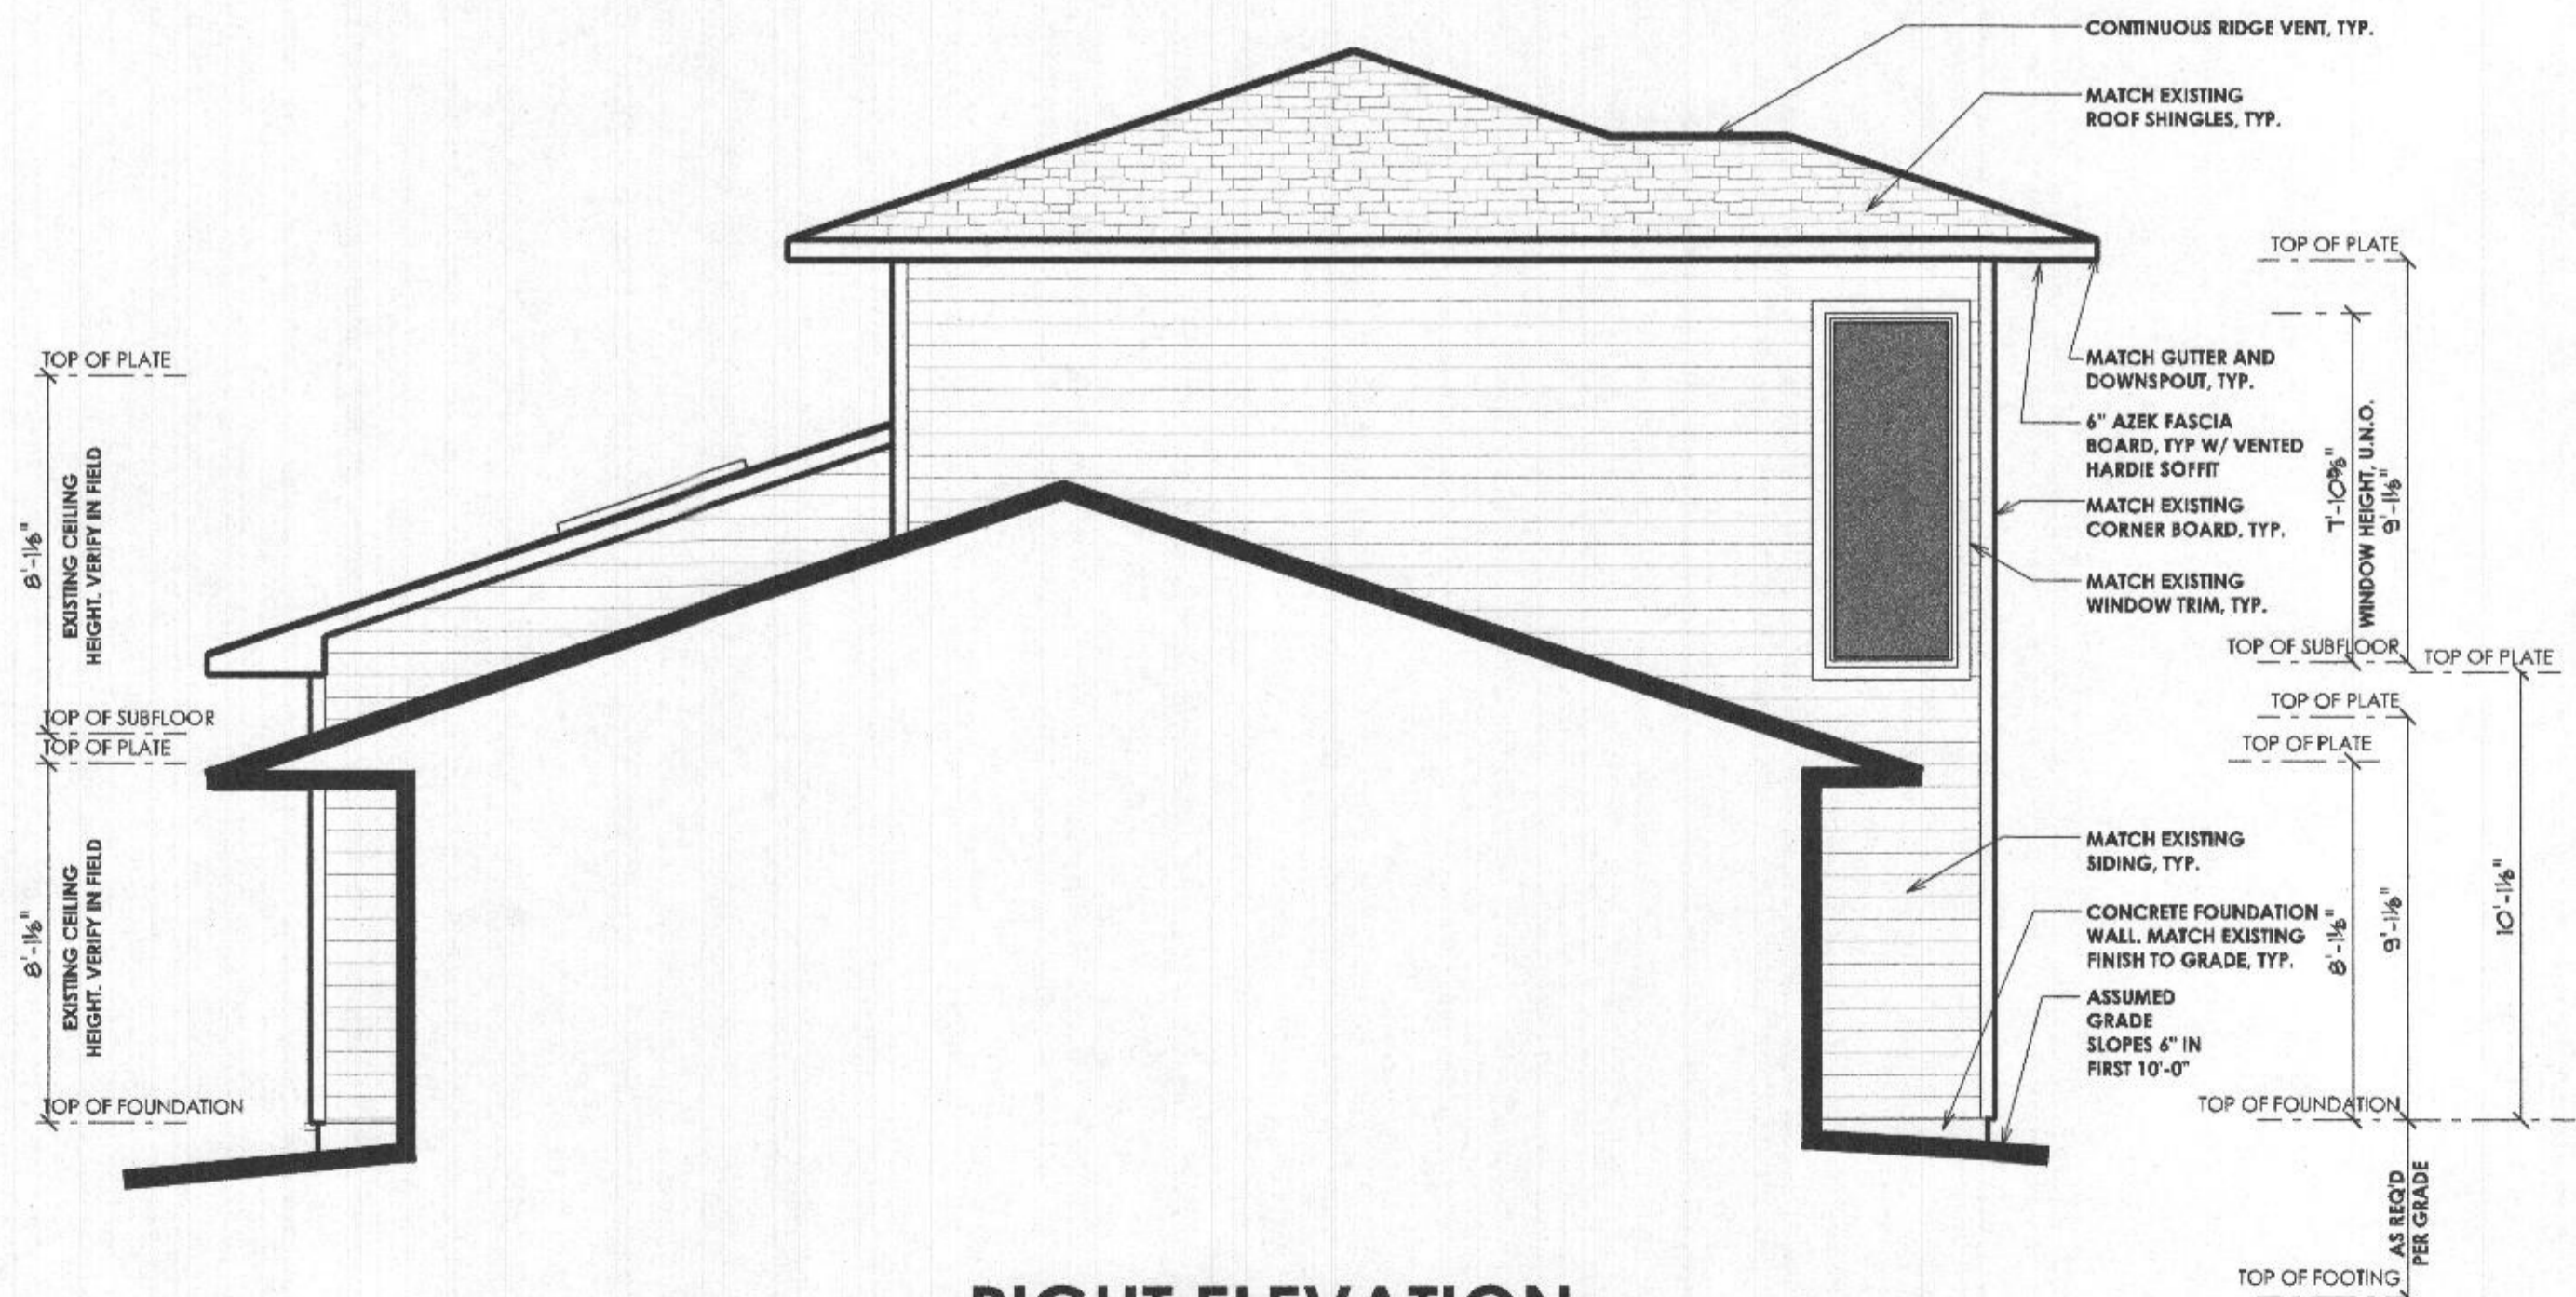

**RIGHT ELEVATION**



*Matthew W. Anderson*  
 6/21/2022  
 Note: PE Seal is for Structural Design Only.

Professional Certification: I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 31582  
 Expiration 04/04/2023

PROFESSIONAL CERTIFICATION  
I certify that these documents were prepared or approved by me, and that I am a duly licensed professional architect under the laws of the State of Maryland, License Number #14678, Expiration Date: 6/30/2022

WARNING: THIS DOCUMENT IS AN INSTRUMENT OF PROFESSIONAL SERVICE PREPARED BY JONATHAN RIVERA ARCHITECT. ALTERATION OF THIS DOCUMENT BY ANY PARTY OTHER THAN JONATHAN RIVERA ARCHITECT IS A VIOLATION OF LAW THAT WILL BE PROSECUTED TO THE FULLEST EXTENT.  
Copyright © 2020 Jonathan Rivera Architect All Rights Reserved

Created by:  
Jonathan Rivera  
P125AD0000044

**PROPOSED RESIDENCE**

**PALOS-SUCIU RESIDENCE**  
6570 Prestwick Drive  
Highland, Maryland 20777

ARCHITECT  
Jonathan Rivera AIA, NCARB  
Howard County, Maryland

443.226.5745  
jrivera@jonathanrivera.com

STRUCTURAL ENGINEER  
Spoin1 Engineering  
68 West Main Street  
New Market, Maryland

(240) 822-3016  
info@spoin1.com



ISSUE DATES:  
6-28-19 REVIEW SET

SCALE: 1/4" = 1'-0"

**FOUNDATION**


**2.01**

PRINT DATE:  
Tuesday, June 21, 2022

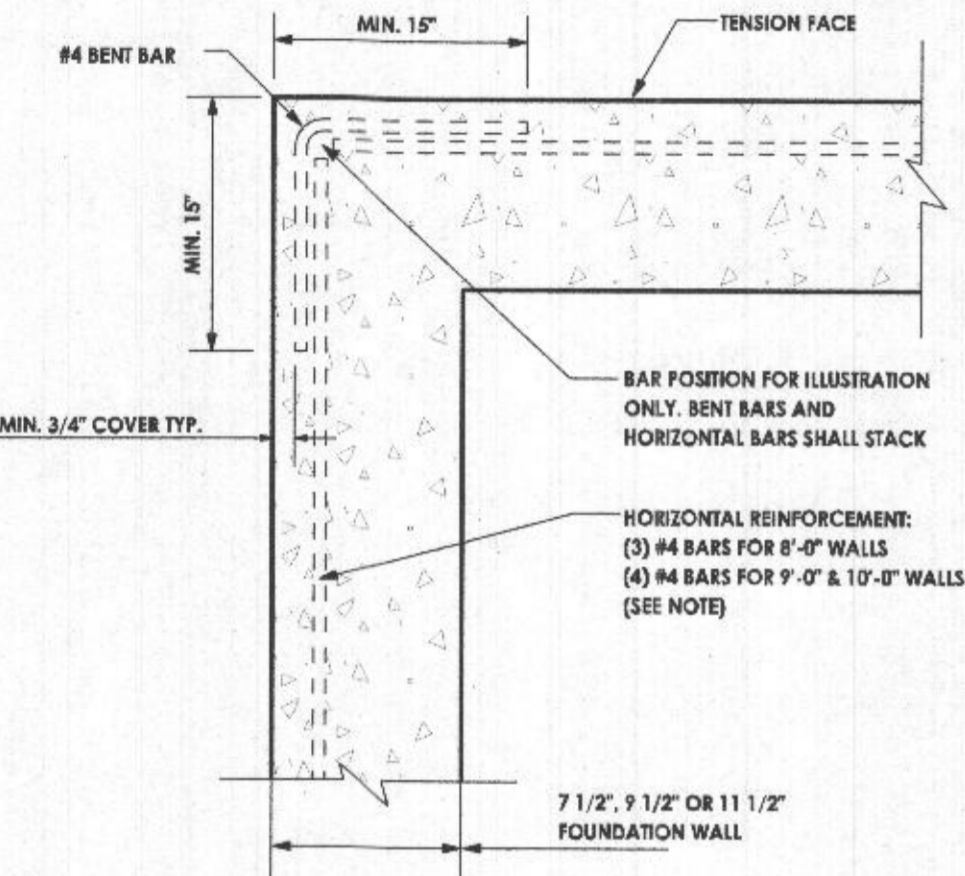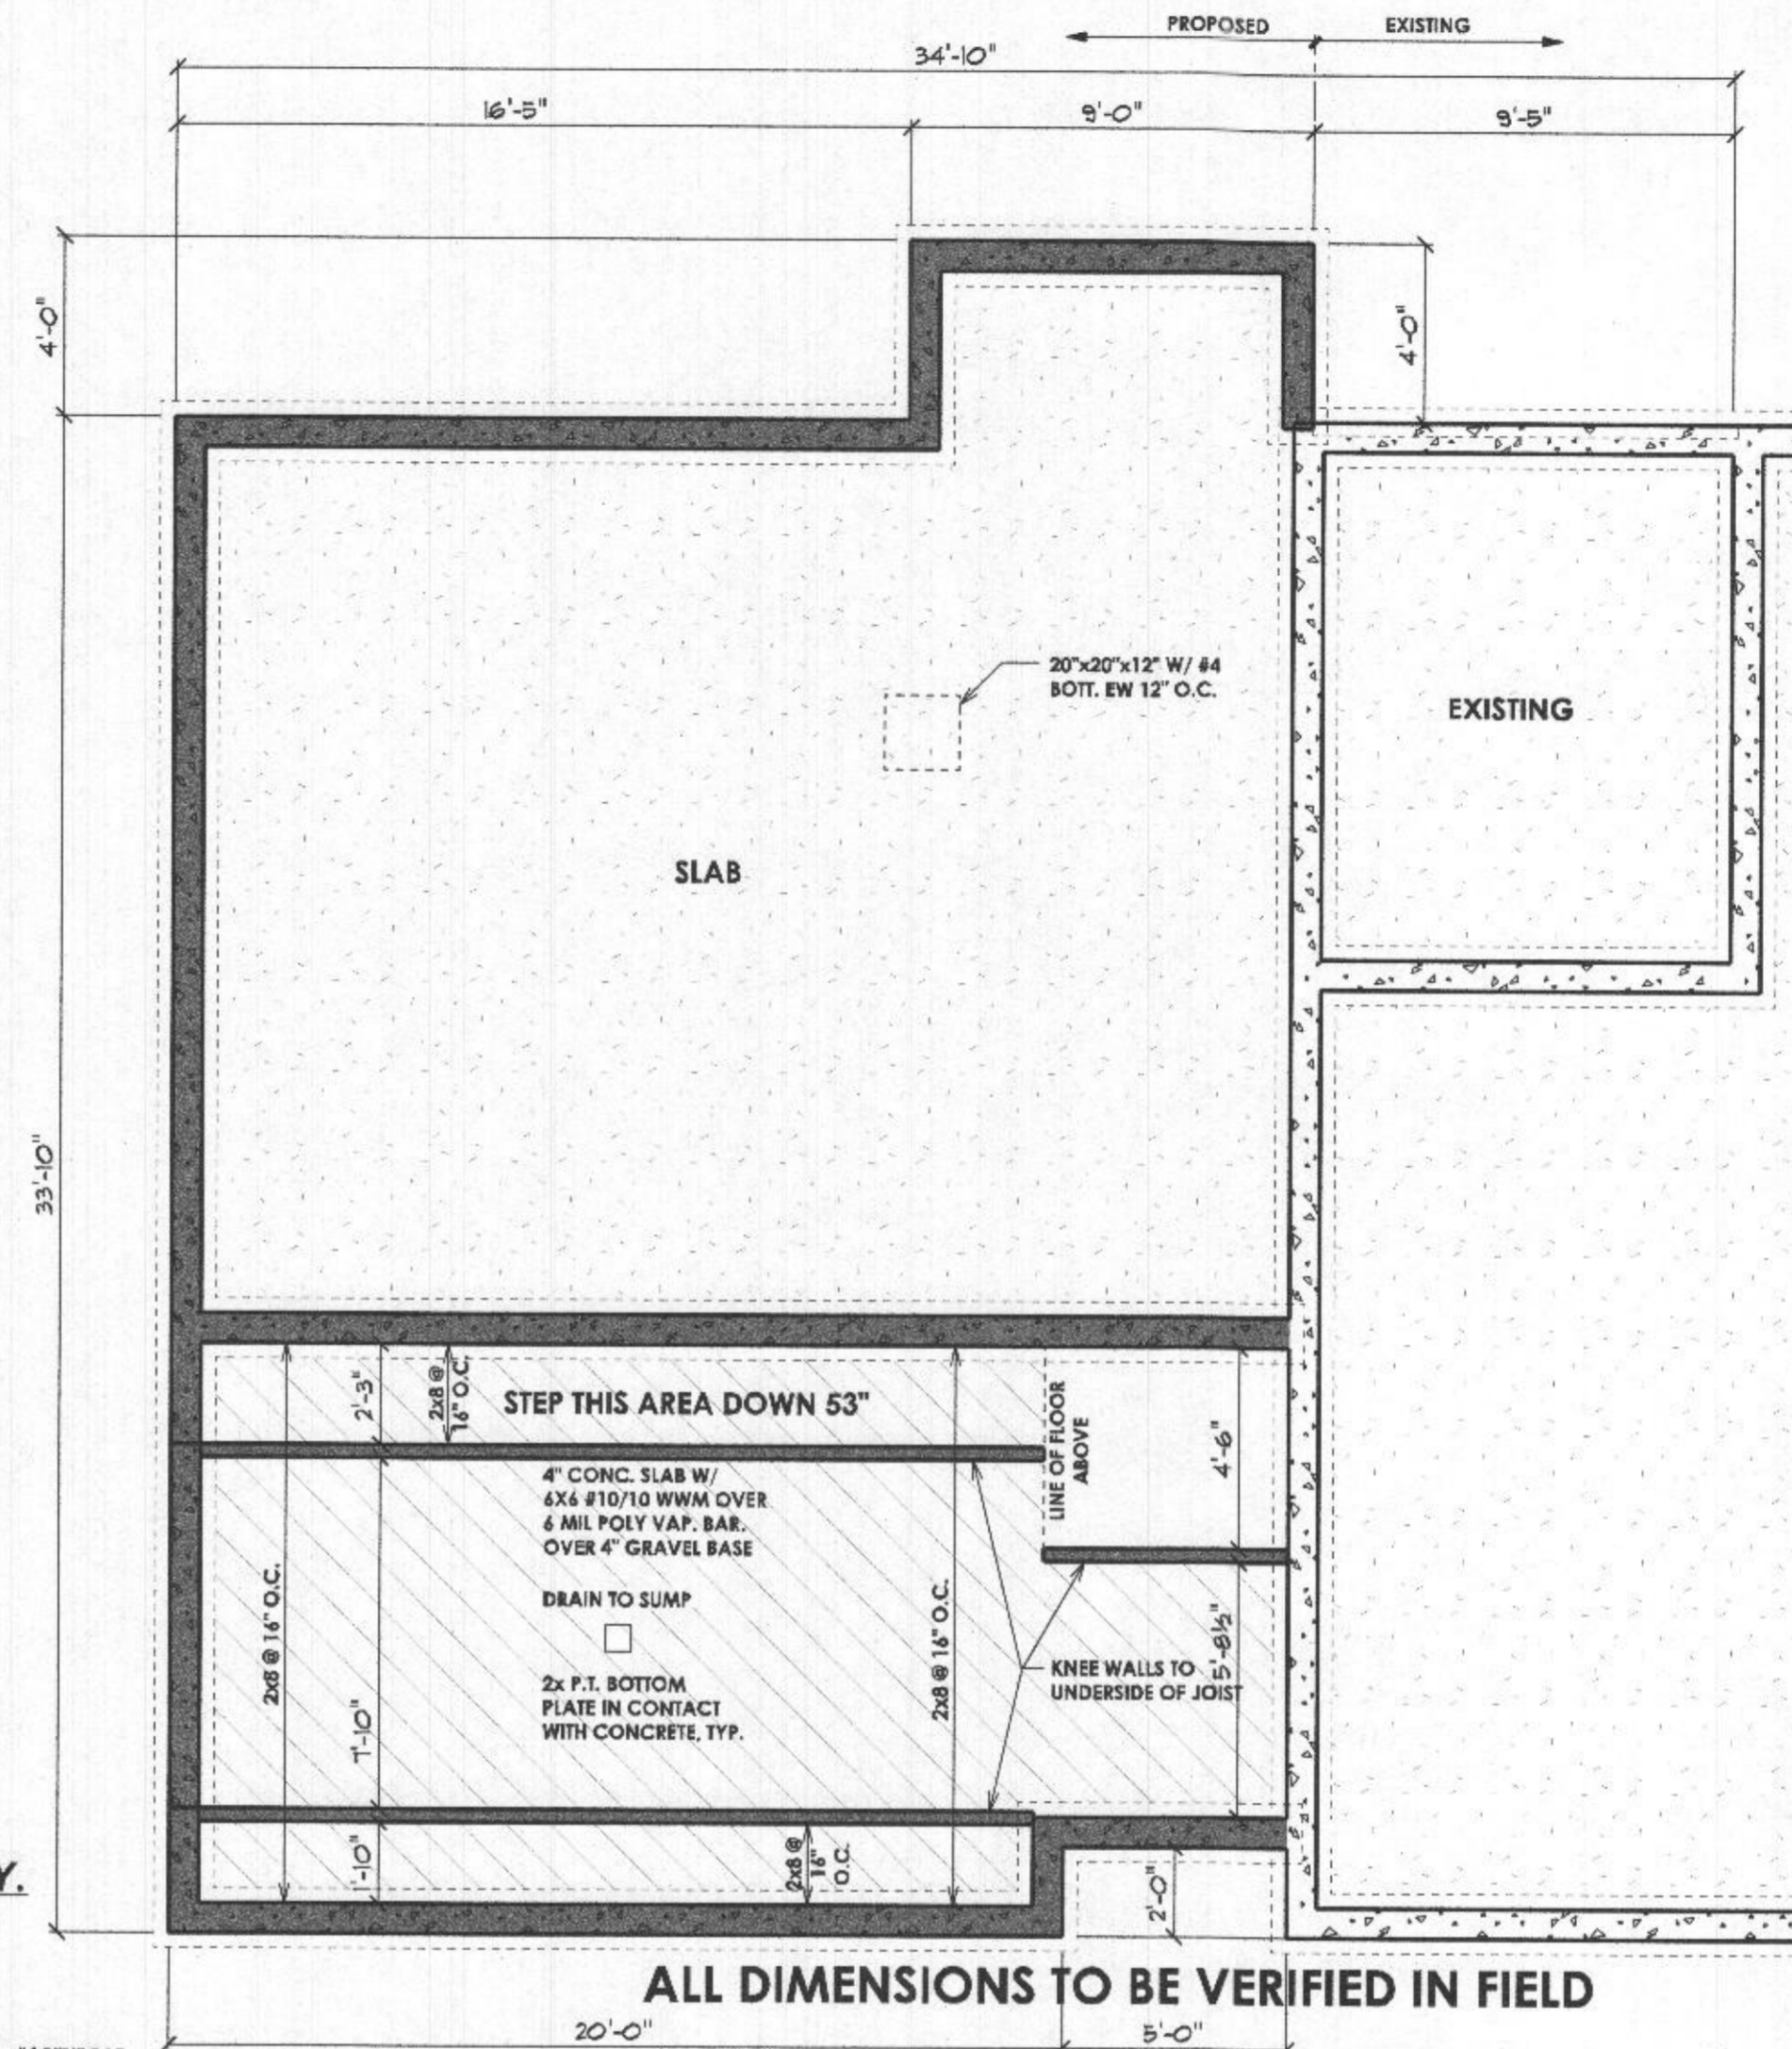


NOTE:  
FOR ALL WALL HEIGHTS, A MINIMUM OF ONE HORIZONTAL BAR SHALL BE LOCATED WITHIN THE TOP 24" AND A MINIMUM OF ONE IN THE BOTTOM 24". THE REMAINING REQUIRED BARS SHALL BE SPACED OVER THE HEIGHT OF THE WALL AS EQUALLY AS PRACTICAL.

**TYPICAL CORNER REINFORCING UNO**

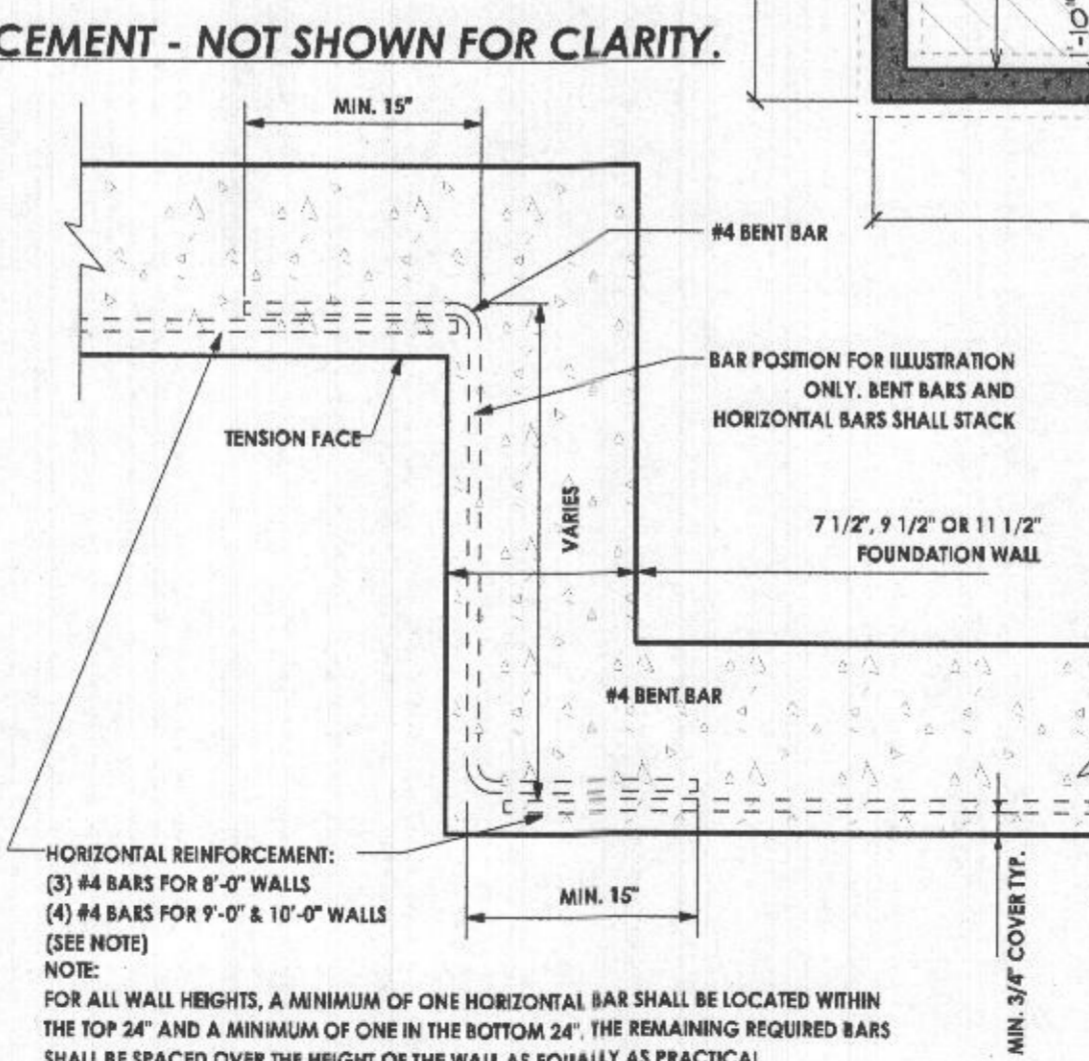

NOTE:  
FOR ALL WALL HEIGHTS, A MINIMUM OF ONE HORIZONTAL BAR SHALL BE LOCATED WITHIN THE TOP 24" AND A MINIMUM OF ONE IN THE BOTTOM 24". THE REMAINING REQUIRED BARS SHALL BE SPACED OVER THE HEIGHT OF THE WALL AS EQUALLY AS PRACTICAL.

**TYPICAL REINFORCING AT "Z" INTERSECTIONS - UNO**

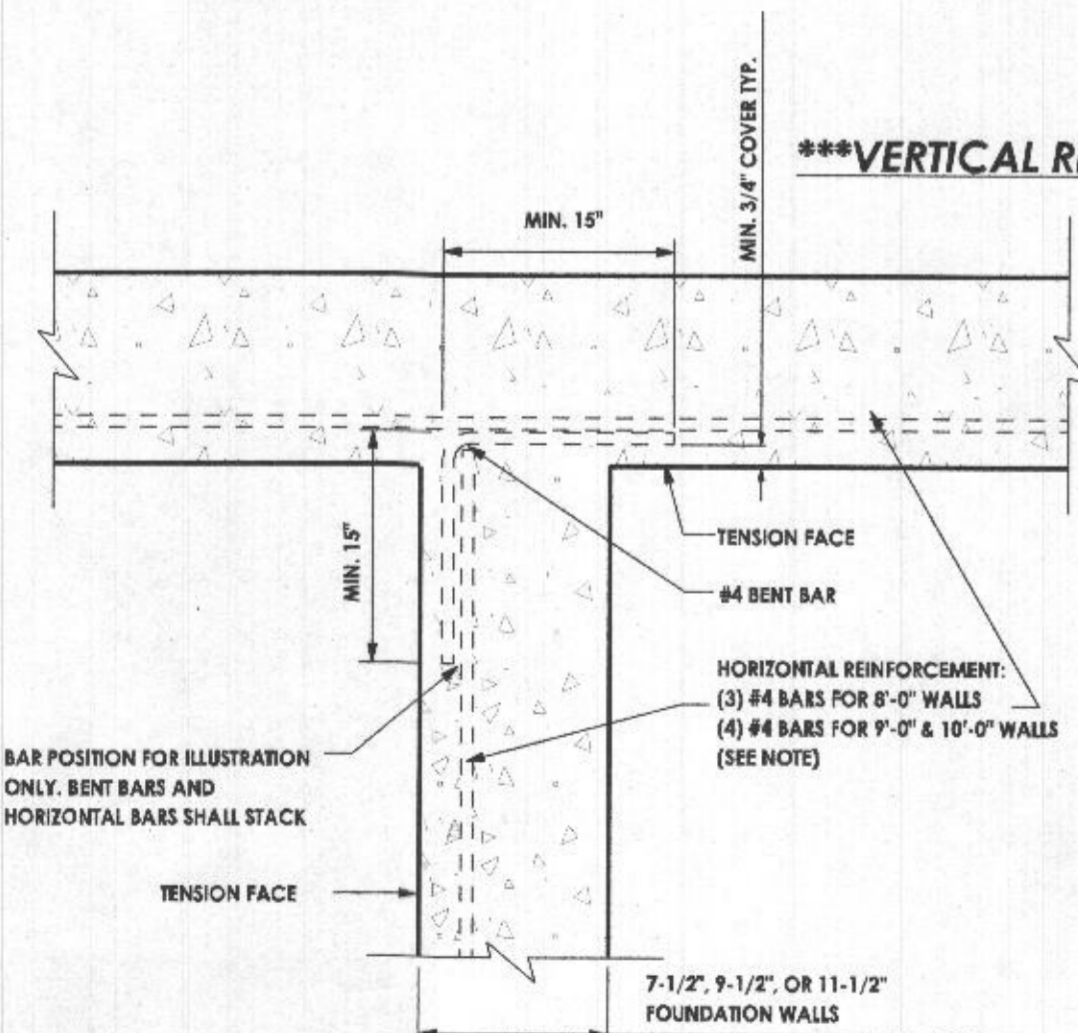

NOTE:  
FOR ALL WALL HEIGHTS, A MINIMUM OF ONE HORIZONTAL BAR SHALL BE LOCATED WITHIN THE TOP 24" AND A MINIMUM OF ONE IN THE BOTTOM 24". THE REMAINING REQUIRED BARS SHALL BE SPACED OVER THE HEIGHT OF THE WALL AS EQUALLY AS PRACTICAL.

**TYPICAL REINFORCING AT "T" INTERSECTIONS - UNO**

**TYPICAL ADDITION FOUNDATION WALL**

MIN. 8" REINFORCED CONCRETE FOUNDATION WALL (THICKNESS & REINFORCING PER SOIL & GRADE CONDITIONS & CODE)  
MIN. 8"x16" CONTINUOUS FOOTING

▬ = EXISTING FOUNDATION WALL  
▬ = PROPOSED FOUNDATION WALL

**FOUNDATION NOTES**

- 2000 PSF MIN SOIL BEARING CAPACITY ASSUMED
- BEAMS, JOISTS, HEADERS & RAFTERS TO BE SPF #1/#2 OR EQ. TYP. THROUGHOUT U.N.O.
- ALL LOCATIONS FOR HVAC, SUMP PUMPS, ROUGH-INS, H/W/H, A/H AND OTHER FEATURES ARE SUBJECT TO BUILDER DISCRETION ON SITE
- FOUNDATION WALL MIN. THICKNESS 8" OR 10" WHERE STEM WALL AT BRICK LEDGE EXCEEDS 12" HIGH
- MIN. 1/2" HOOKED ANCHOR BOLTS EMBEDDED A MIN. 7" INTO CONC. SHALL BE SPACED AT 4' O.C. AND LOCATED 4" TO 12" FROM EACH END OF ALL SILL PLATE PIECES.
- REFER TO WALL SECTION(S) FOR FOUNDATION WALL DETAILS.



*Matthew W. Anderson*  
6/21/2022  
Note: PE Seal is for Structural Design Only.

Professional Certification: I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 31582, Expiration 04/04/2023