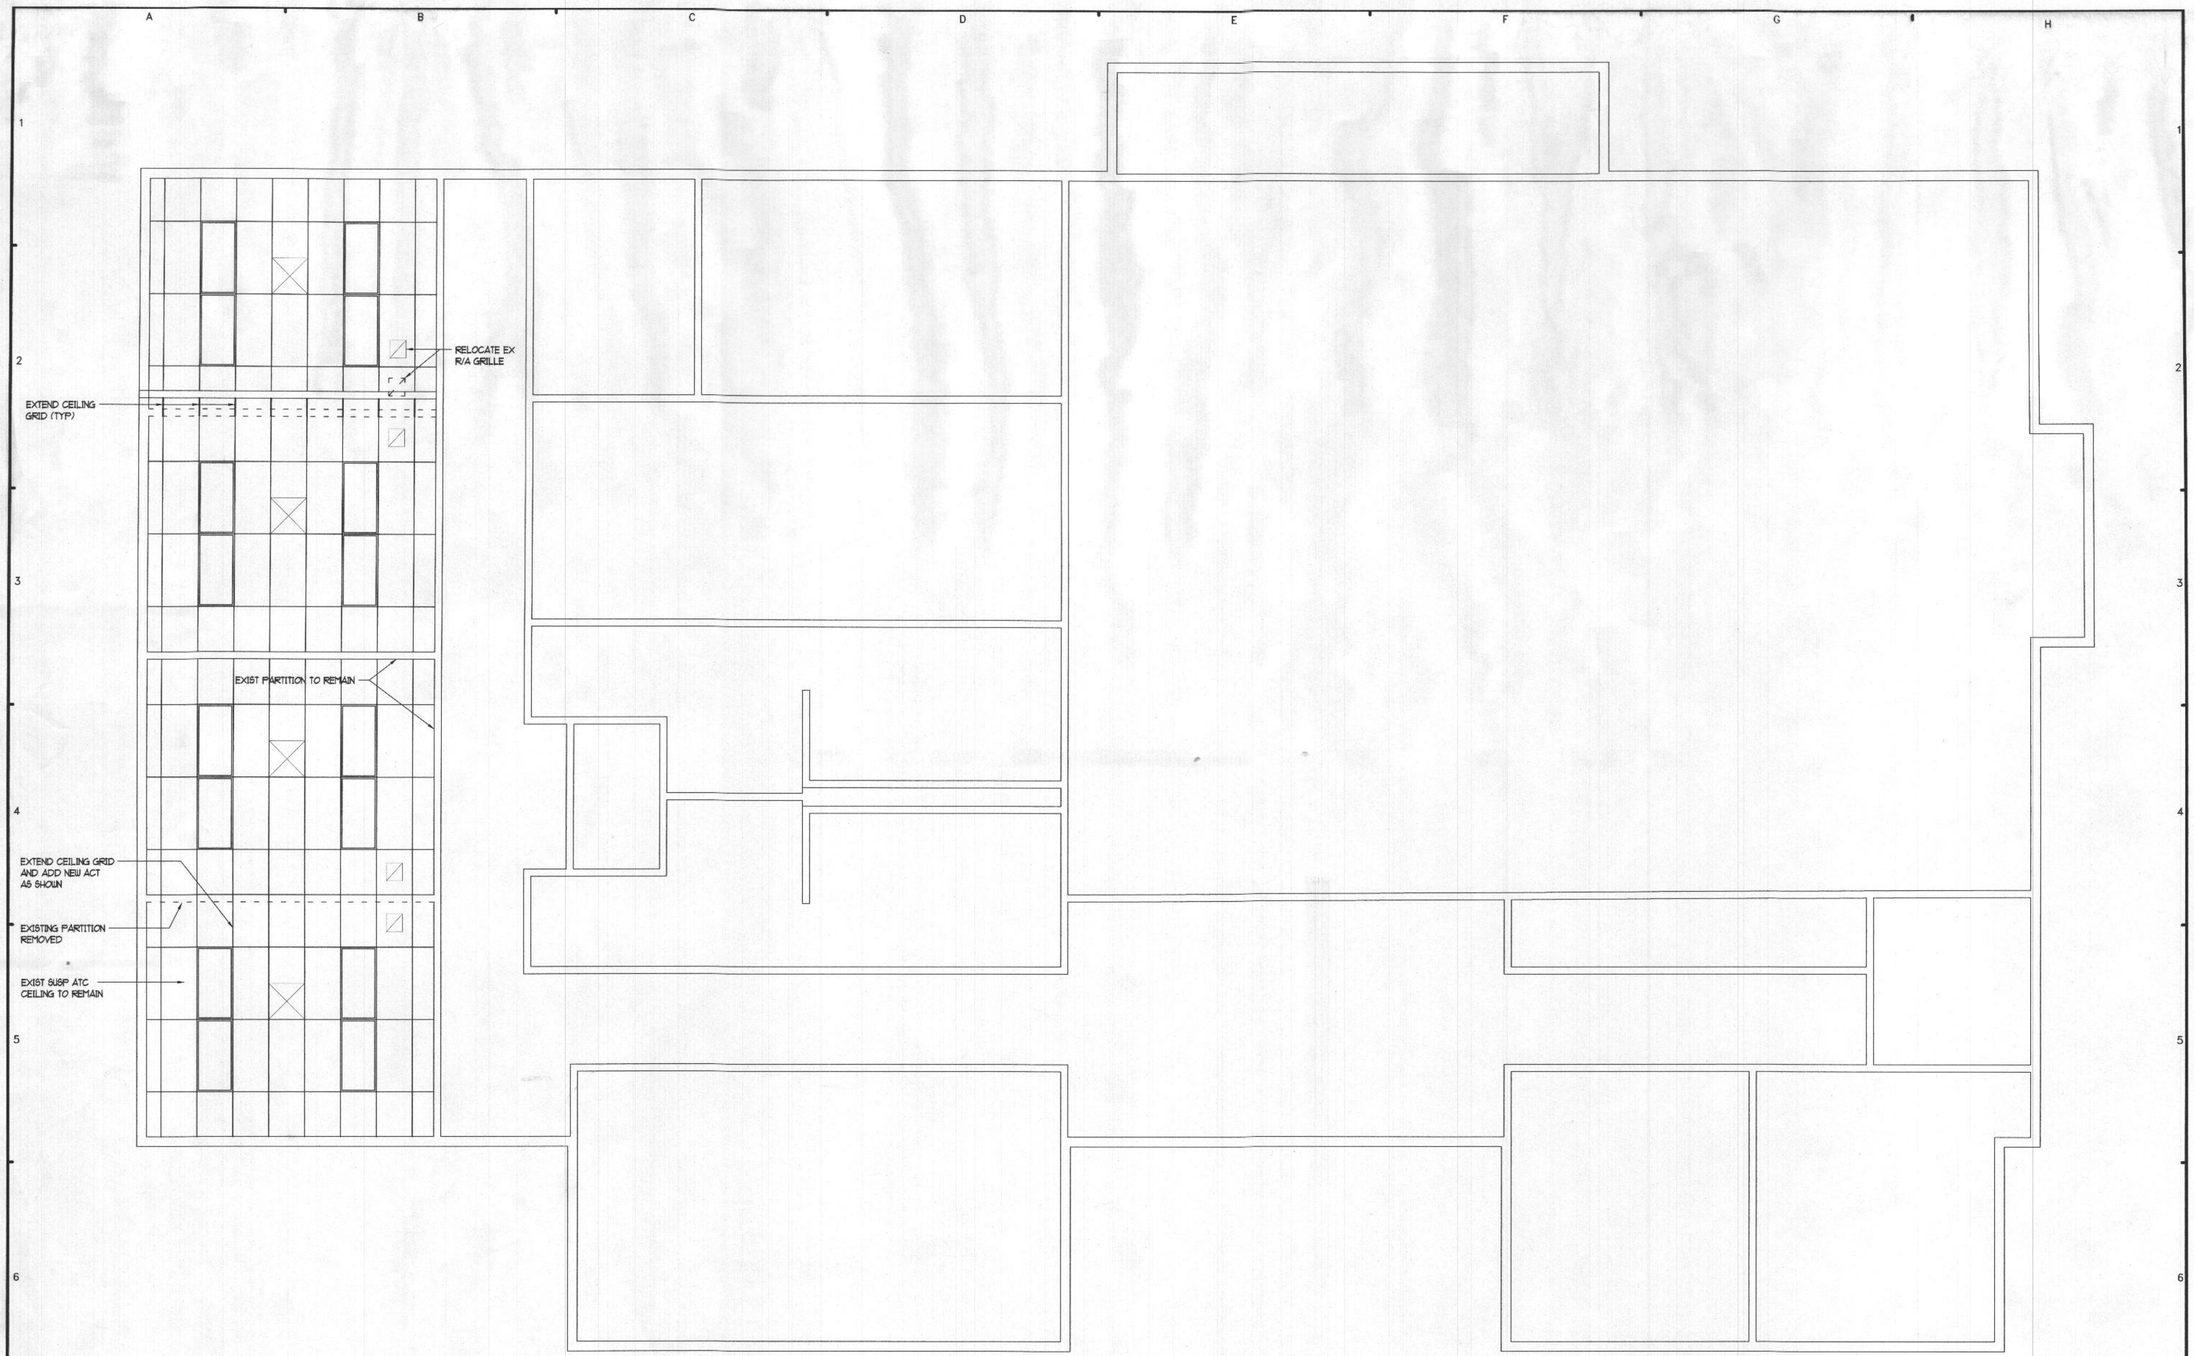

N

REFLECTED CEILING PLAN

1/4" = 1'-0"

RECEIVED
JUL 18 2022
LICENSES & PERMITS DIVISION

REVISIONS

Owner:
Lexi Young
Your Journey Daycare
address
Phone:

Construction Manager:

Structural Engineer:

Mechanical/Electrical/Plumbing Engineer:

Civil Engineer:

Your Journey Daycare at St. Andrews Episcopal Church
2892 Roxbury Mills Rd.
Glenwood, Maryland 21738

MORGAN DESIGN GROUP
Architecture
Interior Design
Landscape Design
2775 Green Leaf Ct.
Suite B
Westminster, Maryland 21157
Phone: 410-356-0122
Fax: 443-926-9964
www.mdgarch.com

ISSUED FOR:
- ☐ PRELIMINARY/PROGRESS (NOT FOR CONST.)
- ☐ PRICING ONLY
- ■ PERMIT
- ☐ CONSTRUCTION DOCUMENTS

SEAL

ARCHITECTURAL REGISTRATION BOARD 7573-R JEFFREY BENSON MORGAN STATE OF MARYLAND

"I certify that these documents were prepared or approved by me, and that I am duly licensed architect under the laws of the State of Maryland, license number 7573-R, Expiration date April 5, 2023"

© COPYRIGHT 2022, MORGAN DESIGN GROUP

DESIGN	JBM
DRAWN	STAFF
APPROVED	
SCALE	AS SHOWN
DATE	MARCH 28, 2022
CAD FILE	
PROJECT NO.	

DRAWING TITLE

FLOOR PLAN

A-1

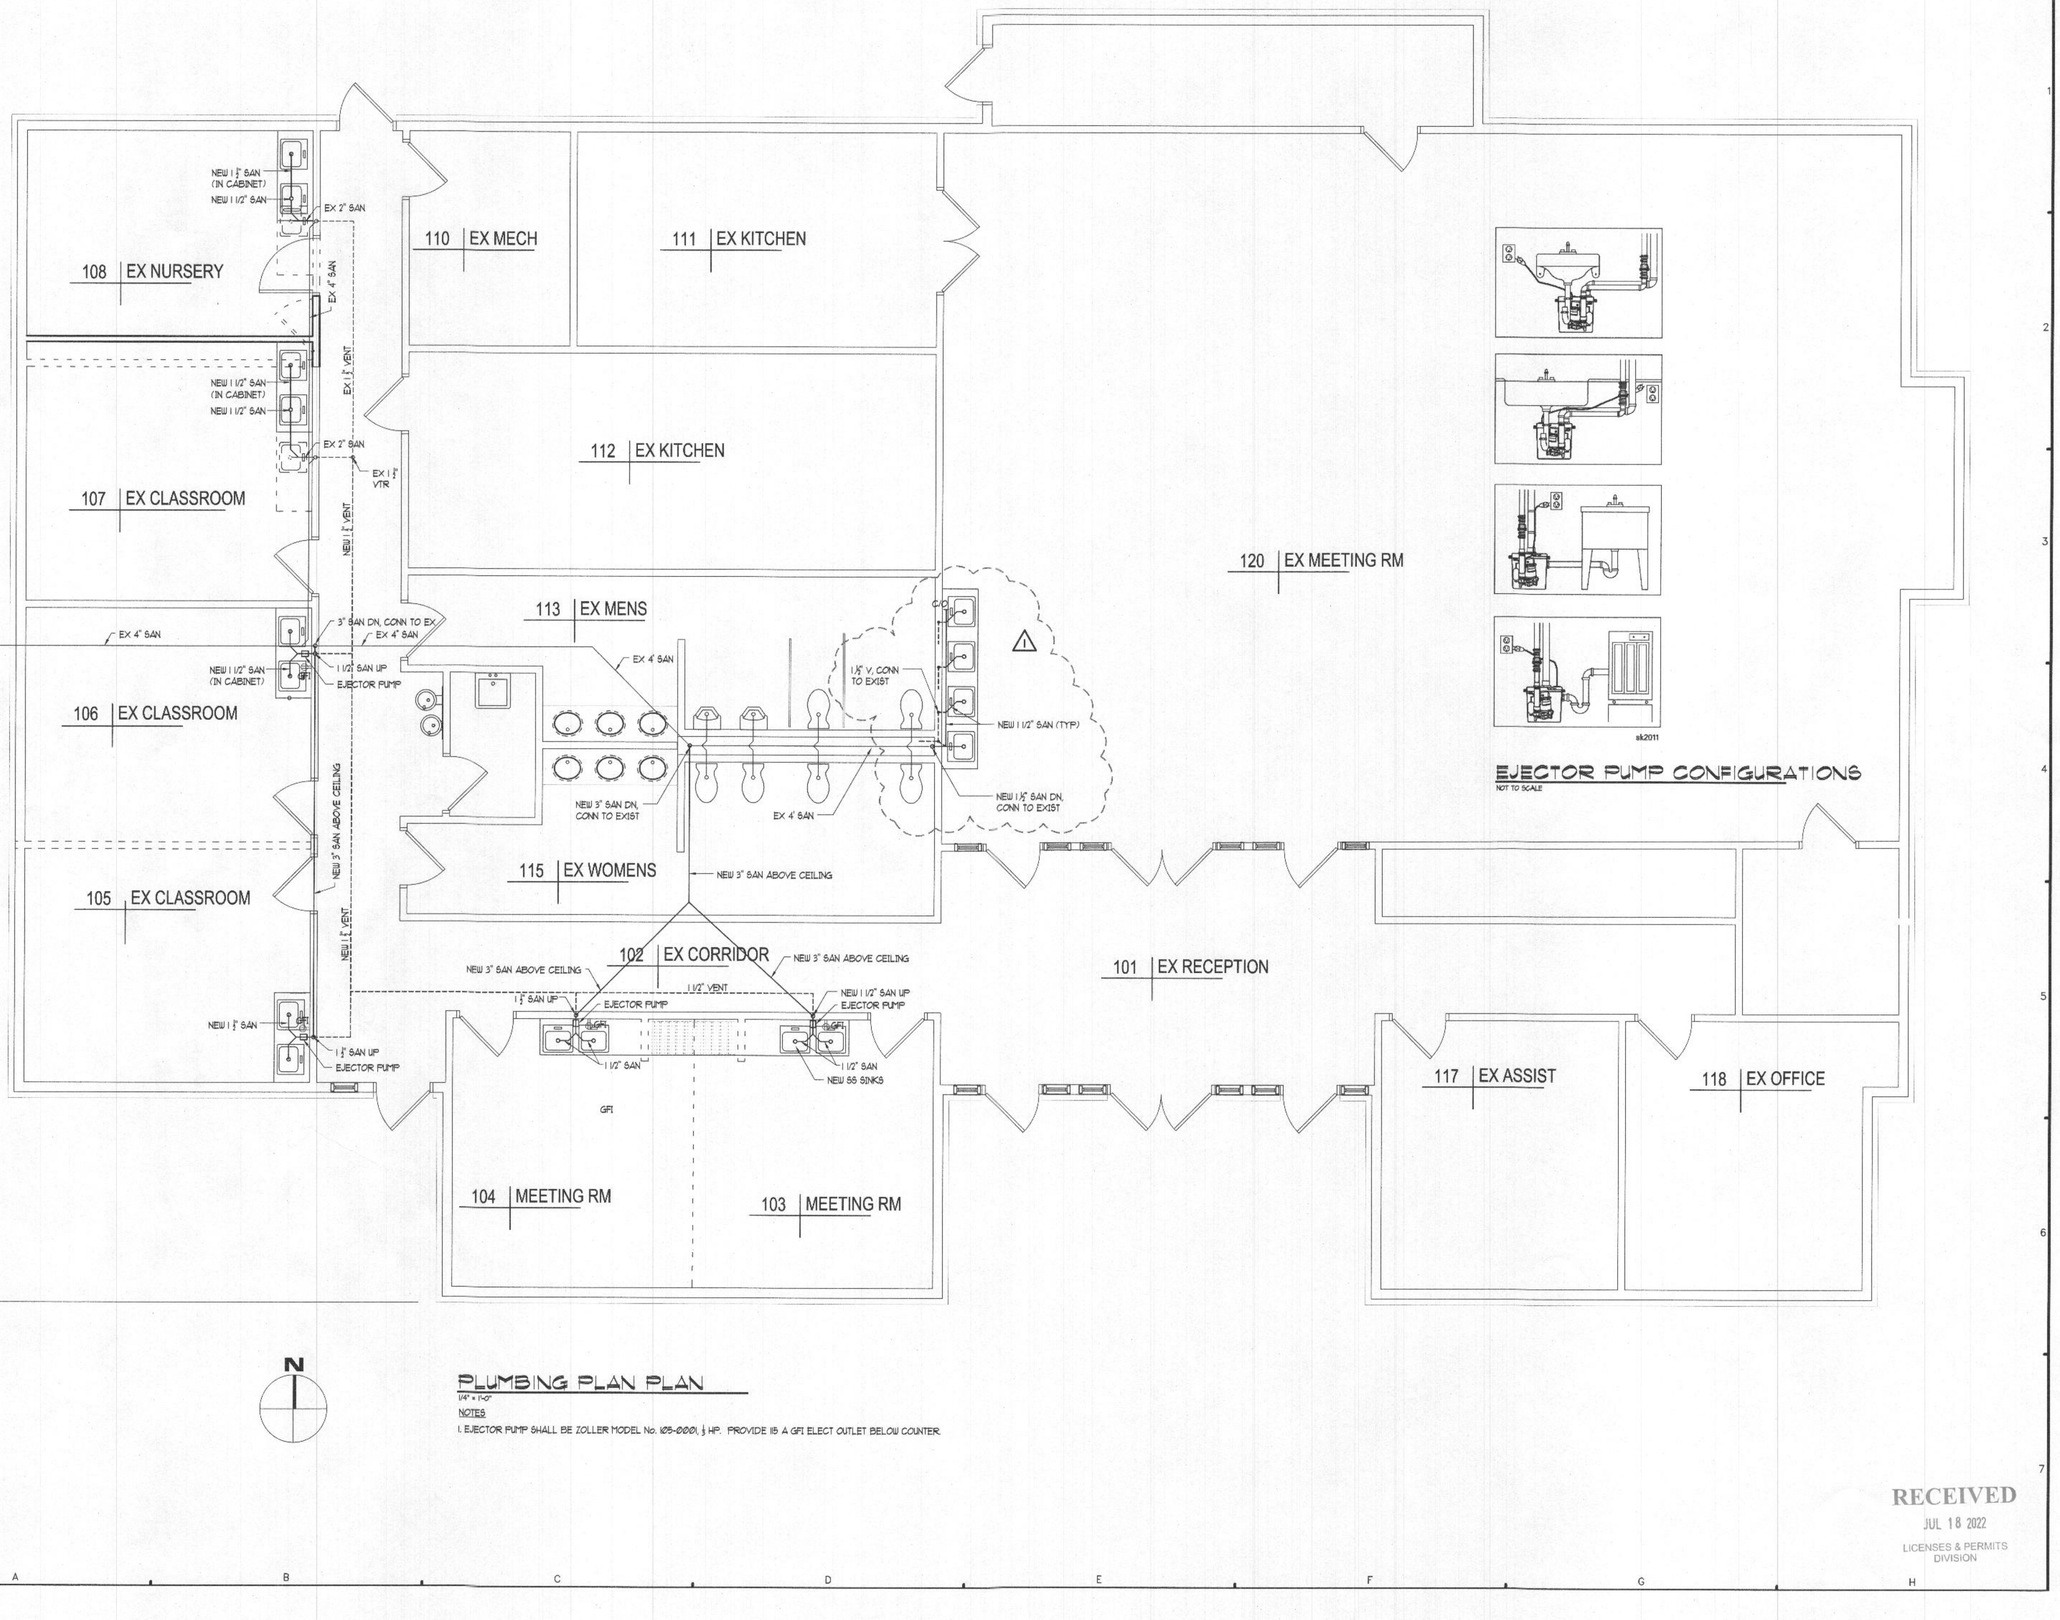

EJECTOR PUMP CONFIGURATIONS
NOT TO SCALE

PLUMBING PLAN PLAN

1/4" = 1'-0"

NOTES

1. EJECTOR PUMP SHALL BE ZOLLER MODEL No. 105-0001, ½ HP. PROVIDE 115 A GFI ELECT OUTLET BELOW COUNTER.

RECEIVED
JUL 18 2022
LICENSES & PERMITS DIVISION

1	6/22/22	ADD SINKS TO MEETING RM

REVISIONS

Owner:
Lexi Young
Your Journey Daycare
address
Phone:

Construction Manager:

Structural Engineer:

Mechanical/Electrical/Plumbing Engineer:

Civil Engineer:

Your Journey Daycare
at
St. Andrews Episcopal Church
2892 Roxbury Mills Rd.
Glenwood, Maryland 21738

MORGAN DESIGN GROUP
Architecture
Interior Design
Landscape Design
2776 Green Leaf Ct.
Suite B
Westminster, Maryland 21157
Phone: 410-556-0122
Fax: 443-926-9964
www.mdgarch.com

ISSUED FOR:
- ☐ PRELIMINARY/PROGRESS (NOT FOR CONST.)
- ☐ PRICING ONLY
- ■ PERMIT
- ☐ CONSTRUCTION DOCUMENTS

SEAL
Scott Misko
6-28-22

"I certify that these documents were prepared or approved by me, and that I am duly licensed architect under the laws of the State of Maryland, license number 7573-R, Expiration date April 5, 2023"

© COPYRIGHT 2022, MORGAN DESIGN GROUP

DESIGN	JBM
DRAWN	STAFF
APPROVED	
SCALE	AS SHOWN
DATE	MARCH 28, 2022
CAD FILE	
PROJECT NO.	

DRAWING TITLE

PLUMBING PLAN

P-1

SOILS LEGEND

SOIL	NAME	CLASS
ChA	Chester silt loam, 0 to 3 percent slopes	B
ChB2	Chester silt loam, 3 to 8 percent slopes, moderately eroded	B
ChC2	Chester silt loam, 8 to 15 percent slopes, moderately eroded	B

NOTES:
* Hydric soils and/or contains hydric inclusions
** May contain hydric inclusions
† Generally only within 100-year floodplain areas

DRAINAGE AREA DATA

AREA = 0.49 AC.± T/C = 10.00 MIN. (MIN.)	A	C = 0.37 % IMP. = 42.9%
AREA = 0.30 AC.± T/C = 11.12 MIN.	B	C = 0.66 % IMP. = 85%
AREA = 2.88 AC.± T/C = 15.00 MIN. (MAX.)	C	C = 0.30 % IMP. = 18%
AREA = 3.67 AC.± T/C = 15.00 MIN. (MAX.)	D	C = 0.28 % IMP. = 20%
AREA=0.88 AC +/- T/C=17.80 MIN	E	RCN=67 % IMP=11.3%
AREA=0.37 AC+/- T/C=11.12 MIN	F	C=0.65 % IMP=50%

STORMWATER MANAGEMENT POND

(PRIVATE)
HAZARD CLASS 'A'
(SEE DETAILS SHEETS 3 & 4)

MAINTENANCE SCHEDULE
WATER QUALITY STRUCTURE INDEX

1. Water quality structures will require periodic cleaning. Owners of these facilities will have to clean them as needed.
2. Maintenance of these facilities will consist of visually out the stormwater and cleanout of the swale and repair of the facility as needed. Periodic inspections of these facilities will be made by the owner.
3. The disposal of the liquid and solid matter shall be as follows: A. All liquid material in the stormwater shall be pumped into a suitable tank truck and disposed of at an approved sanitary disposal site. Permits will be taken by an approved sewage treatment plant for discharge.
B. The solid material shall be handled in an approved sanitary landfill.
4. The inlet, pipes and structures parts shall be repaired, as needed.
5. Stormwater inlet and outlet channels shall be periodically inspected. Blockages shall be removed and disposed of as required in 3B above.

OPERATION AND MAINTENANCE SCHEDULE FOR STORMCEPTOR WATER QUALITY SYSTEMS

1. Stormceptor water quality structures will require periodic inspection and cleaning to minimize operation and function. Owners will have the Stormceptor unit inspected yearly or as required by Howard County, utilizing the Stormceptor Inspection/Maintenance Form. Inspections will be done by using a long Plexiglas tube ("dipstick gauge") to measure water depth in the sump. When sediment depths exceed limit specified (see Table 3 of Technical Manual) then cleaning of the unit is required.
2. Stormceptor water quality structures shall be inspected and cleaned immediately after petroleum spills, per local emergency or regulatory agencies.
3. Maintenance of Stormceptor units should be done by a vacuum truck which will remove the water, sediment, debris, floating hydrocarbons and other pollutants in unit. The proper disposal or recycling of the removed materials and liquid must be followed.
4. Inlet and outlet pipes must be checked for any obstructions and if any obstructions are found they must be removed. Structural parts of the Stormceptor will be repaired as needed.
5. Owner shall retain and keep Stormceptor inspection/maintenance forms available to Howard County officials upon their request.

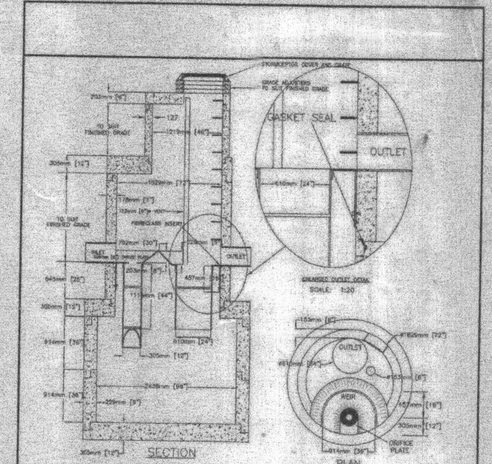

STORMCEPTOR IS PROTECTED BY ONE OR MORE OF THE FOLLOWING PATENTS:
Canadian Patent No. 2,009,209
Canadian Patent No. 2,137,942
U.S. Patent No. 4,985,148
U.S. Patent No. 5,405,531
U.S. Patent No. 5,725,760
U.S. Patent No. 5,753,115

Notes:
1. Dimensions may vary regionally due to different manufacturer's.
2. Access any is offset to allow access to the fiberglass bypass slab unit to allow inspection and maintenance from the surface.
3. Pipe installation by grouting or flexible boots.
4. Flexible boots may not be suitable for all installations. Please contact your sales representative for further information.
   a. 610 mm [24"] outlet to be used for cleanout access to the treatment chamber.
   d. Safety grates for the 610 mm [24"] outlet are available.

DATE	N/A	SCALE	1:40
NO.	10/25/99	BY	A.M.G.

STC 2400 PRECAST CONCRETE STORMCEPTOR
FIBREGLASS DISC DESIGN - 2400 U.S. GALLON CAPACITY

CONCRETE STORMCEPTOR ORDER REQUEST FORM

CONTRACTOR INFORMATION
NAME
ADDRESS
CITY
STATE
ZIP CODE
CONTACT
PHONE
FAX

OFFICE USE ONLY
ORDER #
DATE
INTERNAL SCALE

OWNER INFORMATION
NAME
PHONE
FAX

STORMCEPTOR MODEL
900 ☐ 3600 ☐
1200 ☐ 4800 ☐
1800 ☐ 6000 ☐
2400 ☒ 7200 ☐
IMPERV. D. AREA = AC.

INSERT SIZE
DISC ☐
22" ☐
32" ☐
44" ☐
CUSTOM —

PLEASE DRAW ORIENTATION (ANGLE) OF INLET PIPES (MAX 2) AND OUTLET PIPE (1) ON DIAGRAM ALONG WITH PIPE INSIDE DIAMETER (ID.) AND INVERT ELEVATION (I.E.). CLEARLY MARK INLET PIPES WITH AN 'I' AND OUTLET PIPES WITH AN 'O' AND PROVIDE THE INLET/OUTLET PIPE ANGLE IN DEGREES.

MANHOLE NUMBER	SC-1
FINISH TOP ELEVATION (FT)	560.00
TOP SLAB ELEVATION (FT)	544.50
INLET PIPE INVERT (FT)	554.01/553.51
OUTLET PIPE INVERT (FT)	553.45
PIPE TYPE	HDPE
PIPE INSIDE DIAM. (IN) [ID]	18" (46.3")
PIPE OUTSIDE DIAM. (IN) [OD]	19.8" AND 25.8"

PROJECT NAME ST. ANDREWS EPISCOPAL CHURCH
APPROXIMATE TIME FRAME UNTIL REQUIRED DELIVERY (WEEKS)
DELIVERY ADDRESS: STREET 2892 MARYLAND ROUTE 97 (ROXBURY MILLS ROAD)
CITY GLENWOOD STATE MARYLAND ZIP CODE 21738
DESIGNER COMPANY FISHER, COLLINS & CARTER, INC.
DESIGNER CONTACT RICKY ISAACS PHONE (410) 461-2855 FAX (410) 750-3784

PLEASE FAX THIS ORDER TO HYDRO CONDUIT C/O CAMTEK (412) 327-9556
ATTENTION: ANDREW VIROSTEK PHONE - (412) 327-5400
FOR TECHNICAL ASSISTANCE PLEASE CALL STORMCEPTOR CORPORATION AT (301) 762-8361 OR TOLL FREE AT 1 (800) 762-4103

ALL LIFTING APPARATUS TO BE PROVIDED BY THE INSTALLATION CONTRACTOR

FISHER, COLLINS & CARTER, INC.
CIVIL ENGINEERING CONSULTANTS & LAND SURVEYORS
CENTENNIAL SQUARE OFFICE PARK - 10272 BALTIMORE NATIONAL PIKE
ELLICOTT CITY, MARYLAND 21042
(410) 461 - 2855

REVISION	
DATE	DESCRIPTION
7/3/02	REVISE PAVING LIMIT AND GRADING TO E-1
10/25/02	ADD PROPOSED RETENTION AREA & CURB OPENING W/CHANNEL TO ALLEVIATE STANDING WATER ISSUE. ADD ADDITIONAL (2) DRAINAGE AREAS FOR NEW FACILITIES TO ALLEVIATE STANDING WATER ISSUE.
9/2/10	REVISE HANDICAP ACCESS FROM PARKING AREA. ADD 5' WIDE FLAGSTONE WALK, COLUMBARIUM NICHES, NEW TREES OF FAMILY AND FUTURE COLUMBARIUM, REPLACEMENT TREES AND REMOVAL OF FUTURE CHURCH & FUTURE PARISH SCHOOL BUILDINGS.
4/7/11	ADDED PROPOSED BOARD ON BOARD FENCE

ENGINEER'S CERTIFICATE

"I certify that this plan for erosion and sediment control represents a practical and workable plan based on my personal knowledge of the site conditions and that it was prepared in accordance with the requirements of the Howard Soil Conservation District."

Signature of Engineer (Print name below signature) — Date 8/9/01

DEVELOPER'S CERTIFICATE

"I/We certify that all development and construction will be done according to this plan and that any responsible personnel involved in the construction project will have a certificate of Attendance at a Department of the Environment Approved Training Program for the Control of Sediment and Erosion before beginning the project. I also authorize periodic on-site inspection by the Howard Soil Conservation District."

Signature of Developer (Print name below signature) — Date 8/9/01

Reviewed for HOWARD SCD and meets Technical Requirements

U.S.D.A.-Natural Resources Conservation Service — Date

This development plan is approved for soil erosion and sediment control by the HOWARD SOIL CONSERVATION DISTRICT.

Howard SCD — Date

OWNER

ST. ANDREWS EPISCOPAL CHURCH
RTE. 97 & UNION CHAPEL ROAD
P.O. BOX 52
GLENWOOD, MARYLAND 21738
(410) 489-4055

APPROVED: DEPARTMENT OF PLANNING AND ZONING

Chief, Division of Land Development — Date 12/2/02

Chief, Development Engineering Division — Date 9/3/01

Director, Department of Planning and Zoning — Date 10/23/01

PROJECT	SECTION/AREA	LOT NO.
ST. ANDREWS EPISCOPAL CHURCH "WOODSIDE ESTATES"	N/A	1

PLAT REF.	BLOCK NO.	ZONE	TAX	ELEC. DIST.	CENSUS TR.
14893	16	RC-DEO	14	4TH	6042

WATER CODE: PRIVATE — SEWER CODE: PRIVATE

SOILS MAP AND DRAINAGE AREA MAP

ST. ANDREWS EPISCOPAL CHURCH

WOODSIDE ESTATES
LOT 1

TAX MAP No: 14 PARCEL No: 216
4TH ELECTION DISTRICT, HOWARD COUNTY, MARYLAND
SCALE: AS SHOWN DATE: AUGUST 8, 2001
SHEET 7 OF 8

SDP 01-34

MAINTENANCE OF TRAFFIC SPECIAL PROVISIONS

GENERAL

1. THE PURPOSE OF THIS PORTION OF THE SPECIAL PROVISION IS TO SET FOR THE TRAFFIC CONTROL REQUIREMENTS NECESSARY FOR THE SAFE AND EFFICIENT MAINTENANCE TO TRAFFIC WITHIN WORK AREAS, AND TO MINIMIZE ANY INCONVENIENCES TO THE TRAVELING PUBLIC AND THE CONTRACTOR AND/OR PERMITTEE.
2. PROPERTY TRAFFIC CONTROL THROUGH WORK AREAS IS ESSENTIAL FOR INSURING THE SAFETY AND THAT OF HIGHWAY WORKERS HAS THE HIGHEST PRIORITY OF ALL TASKS WITHIN THIS PROJECT. THE PROPERTY APPLICATION OF THE APPROVED TRAFFIC CONTROL PLAN (TCP) WILL PROVIDE THE DESIRED LEVEL OF SAFETY.
3. THROUGHOUT THESE SPECIAL PROVISIONS, ANY MENTION OF THE TCP SHALL BE IMPLIED TO INCLUDE ANY COMBINATION OF TYPICAL TRAFFIC CONTROL STANDARDS WHICH FORM THE OVERALL TCP FOR THIS PROJECT WHICH HAS BEEN APPROVED BY THE APPROPRIATE SHA TRAFFIC ENGINEER.
4. THE CONTRACTOR AND/OR PERMITTEE SHALL BE REQUIRED TO ADHERE TO THE PROVISIONS OF THE MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES (MUTCD), 1988 EDITION, ESPECIALLY PART VI, AND TO SECTION 814 OF THE MARYLAND DOT STANDARD SPECIFICATIONS FOR CONSTRUCTION AND MATERIALS (JANUARY, 1982; INCLUDING ALL REVISIONS AND SUPPLEMENTS TO EACH.
5. THE CONTRACTOR AND/OR PERMITTEE SHALL BE REQUIRED TO ADHERE TO THE REQUIREMENTS SET FOR IN THE TCP AND THESE SPECIAL PROVISIONS, UNLESS OTHERWISE DIRECTED BY THE ENGINEER. ANY REQUESTS TO MAKE MINOR CHANGES TO THE TCP OR THE SPECIAL PROVISIONS WITH REGARD TO THE TRAFFIC CONTROL ITEMS SHALL BE MADE IN WRITING TO THE ENGINEER A MINIMUM OF THREE(3) WORKING DAYS PRIOR TO THE PROPOSED SCHEDULING CHANGE. THE CONTRACTOR AND/OR PERMITTEE SHALL HAVE WRITTEN APPROVAL OF THE ENGINEER PRIOR TO THE IMPLEMENTATION OF ANY CHANGE.
6. NO WORK SHALL BEGIN ON ANY WORK ACTIVITY OR WORK PHASE UNTIL ALL REQUIRED TRAFFIC CONTROL PATTERNS AND DEVICES INDICATED ON THE TCP FOR THAT ACTIVITY OR PHASE ARE COMPLETELY AND CORRECTLY IN PLACE TO HAVE BEEN CHECKED FOR APPROVED USAGE.
7. GENERAL AND SPECIFIC WARNING SIGNS SHALL ONLY BE IN PLACE WHEN SPECIFIC WORK TASKS AND ACTIVITIES ARE ACTUALLY UNDERWAY OR CONDITIONS EXIST THAT POSE A POTENTIAL HAZARD TO THE PUBLIC, AND ANY ADDITIONAL SIGNING HAS BEEN APPROVED BY THE APPROPRIATE SHA TRAFFIC ENGINEER. NOTE: THE PRACTICE OF PLACING SIGNING AND OTHER TRAFFIC CONTROL DEVICES IN ADDITION TO THOSE INDICATED ON THE APPROVED TCP IS NOT PERMITTED.
8. THE CONTRACTOR AND/OR PERMITTEE SHALL PROVIDE, MAINTAIN IN NEW CONDITION, AND MOVE WHEN NECESSARY, OR AS DIRECTED BY THE ENGINEER, ALL TRAFFIC CONTROL DEVICES USED FOR THE GUIDANCE AND PROTECTION OF MOTORISTS, PEDESTRIANS, AND WORKERS.
9. ALL TRAFFIC CONTROL DEVICES REQUIRED BY THE TCP SHALL BE KEPT IN GOOD CONDITION, FULLY PERFORMING AS SET FORTH IN THE TCP, THE MUTCD, AND/OR SECTION 814 OF THE SPECIFICATIONS. FOR REFLECTIVE DEVICES, A PARTICULAR DEVICE IS ASSUMED TO HAVE FAILED TO MEET MINIMUM OPERATIONAL STANDARDS WHEN THE DEVICE NO LONGER HAS RETRO-REFLECTANCE CAPABILITY OF AT LEAST 60% OF THE SPECIFIED MINIMUM VALUE OVER AT LEAST 90% OF THE VISIBLE REFLECTIVE SURFACE.
10. ALL TRAFFIC CONTROL DEVICES NOT REQUIRED FOR THE SAFE CONDUCT OF TRAFFIC SHALL BE PROMPTLY REMOVED, COMPLETELY COVERED, TURNED AWAY FROM TRAFFIC, OR OTHERWISE TAKEN OUT OF SERVICE. IT IS INTENDED THAT NO TRAFFIC CONTROL DEVICE IS TO BE IN SERVICE WHEN THERE IS NO CLEAR CUT REASON FOR THE DEVICE.
11. THROUGHOUT THE PERIOD(S) OF WORK ACTIVITIES, TRAFFIC SHALL BE MAINTAINED BY IMPLEMENTING THE APPROVED TCP. IN LIEU OF THE TCP PREPARED FOR THIS PROJECT, AND/OR INDIVIDUAL TYPICAL TRAFFIC CONTROL STANDARDS, THE CONTRACTOR AND/OR PERMITTEE HAS THE OPTION OR PREPARING AND SUBMITTING A TCP, WHOLLY OR IN PART, OF HIS OWN DESIGN, FOLLOWING GUIDELINES SET FORTH IN THE MUTCD AND PRESCRIBED BY THE ADMINISTRATION. A TCP DEVELOPED BY THE CONTRACTOR AND/OR PERMITTEE SHALL NOT BE IMPLEMENTED UNTIL ADVANCE WRITTEN APPROVAL IS OBTAINED FROM THE ENGINEER. TCP'S MAY BE IMPLEMENTED WITHIN A SINGLE PROJECT OR JOINTLY BETWEEN TWO OR MORE PROJECTS. IN SITUATIONS WHERE TCP'S JOINTLY IMPLEMENTED, CARE SHALL BE EXERCISED TO PRESENT CORRECT AND NON-CONFLICTING GUIDANCE TO THE TRAVELING PUBLIC.
12. THROUGHOUT THESE SPECIAL PROVISIONS, WHERE SPEED OF TRAFFIC IS NOTED, THIS MEANS THE POSTED SPEED OR PREVAILING TRAVEL SPEED, WHICHEVER IS HIGHER, UNLESS OTHERWISE NOTED.
13. TRAFFIC SHALL BE MAINTAINED AT ALL TIMES THROUGHOUT THE ENTIRE LENGTH OF THE PROJECT, UNLESS OTHERWISE NOTED. NO TRAVEL LANE(S) OTHER THAN THOSE DESIGNATED FOR POSSIBLE CLOSURE IN THE TCP SHALL BE CLOSED WITHOUT OBTAINING PRIOR APPROVAL FORM THE ENGINEER. ALL INGRESS AND EGRESS TO THE WORK AREA BY THE CONTRACTOR AND/OR PERMITTEE SHALL BE PERFORMED WITH THE FLOW OF TRAFFIC.

IMPORTANT: THIS DRAWING SHALL BE USED IN COMBINATION WITH THE GENERAL NOTES AT THE BEGINNING OF STANDARDS NO. MD 104.00.

NOTE: FLAGGER SHALL NEVER BE STATIONED MORE THAN 1000' AWAY FROM THE ADVANCE FLAGGER SIGN.

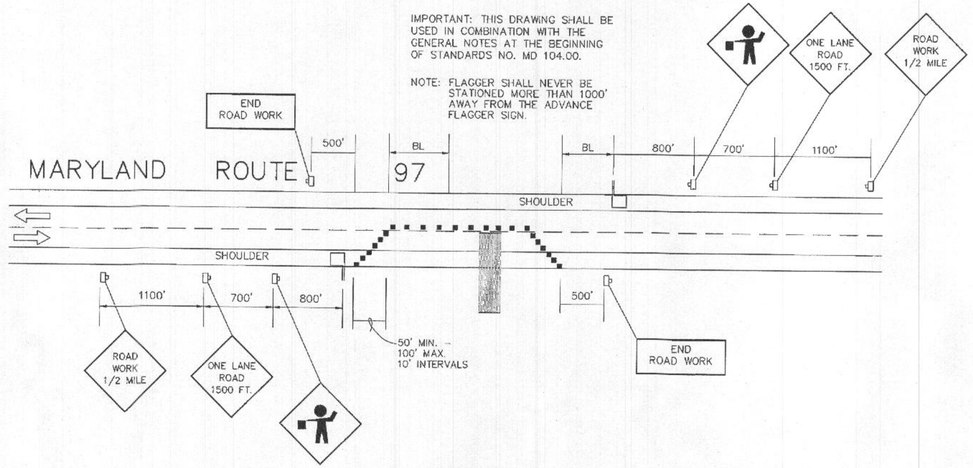

(STANDARD NO. MD 104.31-01)

TEMPORARY TRAFFIC CONTROL PLAN

NO SCALE

KEY

- FLAGGER
- DIRECTION OF TRAFFIC
- SIGN SUPPORT
- FACE OF SIGN
- CHANNELIZING DEVICES
- WORK SITE

STATE OF MARYLAND — JAMES E. CROWE — No. 15906 — PROFESSIONAL ENGINEER

FISHER, COLLINS & CARTER, INC.
CIVIL ENGINEERING CONSULTANTS & LAND SURVEYORS
CENTENNIAL SQUARE OFFICE PARK - 10272 BALTIMORE NATIONAL PIKE
ELLICOTT CITY, MARYLAND 21042
(410) 461 - 2855

REVISION	
DATE	DESCRIPTION

ENGINEER'S CERTIFICATE

"I certify that this plan for sediment and erosion control represents a practical and workable plan based on my personal knowledge of the site conditions and that it was prepared in accordance with the requirements of the Howard Soil Conservation District."

Signature of Engineer (print name below signature) — 8/9/01 Date

DEVELOPER'S CERTIFICATE

"I/We certify that all development and construction will be done according to this plan for sediment and erosion control, and that all responsible personnel involved in the construction project will have a Certificate of Attendance at a Department of the Environment Approved Training Program for the Control of Sediment and Erosion before beginning the project. I also authorize periodic on-site inspection by the Howard Soil Conservation District."

Signature of Developer (print name below signature) — 8/9/01 Date

Reviewed for HOWARD SCD and meets Technical Requirements.

U.S.D.A.-Natural Resources Conservation Service — Date

This development plan is approved for soil erosion and sediment control by the HOWARD SOIL CONSERVATION DISTRICT.

Howard SCD — Date

DEVELOPER/OWNER

ST. ANDREWS EPISCOPAL CHURCH
RTE. 97 & UNION CHAPEL ROAD
P.O. BOX 52
GLENWOOD, MARYLAND 21738
(410) 489-4035

APPROVED: DEPARTMENT OF PLANNING AND ZONING

Director - Department of Planning and Zoning — 10/23/01 Date

Chief, Division of Land Development — 10/9/01 Date

Chief, Development Engineering Division — 9/7/01 Date

SUBDIVISION		SECTION/AREA	LOT NO.
ST. ANDREWS EPISCOPAL CHURCH "WOODSIDE ESTATES"		N/A	1
PLAT NO.	BLOCK NO. / ZONE	TAX/ZONE	ELEC. DIST.	CENSUS TR.
14893	16 / RC-DEO	14	4TH	6040
WATER CODE	PRIVATE	SEWER CODE	PRIVATE	

TRAFFIC CONTROL PLAN

ST. ANDREWS EPISCOPAL CHURCH

WOODSIDE ESTATES
LOT 1

TAX MAP No: 14 PARCEL No: 216
4TH ELECTION DISTRICT, HOWARD COUNTY, MARYLAND
SCALE: AS SHOWN DATE: AUGUST 8, 2001
SHEET 8 OF 8

SDP 01-34

SHEET INDEX

SHEET NO.	DESCRIPTION
1 OF 8	SITE DEVELOPMENT PLAN
2 OF 8	LANDSCAPE & SEDIMENT CONTROL PLAN
3 OF 8	STORMWATER MANAGEMENT PROFILES, STORMWATER MANAGEMENT DETAILS
4 OF 8	STORM DRAIN PROFILES & DETAILS
5 OF 8	NOTES & DETAILS
6 OF 8	FOREST CONSERVATION PLAN
7 OF 8	SOILS MAP & DRAINAGE AREA MAP PLAN
8 OF 8	TRAFFIC CONTROL PLAN

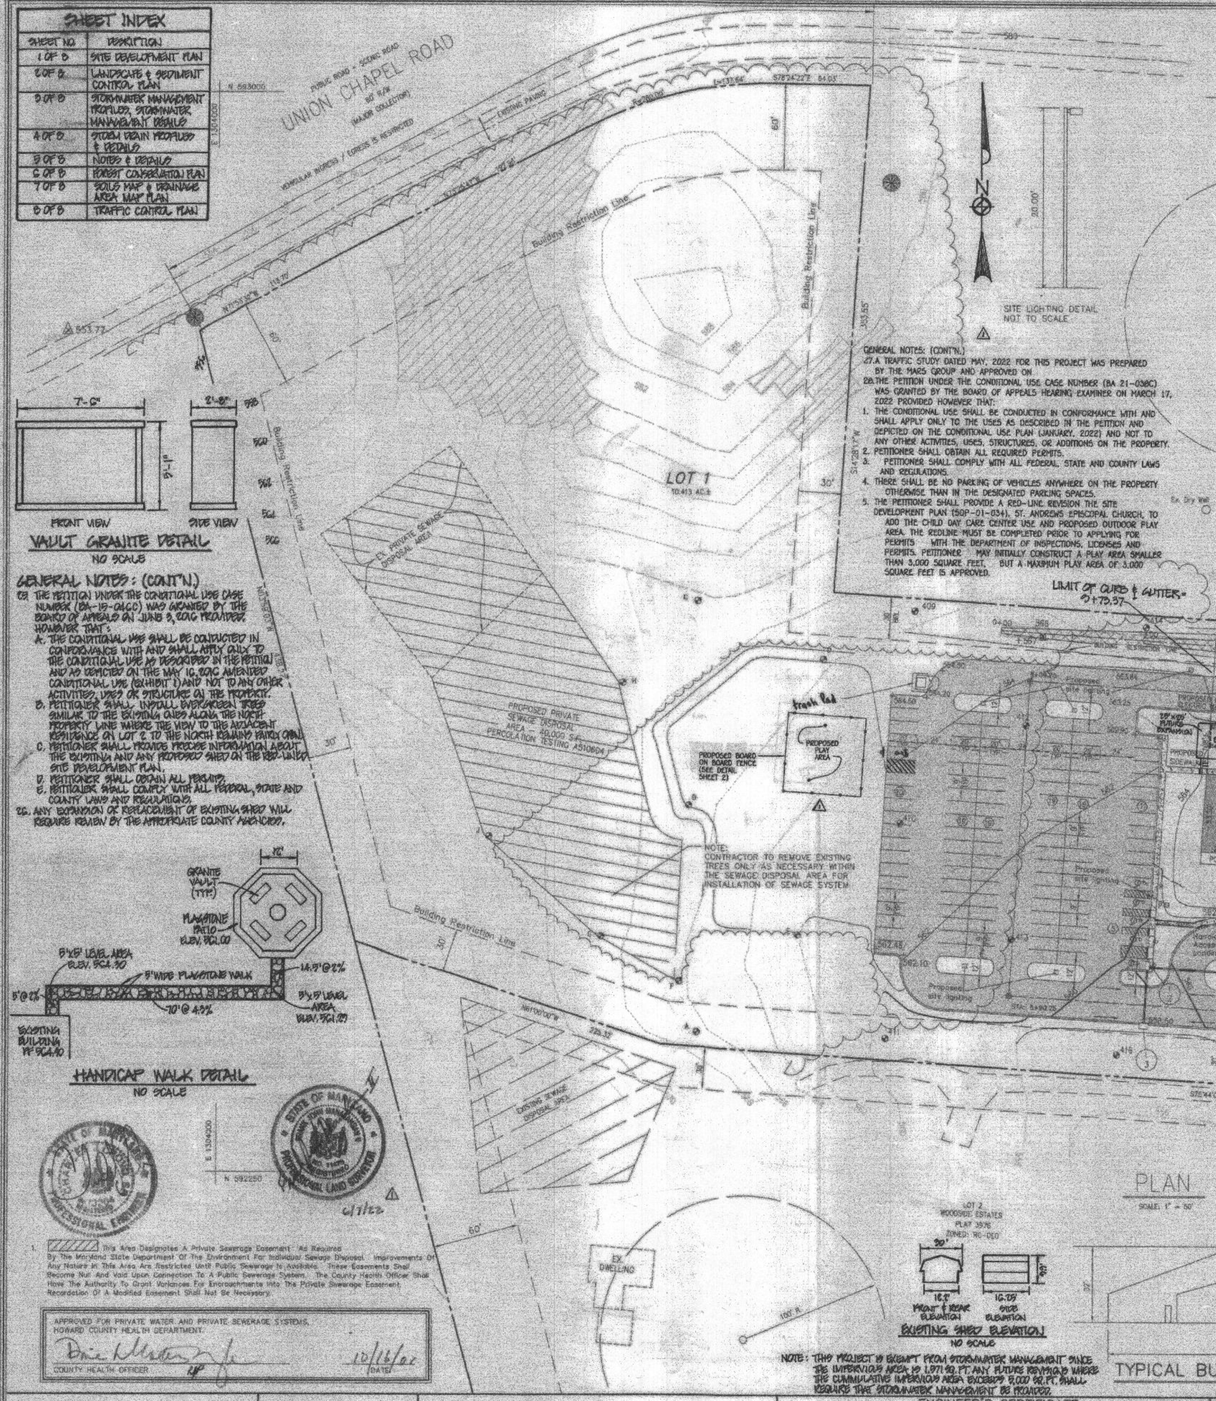
UNION CHAPEL ROAD
PUBLIC ROAD - 20'MC ROAD 30' R/W (MAJOR COLLECTOR)
EXISTING PAVING
HORIZONTAL NUMBERS / CURVES IS REVERSED
Building Restriction Line
LOT 1
10.413 AC.±
PROPOSED PRIVATE SEWAGE DISPOSAL AREA - 25,000 SQ. FT. PERCOLATION TESTING ASTM#24
PROPOSED BOARD ON BOARD FENCE (SEE DETAIL SHEET 3)
PROPOSED PLAY AREA
NOTE: CONTRACTOR TO REMOVE EXISTING TREES ONLY AS NECESSARY WITHIN THE SEWAGE DISPOSAL AREA FOR INSTALLATION OF SEWAGE SYSTEM
EX. PRIVATE SEWAGE DISPOSAL AREA
EX. DWELLING
EX. Dry Well
EX. Dead Out
Ex. Well
SITE LIGHTING DETAIL NOT TO SCALE
GENERAL NOTES: (CONT'N.)
23. A TRAFFIC STUDY DATED MAY, 2022 FOR THIS PROJECT WAS PREPARED BY THE TMDS GROUP AND APPROVED ON
24. THE PETITION UNDER THE CONDITIONAL USE CASE NUMBER (BA 21-038C) WAS GRANTED BY THE BOARD OF APPEALS HEARING EXAMINER ON MARCH 17, 2022 PROVIDED HOWEVER THAT:
1. THE CONDITIONAL USE SHALL BE CONDUCTED IN CONFORMANCE WITH AND SHALL APPLY ONLY TO THE USES AS DESCRIBED IN THE PETITION AND DEPICTED ON THE CONDITIONAL USE PLAN (JANUARY, 2022) AND NOT TO ANY OTHER ACTIVITIES, USES, STRUCTURES, OR ADDITIONS ON THE PROPERTY.
2. PETITIONER SHALL OBTAIN ALL REQUIRED PERMITS.
3. PETITIONER SHALL COMPLY WITH ALL FEDERAL, STATE AND COUNTY LAWS AND REGULATIONS.
4. THERE SHALL BE NO PARKING OF VEHICLES ANYWHERE ON THE PROPERTY OTHERWISE THAN IN THE DESIGNATED PARKING SPACES.
5. THE PETITIONER SHALL PROVIDE A RED-LINE REVISION TO THE SITE DEVELOPMENT PLAN (SDP-01-034), ST. ANDREWS EPISCOPAL CHURCH, TO ADD THE CHILD DAY CARE CENTER USE AND PROPOSED OUTDOOR PLAY AREA. THE REDLINE MUST BE COMPLETED PRIOR TO APPLYING FOR PERMITS - WITH THE DEPARTMENT OF INSPECTIONS, LICENSES AND PERMITS. PETITIONER MAY INITIALLY CONSTRUCT A PLAY AREA SMALLER THAN 3,000 SQUARE FEET, BUT A MAXIMUM PLAY AREA OF 3,000 SQUARE FEET IS APPROVED.
LIMIT OF GUTTER - 2+75.57
PROF. EROSION CONTROL MATTING STA. 0+00 TO STA. 5+80
NOTE: THE APFO STUDY FOR THE ADDITIONAL DAY CARE USE WAS PREPARED BY TMDS GROUP DATED MAY 2022 AND WAS APPROVED ON JUNE 2, 2022.
R.R. KRAMER 633/102 ZONED: RC-DEO
(2) EVERGREEN WHITEPINE TREES
(9) REPLACEMENT WHITEPINE TREES
(9) REPLACEMENT BLOSSOM DOGWOOD TREES
LIMIT OF DISTURBANCE 10.413 AC.±
PROPOSED COLUMBARIUM WALL (SEE DETAIL SHEET 3)
PROPOSED ASH PLANTING AREA
PROPOSED ASH PLANTING AREA
Approx. location of fire suppression system
HOWE SIZER STONEWORKS (SEE DETAIL SHEET 3)
PROPOSED ASH PLANTING AREA
PROPOSED ASH PLANTING AREA
24" HDPE (23')
STD. 7' CURB C & G
WATER QUALITY 80-RETENTION FACILITY (SEE PROFILE AND ENLARGEMENT, SHEET 4)
Existing Utility Pole
Proposed Utility Lighting
Ex. Driveway
BUILDING RESTRICTION LINE
10' WIDE OPEN SPACE (NOT TO BE DISTURBED)
PROP. RIP-RAP CHANNEL @ 0.044 TO MATCH EX. CURB
PROP. MACADAM PAVING PERMANENT SEAL
CONTRACTOR TO PROVIDE POSITIVE FLOW TO CURB
EX. R/W FOR INGRESS AND EGRESS FOR THE RESIDENTIAL USE OF LOT 2 ONLY AND NOT FOR THE CHURCH USE LOCATED ON LOT 1; PLAT NO. 3976 and 14893
FOR S.H.A. WIDENING DETAILS, SEE SHEET 4
Proposed Retention Area
PROF. RIP-RAP CHANNEL SEE DESIGN DATA, SHEET 3
CONCRETE WEIR STRUCTURE SEE DETAILS, SHEET 4
Utility Pole PP 370910
PROF. RIP-RAP CHANNEL SEE DESIGN DATA, SHEET 3
MARYLAND ROUTE 97
(PRIVATE) STORMWATER MANAGEMENT POND
HAZARD CLASS 'A' (SEE DETAILS, SHEETS 3 & 4)
PROF. INTERSECTION TRAPEZOIDAL CHANNEL AND S.W.M. SPILLWAY STA. 5+94
PROF. RIP-RAP CHANNEL SEE DESIGN DATA, SHEET 3

SCHEDULE A PERIMETER LANDSCAPE EDGE

PERIMETER	CATEGORY (PROPERTIES / ROADWAYS)	LANDSCAPE TYPE	LINEAR FEET OF ROADWAY FRONTAGE PERIMETER	CREDIT FOR EXISTING VEGETATION (YES, NO, LINEAR FEET) (DESCRIBE BELOW IF NEEDED)	CREDIT FOR WALL, FENCE OR BERM (YES, NO, LINEAR FEET) (DESCRIBE BELOW IF NEEDED)	NUMBER OF PLANTS REQUIRED: SHADE TREES	NUMBER OF PLANTS REQUIRED: EVERGREEN TREES	NUMBER OF PLANTS REQUIRED: SHRUBS	NUMBER OF PLANTS PROVIDED: SHADE TREES	NUMBER OF PLANTS PROVIDED: EVERGREEN TREES	NUMBER OF PLANTS PROVIDED: OTHER TREES (2:1 SUBSTITUTION) (DESCRIBE PLANT SUBSTITUTION CREDITS BELOW IF NEEDED)	NUMBER OF PLANTS PROVIDED: SHRUBS (10:1 SUBSTITUTION)
P-1	ADJACENT TO PERIMETER	A	773.20'	YES (112')	NO	11	–	–	11	–	–	–
P-2	ADJACENT TO ROADWAY	B	381.44'	NO	NO	8	9	–	8	10	–	–
P-3	ADJACENT TO PERIMETER	E	698.53'	YES (112')	NO	15	–	148	15	–	–	148
P-4	ADJACENT TO PERIMETER	A	225.32'	YES (225.32')	NO	0	–	–	0	–	–	–
P-5	ADJACENT TO PERIMETER	A	438.27'	YES (436.27')	NO	0	–	–	0	–	–	–
P-6	ADJACENT TO ROADWAY	B	508.33'	YES (508.32')	NO	0	–	–	0	–	–	–
P-7	ADJACENT TO PERIMETER	A	383.59'	YES (383.59')	NO	0	–	–	0	–	–	–
P-8	SUBSTITUTE PERIMETER	C	38'	NO	NO	1	2	–	1	2	–	–

(PRIVATE)
STORMWATER MANAGEMENT POND
SEE DETAILS, SHEETS 3 & 4

TEMPORARY S.W.M. DATA

DRAINAGE AREA = 7.96 AC.±
TOTAL VOLUME OF STORAGE REQUIRED = 57,312 CU. YDS.
VOLUME OF WET STORAGE REQUIRED = 28,656 CU. YDS.
VOLUME OF WET STORAGE PROVIDED = 28,669 CU. YDS.
ELEVATION OF WET STORAGE = 555.00
VOLUME OF DRY STORAGE REQUIRED = 28,656 CU. YDS.
VOLUME OF DRY STORAGE PROVIDED = 28,699 CU. YDS.
ELEVATION OF DRY STORAGE = 557.35
WEIR ELEVATION FOR RELEASE = 557.50 (TEMP. MANAGEMENT)
TEMP. S.W.M. STORAGE ELEV. (2 YR. STORM) = 557.36
2 YR. TEMP. S.W.M. RELEASE Q = 0.20 C.F.S.
WIDTH OF WEIR STRUCTURE = 3 FEET
2 YR. TEMP. S.W.M. EXISTING Q = 2.6 C.F.S.
CLEAN-OUT ELEVATION = 553.55
TOP OF DAM ELEV. = 559.80
TOP OF DAM WIDTH = 6'

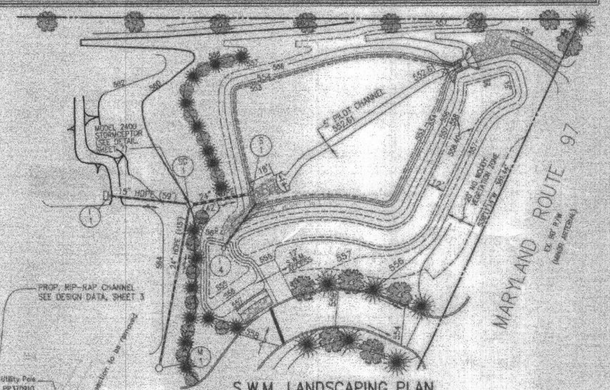

S.W.M. LANDSCAPING PLAN
SCALE: 1" = 50'

SCHEDULE D STORMWATER MANAGEMENT AREA LANDSCAPING

	D1: 258'	D2: 85'	D3: 190'	D4: 110'
LINEAR FEET OF PERIMETER				
NUMBER OF TREES REQUIRED:				
SHADE TREES	5	2	4	3
EVERGREEN TREES	6	2	5	3
CREDIT FOR EXISTING VEGETATION (NO, YES AND, SO)	NO	NO	NO	NO
CREDIT FOR OTHER LANDSCAPING (NO, YES AND, SO)	NO	NO	NO	NO
NUMBER OF TREES PROVIDED:				
SHADE TREES	5	2	4	3
EVERGREEN TREES	6	2	5	3
OTHER TREES (2:1 SUBSTITUTION)				

LANDSCAPING PLANT LIST

QTY.		NAME	SIZE
10		ACER RUBRUM 'OCTOBER GLORY' (OCTOBER RED MAPLE)	2" - 2 1/2" CALIPER FULL CROWN, B&B
27		PINUS STROBUS EASTERN WHITE PINE	6'-8' HEIGHT
20		PLATANUS X ACERIFOLIA 'BLOODGOOD' BLOODGOOD LONDON PLANE	2" - 2 1/2" CALIPER FULL CROWN, B&B
74		AZALEA 'GUMPO WHITE' GUMPO WHITE AZALEA	18"-24" SP.
74		VIBURNUM DENTATUM ARROWWOOD VIBURNUM	2-1/2" - 3' HT.

NOTE:
"THIS PLAN HAS BEEN PREPARED IN ACCORDANCE WITH THE PROVISIONS OF SECTION 16.124 OF THE HOWARD COUNTY CODE AND THE LANDSCAPE MANUAL. FINANCIAL SURETY FOR THE REQUIRED LANDSCAPING HAS BEEN POSTED AS PART OF THE DEVELOPER'S AGREEMENT IN THE AMOUNT OF $24,480.00 FOR 85 SHADE TREES, 87 EVERGREENS AND 148 SHRUBS. AT THE TIME OF INSTALLMENT, ALL SHRUBS AND OTHER PLANTINGS NOT WITH LISTED AND APPROVED FOR THIS SITE, SHALL BE OF THE PROPER HEIGHT REQUIREMENTS IN ACCORDANCE WITH THE HOWARD COUNTY LANDSCAPE MANUAL. IN ADDITION, NO SUBSTITUTIONS OR RELOCATION OF REQUIRED PLANTINGS MAY BE MADE WITHOUT PRIOR REVIEW AND APPROVAL. ANY DEVIATION FROM THIS APPROVED LANDSCAPED PLAN MAY RESULT IN DENIAL OR DELAY IN THE RELEASE OF LANDSCAPE SURETY UNTIL SUCH TIME AS ALL REQUIRED MATERIALS ARE PLANTED AND/OR REVISIONS ARE MADE TO APPLICABLE PLANS AND CERTIFICATES.

SEQUENCE OF CONSTRUCTION

1. OBTAIN GRADING PERMIT.
2. NOTIFY "MISS UTILITY" AT LEAST 48 HOURS BEFORE BEGINNING ANY WORK AT 1-800-257-7777. NOTIFY THE HOWARD COUNTY OFFICE OF CONSTRUCTION/INSPECTION AT (410) 313-1880, 24 HOURS BEFORE STARTING WORK.
3. CLEAR AND GRUB FOR SEDIMENT CONTROL MEASURES WHERE NEEDED. INSTALL STABILIZED CONSTRUCTION ENTRANCES AND PROPOSED EARTH DIKES (0.5 WEEK).
4. GRADE FOR TRAPEZOIDAL CHANNEL AT THE NORTH SIDE OF THE PROPERTY TO COLLECT BYPASS RUNOFF, AND PERMANENTLY STABILIZE CHANNEL UPON COMPLETION. GET PERMISSION FROM INSPECTOR PRIOR TO PROCEEDING. (1 WEEK).
5. GRADE FOR SEDIMENT BASIN, AND STABILIZE WITH TEMPORARY SEEDING. (0.5 WEEK).
6. INSTALL STORM DRAIN I-3 THROUGH S-1 TO BE USED AS DIVERSION FOR SEDIMENT CONTROL FOR ENTIRE SITE. INCLUDING STORMDETPOM FOR WATER QUALITY DEVICE. PRIOR TO PROCEEDING, OBTAIN PERMISSION FROM INSPECTOR. (1 WEEK)
7. GRADE THE ENTRANCE ROAD, PARKING LOT AREA AND SERVICE ROAD AREA TO SUB-GRADE, EXCAVATE NECESSARY AREA FOR PROPOSED BUILDING AREA. PRIOR TO PROCEEDING, OBTAIN PERMISSION FROM INSPECTOR. (2.0 WEEKS)
8. EXCAVATE BORROW AREA FOR EXTRA DIRT NECESSARY TO COMPLETE FILL AREA, STABILIZE THE BORROW AREA WITH TEMPORARY SEEDING FOLLOWING DISTURBANCE. (0.5 WEEK).
9. CONSTRUCT THE PROPOSED BUILDING, GRADE PROPOSED WIDENING AND INSTALL STONE BASE COURSE FOR MD. RTE. 97. (10 WEEKS)
10. STABILIZE ALL REMAINING EXPOSED GROUND WITH TEMPORARY SEEDING. (0.5 WEEK).
11. INSTALL STONE BASE COURSE FOR PROPOSED NEW PAVED AREAS. STABILIZE ALL AREA AROUND THE BUILDING WITH PERMANENT SEEDING. (0.5 WEEK).
12. REMOVE EX. 18" CMP IN MD. RTE. 97 AND INSTALL NEW 24" RCCP. (0.5 WEEKS) *(TO BE DONE UNDER A 3-DAY CLOSURE SCHEDULE PROPOSED BY THE SHA)*
13. INSTALL ALL PROPOSED CURB AND GUTTER FOR ENTIRE SITE, INCLUDING S.H.A. CURB ALONG MD. RTE. 97. (1.5 WEEKS)
14. UPON COMPLETION OF CURB AND GUTTER, STABILIZE ALL AREAS WITH PERMANENT SEEDING. (0.5 WEEK).
15. PAVE DRIVEWAY, PARKING AREA, SERVICE ROAD AND ROAD WIDENING AREA. (1.0 WEEK).
16. FLUSH STORM DRAIN SYSTEM TO REMOVE ANY TRAPPED SEDIMENTS FROM I-3 TO I-2, TO M-1, TO M-1 TO S-1. REMOVE ALL CURB INLET PROTECTION DEVICES. (0.5 WEEK)
17. CONVERT SEDIMENT BASIN TO STORMWATER MANAGEMENT POND. PRIOR TO PROCEEDING, OBTAIN PERMISSION FROM INSPECTOR. (1 WEEK)
18. UPON APPROVAL OF SEDIMENT CONTROL INSPECTOR, REMOVE REMAINING SEDIMENT CONTROL DEVICES. (0.5 WEEK)

SCHEDULE B PARKING LOT INTERNAL LANDSCAPING

NUMBER OF PARKING SPACES	113
NUMBER OF TREES REQUIRED	6
NUMBER OF TREES PROVIDED:	6
SHADE TREES	–
OTHER TREES (2:1 SUBSTITUTION)	

NOTE:
ALL PERIMETER LANDSCAPING WILL BE PLANTED AFTER GRADING OF THE SITE.

PLAN
SCALE: 1" = 50'

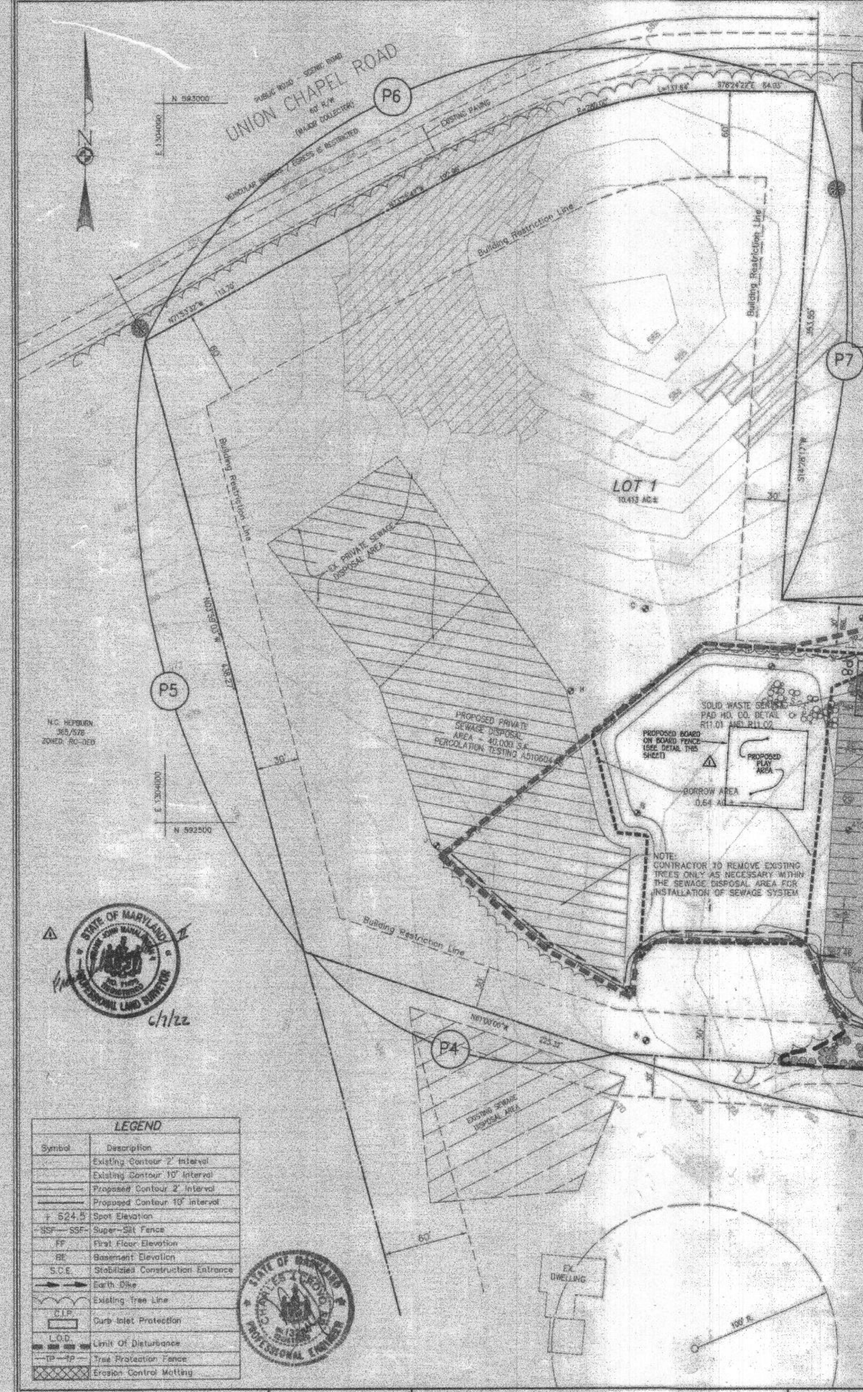

LEGEND

Symbol	Description
	Existing Contour 2' Interval
	Existing Contour 10' Interval
	Proposed Contour 2' Interval
	Proposed Contour 10' Interval
+ 524.5	Spot Elevation
SSF SSF	Super-Silt Fence
FF	First Floor Elevation
BE	Basement Elevation
S.C.E.	Stabilized Construction Entrance
	Earth Dike
	Existing Tree Line
C.I.P.	Curb Inlet Protection
L.O.D.	Limit Of Disturbance
TP TP	Tree Protection Fence
	Erosion Control Matting

APPROVED FOR PRIVATE WATER AND PRIVATE SEWERAGE SYSTEMS, HOWARD COUNTY HEALTH DEPARTMENT:
Diane L. Matuszak M.D., MPH
COUNTY HEALTH OFFICER
10/18/01
DATE

STATE OF MARYLAND — CHARLES A. CROVO — No. 10706 — PROFESSIONAL ENGINEER
STATE OF MARYLAND — JOHN PAUL HOSTER — No. 21402 — PROFESSIONAL LAND SURVEYOR
c/l/12

FISHER, COLLINS & CARTER, INC.
CIVIL ENGINEERING CONSULTANTS & LAND SURVEYORS
CENTENNIAL SQUARE OFFICE PARK - 10272 BALTIMORE NATIONAL PIKE
ELLICOTT CITY, MARYLAND 21042
(410) 461 - 2855

REVISION	DATE	DESCRIPTION
	7/5/02	REVISE PAVING LIMIT AND GRADING TO I-1
	10/25/02	ADD PROPOSED RETENTION AREA & CURB OPENING W/CHANNEL TO ALLEVIATE STANDING WATER ISSUE.
		REVISE LIMITS OF DISTURBANCE
		REVISE HANDICAP ACCESS FROM PARKING AREA
	2/6/12	ADDED 3' WIDE FLAGSTONE WALK, COLUMBARIUM WITH 6 TOTAL FRONT TREES, EX. SHED AND FLAGSTONE WALKWAY REMOVED, TREES, LIMIT OF DISTURBANCE AND REMOVED "FUTURES CHURCH" & "FUTURE SHADY SCHOOL EXPANSION".
⚠	4/7/12	ADDED PROPOSED BOARD ON BOARD FENCE

ENGINEER'S CERTIFICATE
"I certify that this plan for erosion and sediment control represents a practical and workable plan based on my personal knowledge at the site conditions and that it was prepared in accordance with the requirements of the Howard Soil Conservation District."
Signature of Engineer (Print name below signature)
8/3/01
Date

DEVELOPER'S CERTIFICATE
"I/We certify that all development and construction will be done according to this plan, and that any responsible personnel involved in the construction project will have a Certificate of Attendance at a Department of the Environment Approved Training Program for the Control of Sediment and Erosion before beginning the project. I also authorize periodic on-site inspection by the Howard Soil Conservation District."
Signature of Developer (Print name below signature)
8/3/01
Date

Reviewed for HOWARD SCD and meets Technical Requirements
U.S.D.A. Natural Resources Conservation Service
9/6/01
Date
This development plan is approved for soil erosion and sediment control by the HOWARD SOIL CONSERVATION DISTRICT.
Howard SCD
9/6/01
Date

OWNER
ST. ANDREWS EPISCOPAL CHURCH
RTE. 97 @ UNION CHAPEL ROAD
P.O. BOX 52
GLENWOOD, MARYLAND 21738
(410) 489-4030

APPROVED: DEPARTMENT OF PLANNING AND ZONING

Chief, Division of Land Development	10/9/01 Date
Chief, Development Engineering Division	9/3/01 Date
Director, Department of Planning and Zoning	10/23/01 Date

PROJECT	SECTION/AREA	LOT NO.
ST. ANDREWS EPISCOPAL CHURCH "WOODSIDE ESTATES"	N/A	1

PLAT REF.	BLOCK NO.	ZONE	TAX	ELEC. DIST.	CENSUS TR.
14893	16	RC-DEO	14	4TH	6040

WATER CODE: PRIVATE
SEWER CODE: PRIVATE

LANDSCAPE AND SEDIMENT CONTROL PLAN
ST. ANDREWS EPISCOPAL CHURCH
WOODSIDE ESTATES
LOT 1

TAX MAP No: 14 PARCEL No: 216
4TH ELECTION DISTRICT, HOWARD COUNTY, MARYLAND
SCALE: AS SHOWN DATE: AUGUST 8, 2001
SHEET 2 OF 8

SDP 01-34

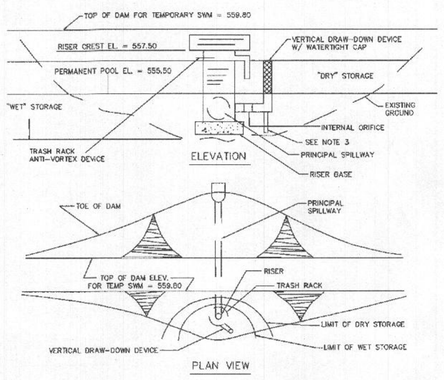

BASIN DRAWDOWN SCHEMATIC
VERTICAL DRAW-DOWN DEVICE

NOT TO SCALE

CONSTRUCTION SPECIFICATIONS

1. PERFORATIONS IN THE DRAW-DOWN DEVICE MAY NOT EXTEND INTO THE WET STORAGE.
2. THE TOTAL AREA OF THE PERFORATIONS MUST BE GREATER THAN 2 TIMES THE AREA OF THE INTERNAL ORIFICE.
3. THE PERFORATED PORTION OF THE DRAW-DOWN DEVICE SHALL BE WRAPPED WITH 1/2" HARDWARE CLOTH AND GEOTEXTILE FABRIC. THE GEOTEXTILE FABRIC SHALL MEET THE SPECIFICATIONS FOR GEOTEXTILE CLASS E.
4. PROVIDE SUPPORT OF DRAW-DOWN DEVICE TO PREVENT SAGGING AND FLOATATION. AN ACCEPTABLE PREVENTATIVE MEASURE IS TO STAKE BOTH SIDES OF DRAW-DOWN DEVICE WITH 1" STEEL ANGLE, OR 1" BY 4" SQUARE OR 2" ROUND WOODEN POSTS SET 3' MINIMUM INTO THE GROUND THEN JOINING THEM TO THE DEVICE BY WRAPPING WITH 12 GAUGE MINIMUM WIRE.

PIPE SCHEDULE

SIZE	MATERIAL	LENGTH
6"	HDPE	36'
15"	HDPE	59'
18"	HDPE	41'
24"	HDPE	402'
18"	C.M.P.	14'
24"	RCCP	65'

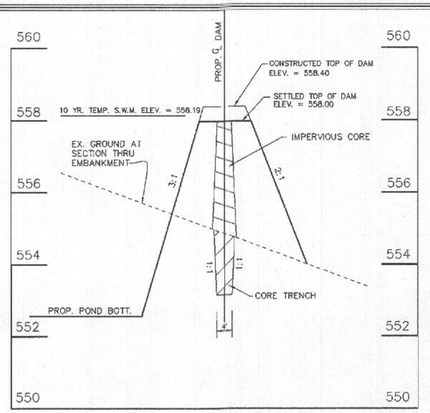

SECTION THRU EARTH EMBANKMENT

SCALE: HORIZ. : 1" = 20'
VERT. : 1" = 2'

STRUCTURE SCHEDULE

STRUCTURE NO.	TOP ELEVATION	INV.IN	INV.OUT	ROAD NAME	BASELINE STA.	OFFSET	TYPE	REMARKS
I-1	563.90	------	555.37	------	℄ STA. 11+38.5	36'L	A-5 INLET	S.D. - 4.40
I-2	560.23	555.51	555.01	------	℄ STA. 6+25.4	94'R	A-5 INLET	S.D. - 4.40
I-3	559.17	------	555.67	------	℄ STA. 5+02	12'L	A-5 INLET	S.D. - 4.40
I-4	557.00	553.43	553.18	------	℄ STA. 1+53	67'R	'D' INLET	S.D. - 4.11
M-1	562.00	554.35	554.10	------	℄ STA. 2+65	27'R	STD. MANHOLE	G. - 5.12
** SC-1	560.00	553.53, 554.03	553.45	------	N 592,491.69 E 1,304,916.11	-----	STORMCEPTOR	MODEL 2400
* S-1	555.05	553.05	553.00	------	N 592,489.70 E 1,304,968.54	-----	HDPE END SECTION	
S-2	550.35	548.35	548.25	------	N 592,534.43 E 1,305,245.54	-----	CONC. END SECTION	MD - 368.01
S-3	552.30	550.30	550.20	------	N 592,569.07 E 1,305,181.90	-----	CONC. END SECTION	MD - 368.01

* - CONTACT ADVANCED DRAINAGE SYSTEMS
3300 RIVERSIDE DRIVE
COLUMBUS, OHIO 43221
PHONE: 1-800-733-7473

** - CONTACT STORMCEPTOR AT 1-724-327-3400
MR. ANDREW VROSTEK
CAMTEK CONSTRUCTION PRODUCTS

DESIGN SUMMARY (TR-20)

DESIGN STORM	CONTROL STRUCTURE ELEVS.	ALLOWABLE RELEASE RATE	FACILITY INFLOW	FACILITY DISCHARGE	WATER SURFACE ELEVATION	STORAGE VOLUME (AC.FT.) (PROVIDED)	STORAGE VOLUME (AC.FT.) (REQUIRED)
2 YEAR	553.00	0.70 CFS	---	0.64 CFS	553.57	0.24	0.15
10 YEAR	553.50	10.1 CFS	---	5.00 CFS	554.70	0.54	0.28
100 YEAR	555.61	N/A	---	12.3 CFS	556.02	0.91	N/A

WATERSHED AREA TO FACILITY (ACRES): 7.98 AC. - DURING CONSTRUCTION
DRAINAGE AREA TO FACILITY = 0.0124 SQ. MI. OR 7.94 ACS

CONSTRUCTION SPECIFICATIONS FOR RIP-RAP OUTFALLS

1. The subgrade for the filter, riprap or gabion shall be prepared to the required lines and grades. Any fill required in the subgrade shall be compacted to a density of approximately that of the surrounding undisturbed material.
2. The rock or gravel shall conform to the specified grading limits when installed respectively in the riprap or filter.
3. Filter cloth shall be protected from punching, cutting or tearing. Any damage other than an occasional small hole shall be repaired by placing another piece of cloth over the damaged part or by completely replacing the cloth. All overlaps whether for repairs or for joining two pieces of cloth shall be a minimum of one foot.
4. Stone for the riprap or gabion outlets may be placed by equipment. Both shall each be constructed to the full course thickness in one operation and in such a manner as to avoid displacement of underlying materials. The stone for riprap or gabion outlets shall be delivered and placed in a manner that will insure that it is reasonably homogenous with the smaller stones and spalls filling the voids between the larger stones. Riprap shall be placed in a manner to prevent damage to the filter blanket or filter cloth. Hand placement will be required to the extent necessary to prevent damage to the permanent works.

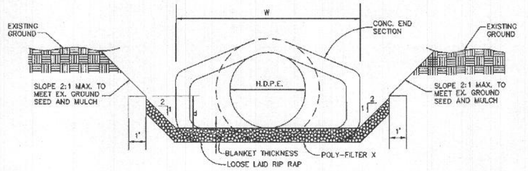

RIP RAP CHANNEL DETAIL

NO SCALE

RIP-RAP CHANNEL DESIGN DATA

STRUCTURE	AREA	WETTED PERIMETER	R	R 2/3	S	S 1/2	W	d	N	V10 (f.p.s.)	Q10 (c.f.s.)	RIP-RAP SIZE D_{50}	RIP-RAP SIZE D_{MAX}	BLANKET THICKNESS
S-1	6.4512	9.757	0.6612	0.7579	0.0050	0.0707	6.0'	0.84'	0.04	1.99	12.73	9.5"	15"	19"
S-2	6.4512	9.757	0.6612	0.7579	0.0244	0.1562	6.0'	0.54'	0.04	1.54	12.8	9.5"	15"	19"
S-3	6.4512	9.757	0.6612	0.7579	0.0244	0.1562	6.0'	0.54'	0.04	1.54	12.8	9.5"	15"	19"
WATER QUALITY SWALE	1.552	7.073	0.2199	0.3625	0.0050	0.2236	6.0'	0.24'	0.04	3.01	4.00	5.5"	7"	12"
OUTFALL CHANNEL OF POND	1.680	8.342	0.2649	0.4106	0.0244	0.1562	5.0'	0.30'	0.04	2.38	3.54	5.5"	7"	12"

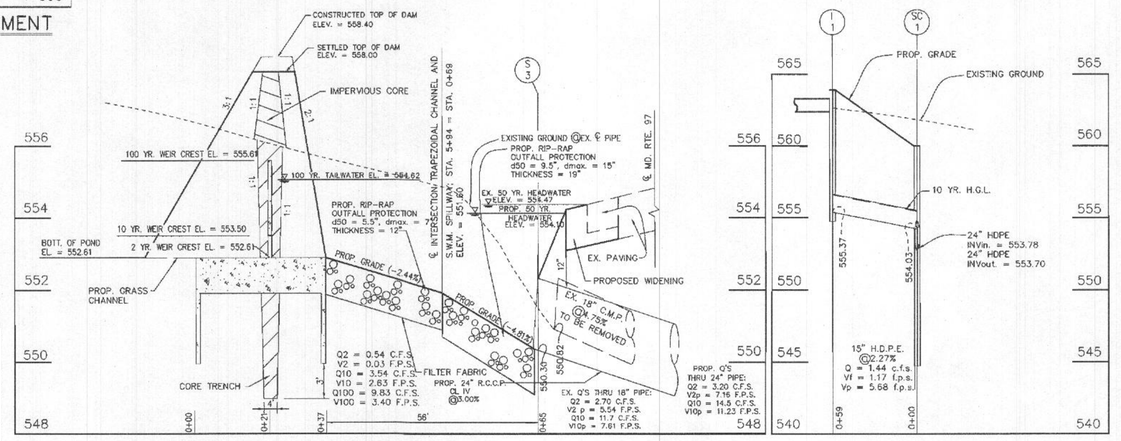

PROFILE THRU SPILLWAY (S.W.M. POND)

SCALE: HORIZ. : 1" = 20'
VERT. : 1" = 2'

PROFILE

SCALE: HORIZ. : 1" = 50'
VERT. : 1" = 5'

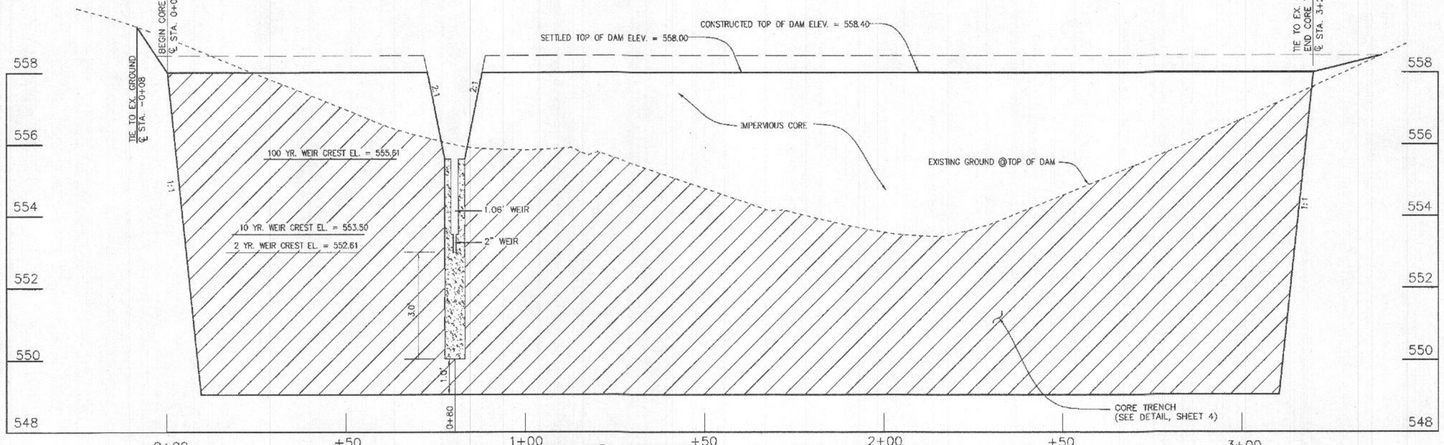

PROFILE @TOP OF DAM (S.W.M. POND)

SCALE: HORIZ. : 1" = 20'
VERT. : 1" = 2'

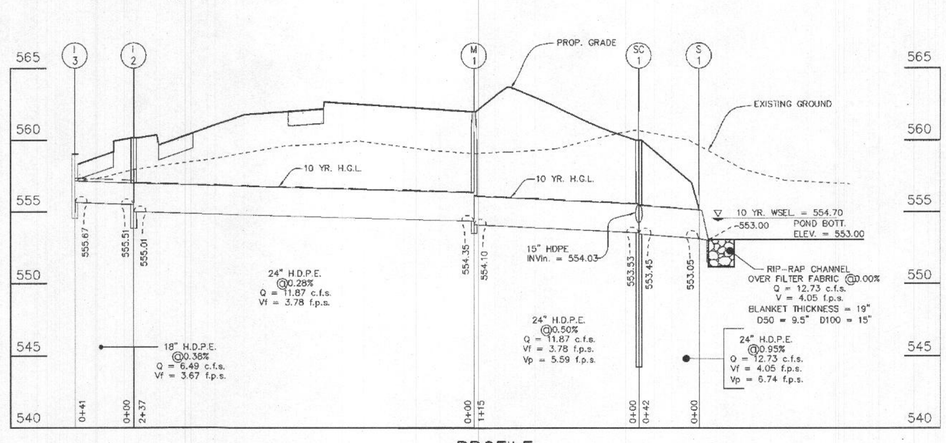

PROFILE

SCALE: HORIZ. : 1" = 50'
VERT. : 1" = 5'

Reviewed for HOWARD SCD and meets Technical Requirements.

U.S.D.A. Natural Resources Conservation Service — 9/4/01 Date

This development plan is approved for soil erosion and sediment control by the HOWARD SOIL CONSERVATION DISTRICT.

Howard SCD — 9/4/01 Date

OWNER

ST. ANDREWS EPISCOPAL CHURCH
RTE. 97 & UNION CHAPEL ROAD
P.O. BOX 53
GLENWOOD, MARYLAND 21738
(410) 489-4035

APPROVED: DEPARTMENT OF PLANNING AND ZONING

Chief, Division of Land Development — 10/19/01 Date

Chief, Development Engineering Division — 9/7/01 Date

Director, Department of Planning and Zoning — 10/23/01 Date

PROJECT	SECTION/AREA	LOT NO.
ST. ANDREWS EPISCOPAL CHURCH "WOODSIDE ESTATES"	N/A	1

PLAT REF.	BLOCK NO.	ZONE	TAX	ELEC. DIST.	CENSUS TR.
14893	16	RC-DEO	14	4TH	6040

WATER CODE	SEWER CODE
PRIVATE	PRIVATE

ENGINEER'S CERTIFICATE

"I certify that this plan for erosion and sediment control represents a practical and workable plan based on my personal knowledge of the site conditions and that it was prepared in accordance with the requirements of the Howard Soil Conservation District."

Signature of Engineer (Print name below signature) — 8/9/01 Date

DEVELOPER'S CERTIFICATE

"I/We certify that all development and construction will be done according to this plan, and that any responsible personnel involved in the construction project will have a Certificate of Attendance at a Department of the Environment Approved Training Program for the Control of Sediment and Erosion before beginning the project. I also authorize periodic on-site inspection by the Howard Soil Conservation District."

Signature of Developer (Print name below signature) — 8/9/01 Date

REVISION	
DATE	DESCRIPTION

FISHER, COLLINS & CARTER, INC.
CIVIL ENGINEERING CONSULTANTS & LAND SURVEYORS
CENTENNIAL SQUARE OFFICE PARK - 10272 BALTIMORE NATIONAL PIKE
ELLICOTT CITY, MARYLAND 21042
(410) 461 - 2855

STORMWATER MANAGEMENT PROFILES, STORM DRAIN PROFILES AND DETAIL SHEET

ST. ANDREWS EPISCOPAL CHURCH

WOODSIDE ESTATES
LOT 1

TAX MAP No: 14 PARCEL No: 216
4TH ELECTION DISTRICT, HOWARD COUNTY, MARYLAND
SCALE: AS SHOWN DATE: AUGUST 8, 2001
SHEET 3 OF 8

SDP 01-34

SUPER SILT FENCE

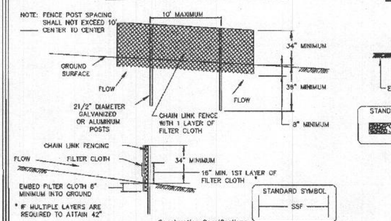

* IF MULTIPLE LAYERS ARE REQUIRED TO ATTAIN 42"

Construction Specifications

1. Fencing shall be 42" in height and constructed in accordance with the latest Maryland State Highway Details for Chain Link Fencing. The specification for a 6' fence shall be used, substituting 42" fabric and 6' length posts.
2. Chain link fence shall be fastened securely to the fence posts with wire ties. The lower tension wire, brace and truss rods, drive anchors and post caps are not required except on the ends of the fence.
3. Filter cloth shall be fastened securely to the chain link fence with ties spaced every 24" at the top and mid section.
4. Filter cloth shall be embedded a minimum of 8" into the ground.
5. When two sections of filter cloth adjoin each other, they shall be overlapped by 6" and folded.
6. Maintenance shall be performed as needed and silt buildups removed when "bulges" develop in the silt fence, or when silt reaches 50% of fence height.
7. Filter cloth shall be fastened securely to each fence post with wire ties or staples at top and mid section and shall meet the following requirements for Geotextile Class F:

Tensile Strength	50 lbs/in (min.)	Test: MSMT 509
Tensile Modulus	20 lbs/in (min.)	Test: MSMT 509
Flow Rate	0.3 gpf/ft /minute(^{2} cmm.)	Test: MSMT 322
Filtering Efficiency	75% (min.)	Test: MSMT 322

STABILIZED CONSTRUCTION ENTRANCE

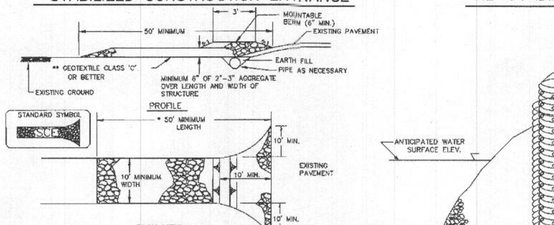

Construction Specification

1. Length – minimum of 50' (*30' for single residence lot).
2. Width – 10' minimum, should be flared at the existing road to provide a turning radius.
3. Geotextile fabric (filter cloth) shall be placed over the existing ground prior to placing stone. **The plan approval authority may not require single family residences to use geotextile.
4. Stone – crushed aggregate (2" to 3") or reclaimed or recycled concrete equivalent shall be placed at least 6" deep over the length and width of the entrance.
5. Surface Water – all surface water flowing to or diverted toward construction entrances shall be piped through the entrance, maintaining positive drainage. Pipe installed through the stabilized construction entrance shall be protected with a mountable berm with 5:1 slopes and a minimum of 6" of stone over the pipe. Pipe has to be sized according to the drainage. When the SCE is located at a high spot and has no drainage to convey a pipe will not be necessary. Pipe should be sized according to the amount of runoff to be conveyed. A 6" minimum will be required.
6. Location – A stabilized construction entrance shall be located at every point where construction traffic enters or leaves a construction site. Vehicles leaving the site must travel over the entire length of the stabilized construction entrance.

REMOVABLE PUMPING STATION

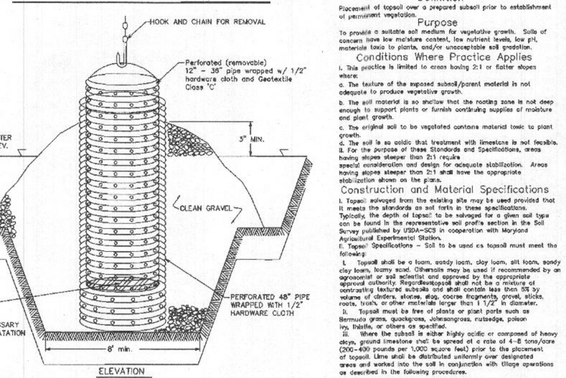

Construction Specifications

1. The outer pipe should be 48" dia. or shall, in any case, be at least 4" greater in diameter than the center pipe. The outer pipe shall be wrapped with 1/2" hardware cloth to prevent backfill material from entering the perforations.
2. After installing the outer pipe, backfill around outer pipe with 2" aggregate or clean gravel.
3. The inside stand pipe (center pipe) should be constructed by perforating a corrugated or PVC pipe between 12" and 36" in diameter. The perforations shall be 1/2" x 6" slits or 1" diameter holes 6" on centers. The center pipe shall be wrapped with 1/2" hardware cloth first, then wrapped again with Geotextile Class C.
4. The center pipe should extend 12" to 18" above the anticipated water surface elevation or riser crest elevation when developing a basin.

TOPSOIL SPECIFICATIONS

Definition

Placement of topsoil over a prepared subsoil prior to establishment of permanent vegetation.

Purpose

To provide a suitable soil medium for vegetative growth. Soils of concern have low moisture content, low nutrient levels, low pH, materials toxic to plants, and/or unacceptable soil gradation.

Conditions Where Practice Applies

I. This practice is limited to areas having 2:1 or flatter slopes where:

a. The texture of the exposed subsoil/parent material is not adequate to produce vegetative growth.

b. The soil material is so finer textured that the rooting zone is not deep enough to support plants or furnish continuing supplies of moisture and plant growth.

c. The original soil to be vegetated contains material toxic to plant growth.

d. The soil is so acidic that treatment with limestone is not feasible.

II. For the purpose of these Standards and Specifications, areas having slopes steeper than 2:1 require special consideration and design for adequate stabilization. Areas having slopes steeper than 2:1 shall have the appropriate stabilization shown on the plans.

Construction and Material Specifications

I. Topsoil removed from the existing site may be used provided that it meets the standards as set forth in these specifications. Typically, the depth of topsoil to be salvaged for a given soil type can be found in the representative soil profile section in the Soil Survey published by USDA-SCS in cooperation with Maryland Agricultural Experimental Station.

II. Topsoil Specifications – Soil to be used as topsoil must meet the following:

a. Topsoil shall be a loam, sandy loam, clay loam, silt loam, sandy clay loam, loamy sand. Materials may be mixed or recommended by an agronomist or soil scientist and approved by the appropriate approval authority. Regardless, topsoil shall not be a mixture of contrasting textured subsoils and shall contain less than 5% by volume of cinders, stones, slag, coarse fragments, gravel, sticks, roots, trash, or other materials larger than 1 1/2" in diameter.

b. Topsoil must be free of plants or plant parts such as Bermuda grass, quackgrass, Johnsongrass, nutsedge, poison ivy, thistle, or others as specified.

III. Where the subsoil is either highly acidic or composed of heavy clays, ground limestone shall be applied at a rate of 4–8 tons/acre (2000–400 pounds per 1,000 square feet) prior to the placement of topsoil. Lime shall be distributed uniformly over designated areas and worked into the soil in conjunction with tillage operations as described in the following procedures.

IV. For sites having disturbed areas over 5 acres:

I. Place topsoil (if required) and apply soil amendments as specified in 10.0 Vegetative Stabilization – Section I – Vegetative Stabilization Methods and Materials.

III. For sites having disturbed areas over 5 acres:

I. On soil meeting topsoil specifications, obtain test results dictating fertilizer and lime amendments required to bring the soil into compliance with the following:

a. pH for topsoil shall be between 6.0 and 7.5. If the tested soil demonstrates a pH of less than 6.0, sufficient lime shall be prescribed to raise the pH to 6.5or higher.

b. Organic content of topsoil shall be not less than 1.5 percent by weight.

c. Topsoil having soluble salt content greater than 500 parts per million shall not be used.

d. No sod or seed shall be placed on soil which has been treated with soil sterilants or

chemicals used for weed control until sufficient time has elapsed (14 days min.) to permit/dissipation of phyto-toxic materials.

Note: Topsoil substitutes or amendments, as recommended by a qualified agronomist or soil scientist and approved by the appropriate approval authority, may be used in lieu of natural topsoil.

II. Place topsoil (if required) and apply soil amendments as specified in 10.0 Vegetative Stabilization – Section I – Vegetative Stabilization Methods and Materials.

V. Topsoil Application

I. When topsoiling, maintain needed erosion and sediment control practices such as diversions, Grade Stabilization Structures, Earth Dikes, Slope Stn Fence and Sediment Traps and Basins.

II. Grades on the areas to be topsoiled, which have been previously established, shall be checked, and adjusted as necessary to allow for the required depth of topsoil and subsequent plant growth.

III. Topsoil shall be uniformly distributed in a 4" – 8" layer and lightly compacted to a minimum thickness of 4". Spreading shall be performed in such a manner that the seeding and planting operations can proceed with a minimum of additional soil preparation and tillage. Any irregularities in the surface resulting from topsoiling or other operations shall be corrected in order to prevent the formation of depressions or water pockets.

IV. Topsoil shall not be placed while the topsoil or subsoil is in a frozen or muddy condition.

V. The subsoil is excessively wet or in a condition that may otherwise be detrimental to proper grading and seedbed preparation.

VI. Alternative for Permanent Seeding – Instead of applying the full amounts of lime and commercial fertilizer, composted sludge and amendments may be applied as specified below:

a. Composted Sludge Material for use as a soil conditioner for sites having disturbed areas over 5 acres shall be tested to prescribe amendments and for sites having disturbed areas under 5 acres shall conform to the following requirements.

b. Composted sludge shall be supplied by, or originate from, a person or persons that are permitted (at the time of acquisition of the compost) by the Maryland Department of the Environment under COMAR 26.04.06.

b. Composted sludge shall contain at least 1 percent nitrogen, 1.5 percent phosphorus, and 0.2 percent potassium and have a Ph of 7.0 to 8.0. If compost does not meet these requirements, the appropriate constituents must be added to meet the requirements prior to use.

c. Composted sludge shall be applied at a rate of 1 ton/1,000 square feet.

d. Composted sludge shall be amended with a potassium fertilizer applied at the rate of 4 lb/1,000 square feet, and 1/3 the normal lime application rate.

SEDIMENT BASIN BAFFLES

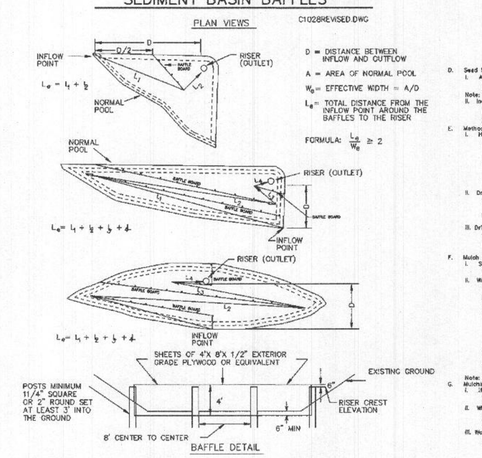

D = DISTANCE BETWEEN INFLOW AND OUTFLOW

A = AREA OF NORMAL POOL

W_B = EFFECTIVE WIDTH = A/D

L_B = TOTAL DISTANCE FROM THE INFLOW POINT AROUND THE BAFFLES TO THE RISER

FORMULA: $\frac{L_B}{W_B} \geq 2$

EROSION CONTROL MATTING

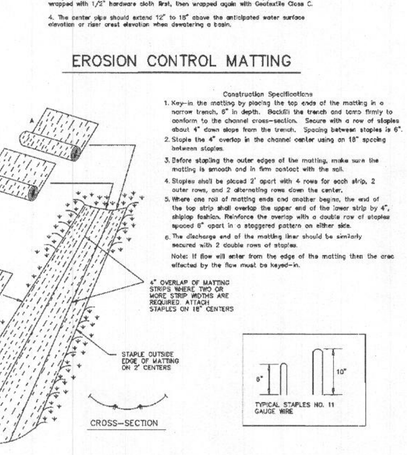

Construction Specifications

1. Key-in the matting by placing the top ends of the matting in a narrow trench, 6" in depth. Backfill and tamp the trench firmly to conform to the channel cross-section. Secure with a row of staples about 4" down slope from the trench. Spacing between staples is 6".
2. Staple the 4" overlap in the channel center using an 18" spacing between staples.
3. Before stapling the outer edges of the matting, make sure the matting is smooth and in firm contact with the soil.
4. Staples shall be placed 2' apart with 4 rows for each strip, 2 outer rows, and 2 alternating rows down the center.
5. Where one roll of matting ends and another begins, the end of the top strip shall overlap the upper end of the lower strip by 4", shiplap fashion. Reinforce the overlap with a double row of staples spaced 4" apart in a staggered pattern on either side.
6. The discharge end of the matting liner should be similarly secured with 2 double rows of staples.

Note: If flow will enter from the edge of the matting then the area affected by the flow must be keyed-in.

4" OVERLAP OF MATTING STRIPS WHERE TWO OR MORE STRIP MATTING ARE REQUIRED. ATTACH STAPLES ON 18" CENTERS

CURB INLET PROTECTION

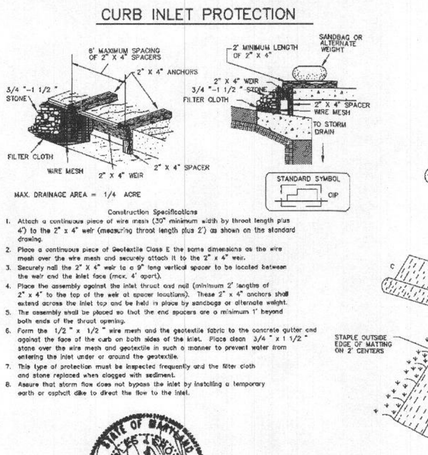

Construction Specifications

1. Attach a continuous piece of wire mesh (.25" minimum width by throat length plus 4") to the 2" x 4" welr (measuring throat length plus 2') as shown on the standard drawing.
2. Place a continuous piece of Geotextile Class E the same dimensions as the wire mesh over the wire mesh and securely attach it to the 2" x 4" wier.
3. Securely nail the 2" X 4" weir to a 9" long vertical spacer to be located between the wier and the inlet face (throat) at each upright.
4. Place the assembly against the inlet throat and nail (minimum 2' lengths of 2" x 4" to the top of the welr at spacer locations). These 2" x 4" anchors shall extend across the inlet top and be held in place by sandbags or alternate weight.
5. The assembly shall be placed so that the end spacers are a minimum 1' beyond both ends of the throat opening.
6. Form the 1/2 " x 1/2 " wire mesh and the geotextile fabric to the concrete gutter and against the face of the curb on both sides of the inlet. Place clean 3/4 " x 1 1/2 " stone over the wire mesh and geotextile in such a manner to prevent water from entering the inlet under or around the geotextile.
7. This type of protection must be inspected frequently and the filter cloth and stone replaced when clogged with sediment.
8. Assure that storm flow does not bypass the inlet by installing a temporary earth or asphalt dike to direct the flow to the inlet.

EARTH DIKE

CONSTRUCTION SPECIFICATIONS

1. ALL DIKES SHALL BE COMPACTED BY EARTH-MOVING EQUIPMENT.
2. ALL DIKES SHALL HAVE POSITIVE DRAINAGE TO AN OUTLET.
3. FOR MOWING MAYBE REQUIRED SIDE SLOPES MAY BE FLATTER IF DESIRED TO FACILITATE CROSSING BY CONSTRUCTION TRAFFIC.
4. ALL EARTH DIKES SHALL BE ADJUSTED AS NEEDED TO UTILIZE A STABILIZED STATE OUTLET.
5. EARTH DIKES SHALL HAVE AN OUTLET THAT FUNCTIONS WITH A MINIMUM OF EROSION. RUNOFF SHALL BE CONVEYED TO A SEDIMENT BASIN WHERE EITHER THE DIKE CHANNEL OR THE DRAINAGE AREA ABOVE THE DIKE ARE NOT ADEQUATELY STABILIZED.
6. STABILIZATION SHALL BE: (A) IN ACCORDANCE WITH STANDARD SPECIFICATIONS FOR SEED AND STRAW MULCH OR STRAW MULCH IF NOT IN SEEDING SEASON, (B) FLOW CHANNEL AS PER THE CHART BELOW.

FLOW CHANNEL STABILIZATION

TYPE OF TREATMENT	CHANNEL GRADE	DIKE A	DIKE B
1	0.5–3.0%	SEED AND STRAW MULCH	SEED AND STRAW MULCH
2	3.1–5.0%	SEED AND STRAW MULCH	SEED USING JUTE, OR EXCELSIOR; SOD; 2" STONE
3	5.1–8.0%	SEED WITH JUTE, OR SOD; 2" STONE	LINED RIP–RAP 4"–8"
4	8.1–20%	LINED RIP–RAP 4"–8"	ENGINEERING DESIGN

A. STONE TO BE 2 INCH STONE, OR RECYCLED CONCRETE EQUIVALENT, IN A LAYER AT LEAST 3 INCHES IN THICKNESS AND BE PRESSED INTO THE SOIL WITH CONSTRUCTION EQUIPMENT.
B. RIP–RAP TO BE 4–8 INCHES IN A LAYER AT LEAST 8 INCHES THICKNESS AND PRESSED INTO THE SOIL.
C. APPROVED EQUIVALENTS CAN BE SUBSTITUTED FOR ANY OF THE ABOVE MATERIALS.

7. PERIODIC INSPECTION AND REQUIRED MAINTENANCE MUST BE PROVIDED AFTER EACH RAIN EVENT.

20.0 STANDARDS AND SPECIFICATIONS FOR VEGETATIVE STABILIZATION

DEFINITION

Using vegetation as cover for bares soil to protect it from forces that cause erosion.

PURPOSE

Vegetative stabilization specifications are used to promote the establishment of vegetation on exposed soil. When soil is stabilized with vegetation, the soil is less likely to erode and more likely to allow infiltration of rainfall, thereby reducing sediment loads and run–off to downstream creek, and topsoiling wildlife habitat and visual resources.

CONDITIONS WHERE PRACTICE APPLIES

This practice shall be used on denuded areas as specified on the plans and may be used on highly erodible or critically eroding areas. This specification is divided into Temporary Seeding, to calmly establish vegetative cover for short duration (days to one year), and Permanent Seeding, for long term vegetative cover. Examples of applicable areas for Temporary Seeding are temporary Soil Stockpiles, cleared areas being left idle during construction phases, earth dikes, etc., and for Permanent Seeding are Areas, dams, cut and fill slopes and other areas that require long term, permanent, and erosion control.

EFFECTS ON WATER QUALITY AND QUANTITY

Timothy vegetative cover will have an effect on the water budget, especially on volumes and rates of runoff, infiltration evaporation, transpiration, and soil moisture storage. Vegetation will increase the soil's organic matter content and improve the water holding capacity of the soil and subsequent plant growth.

Vegetation will help reduce the movement of sediment, nutrients, and other chemicals carried by runoff to receiving waters. Plants will also help control pollutants and improve the air quality by accumulating these contaminants.

Sediment control devices must remain in place during seeding, seedbed preparation, seeding, mulching and vegetative establishment to prevent large quantities of sediment and associated chemicals from entering into surface waters.

SECTION I – VEGETATIVE STABILIZATION METHODS AND MATERIALS

A. Site Preparation

1. Install erosion and sediment control structures (after temporary of permanent) such as diversions, grade stabilization structures, berms, waterways, or sediment control basins.
2. Application of grading operations at right angles to the slope. Final grading and shaping is not usually necessary for temporary seeding.

B. Soil Tests

III. Schedule required soil tests to determine soil amendment composition and application rates for sites having disturbed areas over 5 acres.

C. Soil Amendments (Fertilizer and Lime Specifications)

I. Soil tests must be performed to determine the exact rates and application rates for both lime and fertilizer on sites having disturbed areas over 5 acres. Soil analysis may be performed by the University of Maryland or a recognized commercial laboratory. Soil samples taken for engineering purposes may also be used for chemical analyses.

II. Fertilizers shall be uniform in composition, free flowing and suitable for accurate application by approved equipment. Manure may be substituted for fertilizer only when approved by the appropriate approval authority. Manure shall be analyzed for its fertilizer value and adjustments to the rate of application allowed according to the significant value. Manure has not and shall not be a source of weed seeds or viable pathogens of the producer.

III. Lime materials shall be ground limestone (hydrated or burnt lime may be substituted) which contains at least 50% total oxides (calcium oxide plus magnesium oxide). Limestone shall be ground to such fineness that at least 50% will pass through a #100 mesh sieve and 90% will pass through a #20 mesh sieve.

IV. Incorporate lime and fertilizer into the top 3–5" of soil by disking or other suitable means.

C. Seedbed Preparation

a. Temporary Seeding

I. Seedbed preparation shall consist of loosening soil to a depth of 3" to 5" by means of suitable agricultural or construction equipment, such as disc harrows or other; plows or rippers mounted on construction equipment. Where soil is heavily compacted it shall be rolled or chopped smooth, but left in the roughened condition. Sloped areas (greater than 3:1) should be tracked leaving the surface in a roughened condition with ridges running parallel to the contour of the slope.

b. Apply fertilizer and lime as prescribed on the plans.

c. On corporate lime and fertilizer into the top 3–5" of soil by disking or other suitable means.

d. Permanent Seeding

I. Minimum soil conditions required for permanent vegetative establishment:

1. Soil pH shall be between 6.0 and 7.0.
2. Soluble salts shall be less than 500 parts per million (ppm).
3. The soil shall contain less than 40% clay, but enough fine grained material (20–40% silt plus clay) to provide the required filler to hold a reasonable supply of moisture. An exception is if lowgrass or legume vegetation is to be established, then a sandy soil (<40% silt plus clay) would be acceptable.
4. Soil shall contain 1.5% minimum organic matter by weight.
5. Soil must contain sufficient pore space to permit adequate root penetration.
6. If these conditions cannot be met by soil on site, adding topsoil is required in accordance with Section 21 Standard and Specification for Topsoil.

b. Areas previously graded in conformance with the drainage shall be established in a true and even grade, then scarified or otherwise loosened to a depth of 3–5" to permit bonding of the topsoil to the surface area and to create horizontal erosion check slots to prevent topsoil slippage. Slope and to create horizontal erosion check slots to prevent topsoil from sliding down a slope.

c. Apply soil amendments as per sod test or as included on the plans.

d. Mix soil amendments into the top 3–5" of topsoil by disking or other suitable means. Lawn areas should be raked to smooth the surface, remove large objects like stones and branches, and ready the area for seed and application. Where site conditions will not permit normal seedbed preparation, loosen surface soil by dragging with a heavy chain or other equipment to roughen the surface. Steep slopes (greater than 3:1) should be tracked by a dozer leaving the soil in an irregular condition with ridges running parallel to the contour of the slope. The top 3–5" of soil should be loose and friable. Seedbed loosening may not be necessary on newly disturbed areas.

D. Seed Specifications

I. All seed must meet the requirements of the Maryland State Seed Law. All seed shall be subject to testing by a recognized seed laboratory. All seed used shall have been tested within the 6 months immediately preceding the date of sowing such material on this job.

Note: Seed shall be made available to the inspector to verify type and rate of seed used.

II. Inoculation – The inoculant for treating legume seed is the seed mixtures used be a pure culture of viable bacteria of the species required for the legume to be planted. Use more than the recommended rate when hydroseeding. Note: It is very important to keep inoculant as cool as possible and out of direct sunlight. Temperatures above 70°–80° F. can weaken bacteria and make the inoculant ineffective.

E. Methods of Seeding

I. Hydroseeding – Apply seed uniformly with hydroseeder (slurry includes seed and fertilizer), broadcast or by other approved, or a cultipacker seeder.

a. If fertilizer is being applied at the time of seeding, the application rates amounts will not exceed the following: nitrogen: maximum of 100 lbs. per acre total of soluble nitrogen; P205 (phosphorous): 200 lbs/acc K20 (potassium): 200 lbs/ac.

b. Mix seed, fertilizer, and mulch (if applicable) with water. Mulch over may be applied by hydroseeding. Normally, not more than 2 tons are applied by hydroseeding at any one time. Do not use lunch or hydrated lime when hydroseeding.

c. Seed and fertilizer shall be mixed on site and seeding shall be done immediately and without interruption.

II. Dry Seeding – This includes use of conventional drop or broadcast spreaders.

a. Sow normal dry seed uniformly over the area and rake lightly into the upper one inch of soil. Where practical, seed should be applied in two directions perpendicular to each other. Apply half the seeding rate in each direction.

b. Where practical, seed should be applied in two directions perpendicular to each other. Apply half the seeding rate in each direction.

III. Drill or Cultipacker Seeding: Mechanized seeders that apply seed and cover seed with soil.

a. Sow seed uniformly with drill seeder or cultipacker seeder. Seed should be sown to provide at least ¼" inch of soil covering. Seedbed shall be firm after planting is complete.

b. Where practical, seed should be applied in two directions perpendicular to each other. Apply half the seeding rate in each direction.

F. Mulch Specifications (in order of preference)

Straw shall consist of thoroughly threshed wheat, rye or oat straw, reasonable bright in color, and shall not be brittle, moldy, caked, decayed, or excessively dusty and shall be free of noxious weed seeds or other material detrimental to plant growth.

II. Wood Cellulose Fiber Mulch (WCFM)

a. WCFM shall consist of specially prepared wood cellulose processed into a uniform fibrous physical state.

b. WCFM shall be dyed green or contain a green dye in the package that will provide an appropriate color to facilitate visual inspection of the uniformly spread slurry.

c. WCFM materials shall be manufactured and processed in such a manner that the wood cellulose fiber mulch will remain in uniform suspension in water under agitation and will blend with seed, fertilizer and other additives to form a homogeneous slurry. The mulch material shall form a blotter–like ground cover, on application, having moisture absorption and percolation properties and shall cover and hold grass seed in contact with the soil without inhibiting the growth of the grass seedlings.

d. WCFM shall contain no germination or growth inhibiting factors.

e. WCFM must conform to the following physical requirements: fiber length to approximately 10 mm., diameter approximately 1 mm., pH range of 4.5 to 8.5, ash content of 1.6% maximum and water holding capacity of 90% minimum.

Note: Only straw or straw mulch should be used in areas where the species of grass is desired.

G. Mulching Seeded Areas – Mulch shall be applied to all seeded areas immediately after seeding.

I. Spreading Mulch – Mulch shall be spread uniformly at the rate specified on the plans or prescribed. In this section and maintained until the seeding season reduces and seeding can be performed in accordance with these specifications.

II. When straw mulch is used, it shall be spread over all seeded areas at the rate of 2 tons/acre. Mulch shall be applied to a uniform loose depth of between 1" and 2". Mulch applied shall achieve a uniform distribution and depth so that the soil surface is not exposed. If a mulch crimping tool is used, the rate should be increased to 2.5 tons/acre.

III. Wood cellulose fiber mulch shall be applied at a minimum dry weight of 1,500 lbs. per acre. The wood cellulose fiber shall be mixed with seed, and the mixture shall contain a maximum of 50 lbs. of wood cellulose fiber per 100 gallons of water.

H. Securing Straw Mulch (Mulch Anchoring) – Mulch anchoring shall be performed immediately following mulch application to minimize loss by wind or water. This may be done by one of the following methods (listed by preference), depending upon size of area and erosion hazard.

I. A mulch anchoring tool is a tractor drawn implement designed to punch and anchor mulch into the soil surface a minimum of two (2) inches. This practice is most effective on large areas and where the length of slope permits operation of equipment safely. If used on sloping land, this practice should be used on the contour if possible.

II. Wood cellulose fiber may be used for anchoring straw. The fiber binder shall be applied at a rate of 750 pounds per acre. The wood cellulose fiber shall be mixed with water and the mixture shall contain a maximum of 50 pounds of wood cellulose fiber per 100 gallons of water.

III. Applications of liquid binders should be heavier at the edges where wind catches mulch most and in valleys and crest of banks. The remainder of area should be spread uniform after binder application. Emulsified binders – such as AEROSPRAY 70-30 by Aerospray Co. of Wampanoag, Inc. of Pawtucket, Terra Tack AR or other approved equal may be used at rates recommended by the manufacturer for the specific use.

IV. Lightweight plastic netting may be stapled over the mulch in accordance with manufacturer's recommendations.

I. Incremental Stabilization – Cut Slopes

I. All cuts slopes shall be finished, prepared, seeded and mulched as the work progresses. Slopes shall be excavated and stabilized in equal increments not to exceed 15'.

II. Construction sequence (Refer to Figure 3 below):

a. Excavate and stabilize (a) temporary swales, side ditches, or berms that will be used to convey runoff from the excavations.

b. Perform Phase 1 excavation, drains and stabilize.

c. Perform Phase 2 excavation, drains and stabilize. Overseed Phase 1 areas as necessary.

d. Perform final phase excavation, drains and stabilize. Overseed previously seeded areas as necessary.

Note: Once excavation has begun the operation should be continuous from grubbing through the completion of grading and placement of topsoil (if required) and permanent seed and mulch. Any interruptions in the operation or completing the operation out of the seeding season will necessitate the application of temporary stabilization.

J. Incremental Stabilization of Embankments – Fill Slopes

I. Embankments shall be constructed in lifts as prescribed on the plans.

II. Slopes shall be stabilized immediately when the vertical height of the multiple lifts reaches 10'–0" or when the grading operation ceases as prescribed in the plans.

III. At the end of each day's operation, a slope shall not be constructed along the top edge of the embankment to prevent interrupt surface runoff and convey it down the slope in a non-erosive manner to a sediment trapping device.

IV. Construction sequence: Refer to Figure 4 (below).

a. Excavate and stabilize (a) temporary swales, side ditches, or berms that will be used to convey runoff from the excavations. Slope silt fence at low side of fill as shown in Figure D, unless other mutigate scenario in the plans address this area.

b. Place Phase 1 embankment, drains and stabilize.

c. Place Phase 2 embankment, drains and stabilize.

d. Place final phase embankment, drains and stabilize. Overseed previously seeded areas as necessary.

Note: Once placement of fill has begun the operation should be continuous from grubbing through the completion of grading and placement of topsoil (if required) and permanent seed and mulch. any interruptions in the operation or completing the operation out of the seeding season will necessitate the application of temporary stabilization.

SECTION 2 – TEMPORARY SEEDING

Vegetative – annual grass or grain used to provide cover on disturbed areas for up to 12 months. For long term duration of vegetative cover, Permanent Seeding is required.

A. Seed mixtures – Temporary Seeding

I. Select one or more of the species or mixtures listed in Table 28 for the appropriate Plant Hardiness Zone (from Figure 5) and enter them in the Temporary seeding summary below, along with application rates, seeding dates and seeding depths. If this summary is not put on the construction plans and completed, then Table 25 must be put on the plans. Additional planting specifications for exceptional sites such as shorelines, streambanks, or dunes or for specific purposes such as wildlife or aesthetic treatment may be found in USDA–SCS Technical Field Office Guide, Section 342 – Critical Area Planting. Also see Sections IV Stone Outlets and Section V Temporary Diversions.

II. For sites having disturbed area over 5 acres, the rates shown on this table shall be deleted and the rates determined by the testing agency shall be written in.

III. For areas receiving low maintenance, apply sreaform fertilizer (46–0–0) at 1/2 lb/1000 sq. ft. (1/3 lbs/sq. in addition to the above soil amendments shown in the table below, to be performed at the time of seeding.

Seed Mixture (Hardiness Zone 6a) From Table 28				Fertilizer Rate (10–10–10)	Lime Rate
No.	Species	Application Rate (lb/ac)	Seeding Dates	Seeding Depths	
1	RYE	140	3/15 – 5/1 & 8/1 – 10/31	1" – 2"	800 lb/ac (18 lb/1000sf)	2 tons/ac (100 lb/1000sf)
2	BARLEY OR RYE PLUS FOXTAIL MILLOT	150	8/1 – 7/31	1"		

SECTION 3 – PERMANENT SEEDING

Seeding grass and legumes to establish growing cover for a minimum of one year on disturbed areas generally requiring low maintenance.

A. Seed mixtures – Permanent Seeding

I. Select one or more of the species or mixtures listed in Table 28 for the appropriate Plant Hardiness Zone (from Figure 5) and enter them in the Permanent Seeding Summary below, along with application rates and seeding dates. Seeding depths can be estimated using Table 26. If this summary is not put on the construction plans and completed, then Table 25 must be put on the plans. Additional planting specifications for exceptional sites such as shorelines, streambanks, or dunes or for specific purposes such as wildlife or aesthetic treatment may be found in USDA–SCS Technical Field Office Guide, Section 342 – Critical Area Planting. Also see Sections IV Stone Outlets and Section V Temporary Diversions.

II. For sites having disturbed area over 5 acres, the rates shown on this table shall be deleted and the rates determined by the testing agency shall be written in.

III. For areas receiving low maintenance, apply sreaform fertilizer (46–0–0) at 1/2 lbs/1000 sq. ft. (1/3 lbs/sq. in addition to the above soil amendments shown in the table below, to be performed at the time of seeding.

Seed Mixture (Hardiness Zone 6a) From Table 25							Lime Rate
No.	Species	Application Rate (lb/ac)	Seeding Dates	Seeding Depths	N	Fertilizer Rate (10–20–20) P205	K20
3	TALL FESCUE (95%) KENTUCKY BLUEGRASS (5%) PERENNIAL RYEGRASS (10%)	120 10 10	3/15 – 5/1 & 8/1 – 10/1	1" – 2"	80 lb/ac (2.0 lb/ 1000sf)	175 lb/ac (4 lb/ 1000sf)	175 lb/ac (4 lb/ 1000sf)	2 tons/ac (100 lb/ 1000sf)
10	TALL FESCUE (60%) HARD FESCUE (20%)	120 50	3/15 – 5/1 & 8/1 – 10/1	1" – 2"				

SEDIMENT CONTROL NOTES

1) A MINIMUM OF 48 HOURS NOTICE MUST BE GIVEN TO THE HOWARD COUNTY DEPARTMENT OF INSPECTIONS, LICENSES AND PERMITS, SEDIMENT CONTROL INSPECTION PRIOR TO THE START OF ANY CONSTRUCTION (313–1855).
2) ALL VEGETATIVE AND STRUCTURAL PRACTICES ARC TO BE INSTALLED ACCORDING TO THE PROVISIONS OF THIS PLAN AND ARE TO BE IN CONFORMANCE WITH THE MOST CURRENT MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL AND REVISIONS THERETO.
3) FOLLOWING INITIAL SOIL DISTURBANCE OR RE–DISTURBANCE, PERMANENT OR TEMPORARY STABILIZATION SHALL BE COMPLETED WITHIN: a) 7 CALENDAR DAYS FOR ALL PERIMETER SEDIMENT CONTROL STRUCTURES, DIKES, PERIMETER SLOPES AND ALL SLOPES STEEPER THAN 3:1, b) 14 DAYS AS TO ALL OTHER DISTURBED OR GRADED AREAS ON THE PROJECT SITE.
4) ALL SEDIMENT TRAPS/BASINS SHOWN MUST BE FENCED AND WARNING SIGNS POSTED AROUND THEIR PERIMETER IN ACCORDANCE WITH VOL. 1, CHAPTER 12, OF THE HOWARD COUNTY DESIGN MANUAL, STORM DRAINAGE.
5) ALL DISTURBED AREAS MUST BE STABILIZED WITHIN THE TIME PERIOD SPECIFIED ABOVE IN ACCORDANCE WITH THE 1994 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL FOR PERMANENT SEEDING (SEC. 91), SOD (SEC. 54), TEMPORARY SEEDING (SEC. 50), AND MULCHING (SEC. 52). TEMPORARY STABILIZATION WITH MULCH ALONE CAN ONLY BE DONE WHEN RECOMMENDED SEEDING DATES DO NOT ALLOW FOR PROPER GERMINATION AND ESTABLISHMENT OF GRASSES.
6) ALL SEDIMENT CONTROL STRUCTURES ARE TO REMAIN IN PLACE AND ARE TO BE MAINTAINED IN OPERATIVE CONDITION UNTIL PERMISSION FOR THEIR REMOVAL HAS BEEN OBTAINED FROM THE HOWARD COUNTY SEDIMENT CONTROL INSPECTOR.
7) SITE ANALYSIS:

TOTAL AREA OF SITE	10.413	ACRES
AREA DISTURBED	8.28	ACRES
AREA TO BE ROOFED OR PAVED	2.16	ACRES
AREA TO BE VE

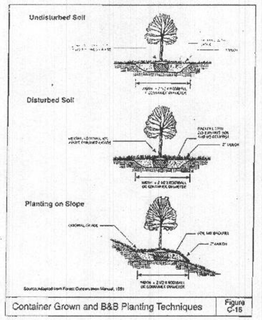

Container Grown and B&B Planting Techniques — Figure C-15

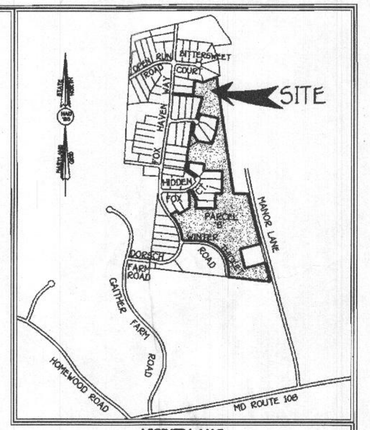

VICINITY MAP
SCALE: 1" = 1200'

Planting Schedule

FCE Planting Area 17 (3.7 acres)

Qty.	Species	Size	Spacing
4	Acer rubrum - Red maple	1" cal.	**
7	Fraxinus americana - White ash	1" cal.	**
160	Acer rubrum - Red maple	2-3 whip	**
70	Cercis canadensis - Red bud	2-3 whip	**
250	Fraxinus americana - White ash	2-3' whip	**
250	Liriodendron tulipifera - Poplar	2-3' whip	**
90	Nyssa sylvatica - Black gum	2-3' whip	**
150	Prunus serotina - Black cherry	2-3' whip	**
150	Quercus rubra - Red oak	2-3' whip	**
80	Viburnum dentatum - Arrowwood	2-3' b.t.	**
80	Viburnum prunifolium - Blackhaw	2-3' b.t.	**

FCE Planting Area 2 (0.2 acres)

Qty.	Species	Size	Spacing
4	Acer rubrum - Red maple	1" cal.	**
60	Acer rubrum - Red maple	2-3 whip	**
30	Cercis canadensis - Red bud	2-3 whip	**
90	Fraxinus americana - White ash	2-3' whip	**
90	Liriodendron tulipifera - Poplar	2-3' whip	**
50	Nyssa sylvatica - Black gum	2-3' whip	**
65	Prunus serotina - Black cherry	2-3' whip	**
65	Quercus rubra - Red oak	2-3' whip	**
35	Viburnum dentatum - Arrowwood	2-3' b.t.	**
35	Viburnum prunifolium - Blackhaw	2-3' b.t.	**

Key:

** Plantings to be spaced on 11 foot centers, no shelters required - plantings should be installed in rows to facilitate future maintenance. Where possible rows should be made along contour.

One caliper plants shall be planted is locations shown by -

b.t. - bruached transplant

Planting Notes:

1. Multiflora rose control must be performed as part of this planting plan.

2. Bareroot plant material may be used to offset the cost of multiflora rose removal and maintenance. If bareroot material is used it must be planted in March-April and an anti-desicant gel should be utilized to protect root systems. Container grown stock is recommended.

3. Plants should be flagged to aid on location during maintenance. Plantings should also be planted in grid pattern to facilitate maintenance and removal of invasive and exotic species.

Multiflora Rose Control Note

Multiflora rose is prevalent in certain areas to be afforested. Prior to planting all multiflora rose shall be removed. Removal of the rose may be performed with mowing and herbicide treatments. Physical removal of all top growth following by a periodic herbicide treatment of stump sprouts is recommended. Native tree and shrub species occurring within the rose thickets should be retained wherever possible. Herbicides treatments shall occur on 2 month intervals during the first growing season and once each in the spring and fall for subsequent years. Herbicide used shall be made specifically to address woody plant material and shall be applied as per manufacturers specifications. Care should be taken not to spray planted trees or naturally occurring native tree/shrub seedlings. It is recommended that initiation of rose removal begin at least six months prior to planting.

NOTE: FOR EASEMENT BEARING & DISTANCES SEE RECORDED PLAT 14903 - 14907 (F02-11)

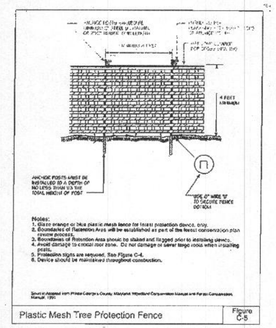
Plastic Mesh Tree Protection Fence — Figure C-8



▼ DENOTES SIGN LOCATION

Planting/Soil Specifications

1. Planting of bareroot stock shall take place between March 15th and April 20th. Container stock may be planted September 1-October 30.
2. A twelve (12) inch layer of topsoil shall be spread over all afforestation areas impacted by site grading to ensure a suitable planting area. Disturbed areas shall be seeded and mulched as per general construction plan for project. Planting areas not impacted by site grading shall have no additional topsoil installed.
3. All bareroot planting stock shall have thick root systems dipped into an anti-desiccant gel prior to planting.
4. Plants shall be installed so that the top of root mass is level with the top of existing grade. Backfill in the planting pits shall consist of 3 parts existing soil to 1 part peat fines or equivalent.
5. Fertilizer shall consist of Agriform 22-8-2, or equivalent, applied as per manufacturer's specifications.
6. A two (2) inch layer of hardwood mulch shall be placed over the root area of all plantings.
7. Plant material shall be transported to the site in a tarped or covered truck. Plants shall be kept moist prior to planting.
8. All non-organic debris associated with the planting operation shall be removed from the site by the contractor.

Sequence of Construction

1. Plants shall be installed as per Plant Schedule and the Planting/Soil Specifications for the project.
2. Upon completion of the planting, signage shall be installed as per the Forest Retention Area Protection Devices shown on Sheet 3 of the Forest Conservation Plan.
3. Plantings shall be maintained and guaranteed in accordance with the Maintenance and Guarantee requirements for project.

Maintenance of Plantings

1. Maintenance of plantings shall last for a period of 24 months.
2. All plant material shall be weeded twice a month during the 1st growing season. Watering may be more or less frequent depending on weather conditions. During second growing season, once a month during May-September, if needed.
3. Invasive species and excessive weeds will be removed from reforestation areas. Old field successional species will be retained.
4. Plants will be maintained a minimum two times during the growing season for serious plant pests and diseases. Serious problems will be treated with the appropriate agent.
5. Dead branches will be pruned from plantings.

Guarantee Requirements

1. After one growing season, plant material shall be maintained at 90% survival threshold. A 75 percent survival rate of forestation plantings will be required at the end of the 24 month maintenance period. All plant materials below the 75 percent threshold will be replaced at the beginning of the next growing season.
2. The contractor will not be liable for plant loss due to theft or vandalism.

Surety for Reforestation

1. The developer shall post a surety (bond, letter of credit) to ensure that reforestation plantings are completed. Upon acceptance of the plantings by the County, the bond shall be released.

FCP NOTES

1. Any Forest Conservation Easement (FCE) area shown hereon is subject to protective covenants which may be found in the Land Records of Howard County which restrict the disturbance and use of these areas.
2. The forest Conservation Easements have been established to fulfill the requirements of Section 16.1200 of the Howard County Code, Forest Conservation Act. No clearing, grading, or construction is permitted within the Forest Conservation Easements; however, forest management practices as defines in the Deed of Forest Conservation Easement are allowed.
3. Limits of disturbance shall be restricted to areas outside the limit of temporary fencing or the FCE boundary, whichever is greater.
4. There shall be no clearing, grading, construction or disturbance of vegetation in the Forest Conservation Easement, except as permitted by Howard County DPZ.
5. No stockpiles, parking areas, equipment cleaning areas, etc. shall occur within areas designated as Forest Conservation Easements.
6. Temporary fencing shall be used to protect forest resources during construction. The fencing shall be placed along all FCE boundaries which occur within 15 feet of the proposed limits of disturbance.
7. Permanent signage shall be placed 50-100' apart along the boundaries of all areas included in Forest Conservation Easements.
8. The reforestation plans shown hereon have been prepared to meet the reforestation obligation of the proposed St. Andrews Episcopal Church (Woodside Estates Lot 1), SDP #01-34.

St. Andrews Episcopal Church Site Data

	Acres
Gross Area:	10.4
Net Tract Area:	10.4
Existing Forest:	6.3
Conservation Threshold:	2.1
Afforestation Threshold:	1.6
Forest To be Retained in FCE:	0.0
Reforestation Obligation:	5.2
Forestation Proposed:	5.2

FISHER, COLLINS & CARTER, INC.
CIVIL ENGINEERING CONSULTANTS & LAND SURVEYORS
CENTENNIAL SQUARE OFFICE PARK - 10272 BALTIMORE NATIONAL PIKE
ELLICOTT CITY, MARYLAND 21042
(410) 461 - 2855

MD DNR Qualified Professional
USACOE Wetland Delineator
Certification #MDCP93MD0610044B
JOHN P. CAROLES 4/6/01

Eco-Science Professionals, Inc.
CONSULTING ECOLOGISTS

REVISION

DATE	DESCRIPTION

ENGINEER'S CERTIFICATE

"I certify that this plan for sediment and erosion control represents a practical and workable plan based on my personal knowledge of the site conditions and that it was prepared in accordance with the requirements of the Howard Soil Conservation District."

Signature of Engineer (print name below signature) Date

DEVELOPER'S CERTIFICATE

"I/We certify that all development and construction will be done according to this plan for sediment and erosion control and that all responsible personnel involved in the construction project will have a Certificate of Attendance at a Department of the Environment Approved Training Program for the Control of Sediment and Erosion before beginning the project. I also authorize periodic on-site inspection by the Howard Soil Conservation District."

Signature of Developer (print name below signature) Date

Reviewed for HOWARD SCD and meets Technical Requirements.

U.S.D.A.-Natural Resources Conservation Service Date

This development plan is approved for soil erosion and sediment control by the HOWARD SOIL CONSERVATION DISTRICT.

Howard SCD Date

DEVELOPER/OWNER

ST. ANDREWS EPISCOPAL CHURCH
ATTN. 97 & UNION CHAPEL ROAD
P.O. BOX 52
GLENWOOD, MARYLAND 21738
(410) 489-4035

APPROVED: DEPARTMENT OF PLANNING AND ZONING

Director - Department of Planning and Zoning — Date 10/23/01

Chief, Division of Land Development — Date 10/19/01

Chief, Development Engineering Division — Date 9/7/01

SUBDIVISION NAME: ST. ANDREWS EPISCOPAL CHURCH "WOODSIDE ESTATES"		SECTION/AREA N/A		LOT NO. 1
PLAT NO.: 5978 & 14903 - 14907	BLOCK NO.: 16	ZONE: RC-DEO	TAX/ZONE: 14	ELEC. DIST.: 4TH
DEED REF.: 4981/505				CENSUS TR.: 6060
WATER CODE: PRIVATE		SEWER CODE: PRIVATE		

OFF-SITE FOREST CONSERVATION PLAN

ST. ANDREWS EPISCOPAL CHURCH

WOODSIDE ESTATES

LOT 1

TAX MAP No: 14 PARCEL No: 216

4TH ELECTION DISTRICT, HOWARD COUNTY, MARYLAND

SCALE: 1" = 100' DATE: MAY 23, 2001

SHEET 6 OF 7

SDP 01-34

K:\Drawings 4\40315 Union Chapel Church\SDP\40315 OFF-SITE FOREST CONSERVATION PLAN.dwg

BUILDING CODE DATA

Jurisdiction:	Howard County, Maryland
Applicable Codes:	2021 International Building Code 2021 NFPA 101 Life Safety Code COMAR - Maryland Accessibility Code 05.02.02 2015 MEGC Plumbing Code (2015 International Plumbing Code) 2021 International Mechanical Code 2021 International Electrical Code 2021 International Energy Conservation Code NFPA 1 Fire Prevention Code ADA - Americans With Disabilities Act
Scope of Work:	Minor interior renovation to existing religious facility.

Building Data:

Area

First Floor 6,564 GSF

Use Group: IBC 302.1	A-3 Assembly
Height & Area Limitations: IBC 506	1 Stories / 56,000 sf
Height Adjustments: IBC 504	N/A
Area Adjustments: IBC 507	N/A
Construction Type: IBC 602.1	II B

Fire-Resistance Rating: IBC 601

	IBC
Exterior Walls	0 hour
Interior Walls	0 hour
Floors	0 hour
Tenant Separation	0 hour
Roof	0 hour
Beams & Columns	0 hour
Corridors	1 hour
Shafts	1 hour
Use separation	2 hour

Fire Suppression Systems: IBC 901	NFPA 13 Sprinkler System Provided
Travel Distance to Exit: IBC 1017	250 ft (sprinkleded)
Common Path of Travel IBC 1006.2	75'

Occupancy Load: IBC 1004

1st Floor

Office/Admin.:	402 sf / 100	4 Occupants
Kitchen:	603 sf / 200	3 Occupants
Mechanical / Utility:	821 sf / 300	3 Occupants
Daycare	1,248 sf / 35	35 Occupants
Assembly:	3,484 sf / 15	232 Occupants
Total:		277 Occupants

Number of Exits: IBC 1006.3	1st Floor: 2 req'd. (less than 500 occupants) 5 provided
Egress Capacity: IBC 1005.1 NFPA 7.2.1.2	277 Occupants X .2" Per Occupant = 55.4 inches (252" PROVIDED) __ Occupants / __" Per Occupant = __ inches
Corridor Width: IBC 1020.1	44" min. 60" Provided (ADA Requirement may Govern)
Accessibility: IBC 1105.1	At least one entry shall be accessible.

Live Loads

	Min.	Design
Floor (corridors):	100 psf	100 psf
Floor (OFFICE):	50 psf	60 psf
Roof:	20 psf	35 psf
Wind:	? psf	? psf

Plumbing Fixture Count

Water Closets	1 per 50 Occupants + 1 per ea additional 150 = 6
Urinals	1 per 50 Occupants + 1 per ea additional 150 = 2
Lavatories	1 per 50 Occupants + 1 per ea additional 150 = 3
Drinking Fountain	1 per 1,000 Occupants
Service Sink	1 per Floor

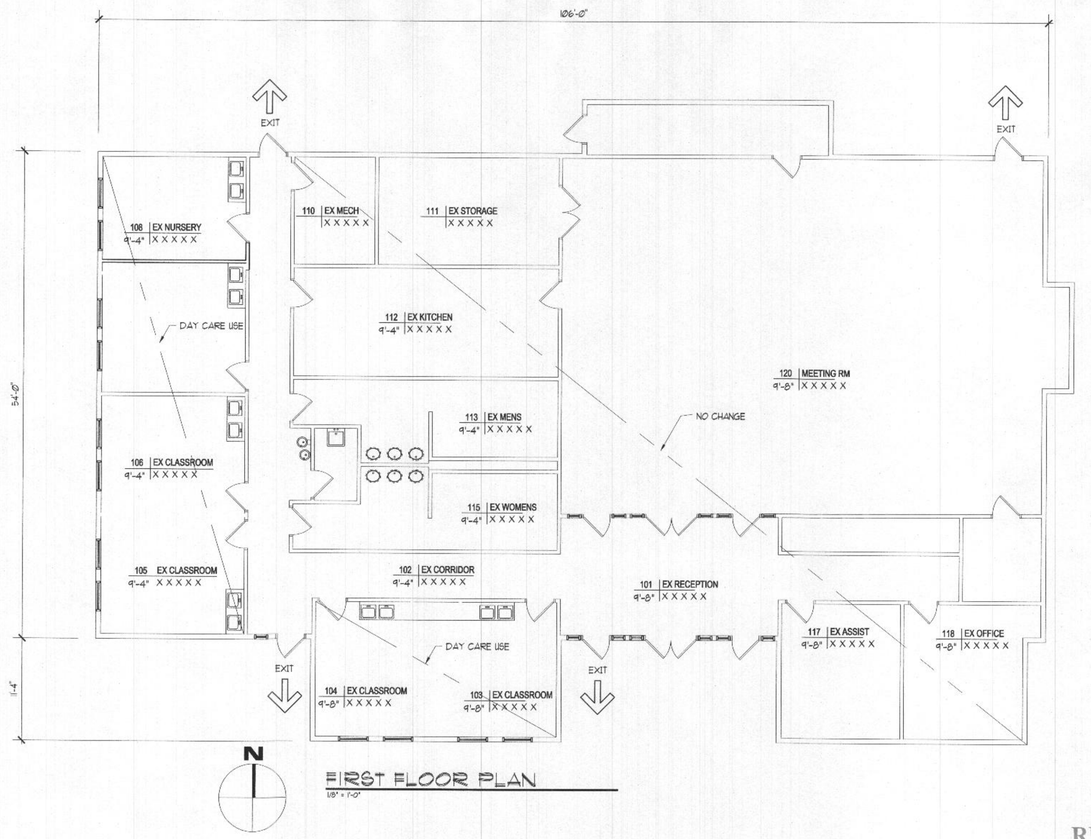

FIRST FLOOR PLAN
1/8" = 1'-0"

RECEIVED
JUL 18 2022
LICENSES & PERMITS DIVISION

REVISIONS

Owner:
Lexi Young
Your Journey Daycare
address
Phone:

Construction Manager:

Structural Engineer:

Mechanical/Electrical/Plumbing Engineer:

Civil Engineer:

Your Journey Daycare
at
St. Andrews Episcopal Church
2892 Roxbury Mills Rd.
Glenwood, Maryland 21738

MORGAN DESIGN GROUP
Architecture
Interior Design
Landscape Design
2775 Green Leaf Ct.
Suite H
Westminster, Maryland 21157
Phone: 410-356-0122
Fax: 443-926-9964
www.mdgarch.com

ISSUED FOR:
- [ ] PRELIMINARY/PROGRESS (NOT FOR CONST.)
- [ ] PRICING ONLY
- [x] PERMIT
- [ ] CONSTRUCTION DOCUMENTS

SEAL

"I certify that these documents were prepared or approved by me, and that I am duly licensed architect under the laws of the State of Maryland, license number 7573-R, Expiration date April 5, 2023"

© COPYRIGHT 2022, MORGAN DESIGN GROUP

DESIGN	JBM
DRAWN	STAFF
APPROVED	
SCALE	AS SHOWN
DATE	MARCH 28, 2022
CAD FILE	
PROJECT NO.	

DRAWING TITLE
CODE ANALYSIS
LIFE SAFETY PLAN

LS-1

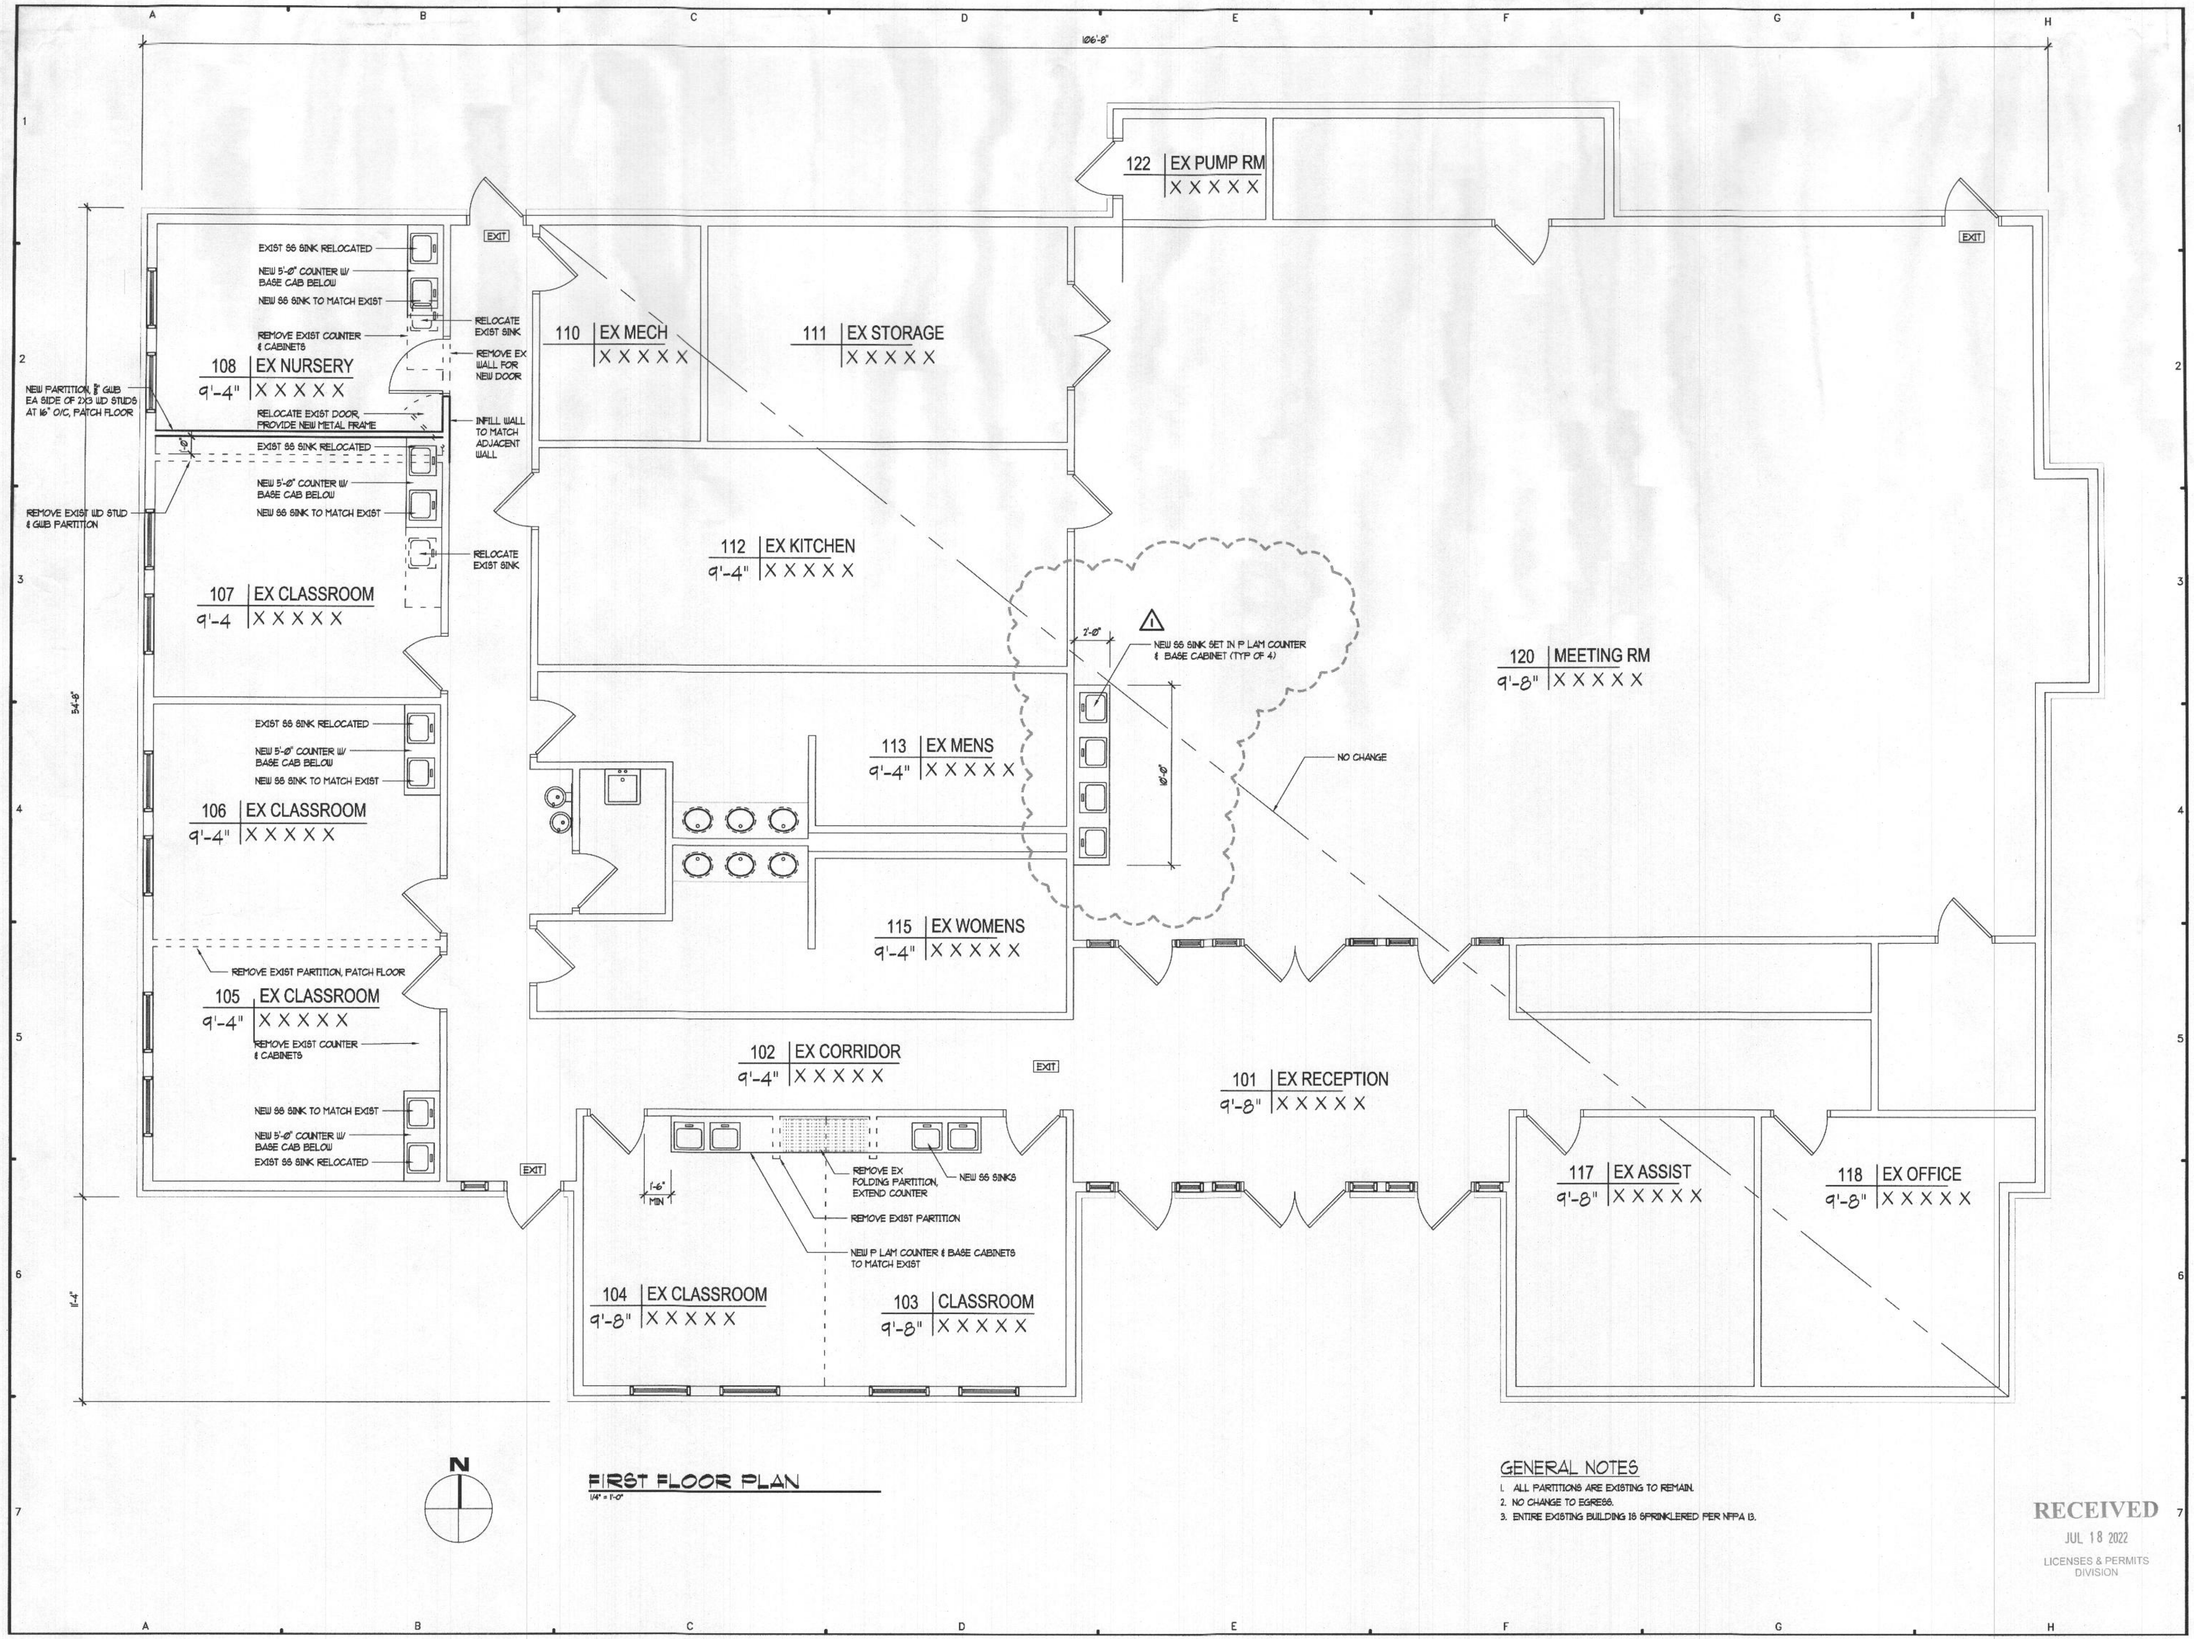

N

FIRST FLOOR PLAN

1/4" = 1'-0"

GENERAL NOTES

1. ALL PARTITIONS ARE EXISTING TO REMAIN.
2. NO CHANGE TO EGRESS.
3. ENTIRE EXISTING BUILDING IS SPRINKLERED PER NFPA 13.

RECEIVED
JUL 18 2022
LICENSES & PERMITS DIVISION

1	6/22/22	ADD SINKS TO MEETING RM

REVISIONS

Owner:
Lexi Young
Your Journey Daycare
address
Phone:

Construction Manager:

Structural Engineer:

Mechanical/Electrical/Plumbing Engineer:

Civil Engineer:

Your Journey Daycare
at
St. Andrews Episcopal Church
2892 Roxbury Mills Rd.
Glenwood, Maryland 21738

MORGAN DESIGN GROUP
Architecture
Interior Design
Landscape Design
2775 Green Leaf Ct.
Suite B
Westminster, Maryland 21157
Phone: 410-356-0122
Fax: 443-926-9964
www.mdgarch.com

ISSUED FOR:
- ☐ PRELIMINARY/PROGRESS (NOT FOR CONST.)
- ☐ PRICING ONLY
- ■ PERMIT
- ☐ CONSTRUCTION DOCUMENTS

SEAL

ARCHITECTURAL REGISTRATION BOARD 7573-R JEFFREY BENSON MORGAN STATE OF MARYLAND

"I certify that these documents were prepared or approved by me, and that I am duly licensed architect under the laws of the State of Maryland, license number 7573-R, Expiration date April 5, 2023"

© COPYRIGHT 2022, MORGAN DESIGN GROUP

DESIGN	JBM
DRAWN	STAFF
APPROVED	
SCALE	AS SHOWN
DATE	MARCH 28, 2022
CAD FILE	
PROJECT NO.	

DRAWING TITLE

FLOOR PLAN

A-1

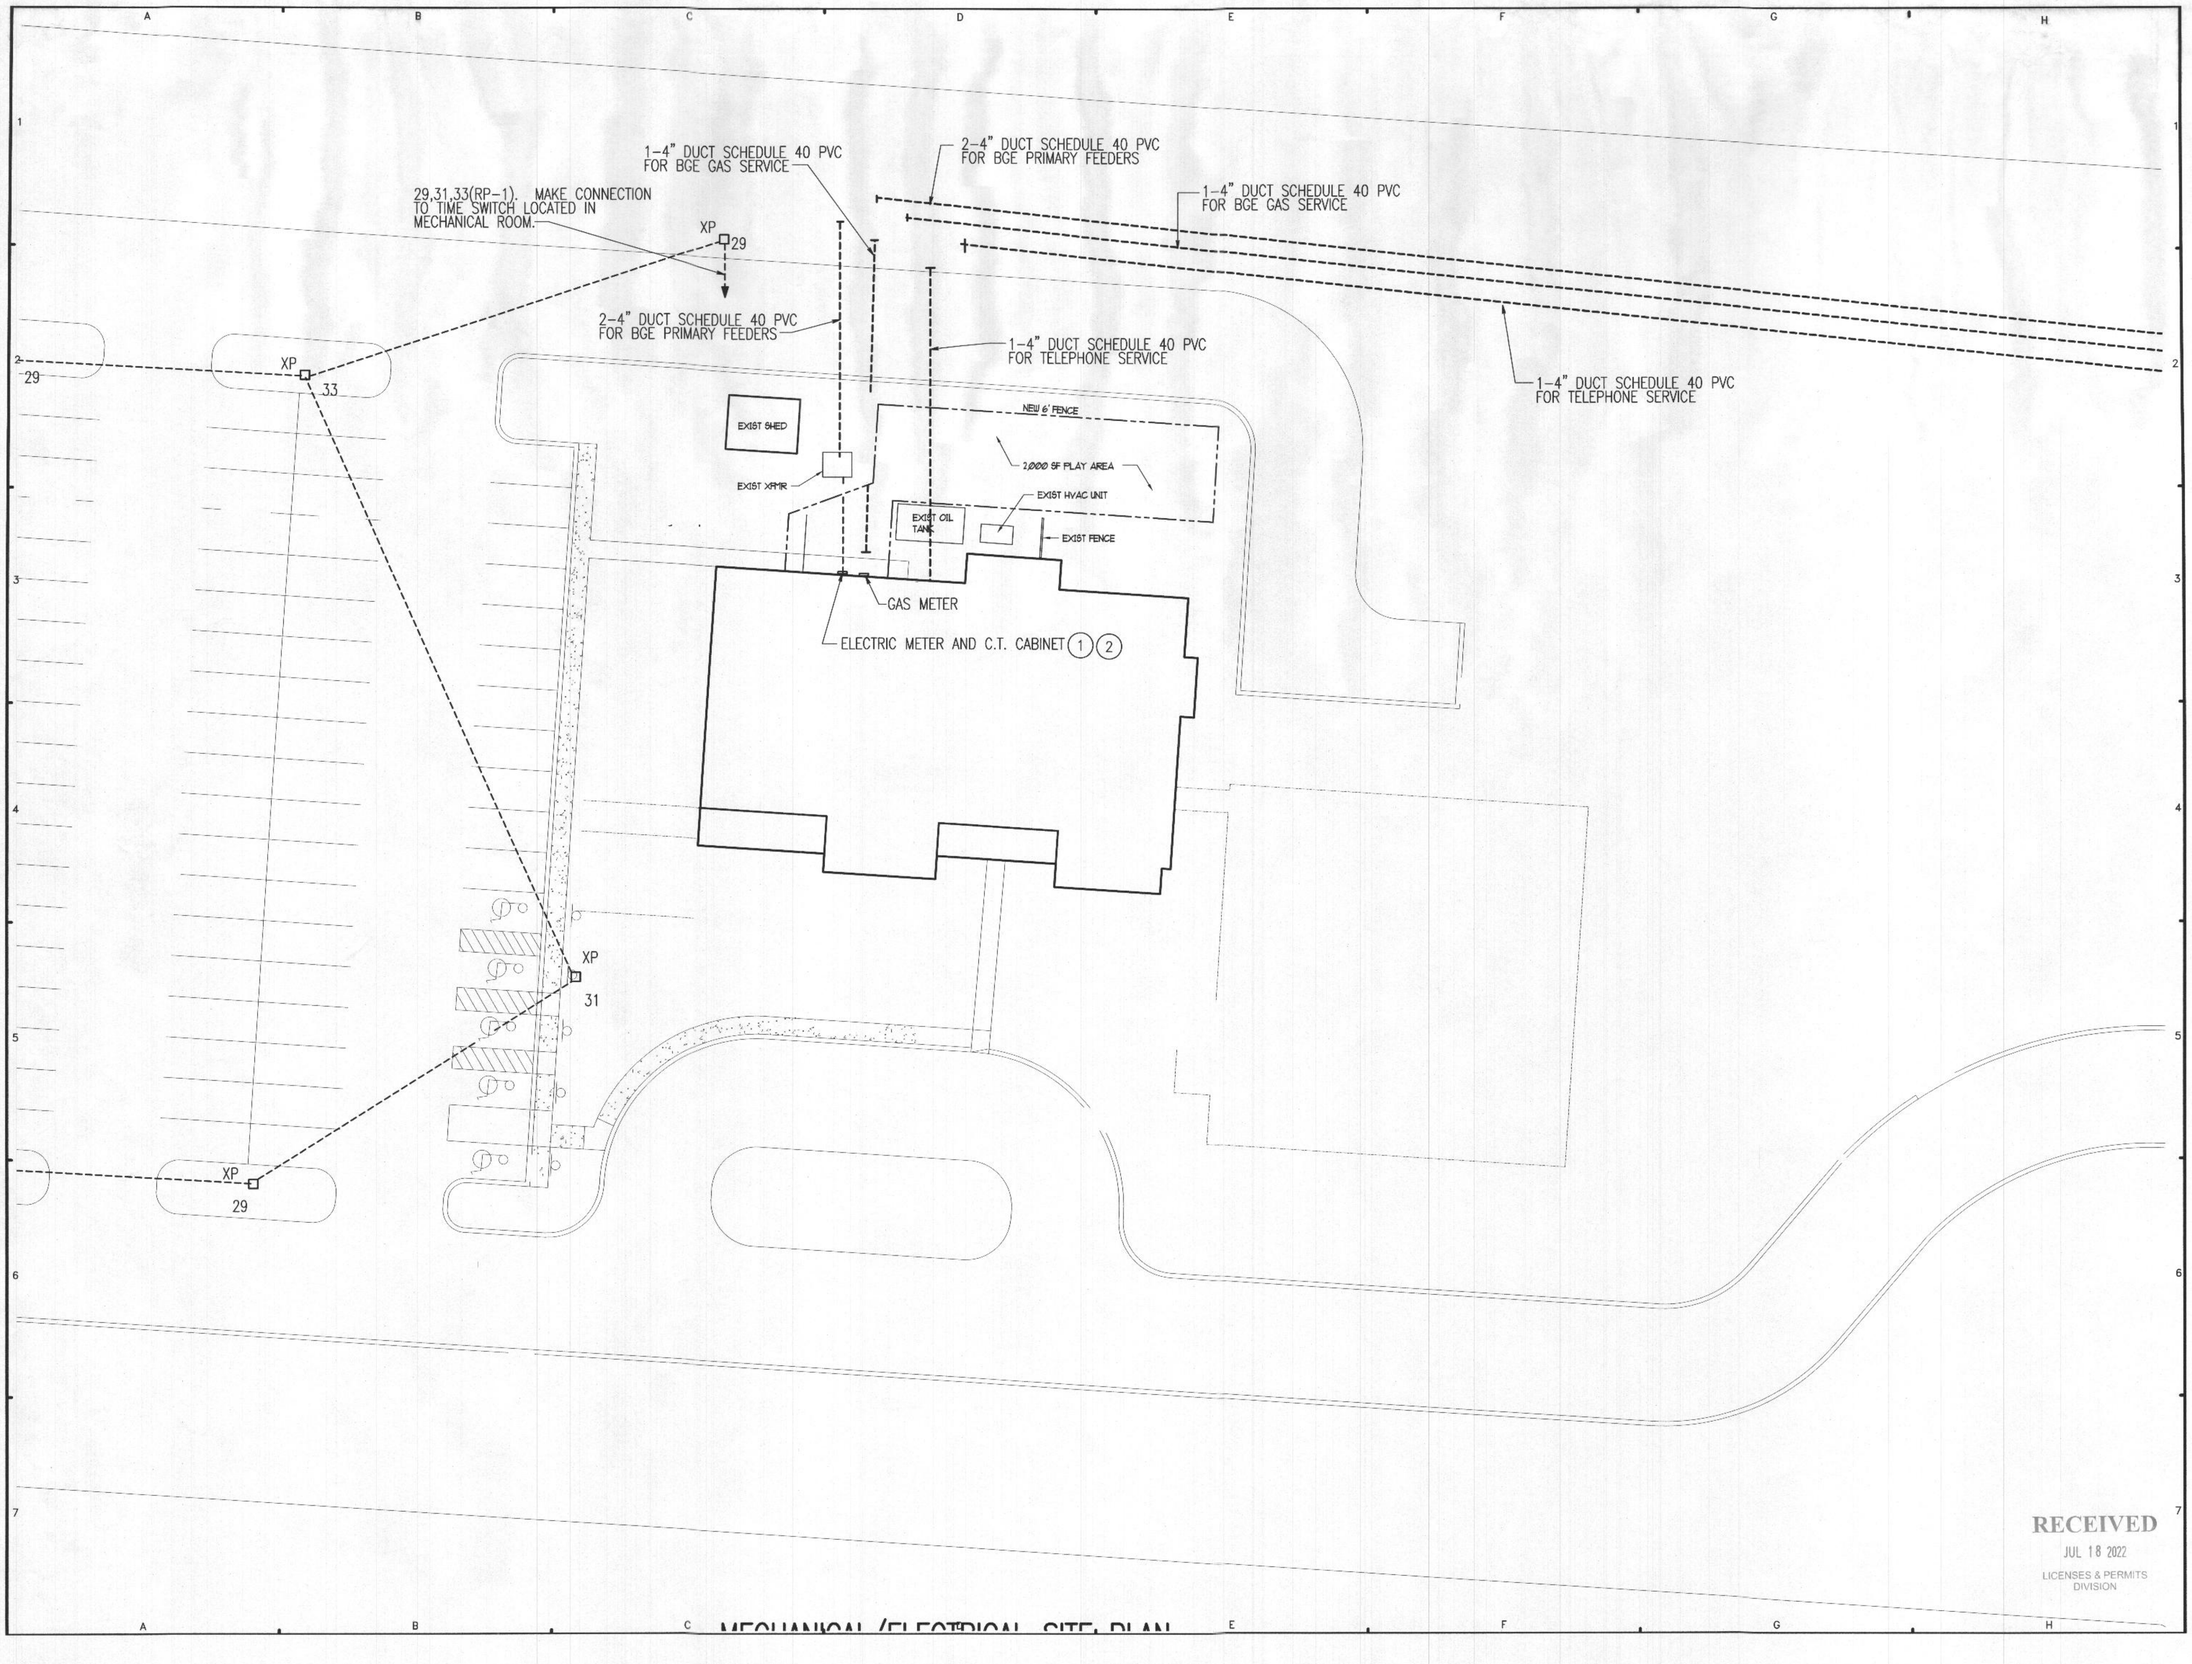

RECEIVED
JUL 18 2022
LICENSES & PERMITS DIVISION

MECHANICAL/ELECTRICAL SITE PLAN

REVISIONS

Owner:
Lexi Young
Your Journey Daycare
address
Phone:

Construction Manager:

Structural Engineer:

Mechanical/Electrical/Plumbing Engineer:

Civil Engineer:

Your Journey Daycare at St. Andrews Episcopal Church 2892 Roxbury Mills Rd. Glenwood, Maryland 21738

MORGAN DESIGN GROUP
Architecture
Interior Design
Landscape Design
2775 Green Leaf Ct.
Suite B
Westminster, Maryland 21157
Phone: 410-356-0122
Fax: 443-926-9964
www.mdgarch.com

ISSUED FOR:
- ☐ PRELIMINARY/PROGRESS (NOT FOR CONST.)
- ☐ PRICING ONLY
- ■ PERMIT
- ☐ CONSTRUCTION DOCUMENTS

SEAL

ARCHITECTURAL REGISTRATION BOARD
7573-R
JEFFREY BENSON MORGAN
STATE OF MARYLAND

"I certify that these documents were prepared or approved by me, and that I am duly licensed architect under the laws of the State of Maryland, license number 7573-R, Expiration date April 5, 2023"

© COPYRIGHT 2022, MORGAN DESIGN GROUP

DESIGN	JBM
DRAWN	STAFF
APPROVED	
SCALE	AS SHOWN
DATE	MARCH 28, 2022
CAD FILE	
PROJECT NO.	

DRAWING TITLE

SITE PLAN

SD-1

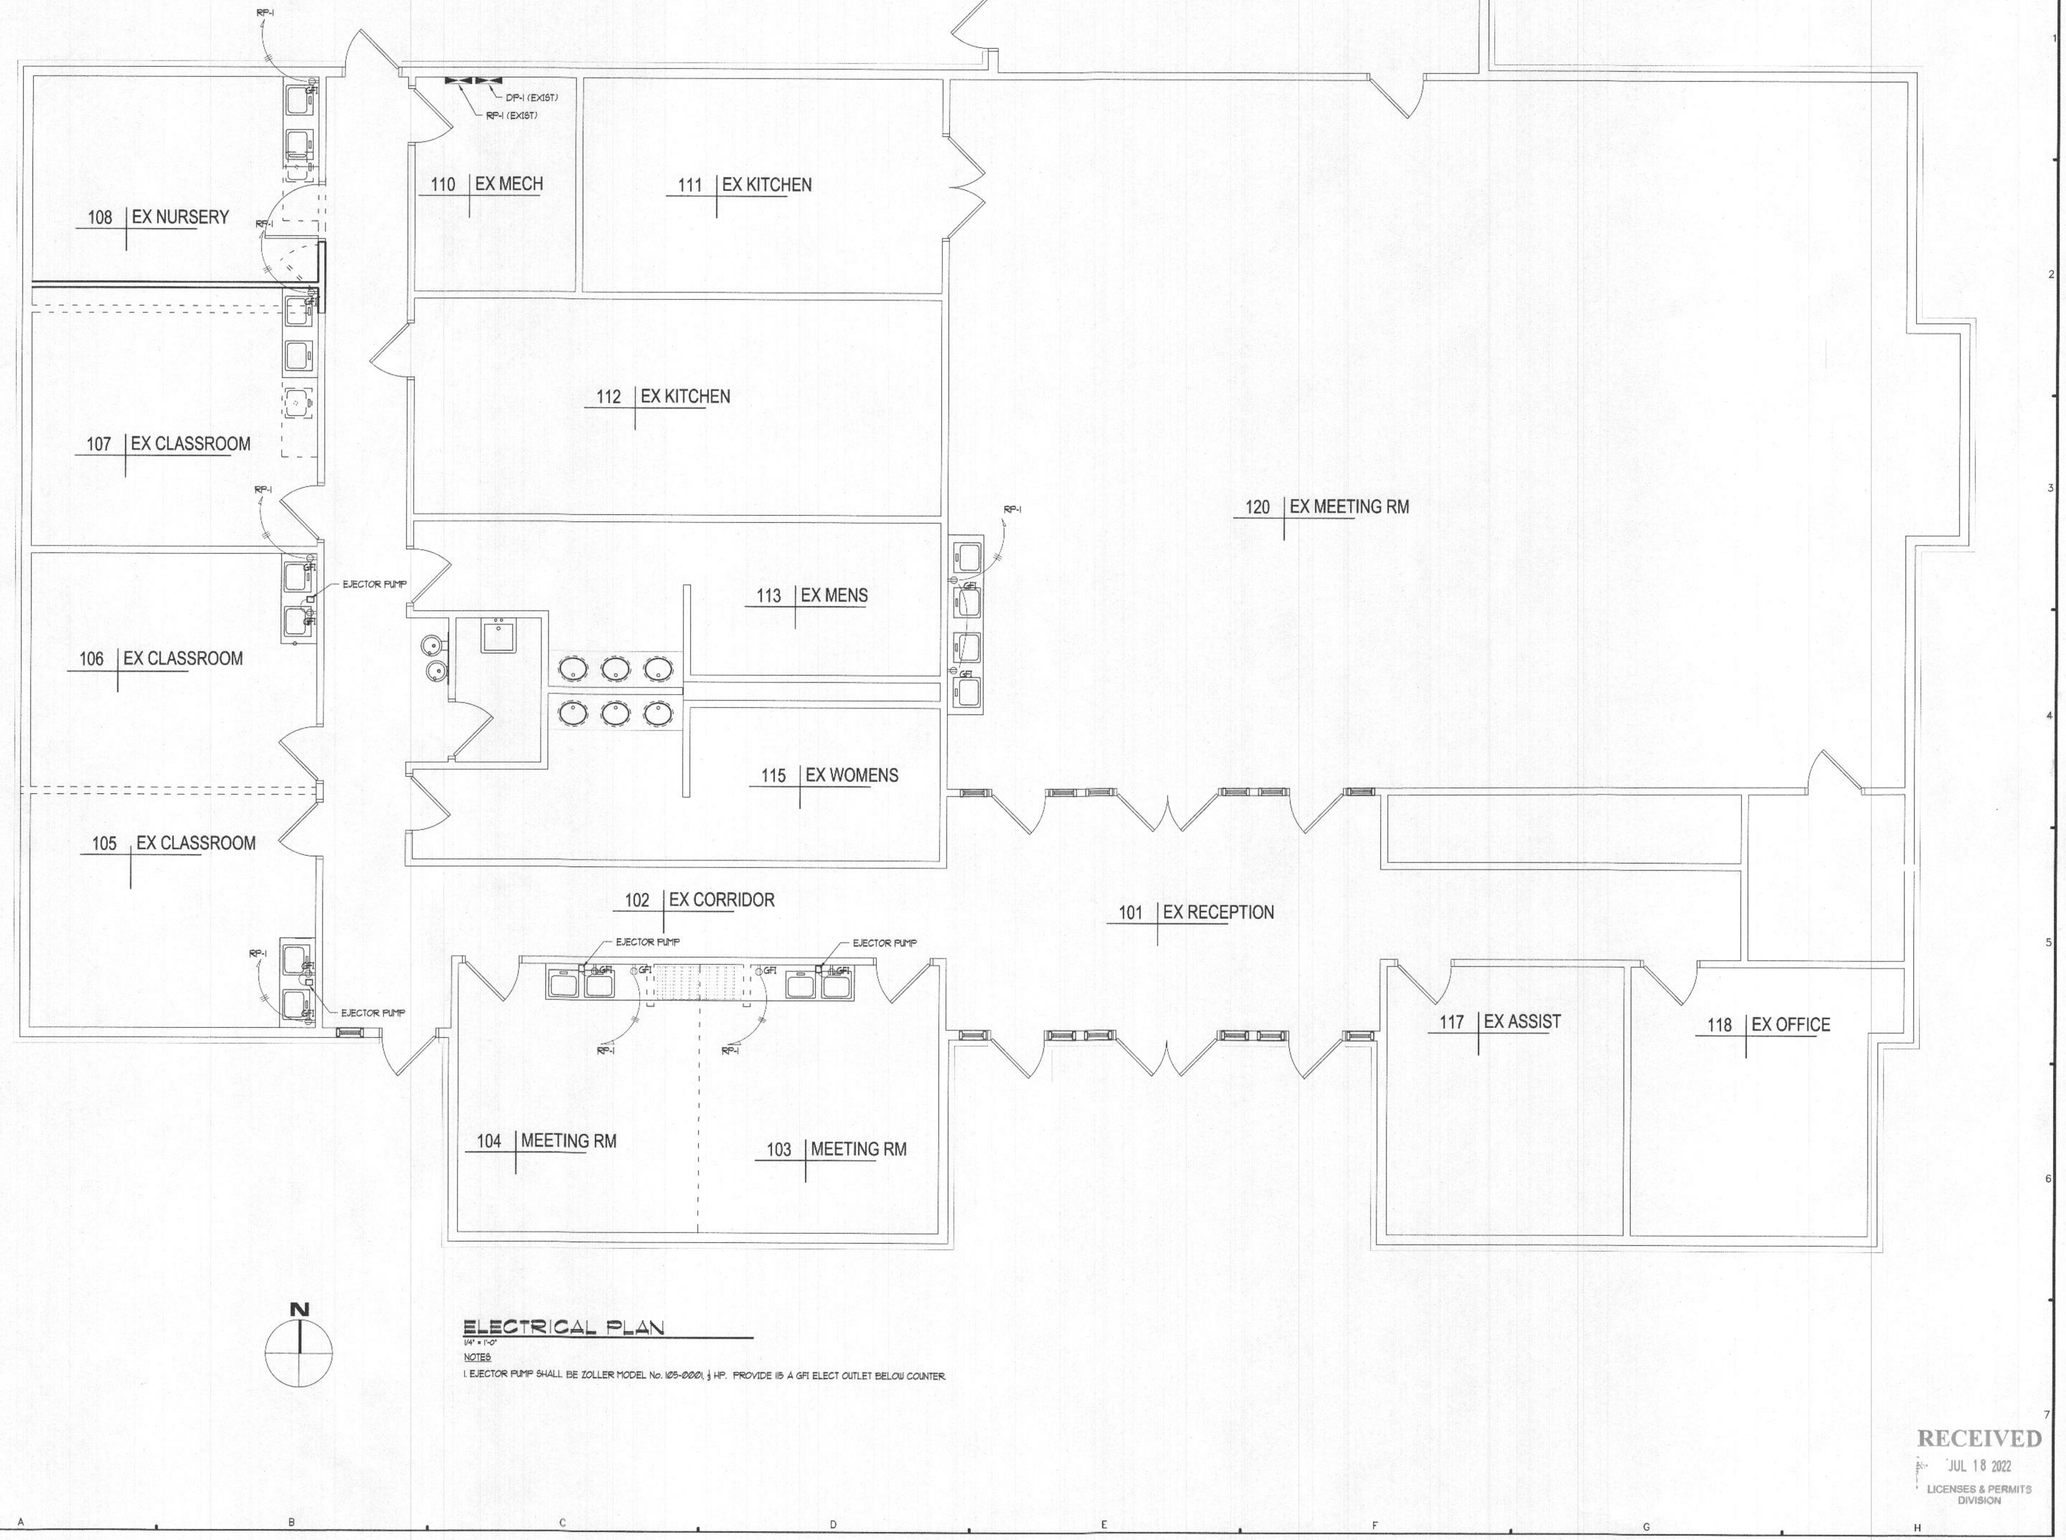

ELECTRICAL PLAN

1/4" = 1'-0"

NOTES

1. EJECTOR PUMP SHALL BE ZOLLER MODEL No. 105-0001, ½ HP. PROVIDE 115 A GFI ELECT OUTLET BELOW COUNTER.

RECEIVED
JUL 18 2022
LICENSES & PERMITS DIVISION

1	6/22/22	ENTIRE SHEET

REVISIONS

Owner:
Lexi Young
Your Journey Daycare
address
Phone:

Construction Manager:

Structural Engineer:

Mechanical/Electrical/Plumbing Engineer:

Civil Engineer:

Your Journey Daycare
at
St. Andrews Episcopal Church
2892 Roxbury Mills Rd.
Glenwood, Maryland 21738

MORGAN DESIGN GROUP
Architecture
Interior Design
Landscape Design
2775 Green Leaf Ct.
Suite B
Westminster, Maryland 21157
Phone: 410-356-0122
Fax: 443-926-9964
www.mdgarch.com

ISSUED FOR:
- ☐ PRELIMINARY/PROGRESS (NOT FOR CONST.)
- ☐ PRICING ONLY
- ■ PERMIT
- ☐ CONSTRUCTION DOCUMENTS

SEAL

O'Grady Companies, Inc.
301 E Patrick Street,
Suite 200
Frederick, MD 21701

"I certify that these documents were prepared or approved by me, and that I am duly licensed architect under the laws of the State of Maryland, license number 7573-R, Expiration date April 5, 2023"

© COPYRIGHT 2022, MORGAN DESIGN GROUP

DESIGN	JBM
DRAWN	STAFF
APPROVED	
SCALE	AS SHOWN
DATE	MARCH 28, 2022
CAD FILE	
PROJECT NO.	

DRAWING TITLE

ELECTRICAL PLAN

E-1

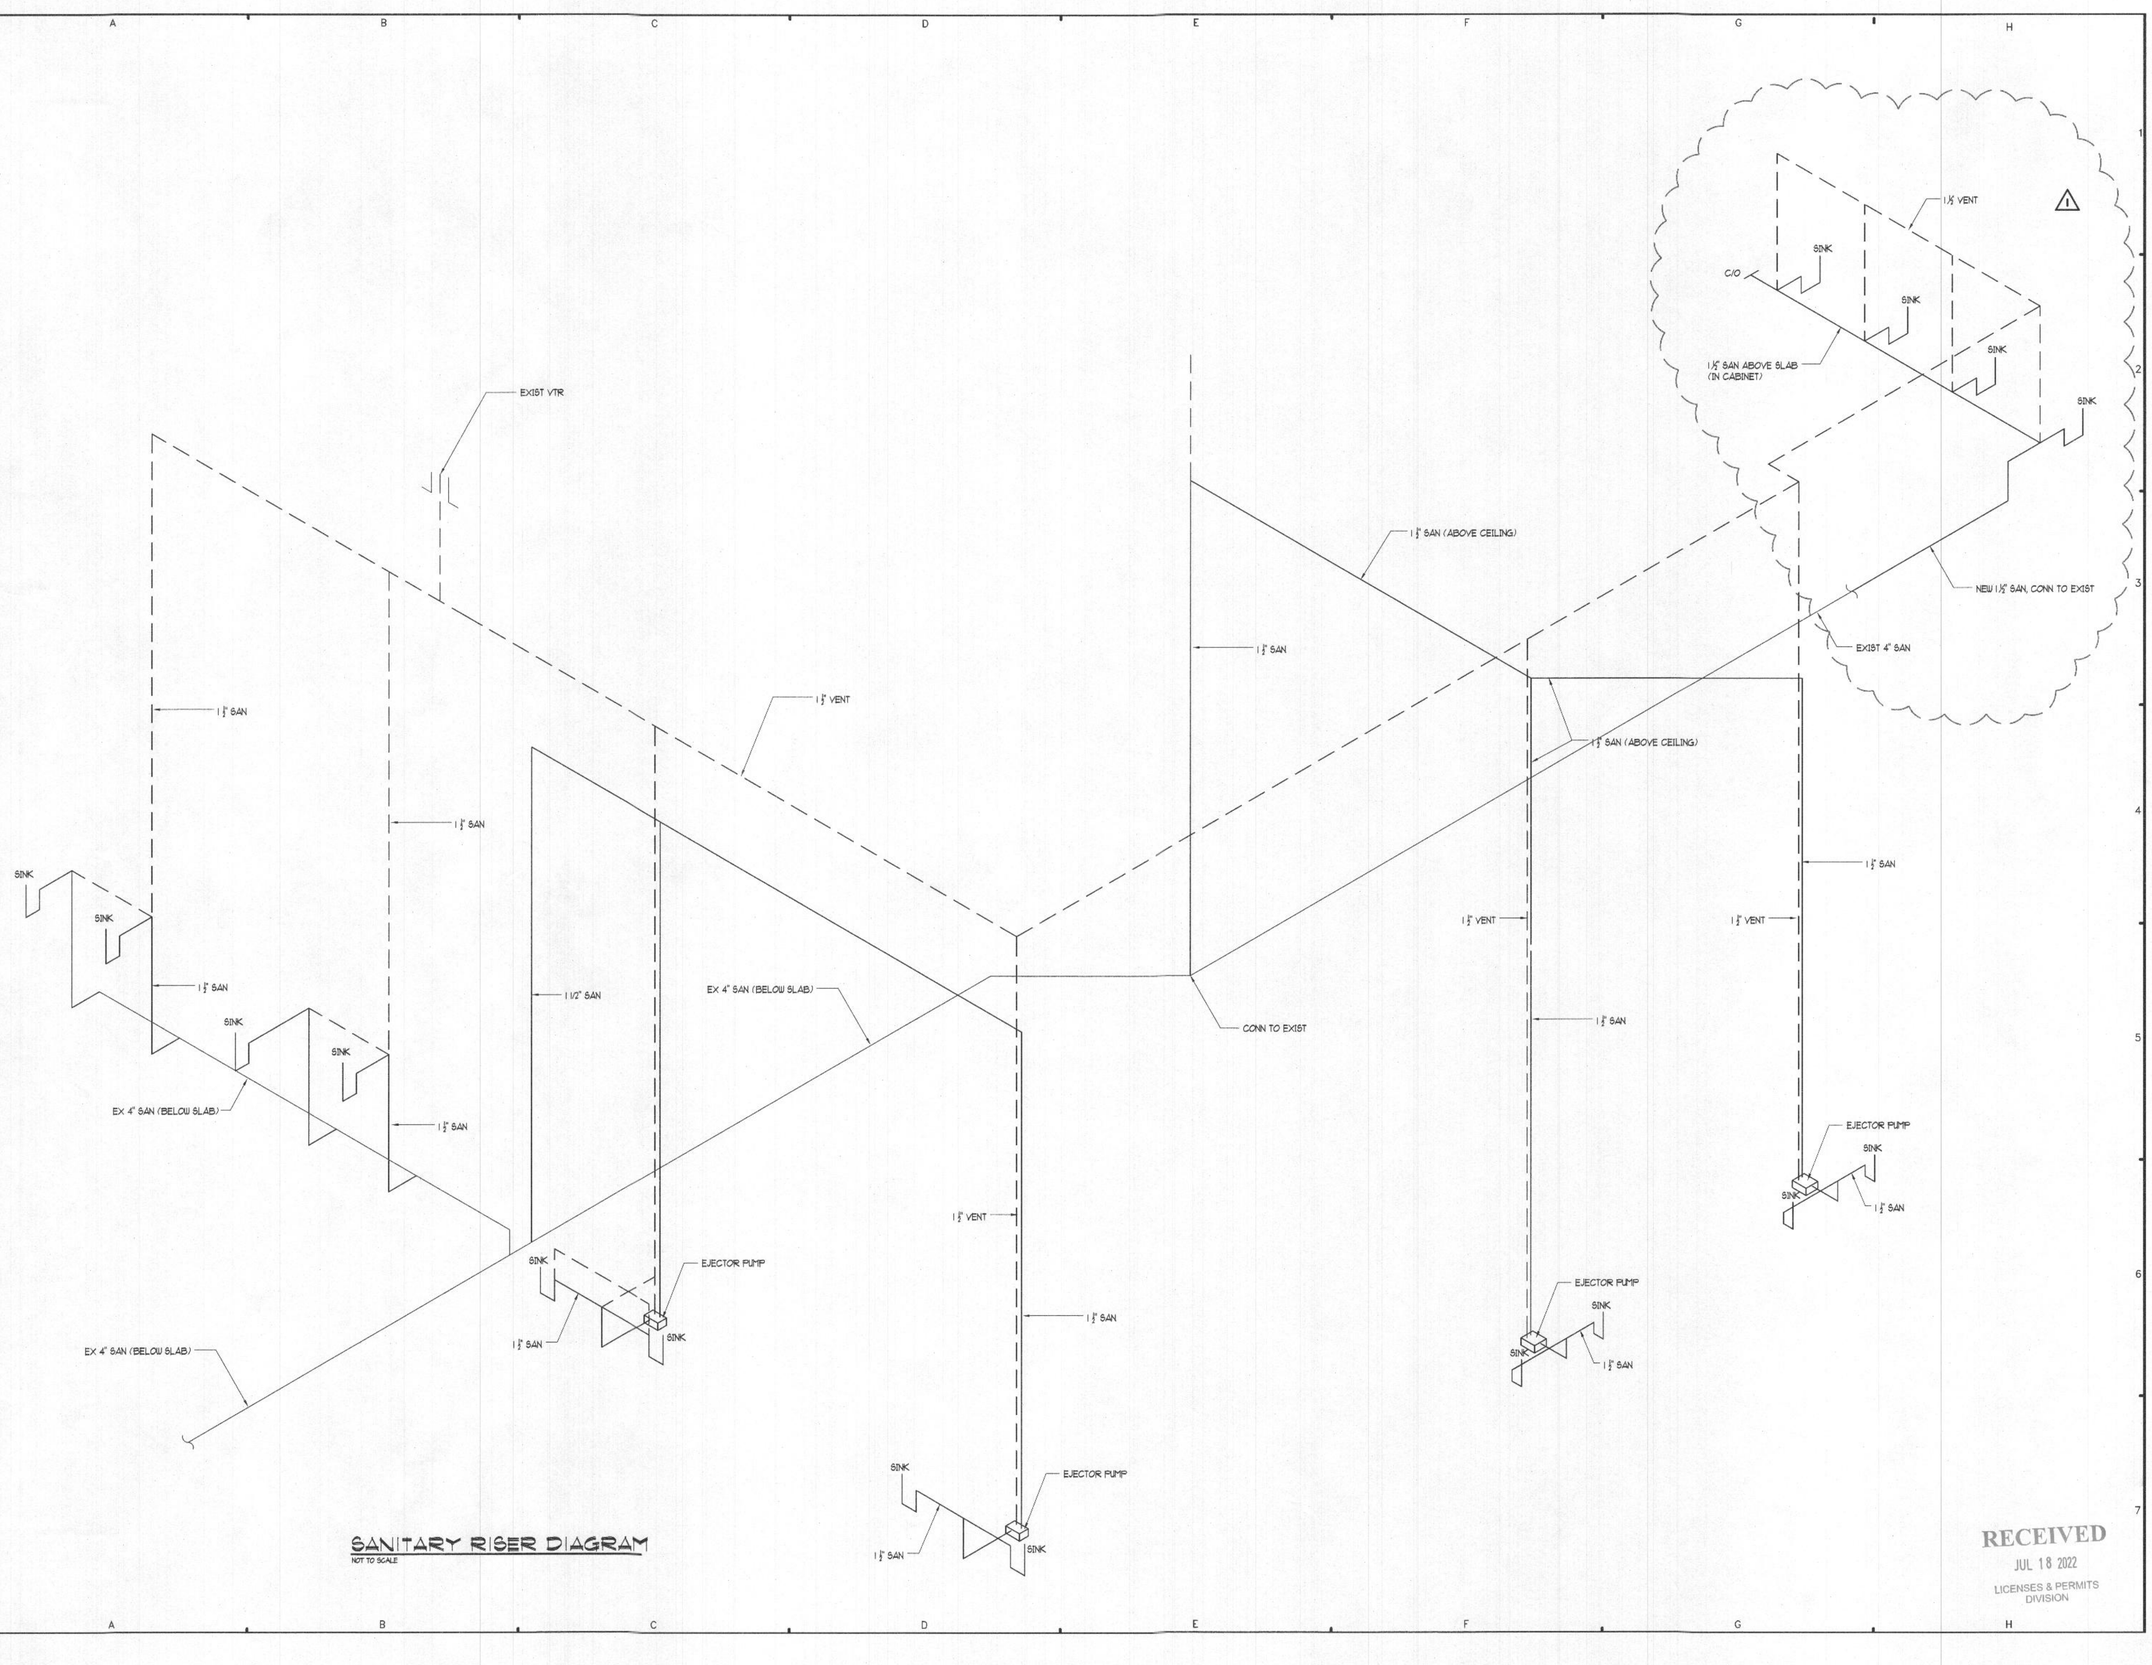

SANITARY RISER DIAGRAM

NOT TO SCALE

RECEIVED
JUL 18 2022
LICENSES & PERMITS DIVISION

1	6/22/22	ADD SINKS TO MEETING RM

REVISIONS

Owner:
Lexi Young
Your Journey Daycare
address
Phone:

Construction Manager:

Structural Engineer:

Mechanical/Electrical/Plumbing Engineer:

Civil Engineer:

Your Journey Daycare
at
St. Andrews Episcopal Church
2892 Roxbury Mills Rd.
Glenwood, Maryland 21738

MORGAN DESIGN GROUP
Architecture
Interior Design
Landscape Design
2775 Green Leaf Ct.
Suite B
Westminster, Maryland 21157
Phone: 410-356-0122
Fax: 443-926-9964
www.mdgarch.com

ISSUED FOR:
- ☐ PRELIMINARY/PROGRESS (NOT FOR CONST.)
- ☐ PRICING ONLY
- ■ PERMIT
- ☐ CONSTRUCTION DOCUMENTS

SEAL

Scott Misho
6-28-22

"I certify that these documents were prepared or approved by me, and that I am duly licensed architect under the laws of the State of Maryland, license number 7573-R, Expiration date April 5, 2023"

© COPYRIGHT 2022, MORGAN DESIGN GROUP

DESIGN	JBM
DRAWN	STAFF
APPROVED	
SCALE	AS SHOWN
DATE	MARCH 28, 2022
CAD FILE	
PROJECT NO.	

DRAWING TITLE

RISER DIAGRAM

P-2

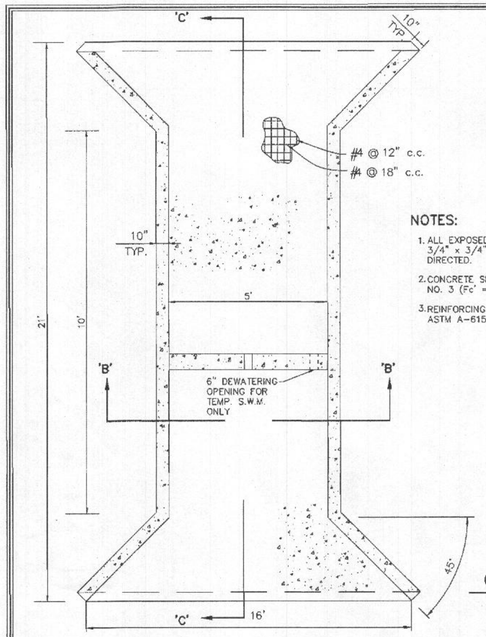

PLAN

NOT TO SCALE

NOTES:

1. ALL EXPOSED EDGES TO HAVE 3/4" x 3/4" CHAMFER OR AS DIRECTED.
2. CONCRETE SHALL BE SHA MIX NO. 3 (f'c = 3500 PSI @ 28 DAYS)
3. REINFORCING STEEL SHALL BE ASTM A-615 GRADE 60.

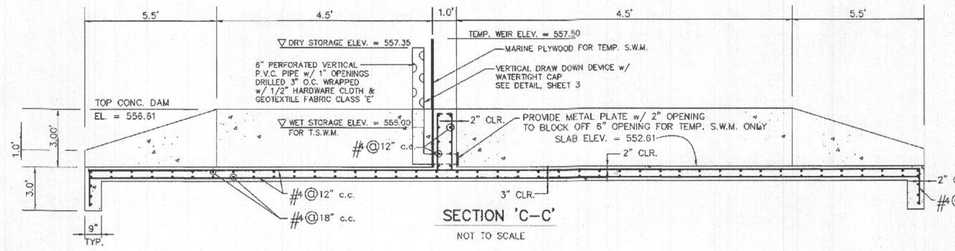

SECTION 'C-C'

NOT TO SCALE

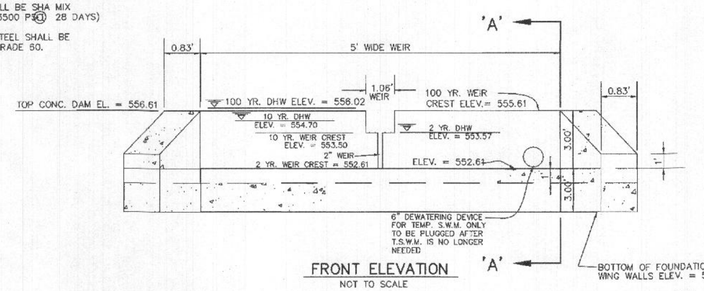

FRONT ELEVATION

NOT TO SCALE

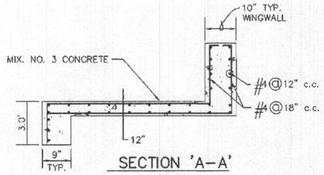

SECTION 'A-A'

NOT TO SCALE

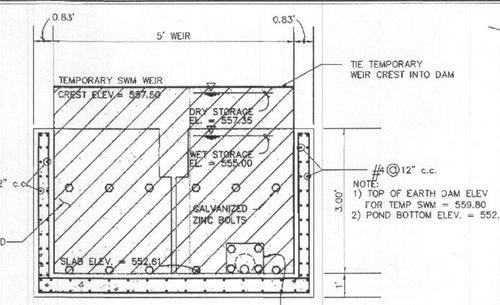

TEMPORARY S.W.M. WEIR DETAIL

SCALE: 1" = 3'

DENOTES PROPOSED MARINE PLYWOOD TO BE BOLTED INTO CONCRETE WALL FOR TEMPORARY STORMWATER MANAGEMENT

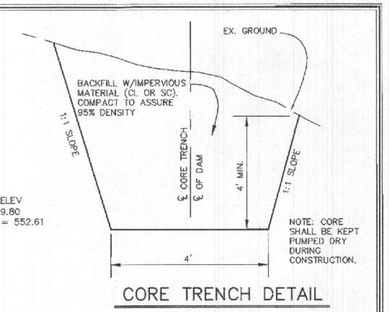

NOTE: CORE SHALL BE KEPT PUMPED DRY DURING CONSTRUCTION.

CORE TRENCH DETAIL

NOT TO SCALE

CONCRETE RELEASE DETAILS FOR PRIVATE S.W.M. FACILITY

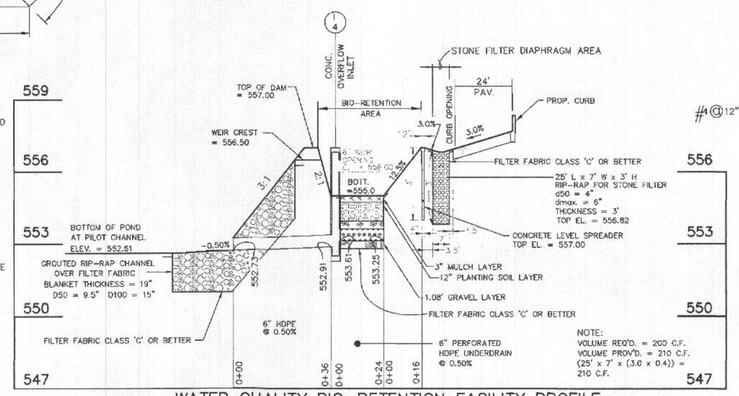

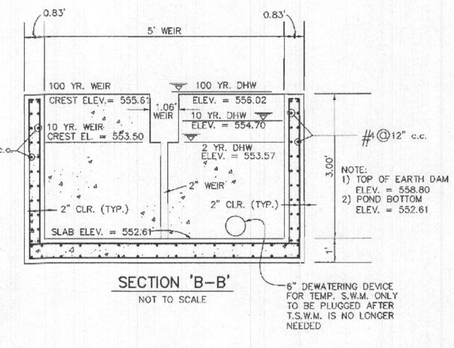

SECTION 'B-B'

NOT TO SCALE

6" DEWATERING DEVICE FOR TEMP. S.W.M. ONLY TO BE PLUGGED AFTER T.S.W.M. IS NO LONGER NEEDED

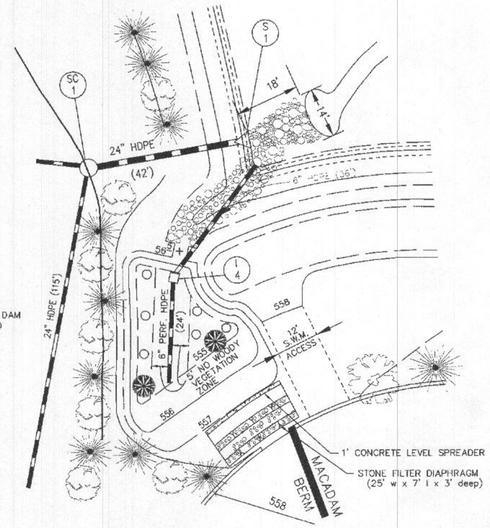

BIO-RETENTION AREA ENLARGEMENT

SCALE: 1" = 20'

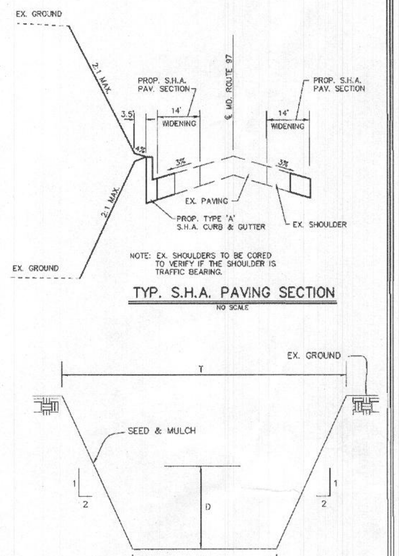

NOTE: EX. SHOULDERS TO BE CORED TO VERIFY IF THE SHOULDER IS TRAFFIC BEARING.

TYP. S.H.A. PAVING SECTION

NO SCALE

TRAPEZOIDAL CHANNEL DETAIL

NO SCALE

STATION	Q10 C.F.S.	n	DEPTH (D)	SLOPE	AREA (A)	WETTED PERIMETER (WP)	HYDRAULIC RADIUS (R)	TOP WIDTH (T)	V F.P.S.
2+00	2.20	0.04	0.28'	2.0%	1.2768	5.2522	0.2431	5.12'	2.04
4+18.20	7.80	0.04	0.44'	2.0%	2.4172	5.9677	0.4050	5.76'	2.86
4+43.63 EX. 18" PIPE	7.80	0.04	0.44'	2.0%	2.4172	5.9677	0.4050	5.76'	2.86

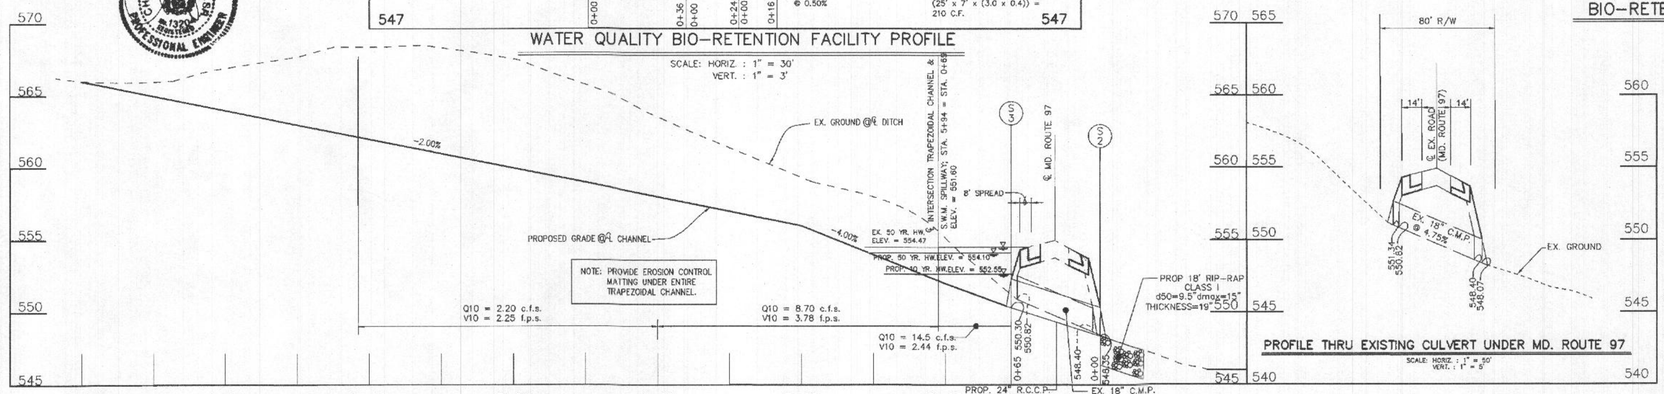

TRAPEZOIDAL CHANNEL PROFILE

SCALE: HORIZ. : 1" = 50'
VERT. : 1" = 5'

PROFILE THRU EXISTING CULVERT UNDER MD. ROUTE 97

SCALE: HORIZ. : 1" = 50'
VERT. : 1" = 5'

BIO-RETENTION PLANT LIST

QTY.	KEY	DESCRIPTION	NAME
2	✱	TREE	RED MAPLE ACER RUBRUM
6	○	SHRUB	BUTTONBUSH, COMMON CEPHALANTHUS OCCIDENTALIS

PLANTING AREA = 6a
HYDROLOGIC ZONE = ZONE 1

OPERATION AND MAINTENANCE SCHEDULE FOR BIO-RETENTION AREA (F-6)

1. ANNUAL MAINTENANCE OF PLANT MATERIAL, MULCH LAYER AND SOIL LAYER IS REQUIRED. MAINTENANCE OF MULCH AND SOIL IS LIMITED TO CORRECTING AREAS OF EROSION OR WASH OUT. ANY MULCH REPLACEMENT SHALL BE DONE IN THE SPRING. PLANT MATERIAL SHALL BE CHECKED FOR DISEASE AND INSECT INFESTATION AND MAINTENANCE WILL ADDRESS DEAD MATERIAL AND PRUNNING.
2. SCHEDULE OF PLANT INSPECTION WILL BE TWICE A YEAR IN SPRING AND FALL. THIS INSPECTION WILL INCLUDE REMOVAL OF DEAD VEGETATION CONSIDERED BEYOND TREATMENT, TREATMENT OF ALL DISEASED TREES AND SHRUBS AND REPLACEMENT OF ALL DEFICIENT STAKES AND WIRES.
3. MULCH SHALL BE INSPECTED EACH SPRING. REMOVE PREVIOUS MULCH LAYER BEFORE APPLYING NEW LAYER ONCE EVERY 2 TO 3 YEARS.
4. SOIL EROSION TO BE ADDRESSED ON AN AS NEEDED BASIS, WITH A MINIMUM OF ONCE PER MONTH AND AFTER HEAVY STORM EVENTS.

OPERATION AND MAINTENANCE SPECIFICATIONS

I HEREBY CERTIFY THAT I WILL OPERATE AND MAINTAIN THE COMPLETED POND IN ACCORDANCE WITH THE FOLLOWING:

1. PERIODIC INSPECTIONS OF THE FACILITY WILL BE MADE TO IDENTIFY POTENTIAL PROBLEMS THAT MAY AFFECT ITS SAFETY. THESE INSPECTIONS WILL BE MADE AFTER PERIODS OF HEAVY RAINFALL AND AT LEAST TWICE ANNUALLY. INSPECTION REPORTS SHALL BE KEPT UNTIL THE NEXT SUBSEQUENT INSPECTION. INSPECTION ITEMS TO BE LOOKED AT INCLUDE:
   A.) SPILLWAY AND OUTLET WORKS;
   B.) RIP-RAP;
   C.) VEGETATIVE COVER;
   D.) CRACKS IN THE FILL;
   E.) SLOPE FAILURES; AND
   F.) SEEPAGE AND OTHER SIGNS OF DISTRESS.
2. PROBLEMS IDENTIFIED DURING INSPECTIONS WILL BE PROMPTLY CORRECTED. MAJOR PROBLEMS WILL BE BROUGHT TO THE ATTENTION OF THE SOIL CONSERVATION DISTRICT AND THE DAM SAFETY DIVISION OF THE MARYLAND WATER RESOURCES ADMINISTRATION. AS A VERY MINIMUM, GRASSY VEGETATION WILL BE MAINTAINED IN A DENSE AND HEALTHY STATE, AND WOODY VEGETATION WILL NOT BE PERMITTED TO GROW ON THE EMBANKMENT.

OPERATION MAINTENANCE AND INSPECTION

INSPECTION OF POND(S) SHOWN HEREON SHALL BE PERFORMED AT LEAST ANNUALLY, IN ACCORDANCE WITH THE CHECKLIST AND REQUIREMENTS CONTAINED WITHIN USDA, SCS "STANDARDS AND SPECIFICATIONS FOR PONDS" (MD-378). THE POND OWNER(S) AND ANY HEIRS, SUCCESSORS, OR ASSIGNS SHALL BE RESPONSIBLE FOR THE SAFETY OF THE POND AND THE CONTINUED OPERATION, SURVEILLANCE, INSPECTION, AND MAINTENANCE, THEREOF. THE POND OWNER(S) SHALL PROMPTLY NOTIFY THE SOIL CONSERVATION DISTRICT OF ANY UNUSUAL OBSERVATIONS THAT MAY BE INDICATIONS OF DISTRESS SUCH AS EXCESSIVE SEEPAGE, TURBID SEEPAGE, SLIDING OR SLUMPING.

AS-BUILT CERTIFICATION

I HEREBY CERTIFY THAT THE FACILITY SHOWN ON THIS PLAN WAS CONSTRUCTED AS SHOWN ON THE "AS-BUILT" PLANS AND MEETS THE APPROVED PLANS AND SPECIFICATIONS.

SIGNATURE _____ PE NO. _____ DATE _____

CERTIFY MEANS TO STATE OR DECLARE A PROFESSIONAL OPINION BASED UPON ONSITE INSPECTIONS AND MATERIAL TESTS WHICH ARE CONDUCTED DURING CONSTRUCTION. THE ONSITE INSPECTIONS AND MATERIAL TESTS ARE THOSE INSPECTIONS AND TESTS DEEMED SUFFICIENT AND APPROPRIATE BY COMMONLY ACCEPTED ENGINEERING STANDARDS. CERTIFY DOES NOT MEAN OR IMPLY A GUARANTEE BY THE ENGINEER NOR DOES AN ENGINEER'S CERTIFICATION RELIEVE ANY OTHER, PARTY FROM MEETING REQUIREMENTS IMPOSED BY CONTRACT, EMPLOYMENT, OR OTHER MEANS, INCLUDING MEETING COMMONLY ACCEPTED INDUSTRY PRACTICES.

STATE OF MARYLAND — CHARLES JACKSON X — 13781 — PROFESSIONAL ENGINEER

FISHER, COLLINS & CARTER, INC.
CIVIL ENGINEERING CONSULTANTS & LAND SURVEYORS
CENTENNIAL SQUARE OFFICE PARK - 10272 BALTIMORE NATIONAL PIKE
ELLICOTT CITY, MARYLAND 21042
(410) 461 - 2855

REVISION

DATE	DESCRIPTION

ENGINEER'S CERTIFICATE

"I certify that this plan for erosion and sediment control represents a practical and workable plan based on my personal knowledge of the site conditions and that it was prepared in accordance with the requirements of the Howard Soil Conservation District."

Signature of Engineer (Print name below signature) — Date 8/9/01

DEVELOPER'S CERTIFICATE

"I/We certify that all development and construction will be done according to this plan, and that any responsible personnel involved in the construction project will have a Certificate of Attendance at a Department of the Environment Approved Training Program for the Control of Sediment and Erosion before beginning the project. I also authorize periodic on-site inspection by the Howard Soil Conservation District."

Signature of Developer (Print name below signature) — Date 8/9/01

Reviewed for HOWARD SCD and meets Technical Requirements.

U.S.D.A.-Natural Resources Conservation Service — Date 9/6/01

This development plan is approved for soil erosion and sediment control by the HOWARD SOIL CONSERVATION DISTRICT.

Howard SCD — Date 9/6/01

OWNER

ST. ANDREWS EPISCOPAL CHURCH
RTE. 97 & UNION CHAPEL ROAD
P.O. BOX 52
GLENWOOD, MARYLAND 21738
(410) 489-4036

APPROVED: DEPARTMENT OF PLANNING AND ZONING

Chief, Division of Land Development — Date 10/9/a

Chief, Development Engineering Division [MA] — Date 9/7/01

Director, Department of Planning and Zoning — Date 10/22/01

PROJECT	SECTION/AREA	LOT NO.
ST. ANDREWS EPISCOPAL CHURCH "WOODSIDE ESTATES"	N/A	1

PLAT REF.	BLOCK NO.	ZONE	TAX	ELEC. DIST.	CENSUS TR.
14893	16	RC-DEO	14	4TH	6040

WATER CODE	SEWER CODE
PRIVATE	PRIVATE

STORMWATER MANAGEMENT DETAIL SHEET

ST. ANDREWS EPISCOPAL CHURCH

WOODSIDE ESTATES
LOT 1

TAX MAP No: 14 PARCEL No: 216
4TH ELECTION DISTRICT, HOWARD COUNTY, MARYLAND
SCALE: AS SHOWN DATE: AUGUST 8, 2001
SHEET 4 OF 8

SDP 01-34