

C1 55787 SEQUENCE NO. (MDE USE ONLY)

STATE OF MARYLAND WELL COMPLETION REPORT FILL IN THIS FORM COMPLETELY PLEASE TYPE

THIS REPORT MUST BE SUBMITTED WITHIN 45 DAYS AFTER WELL IS COMPLETED.

COUNTY NUMBER XIII

ST/CO USE ONLY DATE RECEIVED MM DD YY 09/03/09

DATE WELL COMPLETED MM DD YY 07 15 2019 APPROVED 9/23/09 22 503 (TO NEAREST FOOT)

PERMIT NO. FROM "PERMIT TO DRILL WELL" HO-18-0048

OWNER ELM STREET DEVELOPMENT WELL SITE ADDRESS last name first name TOWN DAYTON SUBDIVISION STARBUCK DENAVIT SECTION LOT 25

WELL LOG Table with columns: DESCRIPTION, FEET (FROM, TO), check if water bearing. Includes entries like TOP SOIL, TAN MICACEOUS GROUND, etc.

GROUTING RECORD yes no Y N 44 44. WELL HAS BEEN GROUTED (Circle Appropriate Box). TYPE OF GROUTING MATERIAL (Circle one) CEMENT CM BENTONITE CLAY BC. NO. OF BAGS 8 NO. OF POUNDS 400. GALLONS OF WATER 160. DEPTH OF GROUT SEAL (to nearest foot) from 0 ft. to 58 ft.

CASING RECORD casing types insert appropriate code below. MAIN CASING TYPE PL 6 60. Nominal diameter top (main) casing (nearest inch)! Total depth of main casing (nearest foot).

OTHER CASING (if used) diameter inch depth (feet) from to.

SCREEN RECORD screen type or open hole insert appropriate code below. ST BR HO STEEL BRASS OPEN HOLE. PL OT PLASTIC OTHER.

NUMBER OF UNSUCCESSFUL WELLS: 0. WELL HYDROFRACTURED Y N.

CIRCLE APPROPRIATE LETTER A A WELL WAS ABANDONED AND SEALED WHEN THIS WELL WAS COMPLETED. E ELECTRIC LOG OBTAINED. P TEST WELL CONVERTED TO PRODUCTION WELL.

I HEREBY CERTIFY THAT THIS WELL HAS BEEN CONSTRUCTED IN ACCORDANCE WITH COMAR 26.04.04 "WELL CONSTRUCTION" AND IN CONFORMANCE WITH ALL CONDITIONS STATED IN THE ABOVE CAPTIONED PERMIT, AND THAT THE INFORMATION PRESENTED HEREIN IS ACCURATE AND COMPLETE TO THE BEST OF MY KNOWLEDGE.

DRILLERS LIC. NO. 1 MWD 5761. DRILLERS SIGNATURE (MUST MATCH SIGNATURE ON APPLICATION). LIC. NO. 1 MWD 5941. DRILLER

SITE SUPERVISOR (sign. of driller or journeyman responsible for sitework if different from permittee)

DEPTH (nearest ft.) 58 503. A C A S I N G. SLOT SIZE 1 2 3. DIAMETER OF SCREEN 6 (NEAREST INCH) from to.

GRAVEL PACK IF WELL DRILLED WAS FLOWING WELL INSERT F IN BOX 68.

MDE USE ONLY (NOT TO BE FILLED IN BY DRILLER) T (E.R.O.S.) W Q. TELESCOPE CASING LOG INDICATOR OTHER DATA.

PUMPING TEST 5 HOURS. HOURS PUMPED (nearest hour) 8 9. PUMPING RATE (gal. per min.) 7.5. METHOD USED TO MEASURE PUMPING RATE WATCH & BUCKET. WATER LEVEL (distance from land surface) BEFORE PUMPING 26 ft. WHEN PUMPING 175 ft. TYPE OF PUMP USED (for test) A air P piston T turbine C centrifugal R rotary O other (describe below) J jet S submersible.

SET PUMP AT 400 FT. PUMP INSTALLED. DRILLER INSTALLED PUMP (CIRCLE) (YES OR NO) YES NO. IF DRILLER INSTALLS PUMP, THIS SECTION MUST BE COMPLETED FOR ALL WELLS. TYPE OF PUMP INSTALLED PLACE (A,C,J,P,R,S,T,O) IN BOX 29. CAPACITY: GALLONS PER MINUTE (to nearest gallon) 31 35. PUMP HORSE POWER 37 41. PUMP COLUMN LENGTH (nearest ft.) 43 47. CASING HEIGHT (circle appropriate box and enter casing height) + above } LAND SURFACE - below } 2 (nearest foot).

LATITUDE 3 9.232509 LONGITUDE 7 6998801 (DEFAULT COORD. WGS 84)

Pursuant to §10-624 of the State Govt. Article of the Maryland Code personal info. requested on this form is used in processing this form pursuant to COMAR 26.04.04. Failure to provide the info. may result in this form not being processed. You have the right to inspect, amend, or correct this form. The Maryland Department of the Environment is subject to the Maryland Public Information Act. This form may be made available on the Internet via MDE's website and is subject to inspection or copying, in whole or in part, by the public and other governmental agencies, if not protected by federal or state law.

B 1
SEQUENCE NO. (MDE USE ONLY)
54050

STATE OF MARYLAND
APPLICATION FOR PERMIT TO DRILL WELL
please type

STATE PERMIT NUMBER
Ho-18-0048
fill in this form completely

Date Received (APA) 030519
OWNER INFORMATION
8 MM DD YY 13
ELM STREET DEVELOPMENT
15 Last Name Owner First Name 34
5704 DORSEY HALL ROAD
36 Street or RFD 55
ELLICOTT CITY MD. 21042
57 Town 70 State 72 Zip 76

B 3 LOCATION OF WELL
HOWARD
8 COUNTY 21
SIMPSON / DENAULT
23 SUBDIVISION 42
SECTION 44 46 LOT 25 48 50
DAYTON
52 NEAREST TOWN 71

DRILLER INFORMATION
RANDALL L. ALEXANDER M WD 576
Driller's Name 76 License No. 81
ALEXANDER'S WELL DRILLING
Firm Name
126 W. MAIN ST. P.O. BOX 443 FAIRFIELD, PA 17320
Address
Signature Date 2-12-19

B 4 SOURCES OF DRILLING WATER
1. WELL WATER
2.
3.
GREEN BRIDGE RD.
11 STREET ADDRESS 30
ON WHICH SIDE OF ROAD (CIRCLE APPROPRIATE BOX)
NORTH
WEST EAST
SOUTH
APPROX 1650 34 1000 37
DISTANCE FROM ROAD FT
ENTER FT OR MI 38 39
TAX MAP: 27 BLK: PARCEL 34-36 98 11-112

B 2 WELL INFORMATION
APPROX. PUMPING RATE (GAL. PER MIN.) 5
8 12
AVERAGE DAILY QUANTITY NEEDED (GAL. PER DAY) 400
14 20

USE FOR WATER (CIRCLE APPROPRIATE BOX)
 DOMESTIC POTABLE SUPPLY & RESIDENTIAL IRRIGATION
 FARMING (LIVESTOCK WATERING & AGRICULTURAL IRRIGATION)
 INDUSTRIAL, COMMERCIAL, DEWATERING
 PUBLIC WATER SUPPLY WELL
 TEST, OBSERVATION, MONITORING
 OPEN LOOP GEOTHERMAL
 CLOSED LOOP GEOTHERMAL


NOT TO BE FILLED IN BY DRILLER HEALTH DEPARTMENT APPROVAL
COUNTY NAME HOWARD COUNTY NO. 21
STATE SIGNATURE INSERT S 41
DATE ISSUED 02/24/2020
43 MM DD YY 48 CO SIGNATURE EXP. DATE

APPROXIMATE DEPTH OF WELL 500 FEET
24 28
APPROXIMATE DIAMETER OF WELL 6 INCH
NEAREST INCH

METHOD OF DRILLING (circle one)
BORED (or Augered) JETTED Jetted & DRIVEN
30 AIR-ROTary AIR-PERCussion ROTARY (Hydraulic Rotary)
37 CABLE REVERSE-ROTary DRIVE-POINT
other

REPLACEMENT OR DEEPENEWED WELLS (CIRCLE APPROPRIATE BOX)
 THIS WELL WILL NOT REPLACE AN EXISTING WELL
 THIS WELL WILL REPLACE A WELL THAT WILL BE ABANDONED AND SEALED
39 THIS WELL WILL REPLACE A WELL THAT WILL BE USED AS A STANDBY-CONTACT LOCAL APPROVING AUTHORITY FOR POLICY ON STANDBY WELLS
 THIS WELL WILL DEEPEN AN EXISTING WELL
PERMIT NUMBER OF WELL TO BE REPLACED OR DEEPENEWED (IF AVAILABLE) 41 52

Not to be filled in by driller (MDE OR COUNTY USE ONLY)
APPROX. PERMIT NUMBER Ho-18-0048
PERMIT No. Ho-18-0048
70 71 72 73 74 75 76 77 78 79

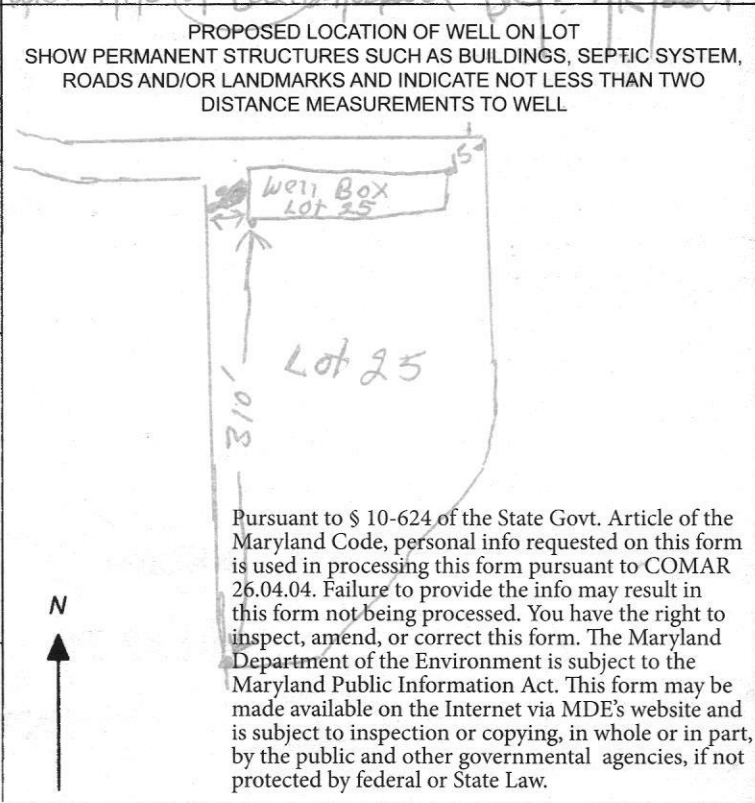

SPECIAL CONDITIONS
NOTE APPROVING AUTHORITIES SHOULD USE SEPARATE SHEET IF NEEDED- SEE ATTACHED MEMO

8 1

54050

SEQUENCE NO. (MODE USE ONLY)

STATE OF MARYLAND APPLICATION FOR PERMIT TO DRILL WELL

STATE PERMIT NUMBER

fill in this form completely

Date Received (APA)

8 mm dd yy 13

15 Last Name

16 First Name

17 Street or RFD

18 City

19 State

20 Zip

DRILLER INFORMATION

21 Driller's Name

22 License No.

23 Firm Name

24 Address

25 City

26 State

27 Zip

WELL INFORMATION

28 APPROX PUMPING RATE (GAL PER MIN)

29 AVERAGE DAILY QUANTITY NEEDED (GAL PER DAY)

30 USE FOR WATER (CIRCLE APPROPRIATE BOX)

31 DOMESTIC POTABLE SUPPLY & RESIDENTIAL IRRIGATION

32 FARMING LIVESTOCK WATERING & AGRICULTURAL IRRIGATION

33 INDUSTRIAL COMMERCIAL DEWATERING

34 PUBLIC WATER SUPPLY WELL

35 TEST OBSERVATION MONITORING

36 OPEN LOOP GEOTHERMAL

37 CLOSED LOOP GEOTHERMAL

38 APPROXIMATE DEPTH OF WELL FEET

39 APPROXIMATE DIAMETER OF WELL INCH

METHOD OF DRILLING (circle one)

40 BORED (or Augered)

41 AIR-ROTARY

42 CABLE

43 OTHER

REPLACEMENT OR DEEPEND WELLS (CIRCLE APPROPRIATE BOX)

44 THIS WELL WILL NOT REPLACE AN EXISTING WELL

45 THIS WELL WILL REPLACE WELL THAT WILL BE ABANDONED

46 THIS WELL WILL REPLACE WELL THAT WILL BE USED FOR A DIFFERENT PURPOSE

47 THIS WELL WILL REPLACE WELL THAT WILL BE USED FOR A DIFFERENT PURPOSE AND CONTACT APPROVING AUTHORITY FOR A PERMIT

48 PERMIT NUMBER (IF AVAILABLE)

49 NOT TO BE FILLED

50 APPROX PERMIT NUMBER (IF OR COUNTY USE ONLY)

51 PERMIT NUMBER

52 SPECIAL CONDITIONS

53

54

55

56

57

LOCATION OF WELL: 21 NEAREST TOWN DAYTON, 22 SECTION 44, 23 SUBDIVISION 48, 24 LOT 22, 25 STREET OR RFD 2704 DORSEY HALL ROAD, 26 CITY ELICOTT CITY MD, 27 STATE 17, 28 ZIP 21115, 29 FIRST NAME ELM, 30 LAST NAME STREET DEVELOPMENT, 31 DATE RECEIVED 03/05/13

SOURCES OF DRILLING WATER: 31 WELL WATER, 32 STREET ADDRESS GREEN BRIDGE RD, 33 DISTANCE FROM ROAD FT, 34 ENTER FT OR MI, 35 TAX MAP, 36 BLK, 37 PARCEL, 38 ON WHICH SIDE OF ROAD, 39 (CIRCLE APPROPRIATE BOX), 40 NORTH, 41 EAST, 42 SOUTH, 43 WEST

NOT TO BE FILLED IN BY DRILLER HEALTH DEPARTMENT APPROVAL: 41 COUNTY NAME HOWARD, 42 STATE, 43 SIGNATURE, 44 DATE ISSUED, 45 CO SIGNATURE, 46 EXP. DATE

PROPOSED LOCATION OF WELL ON LOT: 47 SHOW PERMANENT STRUCTURES SUCH AS BUILDINGS, SEPTIC SYSTEM, ROADS AND/OR LANDMARKS AND INDICATE NOT LESS THAN TWO DISTANCE MEASUREMENTS TO WELL, 48 HOWARD COUNTY HEALTH DEPT. FOOD PROTECTION PROGRAM, 49 RECEIVED MAR 27 2013



protected by Federal or State Law

HOWARD COUNTY HEALTH DEPT. FOOD PROTECTION PROGRAM

8

39. 232509
 76. 998801

Review CABATHUN
9/23/2019

FIELD DATA SHEET
 HOWARD COUNTY WELL YIELD TEST

Well Permit No. HO - 18-0048
 Location of property (road) GREEN BRIDGE ROAD DAYTON MD.
 Subdivision SIMPSON / DENAULT Lot 25 Block Plat Sec.
 Well Driller ALEXANDERS WELL DRILLING Owner ELM STREET DEVELOPMENT

Depth of well 503 FT.
 Distance of measuring point (M.P.) above ground 2 FT.
 Static water level (S.W.L.) below M.P. 26 FT.

TEST PUMP DEPTH 400 FT

I. High rate pumping -- reservoir drawdown

Time pump started 7:20 AM Pumping rate 10 G.P.M.
 Total time 55 MIN to reach pumping water level 175 ft. below M.P.


II. Recovery pump test data - observations to be recorded every 15 minutes

TIME (in 15 minute intervals)	WATER LEVEL below M.P.	PUMPING RATE time to fill X gallon bucket	FLOW METER READING (if used)	CALCULATED FLOW (gallons per minute)
8:15 AM	175 FT.	8 SEC		7.5 G.P.M.
8:30	175	8		7.5
8:45	175	8		7.5
9:00	175	8		7.5
9:15	175	8		7.5
9:30	175	8		7.5
9:45	175	8		7.5
10:00	175	8		7.5
10:15	175	8		7.5
10:30	175	8		7.5
10:45	175	8		7.5
11:00	175	8		7.5
11:15	175	8		7.5
11:30	175	8		7.5
11:45	175	8		7.5
12:00 PM	175	8		7.5
12:15	175	8		7.5

Maura J. Rossman, M.D., Health Officer

MEMORANDUM

TO: **Alexander's Well Drilling**
Attn: Randall Alexander MWD 00576
126 W Main Street
P.O. Box 443
Fairfield, PA 17320

FROM: **Joseph Cabahug** 
Licensed Environmental Health Specialist **001997**
Howard County Health Department
Well & Septic Program

RE: **Simpson and Denault Well Permit Special Conditions**

DATE: **04/24/2019**

This memorandum serves to inform the driller serving The Simpson and Denault Subdivision for construction of a new potable wells for residential use of the special conditions associated with the release of the well permits.

In accordance with current approved Percolation Certification (signed 03/27/2019), the following conditions apply:

Note 15(d) Wells installed on **Lots 2 – 8, 12 – 14, 23, 26 – 34, 38, and 39** must be installed as steel casing to depth of at least 50' below the soil surface or 10 feet into competent bedrock, whichever is deeper.

In accordance with the Water Appropriation and Use Permit (**HO2017G001(01)**), the following conditions apply:

Page 3, Section 15: The Permittee shall conduct simultaneous yield tests of wells closer than 100 feet apart, if at least one of the wells is on a lot less than one acre in size. The yield testing shall be conducted to ensure that the minimum yield requirements of COMAR 26.04.04.26 are met. In the event that a well that has been tested simultaneously with other wells does not meet minimum yield standards, the Permittee may relocate a well to achieve the 100-foot separation distance, deepen or otherwise modify the well to improve its yield or drill a second well to be used in tandem to meet the minimum yield standards during simultaneous testing. All wells shall comply with the well construction requirements.

Maura J. Rossman, M.D., Health Officer

Lots that are less than one acre are shown below.

MINIMUM LOT SIZE CHART			
LOT No.	GROSS AREA (SF)	PIPE STEM	NET AREA
1	54,825		54825
2	59,641		59641
3	55,018		55018
4	41,925		41925
5	40,840		40840
6	55,788		55788
7	55,833		55833
8	45,774		45774
9	42,992		42992
10	44,020		44020
11	42,068		42068
12	40,362		40362
13	41,330		41330
14	56,648	6700	49948
15	40,459		40459
16	49,871		49871
17	40,003		40003
18	40,443		40443
19	40,461		40461
20	40,461		40461
21	40,218		40218
22	54,686		54686
23	55,798		55798
24	44,052	1375	42677
25	41,612	2906	38706
26	48,488	5322	43166
27	46,396		46396
28	40,768		40768
29	44,270		44270
30	44,589		44589
31	46,366		46366
32	49,299		49299
33	47,918		47918
34	52,931		52931
35	54,827	2518	52309
36	44,800	3617	41183
37	55,035	4441	50595
38	33,223	2913	30310
39	31,227		31227
40	35,865		35865
41	40,100		40100
42	34,182		34182
43	41,390		41390
44	41,360		41360
45	45,097		45097
TOTAL AREA	2,043,259	AC.	46.91
			S.F.

Please reach out to the Howard County Health Department – Bureau of the Environment with further questions.

Cc: File



Bureau of Environmental Health
8930 Stanford Blvd | Columbia, MD 21045
410.313.2640 - Voice/Relay
410.313.2648 - Fax
1.866.313.6300 - Toll Free

Maura J. Rossman, M.D., Health Officer

INTERIM CERTIFICATE OF POTABILITY

Expiration Date – August 6, 2023

February 6, 2023

Homeowner
7001 Colt Place
Dayton, MD 21036

RE: Willowshire, Lot 25
7001 Colt Place
Building Permit: B21002780
Well Permit: HO-18-0048

Dear Homeowner:

This is to advise you that the septic system installation and water well construction for the above referenced property have been inspected and approved. Final approval of the septic system was granted on **11/2/2022**. Final approval of the well line connection to the dwelling was granted on **10/14/2022**. The well construction was completed on **9/23/2019**. Water samples were collected on **2/2/2023**.

The water sample results indicate that the water samples submitted for testing were free of coliform and fecal coliform bacteria at the time of sampling and are bacteriologically safe for drinking. This certifies that the initial sampling requirements of COMAR 26.04.04 "Well Regulations" have been met for the water supply system installed under well permit HO-18-0048. Although the submitted sample results are in compliance with COMAR standards, the Health Department does not guarantee water supplies.

This Interim Certificate of Potability will expire **six months** from the date of issuance. Submission of a second bacteriological test indicating the water is free of coliform and fecal coliform bacteria is required prior to the expiration date, after which time a Final Certificate of Potability will be issued. **Failure to submit an additional sample and obtain a Final Certificate of Potability will result in a Notice of Violation and is punishable as a misdemeanor under the *Annotated Code of Maryland, Environment Article, 9-1311*, subject to a fine of up to \$500 or imprisonment not to exceed three months.**

Please contact (410) 313-1773 to schedule a final water sample appointment or contact a Maryland certified water laboratory to schedule a water sample. A list of laboratories certified by the state of Maryland may be found at the following website:
<http://www.mde.state.md.us/assets/document/WSP-Labs-2010apr16.pdf>



Bureau of Environmental Health
8930 Stanford Blvd | Columbia, MD 21045
410.313.2640 - Voice/Relay
410.313.2648 - Fax
1.866.313.6300 - Toll Free

Maura J. Rossman, M.D., Health Officer


In closing, please refer to our "[Homeowner Fact Sheet](#)" which illustrates a better understanding for your Onsite Sewage Disposal System. You will also find a link to Maryland Department of the Environments website which describes in further detail operation and maintenance of your septic system.

Approving Authority,

A handwritten signature in black ink, appearing to read 'Kevin M. Wolf', is written over a light blue horizontal line.

Kevin M. Wolf, LEHS, R.S./REHS, Supervisor
Groundwater Management Section
Well & Septic Program

cc: Howard County Dept. of Inspections, Licenses, and Permits
Community Hygiene Program
File

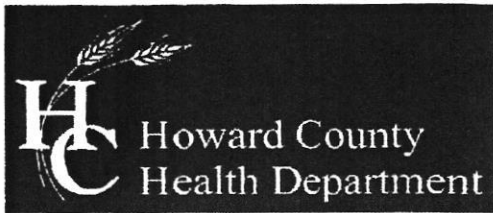

Bureau of Environmental Health

8930 Stanford Boulevard, Columbia, MD 21045

Main: 410-313-2640 | Fax: 410-313-2648

TDD 410-313-2323 | Toll Free 1-866-313-6300

www.hchealth.org

Facebook: www.facebook.com/hocohealth

Twitter: HowardCoHealthDep

Dr. Maura J. Rossman, M.D., Health Officer

TO ALL INTERESTED PARTIES

When submitting a well permit application for a proposed well for new construction, please indicate one of the following:

Lot #'s 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 14, PARCEL 'C', 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45

Well Site Location:

SIMPSON/DENAULT

Subdivision/Property Name

Lot #

GREEN BRIDGE RD.

Road Name

X The well site has been staked by SHANABERGER & LANE (professional land surveyor or company employing professional land surveyors) on 1/9/19 (date) and does not require a site inspection.


The well driller, builder or property owner will call the Health Department to schedule a time to meet in the field to verify the proposed well site location.

This sheet, along with two copies of an acceptable well site plan, must be attached to the green well permit application.

Revised 4/22/14



DO NOT REMOVE THIS TAG
 DEPARTMENT OF THE ENVIRONMENT
 PERMIT NUMBER
 10-10-0048
 THE DATE AND TIME NUMBER AND WRITE
 STATE OF MARYLAND 2-2-20

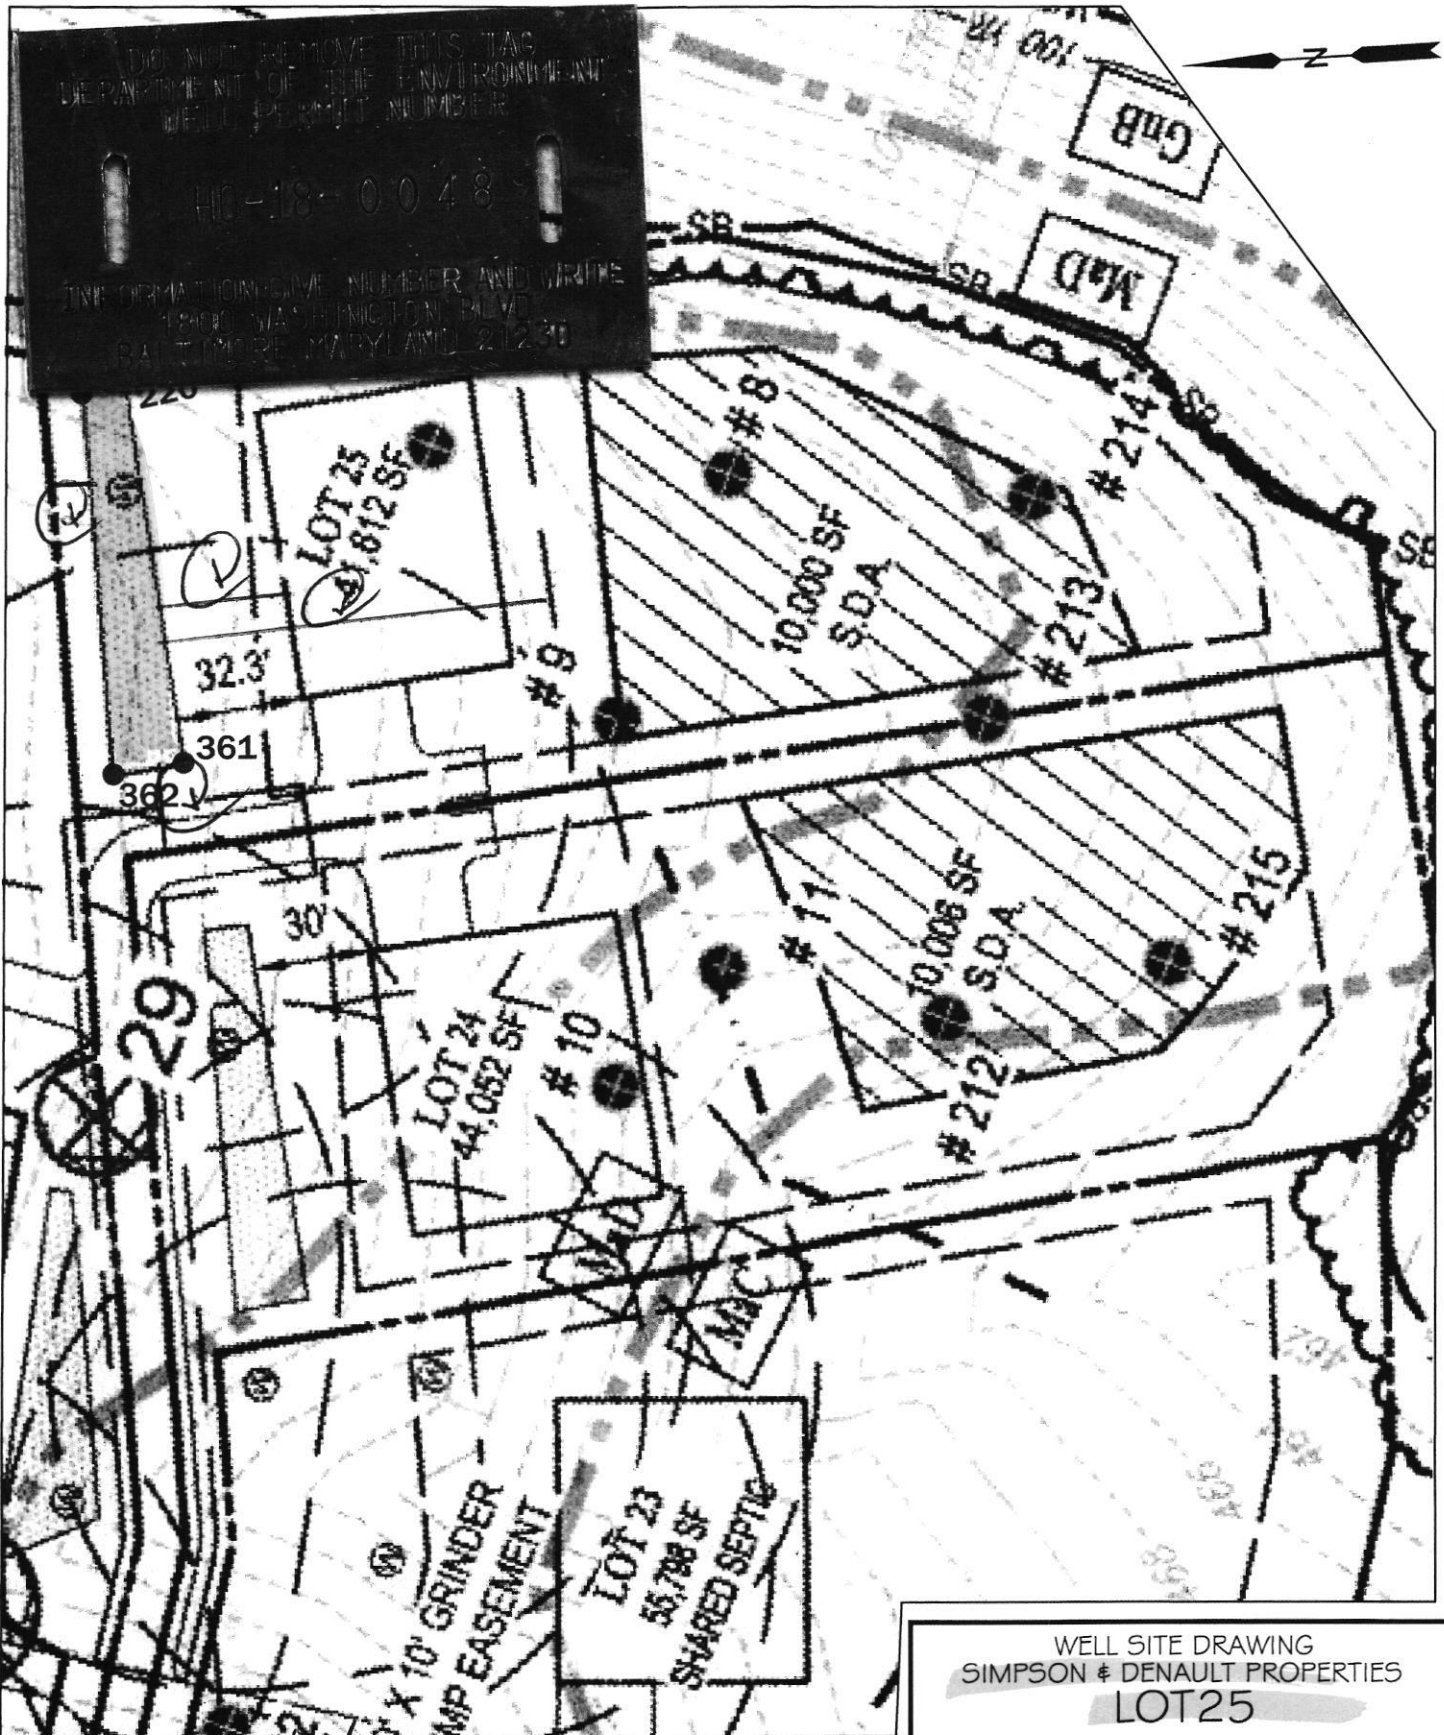

WELL SITE DRAWING
 SIMPSON & DENAULT PROPERTIES
LOT 25
 TAX MAP 27 GRID 18
 PARCELS 34, 36, 98, 111, & 112
 5TH ELECTION DIST.
 HOWARD COUNTY, MD.
 SCALE: 1"=50' DATE: 2/21/19

APPROVED 4/24/2019
 © 2019
 STAMPED BY SHAN
 AND LANE

SHANABERGER & LANE
 8726 TOWN AND COUNTRY BLVD., SUITE 201
 ELLICOTT CITY, MD. 21043
 (410)461-9563 FAX: (410)461-9693

FOUNTAIN VALLEY ANALYTICAL LABORATORY, INC.

1413 Old Taneytown Rd. Westminster, MD (410) 848-1014 (410) 876-4554

REPORT OF ANALYSIS

Laboratory ID #: 157098 Account #: 1933
Reference: Willow Creek Lot 25 Client: Fogle's Well Pump & Treatment
Location: 7001 Colt Place Requested By: Dave Fogle
Dayton, MD 21036 Source: Well Water
Date/ Time Collected: 2/2/2023 1045 Site: Pressure Tank
Date/Time Rec'd: 2/2/2023 1250 Treatment: None
Chlorine ppm: Free: ND Total: ND pH: 7.5
Collected By: J. Evans 0309JE Well #: HO-18-0048

PARAMETERS	RESULTS	UNITS	REFERENCE	METHOD	DATE/TIME/ANALYST
Bacteria, Coliform, Total, MPN	<1.0	MPN/ 100 ml	<1.0	SM20 9223B	2/3/2023 / 0900 / TSD
Bacteria, E. coli, MPN	<1.0	MPN/ 100 ml	<1.0	SM20 9223B	2/3/2023 / 0900 / TSD
Nitrate.	<0.40	mg/L	10	EPA 300.0	2/2/2023 / 1434 / TSD
Turbidity	<0.30	NTU	<10	SM2130B	2/2/2023 / 1600 / TSD
Sand	ND	mg/L	5	Visual/Gravimetric	2/2/2023 / 1555 / TSD

NOTES:

- 1 mg/L = milligrams per liter (also, parts per million)
- 2 MPN/ 100 ml = Most Probable Number [of viable bacteria] per 100 ml of sample.
- 3 NTU = Nephelometric Turbidity Units
- 4 Results less than or within the reference range are considered satisfactory and within potable water limits at the time of sampling.
- 5 Sample collected by client, analyzed as received
- 6 ND:None Detected
- 7 Visual well check: Sealed, vented cap
- 8 pH and Chlorine level tested in lab (pH tested after recommended holding time)

Reason for Test : Use & Occupancy

Building Permit # : 21002780

Date Reported: 2/3/2023



HOWARD COUNTY HEALTH DEPARTMENT

64807

DATE: 3/27/19

WS

Received From

Abraham's well Drilling

PHONE # 776-42-596

CASH
 CHECK
NO. 20911

For

Well permits (2) Green Bridge Rd.

Three thousand three hundred sixty Dollars

\$ 3300.00

Received By

J King