

05 408334

8/9/89 pm 1:30

11:30 am
2:30 pm

8/10/89 ADX

002 001 001 002 002

PERMIT

SEWAGE DISPOSAL SYSTEM

MARYLAND STATE DEPARTMENT OF HEALTH

HOWARD COUNTY
BUREAU OF ENVIRONMENTAL HEALTH
461-9933

INDEXED

P 44760

A 39479

DISTRICT 5th

DATE 7/26/89

DATE SYSTEM APPROVED 8/10/89

INSPECTOR McLittin

001

Paul Schissler/South Carroll Backhoe, Inc. IS PERMITTED TO INSTALL ALTER

ADDRESS 4410 Salem Bottom Road, Westminster, Maryland PHONE 875-4197

SUBDIVISION Chapel Woods ROAD 11824 Chapel Woods Ct LOT 24, Section 2

PROPERTY OWNER Larry Bormel

ADDRESS _____

IF GARBAGE GRINDER IS USED INCREASE SEPTIC TANK CAPACITY BY 50% AND ABSORPTION AREA BY 22%

GARBAGE GRINDER? YES NO

210
4
875 210ft trench

SEPTIC TANK CAPACITY 1250 GALLONS NUMBER OF BEDROOMS 4

TRENCHES - 210 sq. ft. per bedroom. Trench to be 2 feet wide. Inlet 4 feet below original grade. Bottom maximum depth 8 feet below original grade. Effective area begins at 4 feet below original grade. 4 feet of stone below distribution pipe.

LOCATION - Start the first trench 205 feet from the left front corner and 110 feet from the left lot line as seen when facing the lot from Chapel Woods Court. Run trenches on contour toward the left lot line.

NOTE - No trench to exceed 100 feet in length. Provide 6" - 8" diameter cleanout and cap to grade or above on septic tank. OK/CW

2 @ 105ft ok JEN 8-9-89

PLANS APPROVED BY Sid Abel DATE 5/03/89

COVER NO WORK UNTIL INSPECTED AND APPROVED

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM.

NOTE: CLEANOUT REQUIRED EVERY 70 FEET OF SEWER LINE AND/OR AT 90° SWEEPS IN LINES FROM HOUSE TO DRAIN FIELDS

NOTE: ALL PARTS OF SEPTIC SYSTEMS (I.E. TANK, DISTRIBUTION BOX, TRENCHES) TO BE 100 FEET FROM WELL (UNLESS OTHERWISE SPECIFICALLY AUTHORIZED)

NOTE: IF DEEP TRENCHES ARE USED CALL FOR INSPECTION BEFORE AND AFTER PLACING GRAVEL IN TRENCHES

NOTE: NO DRY WELL SHALL EXCEED 15 FOOT IN DIAMETER NO ABSORPTION TRENCH TO EXCEED 100 FEET IN LENGTH

NOTE: ALL PIPE FROM HOUSE TO SEPTIC TANK MUST BE CAST IRON OR SCHEDULE 40 PVC OR ABS

PERMIT VOID AFTER TWO YEARS

NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL. STAND PIPES MUST BE 6 INCHES IN DIAMETER. CAST IRON, CONCRETE OR TERRA COTTA OR PVC OR ABS ACCEPTED. IF TOP OF SEPTIC TANK IS DEEPER THAN 3 FEET, MANHOLE TO GRADE REQUIRED

NOTE: DISTRIBUTION BOXES MUST HAVE BAFFLES

***INSTALLER IS RESPONSIBLE FOR OBTAINING FINAL APPROVAL ON THIS PERMIT**

***CALL 461-9933 FOR INSPECTION OF SEPTIC SYSTEMS.**

A
39479


Crouse Plumbing

531-3311

531-3316

PA at 4 1/2 miles

8-9-89 JEN

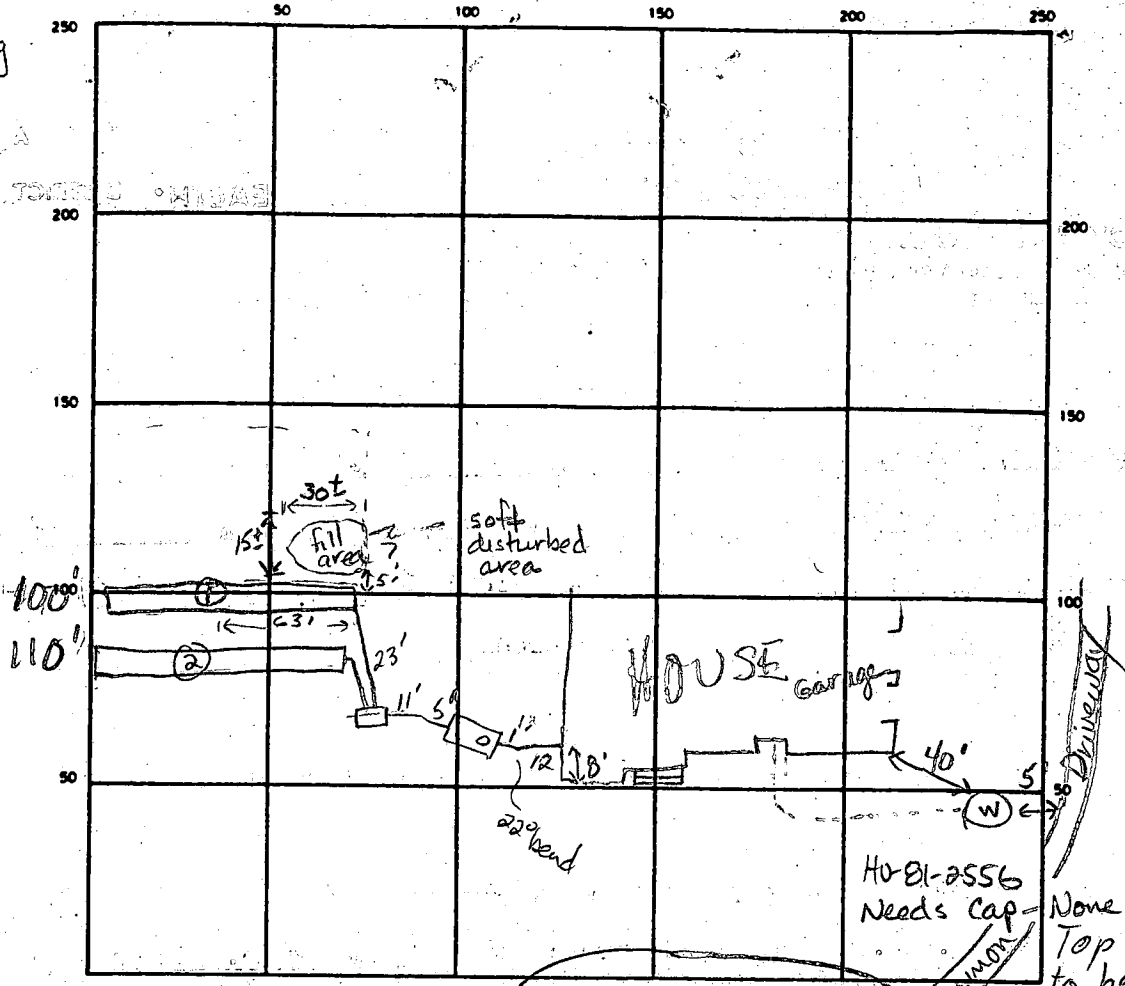

INDICATE NORTH -- NAME ADJOINING ROADWAY AS BASE LINE

Chapel Wood Ct

SEPTIC TANK LEVEL 1500 gal CLEANOUTS 1 on septic tank

DISTRIBUTION BOX LEVEL OK - BAFFLE IN

DRAIN FIELD/TILE FIELD. DEPTH 18" 22" FT. TRENCH WIDTH 2 FT. INLET DEPTH 3 1/2' - 4 3/4' FT.

EFFECTIVE GRAVEL DEPTH 4-4 1/2' 4-4 1/2' FT. TOTAL LENGTH 110 3210 FT.

NUMBER OF TRENCHES 2 ONE SIDEWALL/BOTTOM AREA 400 440 SQ. FT.

DRYWELL INSIDE DIAMETER _____ FT. EFFECTIVE DEPTH BELOW INLET _____ FT.

ABSORBENT AREA 840 SQ. FT.

REMARKS 8-9-89 slight amount of rock at 6 to 8 ft about 60 ft from distribution line in trench #1. Instructed contractor to continue w/trench unless rock becomes more abundant. No obvious structure to rock. OK to stone excavated area and cover from house to dist. box. JEN

8/10/89 OK TO COVER ALL WORK MR

DATE SYSTEM APPROVED 8/10/89

INSPECTOR M-Riffin

APPLICATION

SEWAGE DISPOSAL TESTING

STATE OF MARYLAND - DEPARTMENT OF HEALTH AND MENTAL HYGIENE

A 39479
P _____

HOWARD COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SERVICES
P. O. BOX 476 ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 992-2330

DISTRICT _____
DATE 6-11-87

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I, HEREBY, APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER Newborn Development Corp LARRY BORMEL - 381-3939
ADDRESS 5570-201 Sterrett Place PHONE 301-997-3815
Columbia, MD 21044 FINAL LOT # AREA 3
NEW LOT # (Sec. 2)

PROPERTY LOCATION:
SUBDIVISION Chapel Woods Sec. 2 Area 2 LOT NO. 8 AREA 2A

ROAD AND DESCRIPTION Linden Chapel road located on the north side
of MD rte. 108 approx. 900' East of Trotter Road.

SIZE OF LOT 3.61 Ac ± 11824 CHAPEL WOODS Ct. TYPE BLDG. 5?
(NUMBER OF BEDROOMS)

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE. I FULLY UNDERSTAND THE FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER ANY CIRCUMSTANCES. I ALSO AGREE TO COMPLY WITH ALL M.O.S.H.A. REQUIREMENTS IN TESTING THIS LOT.

Eric A. Henne
(SIGNATURE OF APPLICANT)

APPROVED BY Eric A. Henne FOR Dupstuck DATE 5-3-87

REJECTED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING 6-16-87 Re-eval Satisfactory Hold for PLAT. S. Ab


BLDG. PERMIT SIGNED
AND RETURNED 5-3-87
BP05355
SAL

THIS IS NOT A PERMIT



SOIL PROFILE

0"	A-3
3"	Yellow BK Silty CLAY LOAM <10% FRAGS
3-3.5"	Yellow BK SANDY Silt LOAM 10-15% FRAGS

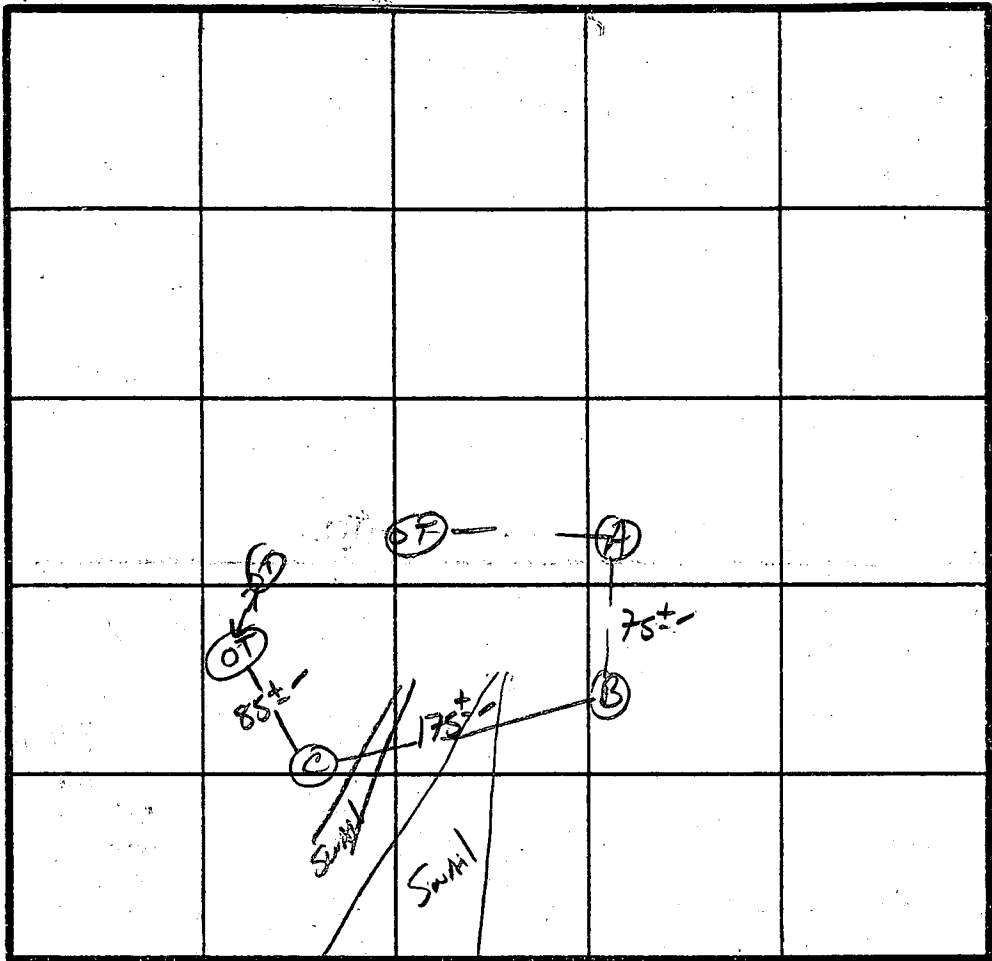

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE.

DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME
			START	STOP	START	STOP	
	AV	12"	UNIFORM SOIL	below N 3.5"	1ST APPROX	PERC 5-7 MIN	
	BV	12"	SAME AS A	CLAY 10 N 30"	APPROX	PERC 5-7 MIN	
	CV	12"	SAME AS A+B				

REMARKS SYST DEEP 4-8

TYPE OF SOIL CHESTER

TESTED BY S. Abel

ALSO PRESENT

EH-12-1079

APPLICATION

SEWAGE DISPOSAL TESTING

STATE OF MARYLAND - DEPARTMENT OF HEALTH AND MENTAL HYGIENE

A 36156

P _____

Ret. 11/19/85

HOWARD COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SERVICES
P. O. BOX 476 ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 992-2330

DISTRICT 5th

DATE 10/30/85

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I, HEREBY, APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER Newburn Development Corp.
Suite 201, 5570 Sterrett Place
ADDRESS Columbia, Maryland 21044 PHONE 596-3877

PROPERTY LOCATION:

SUBDIVISION Chapel Woods LOT NO. 14 *(new B)*

ROAD AND DESCRIPTION _____

SIZE OF LOT _____ TYPE BLDG. Single Family Dwelling
(NUMBER OF BEDROOMS)

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE. I FULLY UNDERSTAND THE FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER ANY CIRCUMSTANCES. I ALSO AGREE TO COMPLY WITH ALL M.O.S.H.A. REQUIREMENTS IN TESTING THIS LOT. /s/ James L. Newburn

(SIGNATURE OF APPLICANT)

APPROVED BY _____ FOR _____ DATE _____

REJECTED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING 11-12-85 Perc. Satisfactory; Hold For Certified Subdivision Plat. S. App


THIS IS NOT A PERMIT

①
SOIL PROFILE

0'
3" AP
Red Brown
Clay Loam
<10%
SAPROLITE

4'
Yellow BR
Sand Lm.
<10%
SAPROLITE

12'

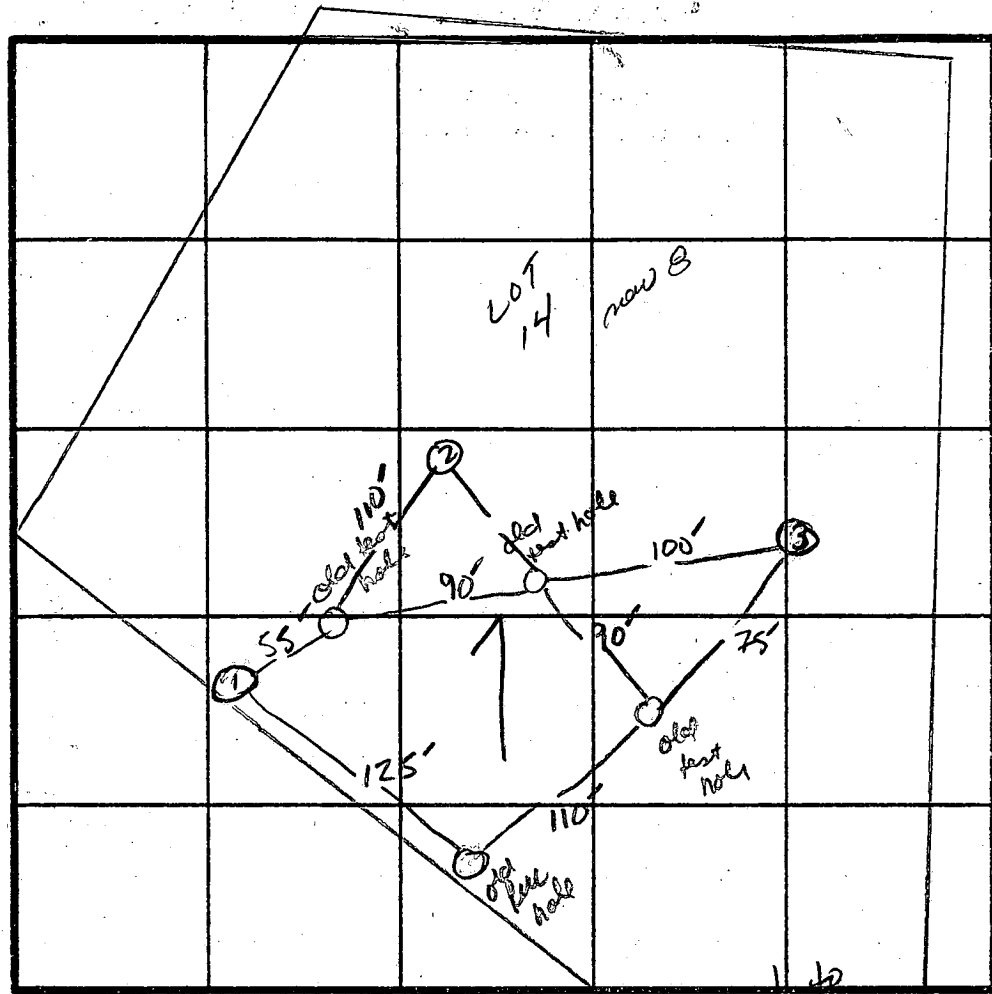

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE. V COURT

②

0'
3" AP
Yellow BR
SAND CLAY
LOAM <10%
SAPROLITE

3'
Orange Yellow
SAND Silt
LOAM
SANDSTONE
APPARENT
MATERIAL
<10%
SAPROLITE

DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME
			START	STOP	START	STOP	
11/8/85	1 S V	4.5' 12"	2:13	2:15	2:15	2:18	3min
	2 S V	4' 17"	2:33	2:35	2:35	2:39	4min
	3 S V	4.5' 12"	2:53	2:55	2:55	3:01	6min
							ROCK AT 10"

③

0'
3" AP
Yellow BR.
CLAY LOAM
<10%
SAPROLITE

3'
Brown
micaceous
Silt SAND
<10% Lm.
SAPROLITE

12'
10" ROCK AT

REMARKS: Hole # 2 distance from old test holes is approximate.

TYPE OF SOIL: Silty Sand Loam

TESTED BY: S. Abel

ALSO PRESENT: Eric, Woody ISSAC

EH-12-10

APPLICATION

A. 34815

SEWAGE DISPOSAL TESTING

P. _____

STATE OF MARYLAND - DEPARTMENT OF HEALTH AND MENTAL HYGIENE

HOWARD COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SERVICES
P. O. BOX 476, ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 465-5000, EXT. 356

DISTRICT 5

DATE Jan 8 1985

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I, HEREBY, APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER Newburn Development Corporation
Suite 201, 5570 Sterrett Place
ADDRESS Columbia, Maryland 21044

PHONE 997-3815

PROPERTY LOCATION:

SUBDIVISION Chapel Woods, Section 2 LOT NO. 14

ROAD AND DESCRIPTION Linden Chapel Road

SIZE OF LOT 3-acre TYPE BLDG. single family residence
NUMBER OF BEDROOMS _____

IF NOT SINGLE RESIDENCE DESCRIBE _____

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE.

SIGNATURE OF APPLICANT James L. Newburn


APPROVED BY _____ FOR _____ DATE _____
(KIND OF SYSTEM)

REJECTED BY _____ FOR _____ DATE _____
(KIND OF SYSTEM)

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING 2-19-85 Rec. OK, hold for certified hole
LOCATION AND well/ HOUSE SITE, same

THIS IS NOT A PERMIT

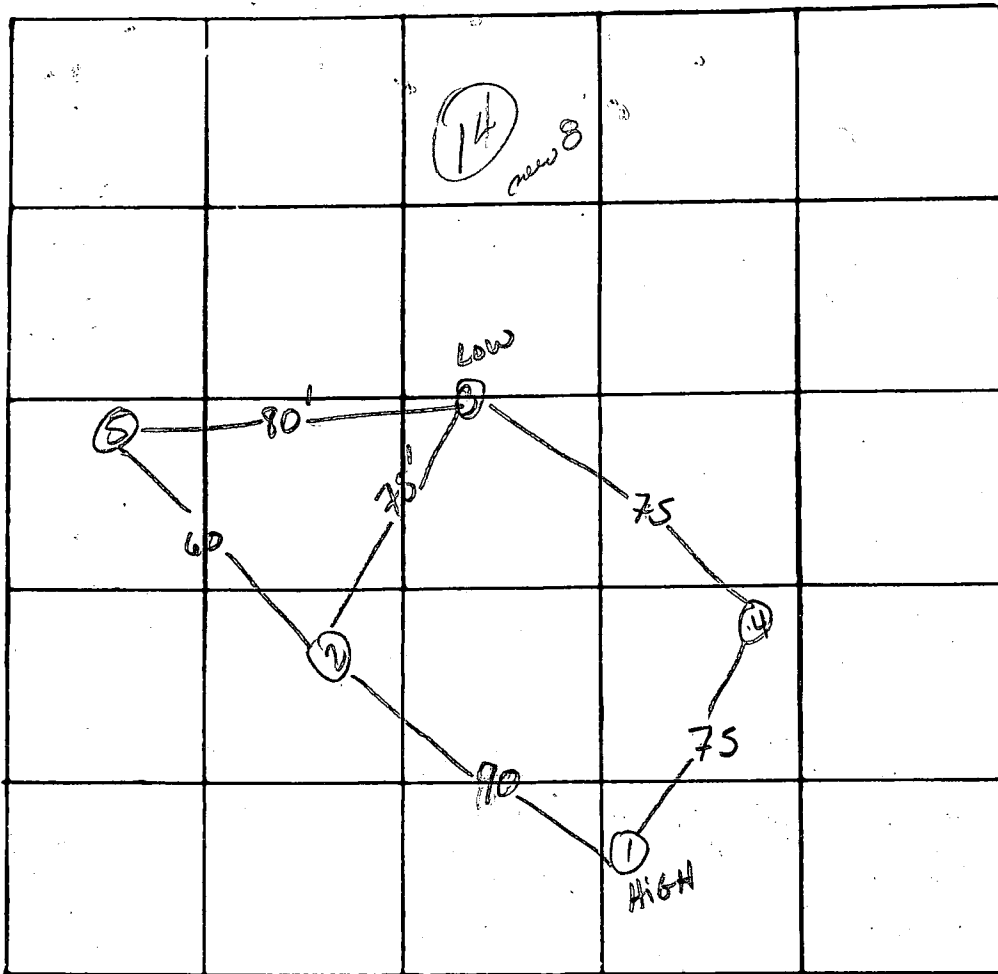

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE

① Rt 108 ①

DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME
			START	STOP	START	STOP	
Vig/ps	1S 1V	4' 13'	3:24	3:25	3:25	3:28	3min
	2S 2V	4' 13'	3:26	3:29	3:29	3:35	6min
	3S 3V	3.5' 12'	3:36	3:39	3:39	3:47	8min
	4S 4V	3' 13'	3:25	3:26	3:26	3:28	2min
	5V	13'	uniform soil	TD 13'	NO H2O		

REMARKS

TYPE OF SOIL

Chester / Glenelg association

TESTED BY

S. Abel


ALSO PRESENT:

DR. DEBRA FRANK,
WARREN


①②
6" A0-3
BROWN CLAY LOAM <10% SAPROLITE
3' BROWN SILTY SAND 10-20% SAPROLITE

③④
6" P0-3
BROWN CLAY LOAM <10% SAPROLITE
2.5' BROWN/WHITE SAND <10% SAPROLITE

④
6" A0-3
BROWN SILTY CLAY LOAM <10% SAPROLITE
3' GREY SAND 20-30% SAPROLITE
13'

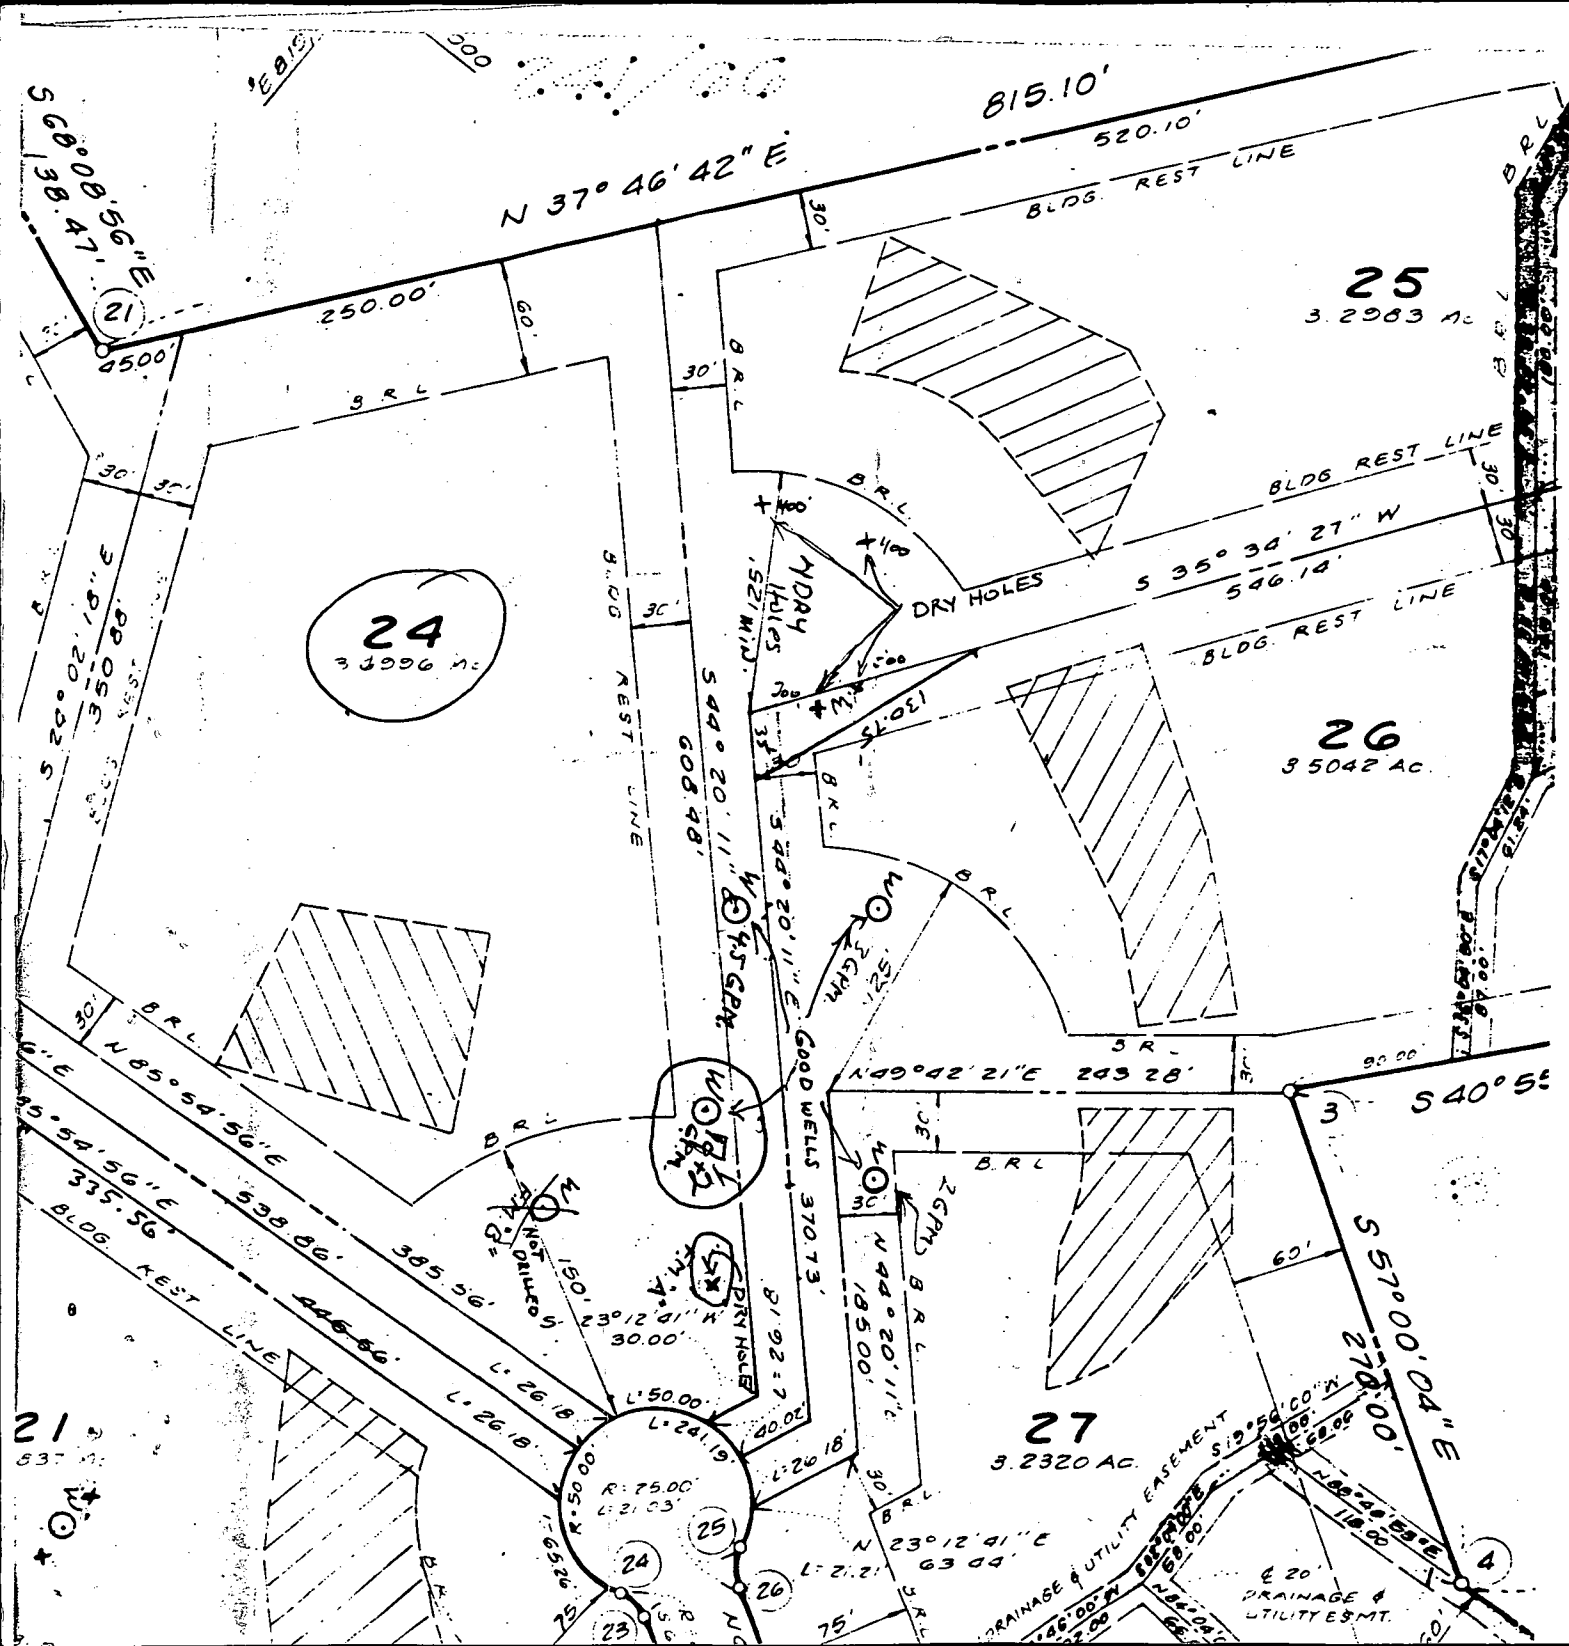


Note: Trench Lengths Determined With Permi
No Basement Sewer Service Proposed

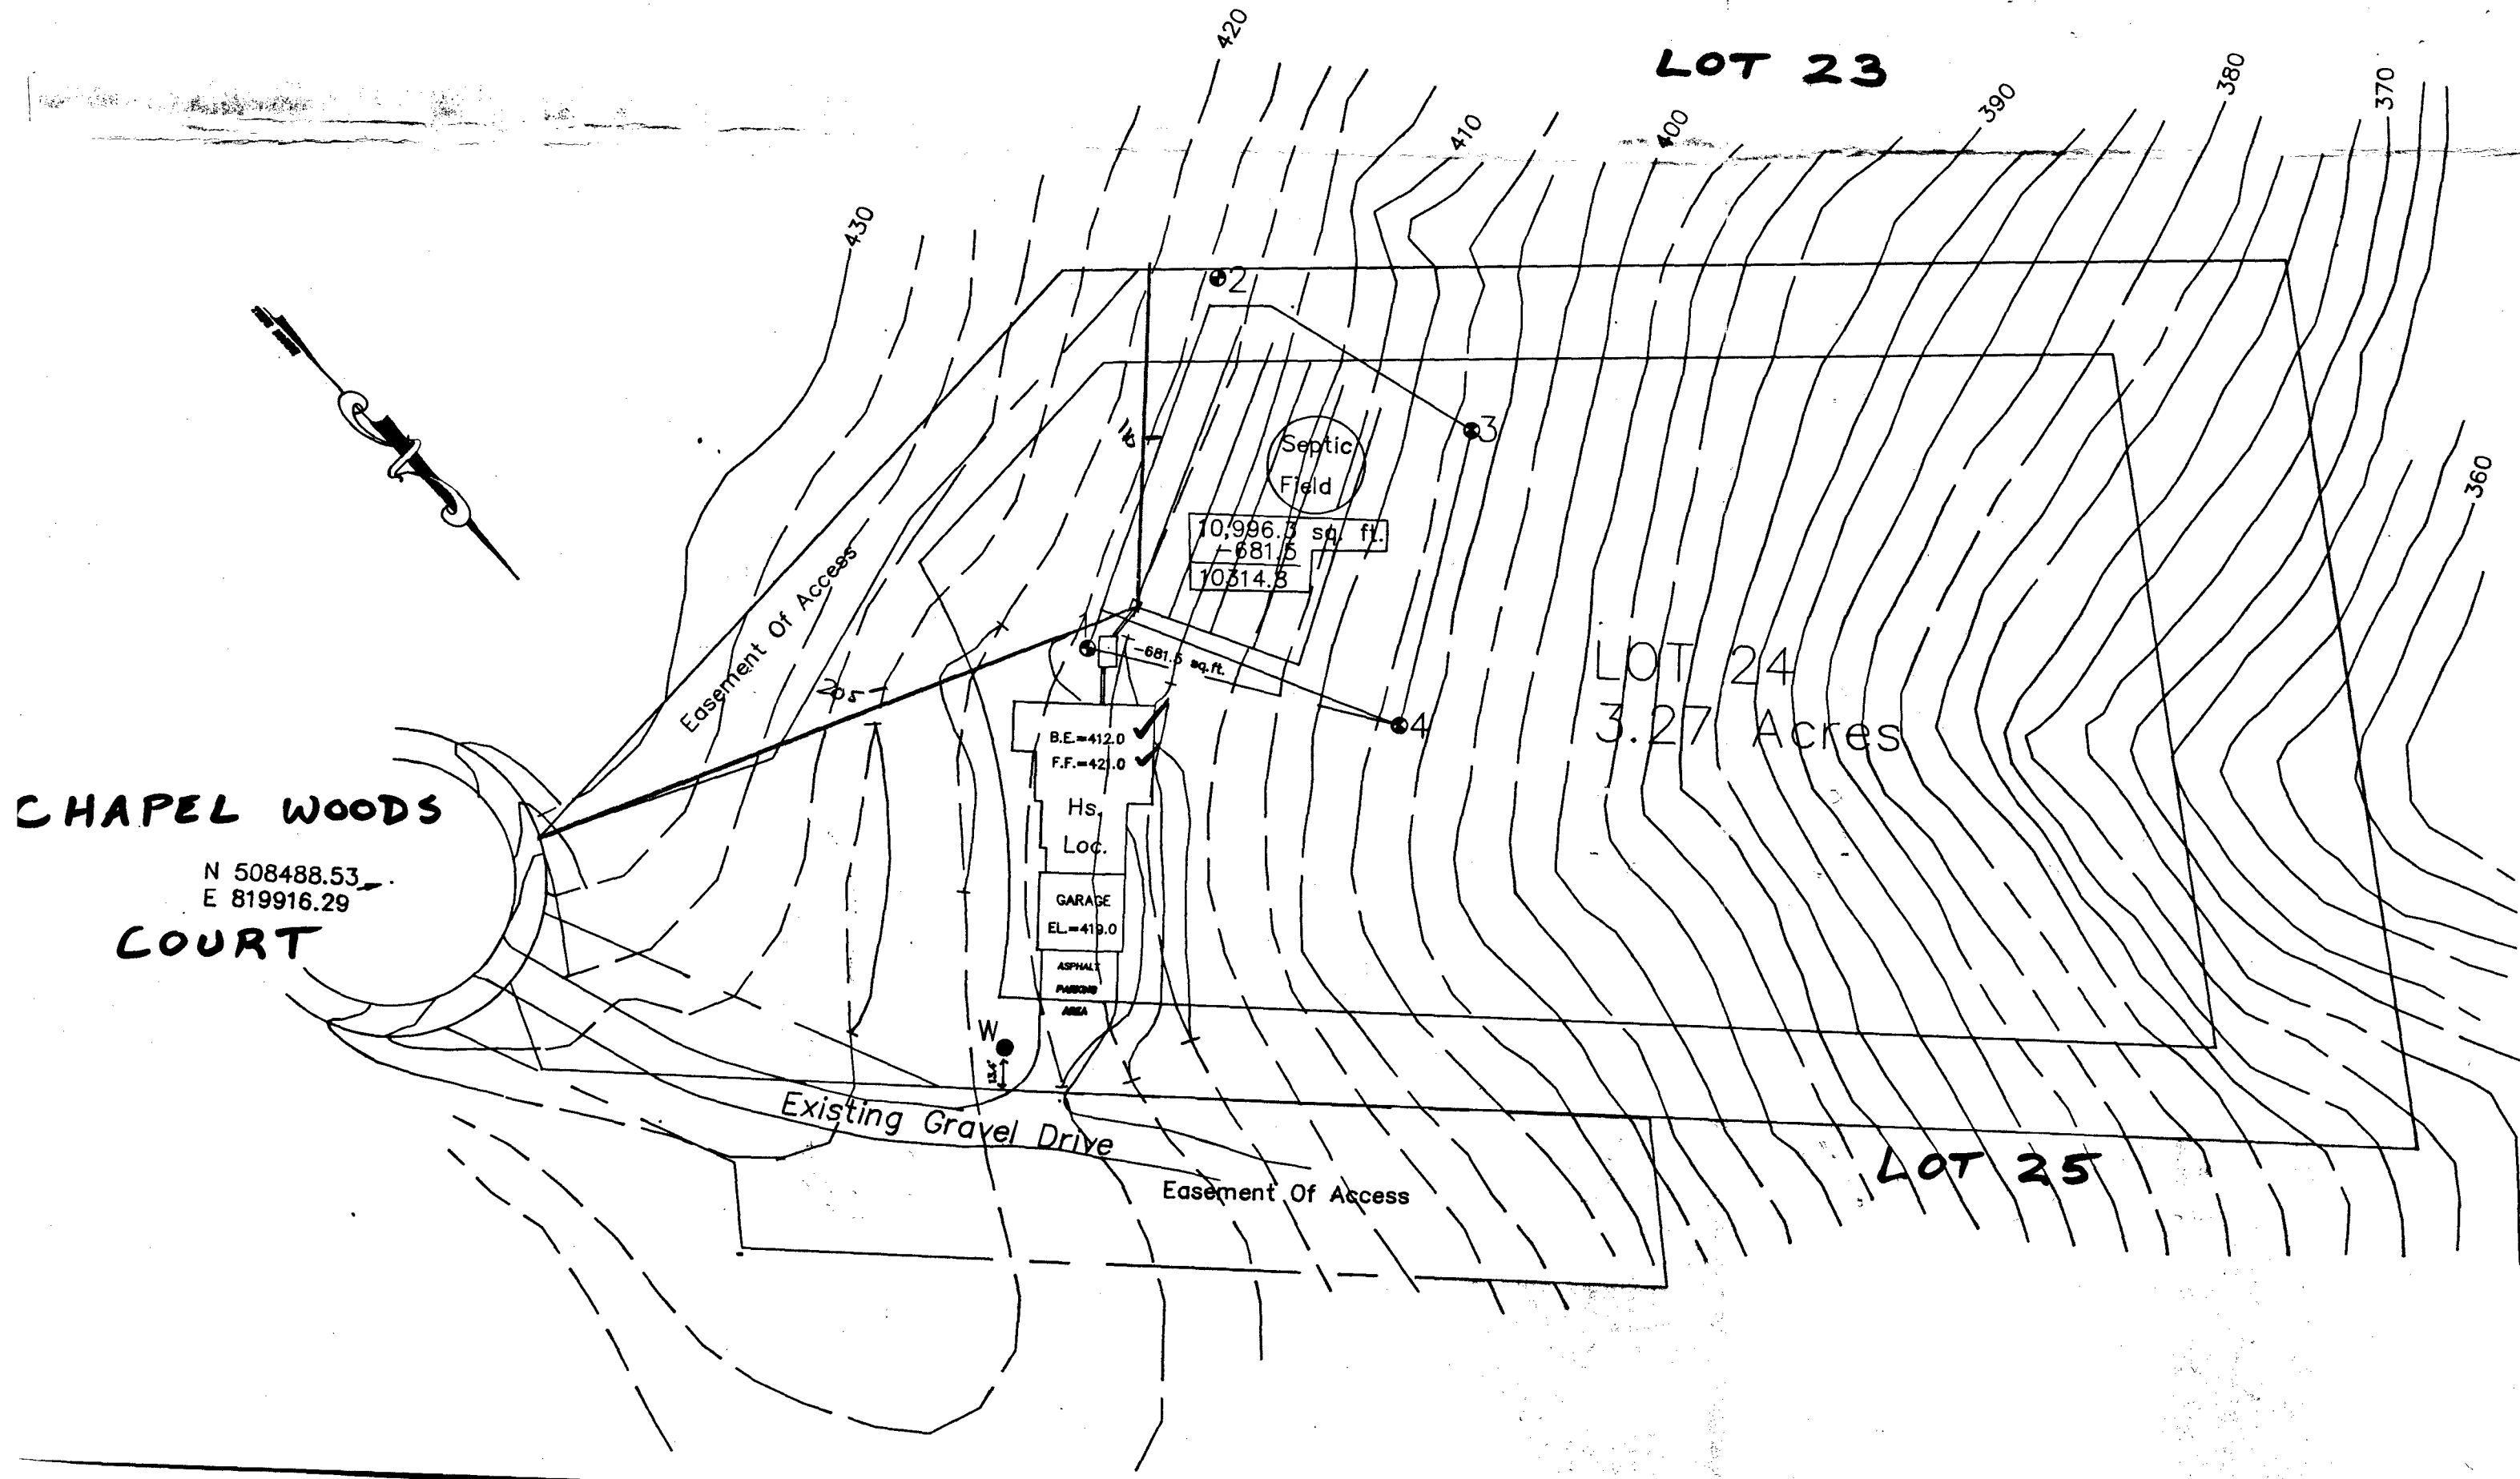

SEPTIC SYSTEM DATA	
INVERT AT	ELEV.
House (out of)	414.00 ✓ (BSMT)
Septic Tank (in)	413.75 ✓
Septic Tank (out)	413.45 ✓
Dist. Box (in)	413.25 ✓
Dist. Box (out)	413.00 ✓
First Trench (in)	413.00 ✓
ELEVATION AT TESTS	
Test#1	417.1 ✓
Test#2	417.5
Test#3	405.3
Test#4	405.1
Ground Elevation @ Well=419.9 ✓	

BDDG. PERMIT SIGNED
AND RETURNED 5-3-89
BP25355
SA

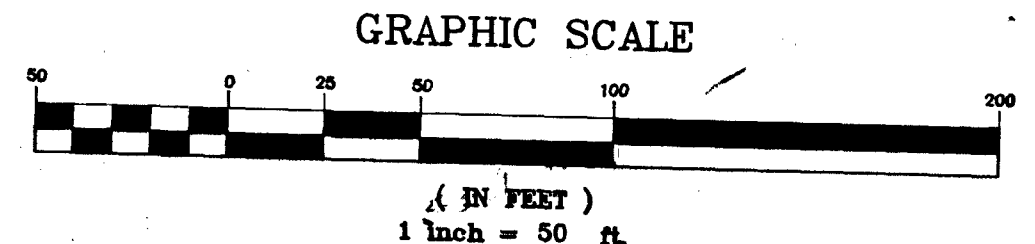

B 1 3606

SEQUENCE NO. (DP USE ONLY)

STATE OF MARYLAND PERMIT TO DRILL WELL

STATE PERMIT NUMBER

HO-81-2556

(THIS NUMBER IS TO BE PUNCHED IN COLS. 3-6 ON ALL CARDS)

please print or type

fill in this form completely

Date Received (APA)

12 11 87

OWNER INFORMATION

NEWBURN DEVELOPMENT

5705 STERKREFF PLACE

COLUMBIA MD 21044

B 3

LOCATION OF WELL

HOWARD

8 COUNTY

CLIPPER WOODS

SECTION 2 LOT 24 (Area 3)

CLIPPER WOODS

52 NEAREST TOWN

MILES FROM TOWN (enter 0 if in town) 1 1/2 MI

DRILLER INFORMATION

Joseph H. Mayne 238


Joseph H. Mayne Well Drilling

5512 Ridge Rd. Mt. Airy, Md. 21771

Joseph H. Mayne 12/7/87

B 4

DIRECTION OF WELL FROM TOWN (CIRCLE BOX)




CHAPL WOODS COURT

East A

NEAR WHAT ROAD

ON WHICH SIDE OF ROAD (CIRCLE APPROPRIATE BOX)



130 DISTANCE FROM ROAD

ENTER FT or MI FT

B 2

WELL INFORMATION

APPROX. PUMPING RATE (GAL. PER MIN.) 5

AVERAGE DAILY QUANTITY NEEDED (GAL. PER DAY) 500

USE FOR WATER (CIRCLE APPROPRIATE BOX)

- Home (single or double household unit only)
Farming (livestock watering & agricultural irrigation)
Industrial, commercial, state and federal gov. other (requires appropriation permit)
Public or private water company (requires appropriation permit and state health department approval)
Test, observation, monitoring (may require appropriation permit)

NOT TO BE FILLED IN BY DRILLER HEALTH DEPARTMENT APPROVAL

HOWARD COUNTY NAME A 39479 COUNTY NO.

STATE SIGNATURE INSERT S

DATE ISSUED 02 16 88

COSIGNATURE R. Wilson 08/16/88 EXP. DATE

NORTH GRID 503000 EAST GRID 0819000

APPROXIMATE DEPTH OF WELL 300 FEET

APPROXIMATE DIAMETER OF WELL 6 INCH


METHOD OF DRILLING (circle one)

- Bored (or Augered)
JETTED
Jetted & Driven
AIR-ROTary
AIR-PERCussion
ROTARY (Hydraulic Rotary)
CABLE
REVerse-ROTary
Drive-POINT

SHOW MAJOR FEATURES OF BOX & LOCATE WELL WITH AN X

SOURCES OF DRILLING WATER

- 1. WELL
2.
3.
WRITE THE BOX NUMBER FROM THE MAP HERE




2/29/88 9:30
WELL GROUT
OK SEE
OTHER SIDE
R 17

REPLACEMENT OR DEEPEMED WELLS (CIRCLE APPROPRIATE BOX)

- N THIS WELL WILL NOT REPLACE AN EXISTING WELL
Y THIS WELL WILL REPLACE A WELL THAT WILL BE ABANDONED AND SEALED
S THIS WELL WILL REPLACE A WELL THAT WILL BE USED AS A STANDBY
D THIS WELL WILL DEEPEM AN EXISTING WELL

DRAW A SKETCH BELOW SHOWING LOCATION OF WELL IN RELATION TO NEARBY TOWNS AND ROADS AND GIVE DISTANCE FROM WELL TO NEAREST ROAD JUNCTION

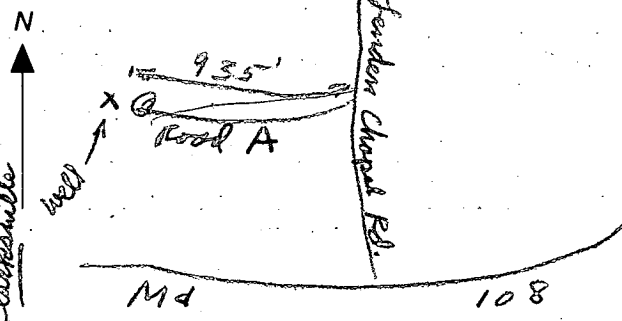

Not to be filled in by driller (OEP USE ONLY)

APPROP. PERMIT NUMBER GAP

FORCE INITIALS PERMIT No. HO-81-2556

SPECIAL CONDITIONS TO BE CONVERTED TO DRINKING WELL UPON FINAL PLAT APPROVAL

① 32 ft open hole

② 9 bags

③ 37 ft pipe

④ arrows late 12 20 for

a 930 grant. Out information
from Judy who was testing yield

B/H
2/29/88

C1 2174 SEQUENCE NO. (OEP USE ONLY)
1 2 3 6
(THIS NUMBER IS TO BE PUNCHED IN COLS. 3-6 ON ALL CARDS)

STATE OF MARYLAND WELL COMPLETION REPORT
FILL IN THIS FORM COMPLETELY PLEASE PRINT OR TYPE

THIS REPORT MUST BE SUBMITTED WITHIN 45 DAYS AFTER WELL IS COMPLETED:
COUNTY NUMBER A 39479

DATE Received [] DATE WELL COMPLETED 022988 Depth of Well 22 225 26 (TO NEAREST FOOT) PERMIT NO. FROM "PERMIT TO DRILL WELL" H10-81-2556

OWNER DEVELOPMENT NEWBURN
STREET OR RFD CHAPEL WOODS COURT TOWN
SUBDIVISION CHAPEL WOODS SECTION 2 AREA 3 LOT 24

WELL LOG
Not required for driven wells
STATE THE KIND OF FORMATIONS PENETRATED, THEIR COLOR, DEPTH, THICKNESS AND IF WATER BEARING

DESCRIPTION (Use additional sheets if needed)	FEET		Check if water bearing
	FROM	TO	
SAND	0	33	
Concretion rock	33	225	

GROUTING RECORD
WELL HAS BEEN GROUTED (Circle Appropriate Box) YES [Y] NO [N]
TYPE OF GROUTING MATERIAL CEMENT [CM] BENTONITE CLAY [BC]
NO. OF BAGS 9 NO. OF POUNDS 846
GALLONS OF WATER 24
DEPTH OF GROUT SEAL (to nearest foot) from 0 ft. to 32 ft.

CASING RECORD
casing types insert appropriate code below
STEEL [ST] CONCRETE [CO] PLASTIC [PL] OTHER [OT]
MAIN CASING TYPE SH Nominal diameter 60 61 top (main) casing (nearest inch) 63 64 Total depth of main casing (nearest foot) 66 67 32 70

OTHER CASING (if used) diameter inch depth (feet) from to

SCREEN RECORD
screen type or open hole insert appropriate code below
STEEL [ST] BRASS [BR] OPEN HOLE [HO] PLASTIC [PL] OTHER [OT]

DEPTH (nearest ft.)
EACH SCREEN 1 H10 35 225
2
3
SLOT SIZE 1 2 3
DIAMETER OF SCREEN [] (NEAREST INCH) 56 60

PUMPING TEST
HOURS PUMPED (nearest hour) 3
PUMPING RATE (gal. per min. to nearest gal.) 7 1/2
METHOD USED TO MEASURE PUMPING RATE Bucket
WATER LEVEL (distance from land surface) BEFORE PUMPING 43 WHEN PUMPING 115
TYPE OF PUMP USED (for test) [A] air [P] piston [T] turbine [C] centrifugal [R] rotary [O] other (describe below) [J] jet [S] submersible

PUMP INSTALLED
DRILLER WILL INSTALL PUMP YES [NO]
IF DRILLER INSTALLS PUMP, THIS SECTION MUST BE COMPLETED FOR ALL WELLS EXCEPT HOME USE
TYPE OF PUMP INSTALLED PLACE (A,C,J,P,R,S,T,O) IN BOX - SEE ABOVE: []
CAPACITY: GALLONS PER MINUTE (to nearest gallon) []
PUMP HORSE POWER []
PUMP COLUMN LENGTH (nearest ft.) []
CASING HEIGHT (circle appropriate box and enter casing height) []
LAND SURFACE [] (nearest foot)

CIRCLE APPROPRIATE LETTER
A A WELL WAS ABANDONED AND SEALED WHEN THIS WELL WAS COMPLETED
E ELECTRIC LOG OBTAINED
P TEST WELL CONVERTED TO PRODUCTION WELL

I HEREBY CERTIFY THAT THIS WELL HAS BEEN CONSTRUCTED IN ACCORDANCE WITH COMAR 10.17.13 "WELL CONSTRUCTION" AND IN CONFORMANCE WITH ALL CONDITIONS STATED IN THE ABOVE CAPTIONED PERMIT, AND THAT THE INFORMATION PRESENTED HEREIN IS ACCURATE AND COMPLETE TO THE BEST OF MY KNOWLEDGE.

DRILLERS IDENT. NO. 238
DRILLERS SIGNATURE Joseph A. Mayne

SITE SUPERVISOR (sign. of driller or journeyman responsible for sitework if different from permittee)

GRAVEL PACK []
IF WELL DRILLED WAS FLOWING WELL INSERT F IN BOX 68 []

OEP USE ONLY (NOT TO BE FILLED IN BY DRILLER)
T (E.R.O.S.) [] WQ []
TELESCOPE CASING [] LOG INDICATOR [] OTHER DATA []

LOCATION OF WELL ON LOT
SHOW PERMANENT STRUCTURE SUCH AS BUILDING, SEPTIC TANKS, AND/OR LANDMARKS AND INDICATE NOT LESS THAN TWO DISTANCES (MEASUREMENTS TO WELL)
See attached well sites