

PERMIT

SEWAGE DISPOSAL SYSTEM

DEPARTMENT OF HEALTH AND MENTAL HYGIENE

P 48086

A REPAIR

DISTRICT _____

DATE 5-7-92

HOWARD COUNTY HEALTH DEPARTMENT
BUREAU OF ENVIRONMENTAL HEALTH
461-9933

INDEXED
no new septic system

DATE SYSTEM APPROVED _____

INSPECTOR BH

Roy A. Bauman Company IS PERMITTED TO INSTALL _____ ALTER

ADDRESS 5750 Furnance Avenue, Elkridge, Maryland 21227 PHONE 796-2515

SUBDIVISION _____ LOT _____ ROAD 7211 Montgomery Road

PROPERTY OWNER Michael McMullen

ADDRESS 7211 Montgomery Road
Elkridge, Maryland 21227

SEPTIC TANK CAPACITY _____ GALLONS

NUMBER OF BEDROOMS _____

_____ SQUARE FEET PER BEDROOM

LINEAR FEET OF TRENCH REQUIRED _____

Sealed tank

REPAIR - PURPOSE - TO REPAIR EXISTING FAILING SEPTIC SYSTEM.

Call for inspection when ground is opened so sanitarian can recommend repair.

PLANS APPROVED BY _____ DATE _____

COVER NO WORK UNTIL INSPECTED AND APPROVED

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM

NOTE: CLEANOUT REQUIRED EVERY 70 FEET OF SEWER LINE AND/OR AT 90° SWEEPS IN LINES FROM HOUSE TO DRAIN FIELDS, 90° ELBOWS NOT ACCEPTABLE.

NOTE: ALL PARTS OF SEPTIC SYSTEMS (I.E. TANK, DISTRIBUTION BOX TRENCHES) TO BE 100 FEET FROM WELL (UNLESS OTHERWISE SPECIFICALLY AUTHORIZED)

NOTE: IF DEEP TRENCH(ES) ARE USED CALL FOR INSPECTION BEFORE AND AFTER PLACING GRAVEL IN TRENCH(ES)

NOTE: NO DRY WELL SHALL EXCEED 15 FOOT IN DIAMETER NO ABSORPTION TRENCH TO EXCEED 100 FEET IN LENGTH

NOTE: ALL PIPE FROM HOUSE TO SEPTIC TANK MUST BE CAST IRON OR SCHEDULE 35/40 PVC OR ABS


PERMIT VOID AFTER TWO YEARS

NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL STAND PIPES MUST BE 6 INCHES IN DIAMETER CAST IRON. CONCRETE OR TERRA COTTA OR PVA OR ABS ACCEPTED. IF TOP OF SEPTIC TANK IS DEEPER THAN 3 FEET. MANHOLE TO GRADE REQUIRED.

NOTE: DISTRIBUTION BOXES MUST HAVE BAFFLES

***INSTALLER IS RESPONSIBLE FOR OBTAINING FINAL APPROVAL ON THIS PERMIT**

48086

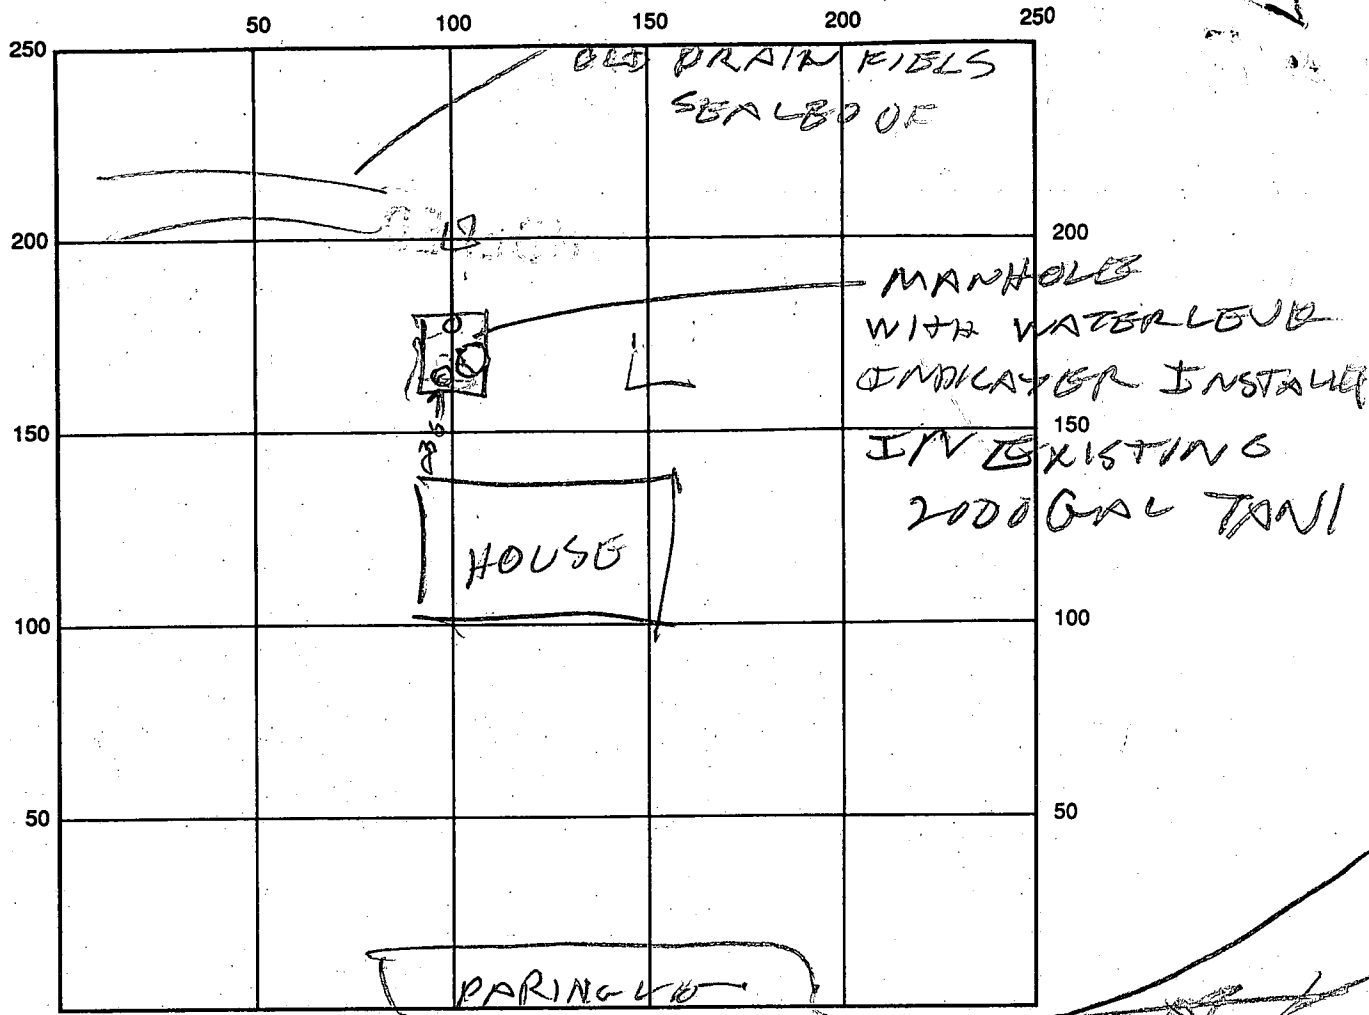

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE

SEPTIC TANK LEVEL _____ CLEANOUTS _____

DISTRIBUTION BOX LEVEL _____

DRAIN FIELD/TITLE DEPTH _____ FT. TRENCH WIDTH _____ FT. INLET DEPTH _____ FT.

EFFECTIVE GRAVEL DEPTH _____ FT. TOTAL LENGTH _____ FT.

NUMBER OF TRENCHES _____ ONE SIDEWALL/BOTTOM AREA _____ SQ. FT.

DRYWALL INSIDE DIAMETER _____ FT. EFFECTIVE DEPTH BELOW INLET _____ FT.

ABSORBENT AREA _____ SQ. FT.

REMARKS: 6/4/92 from 6/3/88 6/4/92 Home
 Visual holes dug & were poor. It
 may be possible to have a pump up trench
 system but it would be very expensive
 Public Sewer may be available in
 2-5 years R/T

DATE SYSTEM APPROVED 6/4/92 INSPECTOR Raymond Hodges
 Sheet with Visual Holes Messing



HOWARD COUNTY HEALTH DEPARTMENT

Joyce M. Boyd, M.D., County Health Officer

June 8, 1992

Reply to: 313-2640

Mr. Michael McMullen
7211 Montgomery Road
Elkridge, Maryland 21227

RE: Holding Tank Septic System Repair
7211 Montgomery Road

Dear Mr. McMullen:

Percolation testing for septic system repair conducted June 3, 1992 revealed soil conditions which were marginal at best.

Septic system repair in such conditions would have been costly and unreliable. As a reasonable alternative, approval was granted to permit a temporary conversion to a septic holding tank, with no on-site discharge, until such time as public sewer becomes available to the property. Contents of the holding tank are to be pumped, as often as necessary, by a licensed scavenger and taken to the appropriate county treatment facility.

Please be advised that there is process for application for exemption to certain discharge fees when the discharge is from an authorized septic holding tank. You may be interested in contacting the treatment plant (313-2070) to discuss applicability to your situation.

DDN
LIGW'S #

If you have any questions relative to this matter, please call me at 313-2640.

Very truly yours,

Craig Williams, Program Director
Water and Sewerage Program

WRONG NUMBER
SHOULD BE
792-7020

DON LIGU
will

Relay

CONNECT
TO

McMullen

CW:jr

cc: Roy Bauman Company
File

for Jane Nadeau
Jen



DEPARTMENT OF PUBLIC WORKS

James M. Irvin, Director

April 27, 1992

Mr. Michael McMullen
7211 Montgomery Road
Elkridge, Maryland 21227

Subject: Sewer Service Inquiry
7211 Montgomery Road

Dear Mr. McMullen,

I am writing in response to Mr. Roy Bauman's inquiry regarding sewer service to your property located at 7211 Montgomery Road. We have reviewed the plans on the existing sewer system in the area. In order to serve your property, the sewer would be required to be extended from the area of US Route 1 north along Montgomery Road to your property. The extension would require a capital project for the acquisition of the necessary easements for construction of the sewer. If you wish the sewer extended to serve your property, please provide a written request to:

Mr. William E. Riley, Chief
Bureau of Engineering
3450 Court House Drive
Ellicott City, Maryland 21043

The letter should state that you are requesting sewer service, give the address of the property to be served and be signed by the property owner.

New capital projects are considered each year in the capital budget process. A capital project request received at this time would be considered in the 1994 fiscal year budget with funds becoming available in July 1993.


If you request a capital project for a sewer extension at this time, your request will be brought before the Public Works Board in January 1993. If the project receives the approval of the Public Works Board, the project will be considered by the Planning Board and finally the County Council. All interested persons will be given an opportunity to speak on the proposed project at each of these public meetings.

If the project receives the approval of the Public Works Board, Planning Board and County Council, funds for the design and construction of the sewer main will become available in July 1993. Barring any unforeseen difficulties in acquiring the necessary easements, construction of the sewer main to serve your property should be completed within 18 months after the project funds are made available.

Enclosed for your information is a question and answer sheet with some frequently asked questions regarding connections to water and sewer.

If you have any questions concerning the information provided, please do not hesitate to contact me at 992-2070.

Very truly yours,

A handwritten signature in cursive script that reads "Don Lieu". The signature is written in black ink and is positioned above the typed name and title.

Don Lieu, Chief
Utility Design Division
Bureau of Engineering

DL/a
Enclosure
cc: Roy A. Bauman