

44110 05421810

LAYOUT 11³⁰ AM 10/7 INSP 4 3pm 10/17 P&A
INSP 2 10/6/03 - 2 PM INSP 5 2:30 pump 10/22/03
INSP 3 10/9/03 - 2 PM INSP 6 _____

ISSUE DATE: 8/28/03
8/28/2003

APPROVAL DATE: 11/4/04

PERMIT INDEXED

P 519098

A 49455-A

ON-SITE SEWAGE DISPOSAL SYSTEM HOWARD COUNTY HEALTH DEPARTMENT BUREAU OF ENVIRONMENTAL HEALTH

South Carroll Backhoe, Inc. _____ INS PERMITTED TO INSTALL ALTER

ADDRESS: 4410 Salem Bottom Rd., Westminster PHONE NUMBER: 410-875-4197

SUBDIVISION: PATERNAL GIFT FARM LOT NUMBER: 15

ADDRESS: 13516 PATERNAL GIFT DRIVE PROPERTY OWNER: STEVE ROBINSON

SEPTIC TANK CAPACITY (GALLONS): 2250 OUTLET BAFFLE FILTER REQUIRED

PUMP CHAMBER CAPACITY (GALLONS): 2606^{TD}
2250 COMPARTMENTED TANK REQUIRED

NUMBER OF BEDROOMS: 7

SQUARE FEET PER BEDROOM: 180

LINEAR FEET OF TRENCH REQUIRED: 315

TRENCHES:	Trench to be 2.0 feet wide. Inlet 4.0 feet below original grade. Bottom maximum depth 8.0 feet below original grade. Effective area begins at 4.0 feet below original grade. 4.0 feet of stone below distribution pipe.
LOCATION:	Place distribution box as shown on plan. Install trenches as shown on plan with 9 foot separation edge-to-edge.
NOTES:	As a result of minimum space, the tank and pump pit should be poured in place. Ejector pit required to allow basement service. High water alarm required. All parts of septic system that go under driveway must be sleeved.

PLANS APPROVED: John Boris OK MR DATE: 12/24/2002

NOTE: PERMIT VOID AFTER 2 YEARS
NOTE: CONTRACTOR RESPONSIBLE FOR SCHEDULING A PRE-CONSTRUCTION INSPECTION FOR ALL INSTALLATIONS
NOTE: WATERTIGHT SEPTIC TANKS REQUIRED
NOTE: ALL PARTS OF SEPTIC SYSTEM SHALL BE 100 FEET FROM ANY WATER WELL
NOTE: MANHOLE RISERS REQUIRED ON ALL SEPTIC TANKS AND PUMP CHAMBERS UNLESS SPECIFICALLY NOTED OTHERWISE

**BUILDING PERMIT SIGNED
AND RETURNED**

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM PERMITTEE RESPONSIBLE FOR OBTAINING FINAL APPROVAL ON THIS PERMIT CALL 410-313-2640 FOR INSPECTION OF SEPTIC SYSTEM


11/26/03 B 00145258, Pool, Pool House, JAKUZZI

10/22 Still NEED to test alarm when electric in house.
10-1-03 Ingr. pool 44320 (KN)

WPI Approved 11-8-04 (BB)
BP - House - 12/24/02 139588

A4 94455A

NOT TO SCALE

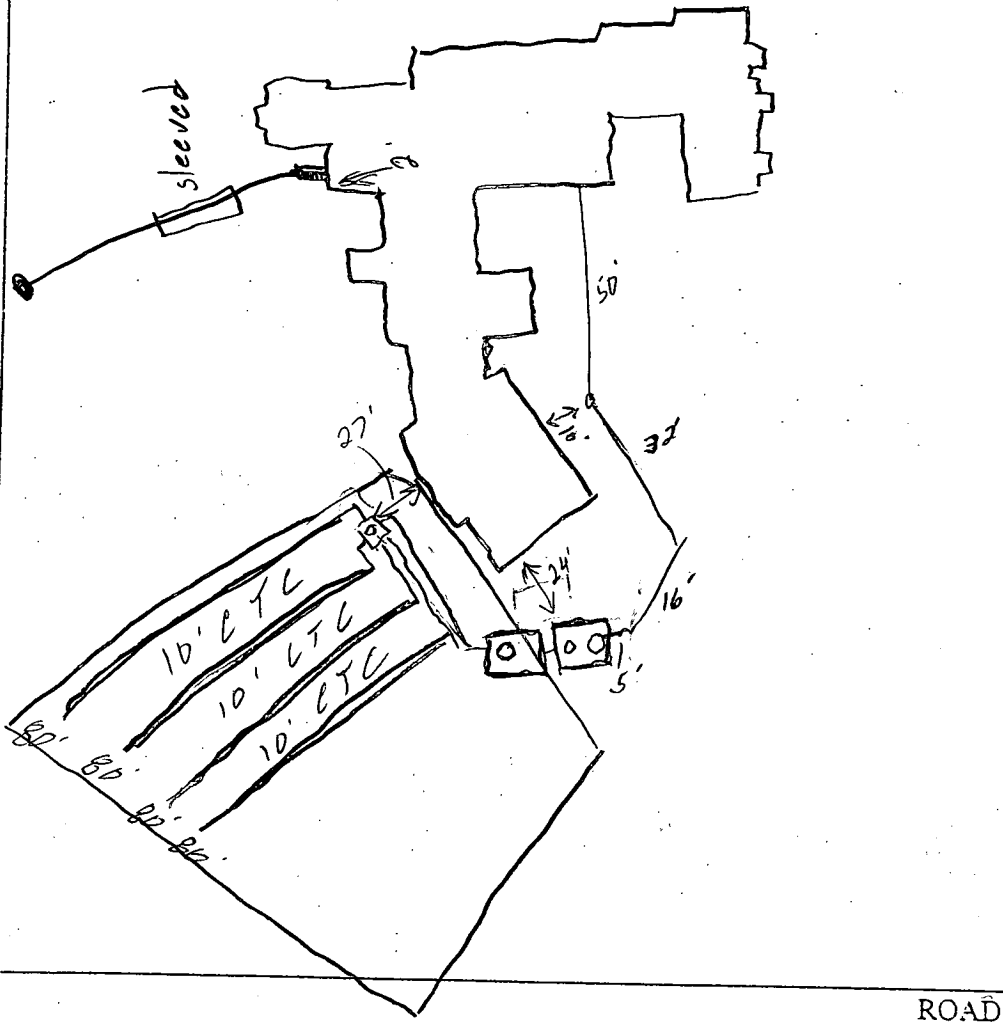

TRENCH/DRAINFIELD DATA		
WIDTH	INLET	BOTTOM
2'	4'	8'
NUMBER OF TRENCHES		4
TOTAL LENGTH		320'
ABSORPTION AREA		1260 0
DISTRIBUTION BOX LEVEL		✓
DISTRIBUTION BOX BAFFLE		✓
DISTRIBUTION BOX PORT		✓

SEPTIC TANK DATA	
SEPTIC TANK 1 LEVEL	✓
CAPACITY	2000 GAL
SEAM LOC	Top
TANK LID DEPTH	2.5'
BAFFLES	✓
BAFFLE FILTER	—
MANHOLE LOC	Front
6" PORT LOC	—
WATERTIGHT TEST	—
SEPTIC TANK 2 LEVEL	✓
CAPACITY	2000 GAL
SEAM LOC	Top
TANK LID DEPTH	2.5'
BAFFLES	✓
BAFFLE FILTER	—
MANHOLE LOC	Back
6" PORT LOC	Front
WATERTIGHT TEST	✓

PRE-CONSTRUCTION 10/7/03 - SRA staked, berm & walk way in SRA. Dug hole in berm to confirm original grade undisturbed.

INSTALLATION Install (4) 80' trench per BP - 9' LTC (50)

10/8/03 - S.T. set, 1 trench installed (50)

10/9/03 - Ok to cover all work. Pump & Alarm (50)

10/17/03 Not Ready (50)


10/22/03 Pump working. Contractor said 50 wanted to see water reach d. box. No electricity in house nor breaker box; just wanted ok to cover d. box. Will call final pump inspect, after electric in for alarm test. I told contractor pump & alarm on sep. breakers. (KN)

FINAL INSPECTOR B. Baker DATE OF APPROVAL 11/4/04

11/4/04 Alarm working but installed in garage. Told builder that we prefer it to be installed inside house. (BB)

GENERAL NOTES:

- 1) THIS LOCATION DRAWING IS PREPARED FOR THE BENEFIT OF THE CLIENT SIGNING THE HOUSE LOCATION SURVEY APPROVAL FORM INsofar AS IT IS REQUIRED BY A LENDER OR TITLE INSURANCE COMPANY OR ITS AGENTS IN CONNECTION WITH THE COMTEMPLATED TRANSFER, FINANCING OR REFINANCING OF THE PROPERTY SHOWN HEREON. UNLESS INDICATED AS BEING A BOUNDARY SURVEY, THIS LOCATION DRAWING IS NOT INTENDED FOR USE IN THE ESTABLISHMENT OF PROPERTY LINES AND IS NOT TO BE RELIED UPON FOR THE ESTABLISHMENT OR LOCATIONS OF FENCES, GARAGES, BUILDINGS OR OTHER EXISTING OR FUTURE IMPROVEMENTS. AS A RESULT, THIS LOCATION DRAWING DOES NOT PROVIDE FOR ACCURATE IDENTIFICATION OF PROPERTY LINES, BUT SUCH IDENTIFICATION MAY NOT BE REQUIRED FOR THE TRANSFER OF TITLE OR SECURING FINANCING FOR RE-FINANCING.
- 2) SUBJECT PROPERTY IS SHOWN IN ZONE C ON THE NATIONAL FLOOD INSURANCE PROGRAM FLOOD INSURANCE RATE MAP OF HOWARD COUNTY, MARYLAND, COMMUNITY PANEL No. 2400440037.B EFFECTIVE DEC. 4, 1995.
- 3) THE OFFSETS FROM BUILDING LINE TO PROPERTY LINE AS SHOWN ON THE PLAT HEREON ARE TO AN ACCURACY OF PLUS OR MINUS 0.1' (±).
- 4) NO TITLE REPORT FURNISHED. SUBJECT TO ALL EASEMENTS, RIGHTS OF WAY AND CONDITIONS OF RECORD.
- 5) SEPTIC AREA REVISED BY HOWARD COUNTY HEALTH DEPT. NOVEMBER 18, 2002.

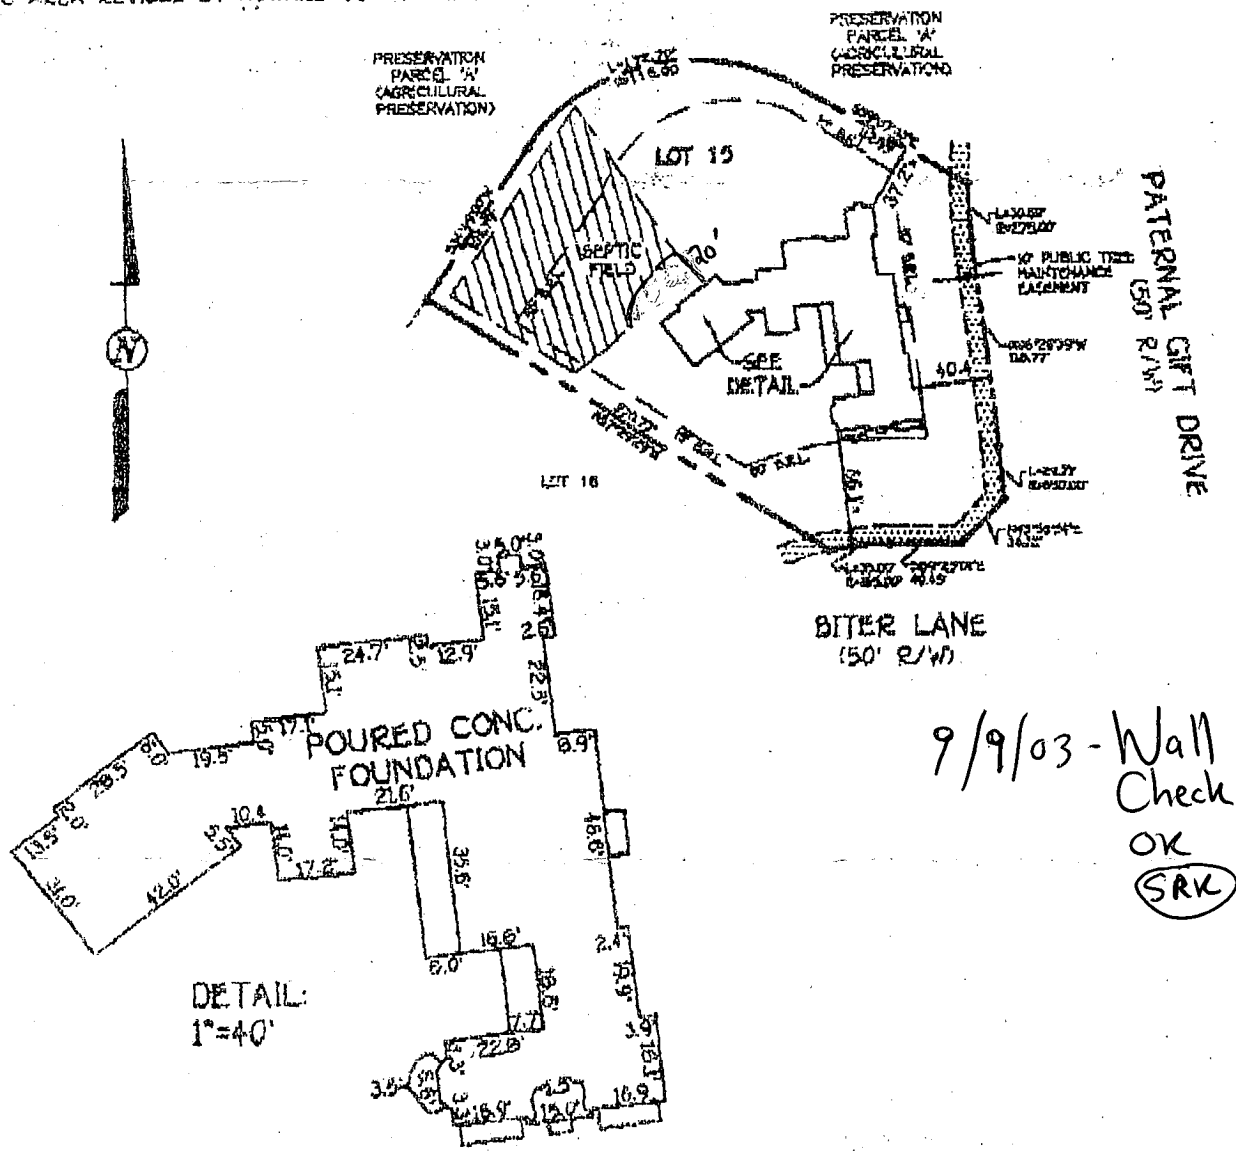

LOT 15
 PATERNAL GIFT FARM
 LOTS 1 - 28
 AND PRESERVATION PARCEL 'A'
 FIFTH ELECTION DISTRICT
 HOWARD COUNTY, MARYLAND
 PLAT REF. 11969

B.R.L. = BUILDING RESTRICTION LINE
 TOP OF FOUNDATION ELEV. 538.5'


FISHER, COLLINS & CARTER, INC.
 CIVIL ENGINEERING CONSULTANTS & LAND SURVEYORS
 CENTENNIAL SQUARE OFFICE PARK - 12772 BALTHAZAR NATIONAL PkE
 ELLESMERE CITY, MARYLAND 21042
 (410) 481-2272

STATE OF MARYLAND
 PROFESSIONAL SURVEYOR
 REG. 502
 DATE 6/15/03

HOUSE LOCATION DRAWING

FOUNDATION LOCATION: 5/21/03
 FINAL LOCATION: _____
 BOUNDARY SURVEY: _____

SCALE: 1"=100'
 DATE: 6/15/03
 DRAWN BY: A.K.D.
 CHECKED BY: S.R.K.
 PROJECT No. 61803

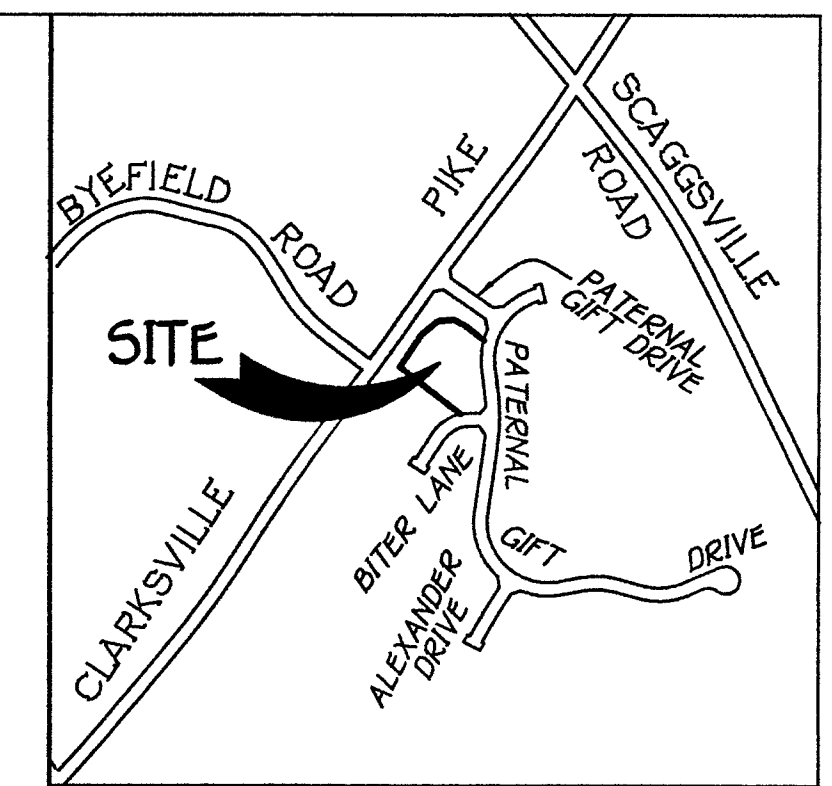


VICINITY MAP
SCALE: 1" = 2,000'


LEGEND	
SYMBOL	DESCRIPTION
---	EXISTING CONTOUR 2' INTERVAL
- - - -	PROPOSED CONTOUR
+362.5	SPOT ELEVATION
-55F-56F	SUPER SILT FENCE
-SF-SF	SILT FENCE
ECH	EROSION CONTROL MATTING
L.O.D.	LIMIT OF DISTURBANCE
---	EXISTING STREET

GENERAL NOTES

1. REFERENCE PLAT NUMBER 11969
2. LIMIT OF DISTURBED AREA: 29,456 SF
3. LENGTH OF TRENCHES TO BE DETERMINED AT TIME OF PERMIT ISSUANCE. 1000 LF TOTAL SHOWN ON PLAN
4. EXISTING TOPOGRAPHY WAS FIELD RUN BY FISHER, COLLINS AND CARTER, INC. IN OCTOBER 2002.
5. TOTAL SEPTIC EASEMENT AREA: 11,260 SF
6. SLEEVE ALL SEWER HOUSE CONNECTIONS LOCATED UNDER DRIVRWAY.
7. EJECTOR PUMP REQUIRED IN BASEMENT.
8. LIMIT OF DISTURBED AREA: 29,672 SF

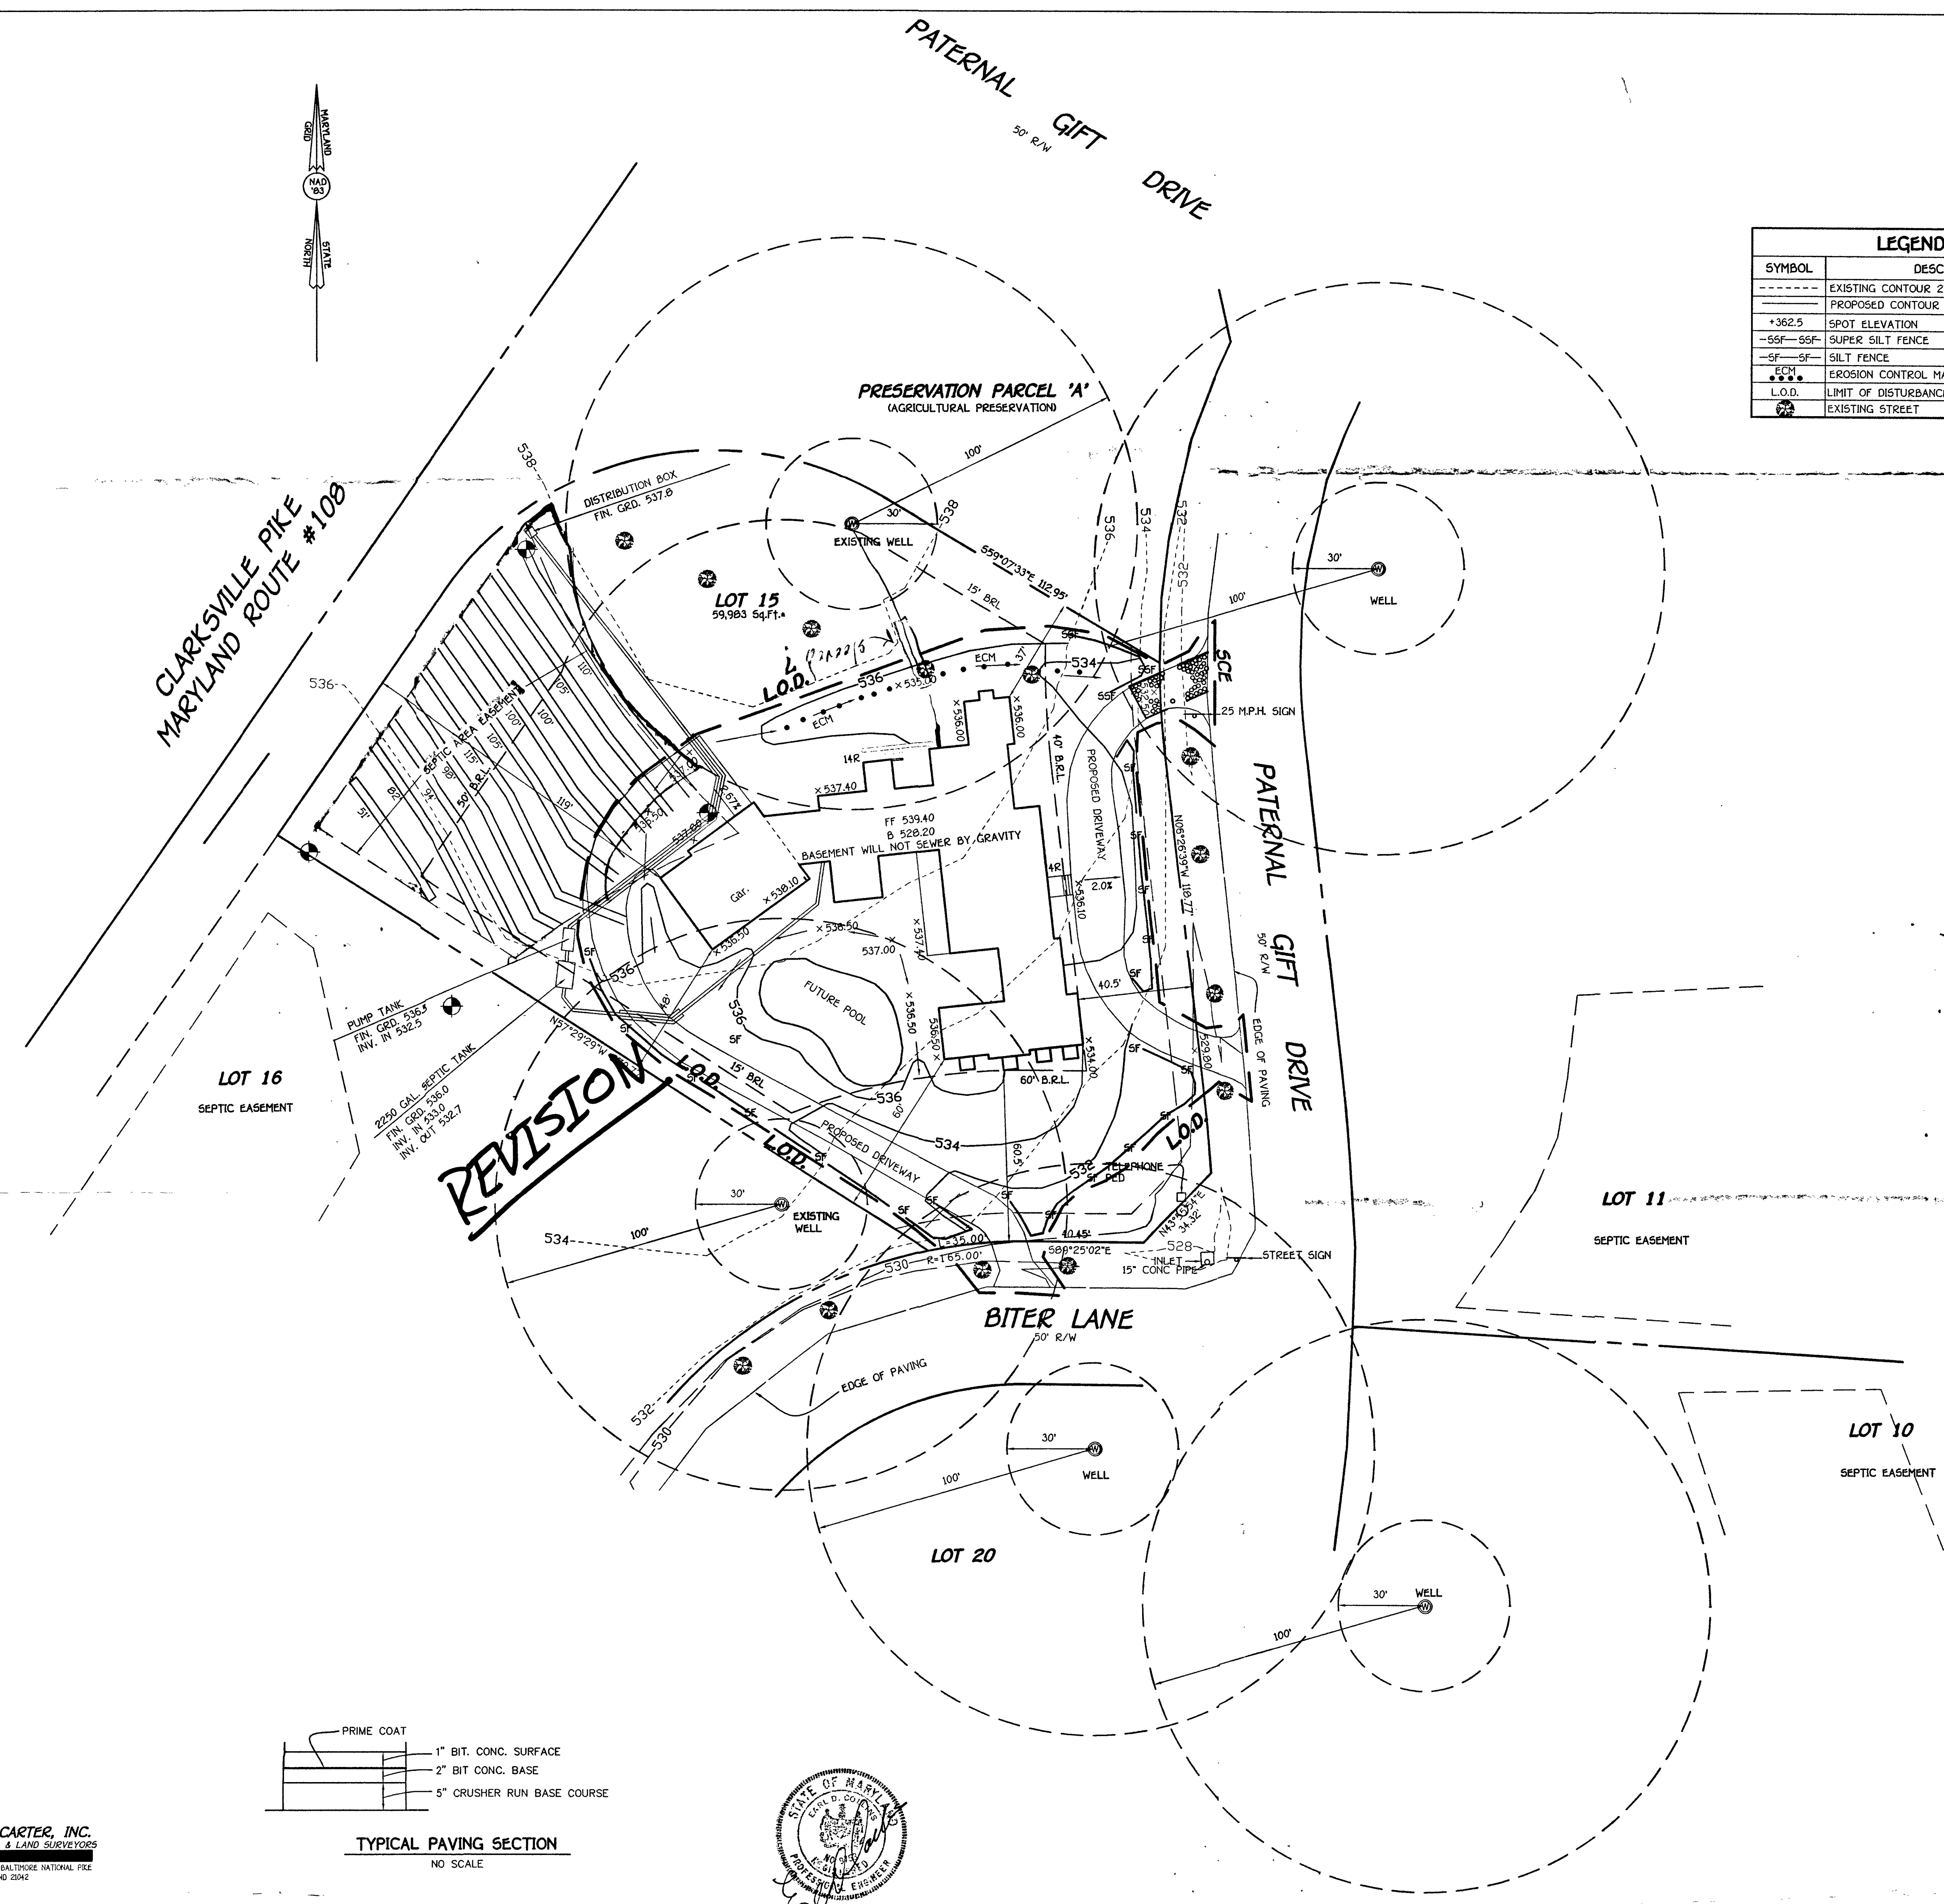

REVISION

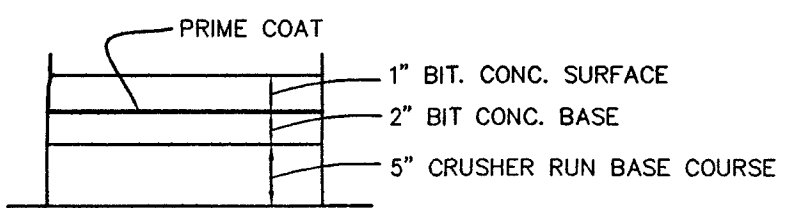

TYPICAL PAVING SECTION
NO SCALE



FISHER, COLLINS & CARTER, INC.
CIVIL ENGINEERING CONSULTANTS & LAND SURVEYORS
CENTENNIAL SQUARE OFFICE PARK - 10272 BALTIMORE NATIONAL PIKE
ELLCOTT CITY, MARYLAND 21042
1000 MI - 2000

BUILDER
PINECREST BUILDERS
13405 DOVE STREET
SILVER SPRING, MD. 20904

OWNER
STEVE & JEANNE ROBINSON
5313 KERGER ROAD
ELLCOTT CITY, MD. 21043

REVISED
Date: 1-31-03
13516 Paternal Gift Farm
Comments: *Boo3588*
move house + enlarge
garage w/ basketball court
under garage

PLOT PLAN
SINGLE FAMILY DETACHED
13516 PATRNL GIFT DRIVE
PATERNAL GIFT FARM
LOT 15
ZONED:RR TAX MAP NO. 40
FIFTH ELECTION DISTRICT, HOWARD COUNTY, MARYLAND
SCALE: 1" = 30' DATE: NOVEMBER, 2002
SHEET 1 OF 1 REVISED JANUARY 23, 2003

I:\Drawings\330456 Paternal Gift Farm - Sched\16180361803 LOT 15 PLOT PLAN.dwg, 01/23/03 03:31:09 PM

50:14 6-11-03

C1 08020

SEQUENCE NO. (MDE USE ONLY)

STATE OF MARYLAND WELL COMPLETION REPORT

FILL IN THIS FORM COMPLETELY PLEASE TYPE

THIS REPORT MUST BE SUBMITTED AFTER WELL IS COMPLETED.

COUNTY NUMBER A49455A

ST/CO USE ONLY DATE RECEIVED MM DD YY

DATE WELL COMPLETED

Depth of Well

PERMIT NO. FROM "PERMIT TO DRILL WELL" HO-94-2840

OWNER Scheidt & Susan last name first name STREET OR RFD PATERNAL GIFT DR. TOWN Highland SUBDIVISION Paternal Gift Farm SECTION LOT 15

WELL LOG Not required for driven wells

GROUTING RECORD WELL HAS BEEN GROUTED (Circle Appropriate Box) YES (Y) NO (N)

C3 PUMPING TEST

STATE THE KIND OF FORMATIONS PENETRATED, THEIR COLOR, DEPTH, THICKNESS AND IF WATER BEARING

TYPE OF GROUTING MATERIAL (Circle one) CEMENT (CM) BENTONITE CLAY (BC)

HOURS PUMPED (nearest hour) 3

Table with columns: DESCRIPTION, FEET (FROM, TO), check if water bearing. Rows include Topsoil, Sandy clay, Soapstone, Tan mica, Gray mica, Red mica, Gray Red, White mica.

NO. OF BAGS 45 NO. OF POUNDS 4500 GALLONS OF WATER 270 DEPTH OF GROUT SEAL (to nearest foot) from 0 ft. to 80 ft.

PUMPING RATE (gal. per min.) 12. METHOD USED TO MEASURE PUMPING RATE Bucket

CASING RECORD casing types insert appropriate code below ST STEEL CO CONCRETE PL PLASTIC OT OTHER

WATER LEVEL (distance from land surface) BEFORE PUMPING 48 ft. WHEN PUMPING 122 ft.

MAIN CASING TYPE Nominal diameter top (main) casing (nearest inch)! Total depth of main casing (nearest foot) ST 6 180

TYPE OF PUMP USED (for test) A air P piston T turbine C centrifugal R rotary O other (describe below) J jet S submersible

OTHER CASING (if used) diameter inch depth (feet) from to

PUMP INSTALLED DRILLER INSTALLED PUMP (CIRCLE) (YES or NO) YES (NO)

NUMBER OF UNSUCCESSFUL WELLS 0

DEPTH (nearest ft.) 98 300

PUMP COLUMN LENGTH (nearest ft.) 43 47

WELL HYDROFRACTURED YES (Y) NO (N)

SCREEN RECORD screen type or open hole ST STEEL BR BRASS HO OPEN HOLE PL PLASTIC OT OTHER

CASING HEIGHT (circle appropriate box and enter casing height) + above - below LAND SURFACE 2 (nearest foot)

CIRCLE APPROPRIATE LETTER A A WELL WAS ABANDONED AND SEALED WHEN THIS WELL WAS COMPLETED E ELECTRIC LOG OBTAINED P TEST WELL CONVERTED TO PRODUCTION WELL

SLOT SIZE 1 2 3 DIAMETER OF SCREEN (NEAREST INCH) from 56 to 60

LOCATION OF WELL ON LOT SHOW PERMANENT STRUCTURES AND INDICATE NOT LESS THAN TWO DISTANCES (MEASUREMENTS TO WELL) Lot 15

I HEREBY CERTIFY THAT THIS WELL HAS BEEN CONSTRUCTED IN ACCORDANCE WITH COMAR 26.04.04 "WELL CONSTRUCTION" AND IN CONFORMANCE WITH ALL CONDITIONS STATED IN THE ABOVE CAPTIONED PERMIT, AND THAT THE INFORMATION PRESENTED HEREIN IS ACCURATE AND COMPLETE TO THE BEST OF MY KNOWLEDGE.


GRAVEL PACK IF WELL DRILLED WAS FLOWING WELL INSERT F IN BOX 68

DRILLERS LIC. NO. MW D 040 Design F. Easterday DRILLERS SIGNATURE LIC. NO. 1 MW D 501

MDE USE ONLY (NOT TO BE FILLED IN BY DRILLER) T (E.R.O.S.) W Q 70 72 74 75 76

SITE SUPERVISOR (sign. of driller or journeyman responsible for sitework if different from permittee)

TELESCOPE CASING LOG INDICATOR OTHER DATA

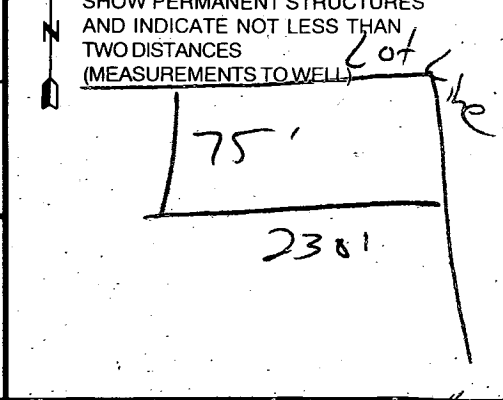

B 1 01446 SEQUENCE NO. (MDE USE ONLY) 8370


STATE OF MARYLAND PERMIT TO DRILL WELL W514191 please print or type

STATE PERMIT NUMBER HO-94-2840 fill in this form completely

OWNER INFORMATION Date Received (APA) 8/16/00 Scheidt Susan 12730 Hall Shop Highland, Md. 20777

LOCATION OF WELL HOWARD Paternal Gift Farm Highland NEAREST TOWN

DRILLER INFORMATION George F. Easterday MWD 040 L. Franklin Easterday, Inc. 9265 Brown Church Rd., MT. Airy, Md. 21771

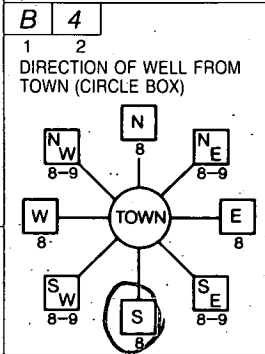

DIRECTION OF WELL FROM TOWN (CIRCLE BOX) NEAR WHAT ROAD Paternal Gift Dr or Bitterline ON WHICH SIDE OF ROAD (CIRCLE APPROPRIATE BOX) DISTANCE FROM ROAD 40 FT. TAX MAP: 40 BLK: 10 PARCEL 90

WELL INFORMATION APPROX. PUMPING RATE 5 (GAL. PER MIN.) AVERAGE DAILY QUANTITY NEEDED 500 (GAL. PER DAY)

NOT TO BE FILLED IN BY DRILLER HEALTH DEPARTMENT APPROVAL HOWARD A 49455A COUNTY NAME COUNTY NO. STATE SIGNATURE DATE ISSUED 9/6/00 CO SIGNATURE EXP. DATE 9/6/01 NORTH GRID 488 000 EAST GRID 10812 000


USE FOR WATER (CIRCLE APPROPRIATE BOX) DOMESTIC POTABLE SUPPLY & RESIDENTIAL IRRIGATION FARMING (LIVESTOCK WATERING & AGRICULTURAL IRRIGATION) INDUSTRIAL, COMMERCIAL, DEWATERING PUBLIC WATER SUPPLY WELL TEST, OBSERVATION, MONITORING GEO-THERMAL

APPROXIMATE DEPTH OF WELL 300 FEET APPROXIMATE DIAMETER OF WELL 6 INCH NEAREST

SHOW MAJOR FEATURES OF BOX & LOCATE WELL WITH AN X SOURCES OF DRILLING WATER 1. wells 2. 3. WRITE THE BOX NUMBER FROM THE MAP HERE E 8102 N 4808

METHOD OF DRILLING (circle one) BORED (or Augered) JETTED Jetted & DRIVEN AIR-ROTary AIR-Percussion ROTARY (Hydraulic Rotary) CABLE REVERSE-ROTary Drive POINT other

REPLACEMENT OR DEEPEMED WELLS (CIRCLE APPROPRIATE BOX) THIS WELL WILL NOT REPLACE AN EXISTING WELL THIS WELL WILL REPLACE A WELL THAT WILL BE ABANDONED AND SEALED THIS WELL WILL REPLACE A WELL THAT WILL BE USED AS A STANDBY-CONTACT LOCAL APPROVING AUTHORITY FOR POLICY ON STANDBY WELLS THIS WELL WILL DEEPEM AN EXISTING WELL PERMIT NUMBER OF WELL TO BE REPLACED OR DEEPEMED (IF AVAILABLE) 41

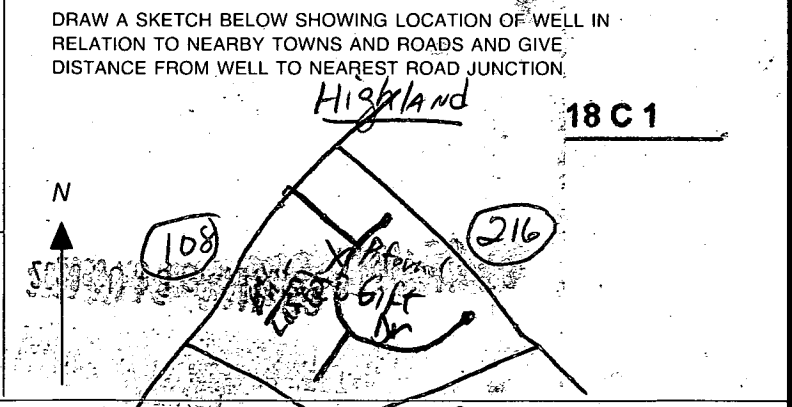

Not to be filled in by driller (MDE OR COUNTY USE ONLY) APPROP. PERMIT NUMBER Ho 96 GAP 007 PERMIT No. HO-94-2840

SPECIAL CONDITIONS NOTE - APPROVING AUTHORITIES SHOULD USE SEPARATE SHEET IF NEEDED

APPLICATION

PERCOLATION TESTING

No Fee Paid for this lot
used to pay Parcel # 29
A 49455A

P _____

HOWARD COUNTY HEALTH DEPARTMENT
BUREAU OF ENVIRONMENTAL HEALTH
3525-H ELLICOTT MILLS DRIVE/ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 313-2640

DISTRICT _____

DATE _____

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I HEREBY APPLY FOR THE NECESSARY TEST PRIOR TO APPLICATION FOR PERMIT TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER Scheidt

ADDRESS _____ PHONE _____

AGENT OR PROSPECTIVE BUYER _____

ADDRESS _____ PHONE _____

PROPERTY LOCATION:

SUBDIVISION Paternal Gift LOT NO. 15 Parcel 15 (o.d.A)

ROAD AND DESCRIPTION _____

TAX MAP 40 PARCEL # 396,178,+90

SIZE OF LOT _____ TYPE BLDG. _____
(SINGLE FAMILY DWELLING OR COMMERCIAL)

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE. I FULLY UNDERSTAND THE FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER ANY CIRCUMSTANCES. I ALSO AGREE TO COMPLY WITH ALL M.O.S.H.A. REQUIREMENTS IN TESTING THIS LOT.

(SIGNATURE OF APPLICANT)

APPROVED BY _____ FOR _____ DATE _____

DISAPPROVED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____

REASONS FOR REJECTION OR HOLDING _____

PERCOLATION TEST PLAT/PRELIMINARY PLAT - TITLE OR I.D. # _____ DATE _____

SITE DEVELOPMENT PLAN/FINAL PLAT - TITLE OR I.D. # _____ DATE _____

THIS IS NOT A PERMIT

Final
 No. 15 A49455A


COUNTY #

SOIL PROFILE A

0' Blue Brn
 CL
 -SiCL
 3' Red SiCL
 mfr
 6-7' Red loam
 -SiL
 9-10' pale red/pink
 and brown
 Loam-SiSL
 13'

SOIL PROFILE B

0' Similar
 to C

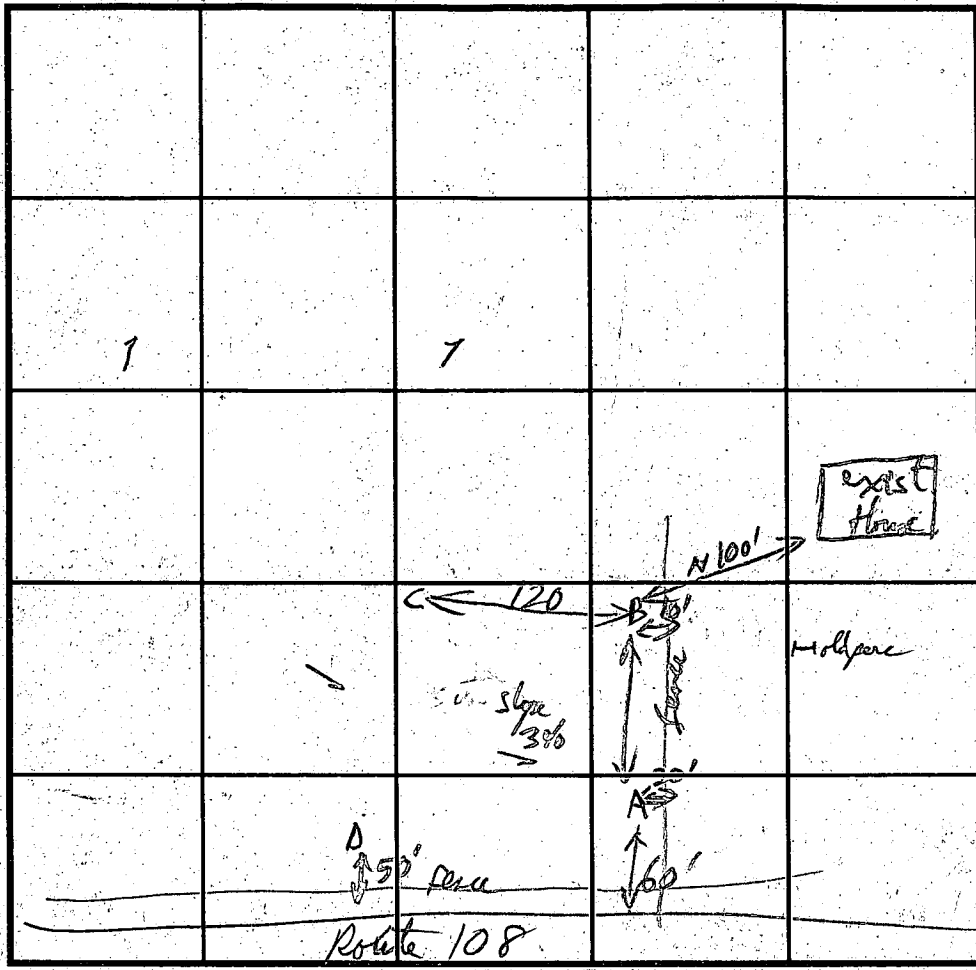

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE.

Note
 Figure soft according
 pare H. L. only 5" diameter
 present hole size


1 1/2' Red Brn yellow
 SiCL
 Red SC
 4-5' Red loam
 mixe brn/pk
 6' pale red
 -yl red
 SL
 8' white +
 cream SL
 13'

DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME	
			START	STOP	START	STOP		
1-25-94	A	5'	4:01:30	4:03		4:06	3 min	
		VB 8'	4:26	left covering - not tested				
	D	5'	4:14	4:17	4:17	4:26 1/2	3 1/2 min	
		VB	4:39 1/2	4:42 - OK below 4 1/2	4:42	4:45 1/2	3 1/2 min	
	C	4'	4:26:30 4:22:34	4:27 1/2 4:23:34	4:29 1/2	4:29 1/2 4:25: 1/2	2 min	
		VB	OK below 3 1/2 or 4'					
	B	3 1/2'	4:38 3/4	4:38 3/4	4:38 3/4	4:41 1/2	3 min	
		VB	OK below 3 1/2					

10' Brn SiCL
 top soil
 Red clay
 3-4' Red h SiL
 -SiL
 6' Jack Red
 eyes parts
 H SiL
 8 1/2' Red Brn
 -pale Brn
 SL
 10'

REMARKS OK below 3 1/2' - his site check appearance per spec OK
 TYPE OF SOIL Chester
 TESTED BY R. H. H. H. ALSO PRESENT Mr. Scheidt, Furb's crew
 TRENCH DESIGN DATA: AVERAGE PERCOLATION TIME 3 1/2 TRENCH WIDTH 3
 INLET DEPTH 4 MAXIMUM BOTTOM DEPTH 8 SQ. FT./BEDROOM 180

Paternal 61st Farm
From Signal Point Plan
P-94-09

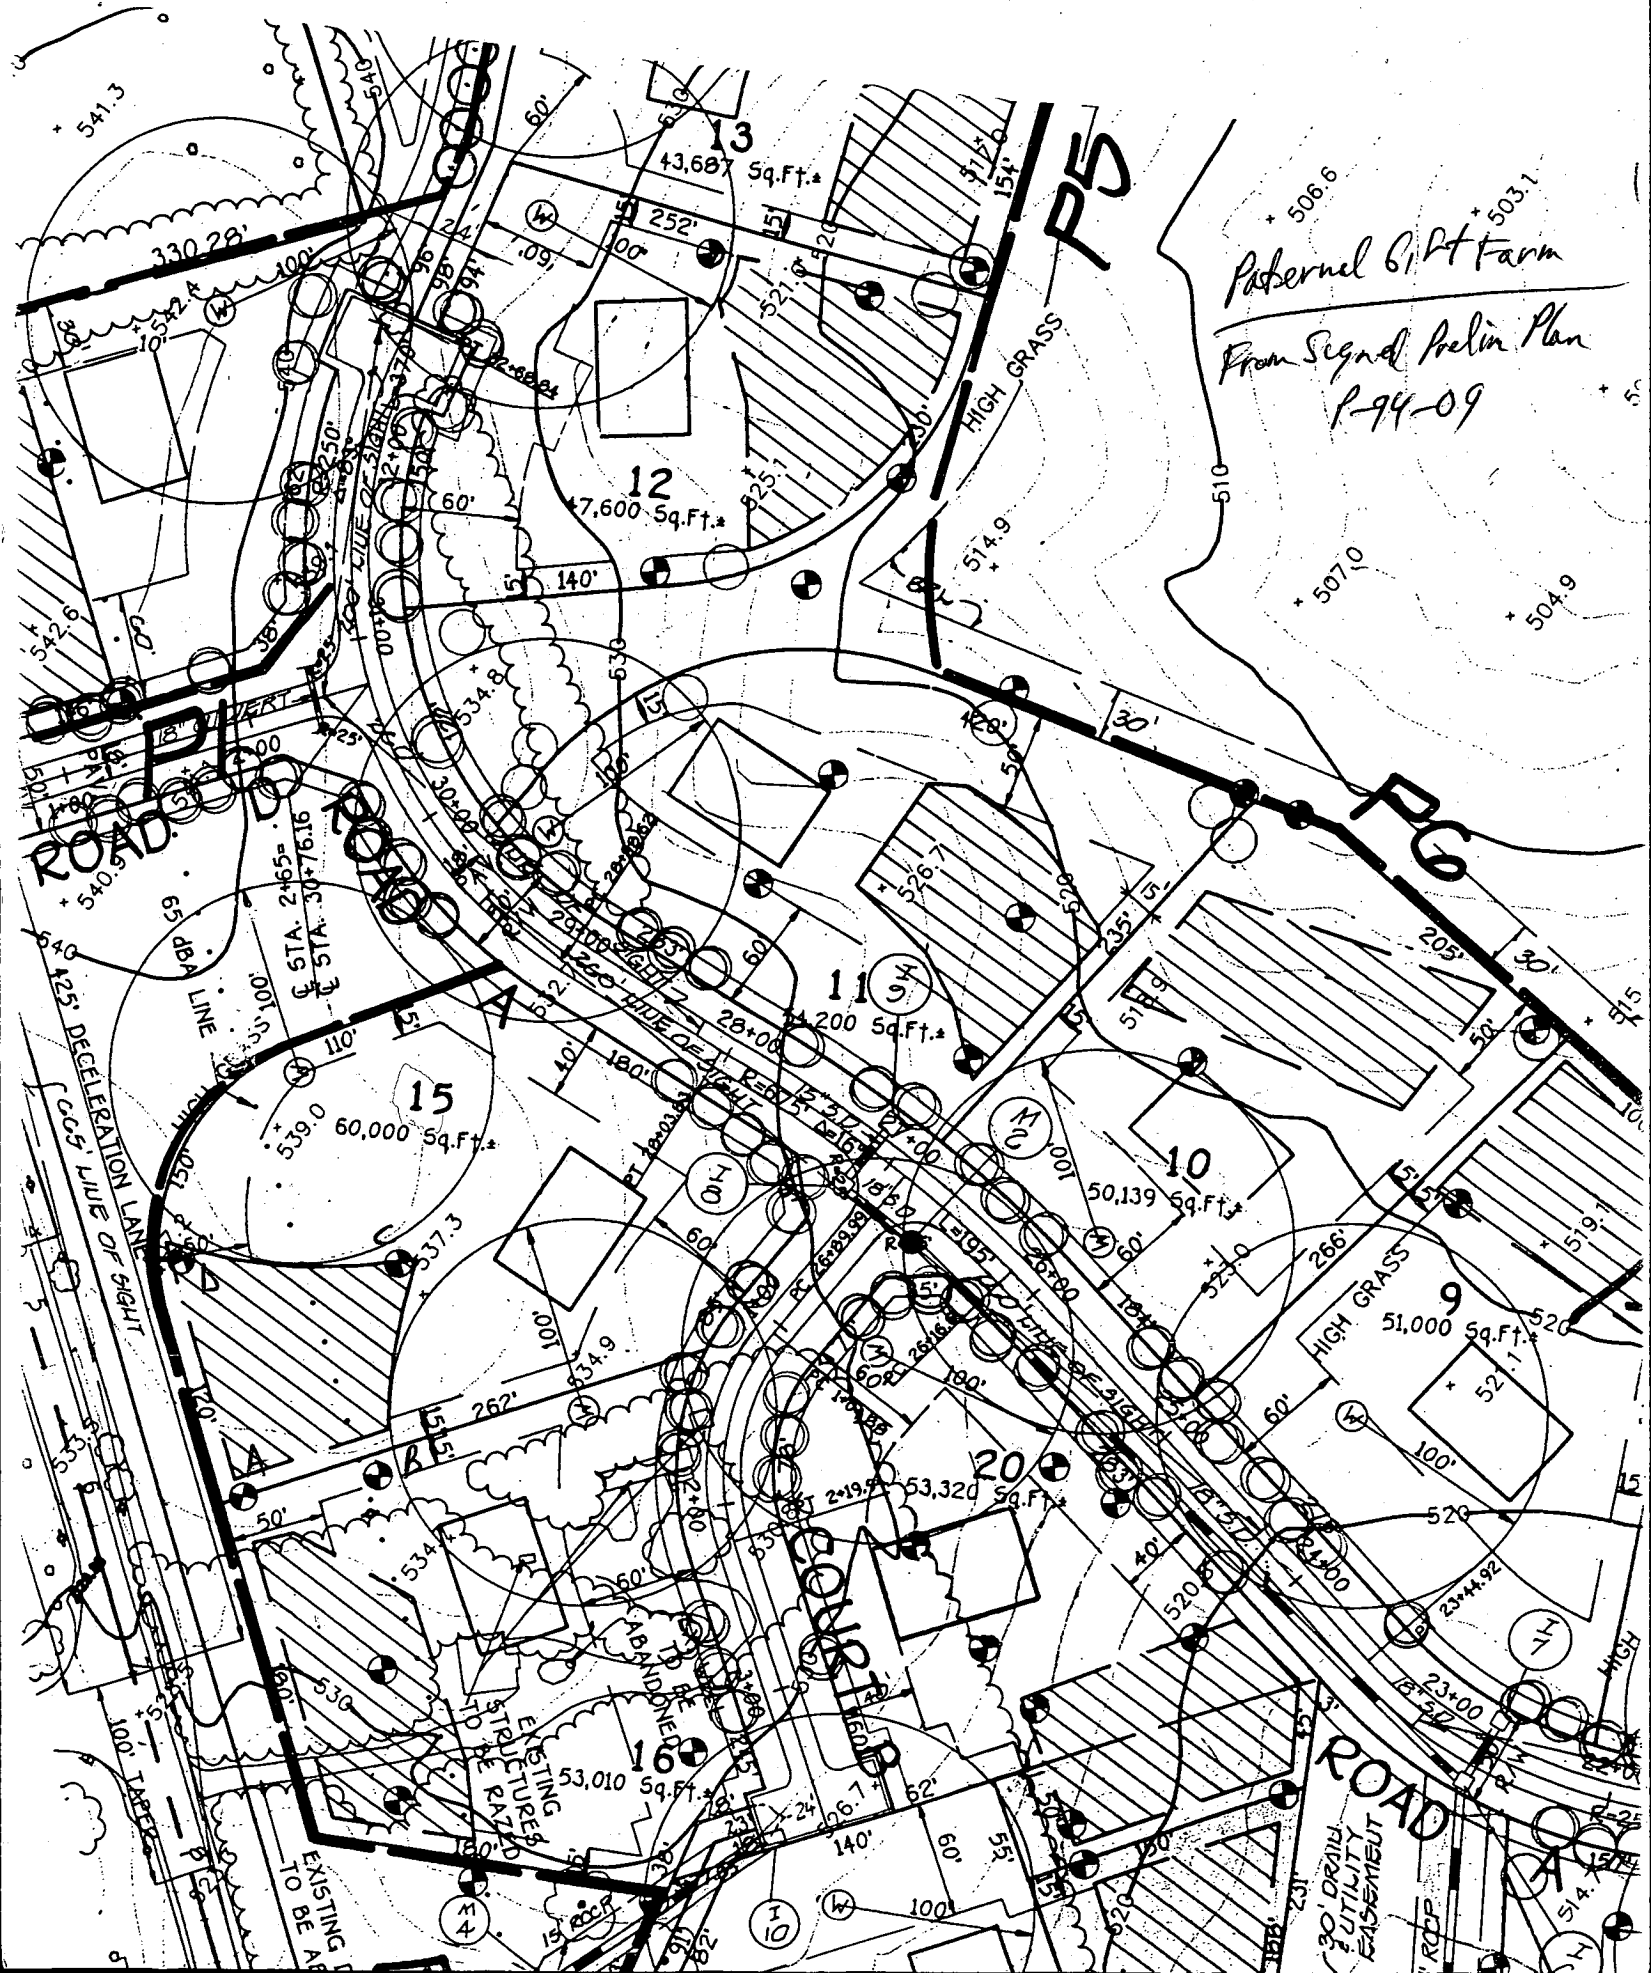

541.3

330.28'

540.9

540.9

540.9

540.9

540.9

540.9

540.9

540.9

540.9

540.9

540.9

540.9

540.9

540.9

540.9

540.9

60'

252'

100'

60'

140'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

60'

65 PBA LINE

125' DECELERATION LANE

CGS LINE OF SIGHT

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

65 PBA LINE

125' DECELERATION LANE

CGS LINE OF SIGHT

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED


EXISTING

TO BE AVOIDED

EXISTING

TO BE AVOIDED

EXISTING

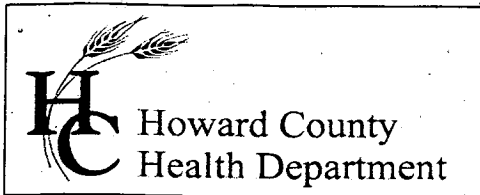

7178 Columbia Gateway Drive, Columbia Maryland 21046
(410) 313-1771 Fax (410) 313-2648
TDD (410) 313-2323 Toll Free 1-866-313-6300
website: www.hchealth.org

Penny E. Borenstein, M.D., M.P.H., Health Officer

November 17, 2004

Pine Crest Builders
13405 Dove St.
Silver Spring, MD 20904

RE: Paternal Gift Farm, Lot 15
13516 Paternal Gift Drive
Highland, MD 20777
BP #: B00145258
Well Permit # HO-94-2840

Dear Sir:

This is to advise you that the septic system for the above referenced property has been installed and inspected. **Final approval of the septic system was granted on 11/04/2004. Final approval of the well line connection to the dwelling was approved on 11/08/2004.**

The water sample results indicate that the water samples submitted for testing were free of coliform and fecal coliform bacteria at the time of sampling and are bacteriologically safe for drinking. The water sample results were found to be in compliance with COMAR water quality standards.

INTERIM CERTIFICATE OF POTABILITY

This certifies that the initial sampling requirements of COMAR 26.04.04 "Well Regulations" have been met for the water supply system installed under well permit #HO-94-2840. Although the submitted sample results are in compliance with COMAR standards, the Health Department does not guarantee water supplies. Based upon satisfactory investigation and evaluation, the Howard County Health Department as authorized by the Maryland Department of the Environment accepts this well system as required by COMAR 26.04.04.

This certificate may become final upon completion of the second bacteriological test, which is to be taken by the county health department within six months of receipt of this letter. **Please contact (410) 313-1773 to schedule a final water sample appointment. Currently, there is no charge for this final sampling.**

Date of Water Samples: 11/⁰⁵~~02~~/2004
Date of Well Completion: 10/23/2000

Approving Authority,


Kacie Noonan, R. S.
Well & Septic Program

cc: Building Inspector's Office
Community Health Services
File




ROWAN LANDSCAPE Co. INC.

16643 FREDERICK ROAD MT. AIRY, MD 21771
410-489-0707 ROWAN LANDSCAPE@MSN.COM

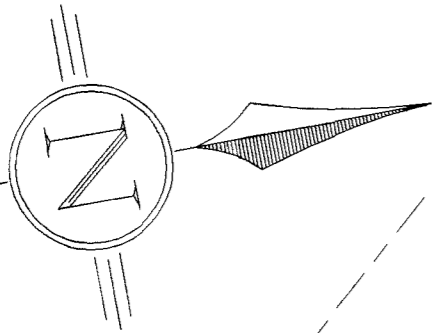

BBB 1/22/03
OK'd
By Gm

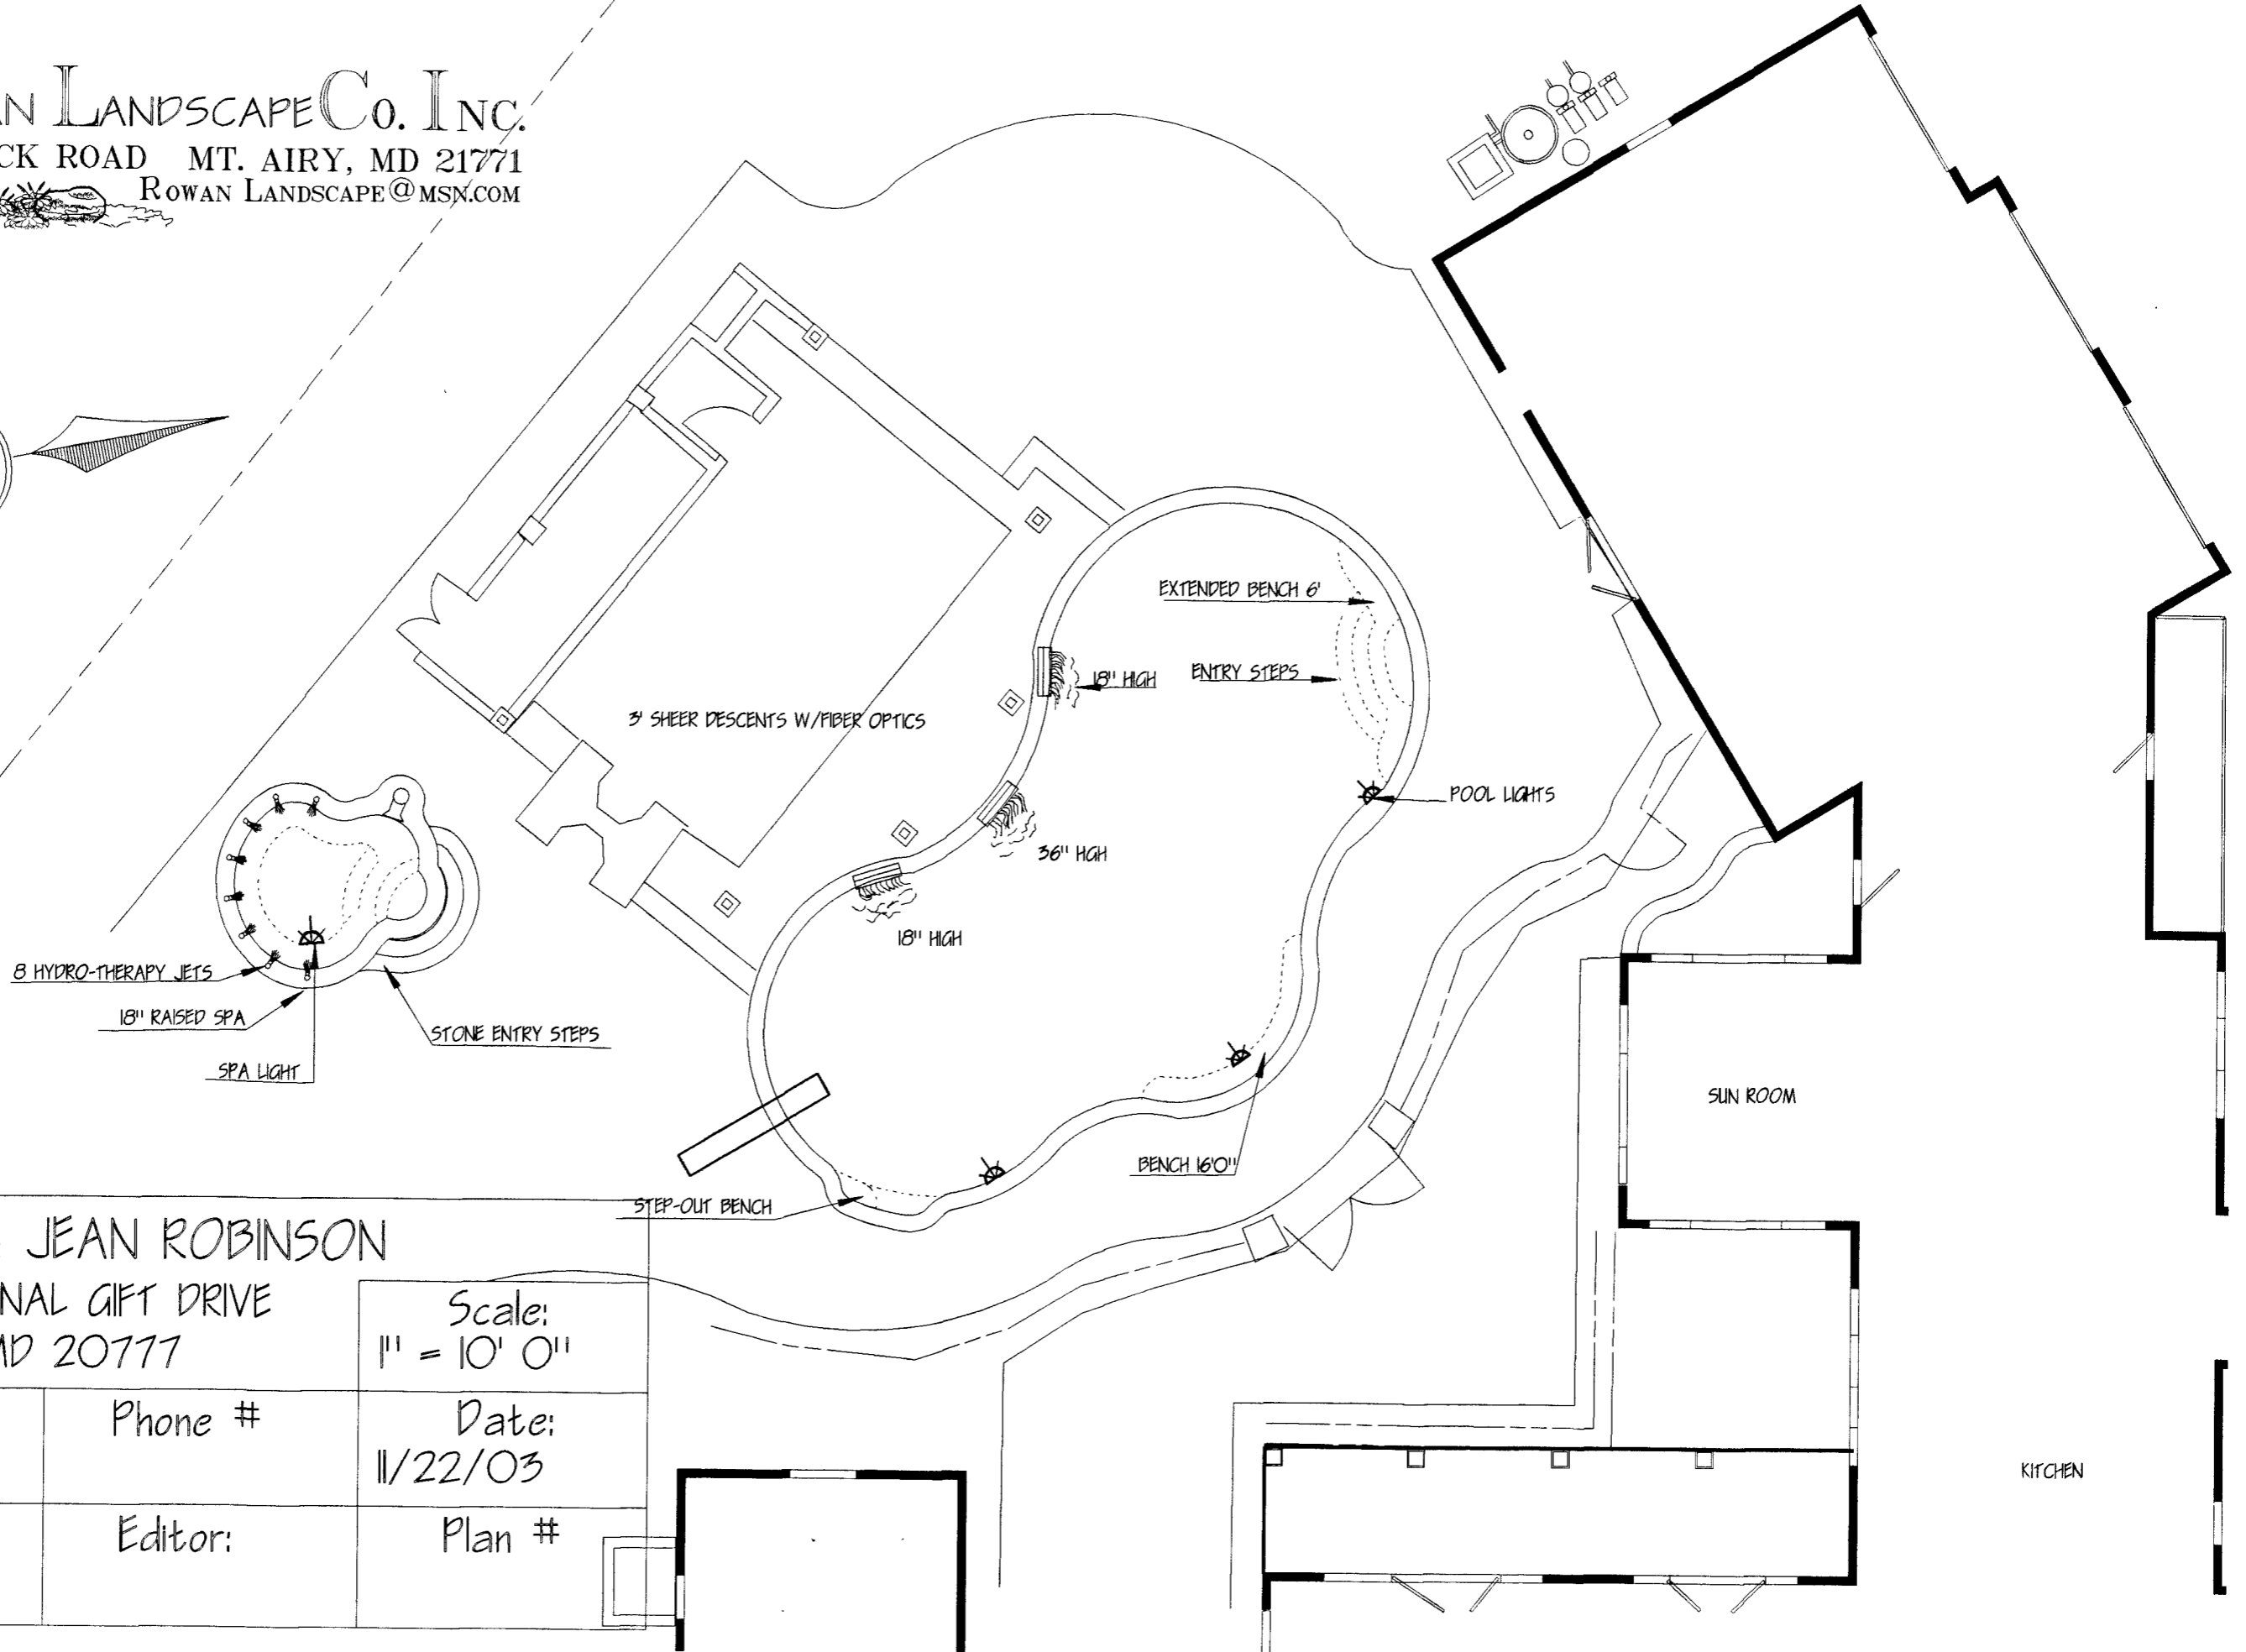

Client: STEVEN & JEAN ROBINSON

Street: 13516 PATERNAL GIFT DRIVE

Town: HIGHLAND, MD 20777

Scale:
1" = 10' 0"

Date:
11/22/03

Plan #


Contact:
STEVEN ROBINSON

Phone #

Designer:
TIMOTHY ROWAN


Editor:

KITCHEN

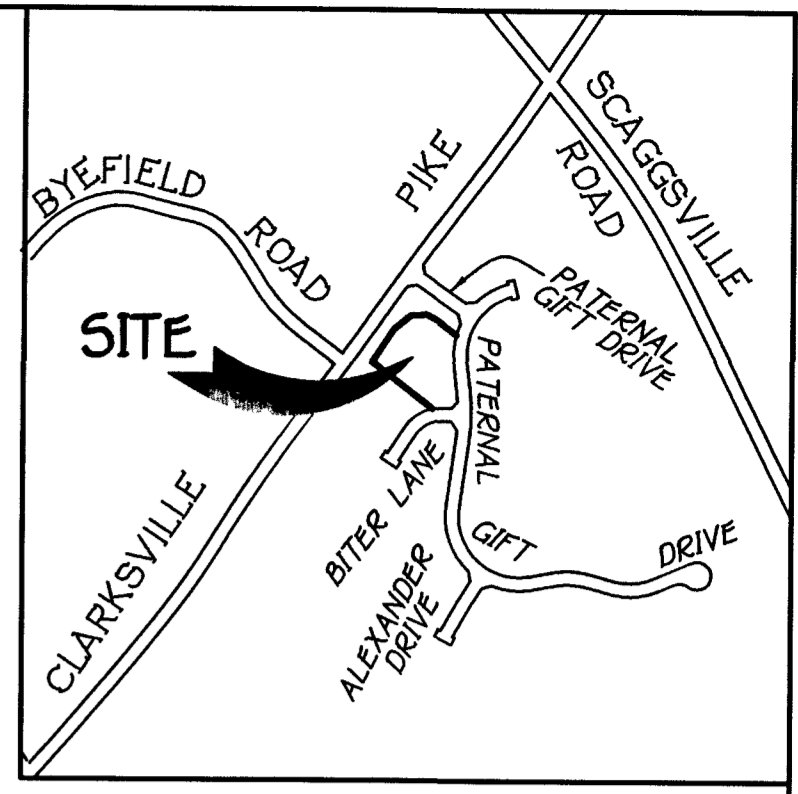


VICINITY MAP
SCALE: 1" = 2,000'

LEGEND	
SYMBOL	DESCRIPTION
---	EXISTING CONTOUR 2' INTERVAL
- - - -	PROPOSED CONTOUR
+362.5	SPOT ELEVATION
-55F-55F	SUPER SILT FENCE
-5F-5F	SILT FENCE
ECM	EROSION CONTROL MATTING
L.O.D.	LIMIT OF DISTURBANCE
---	EXISTING STREET

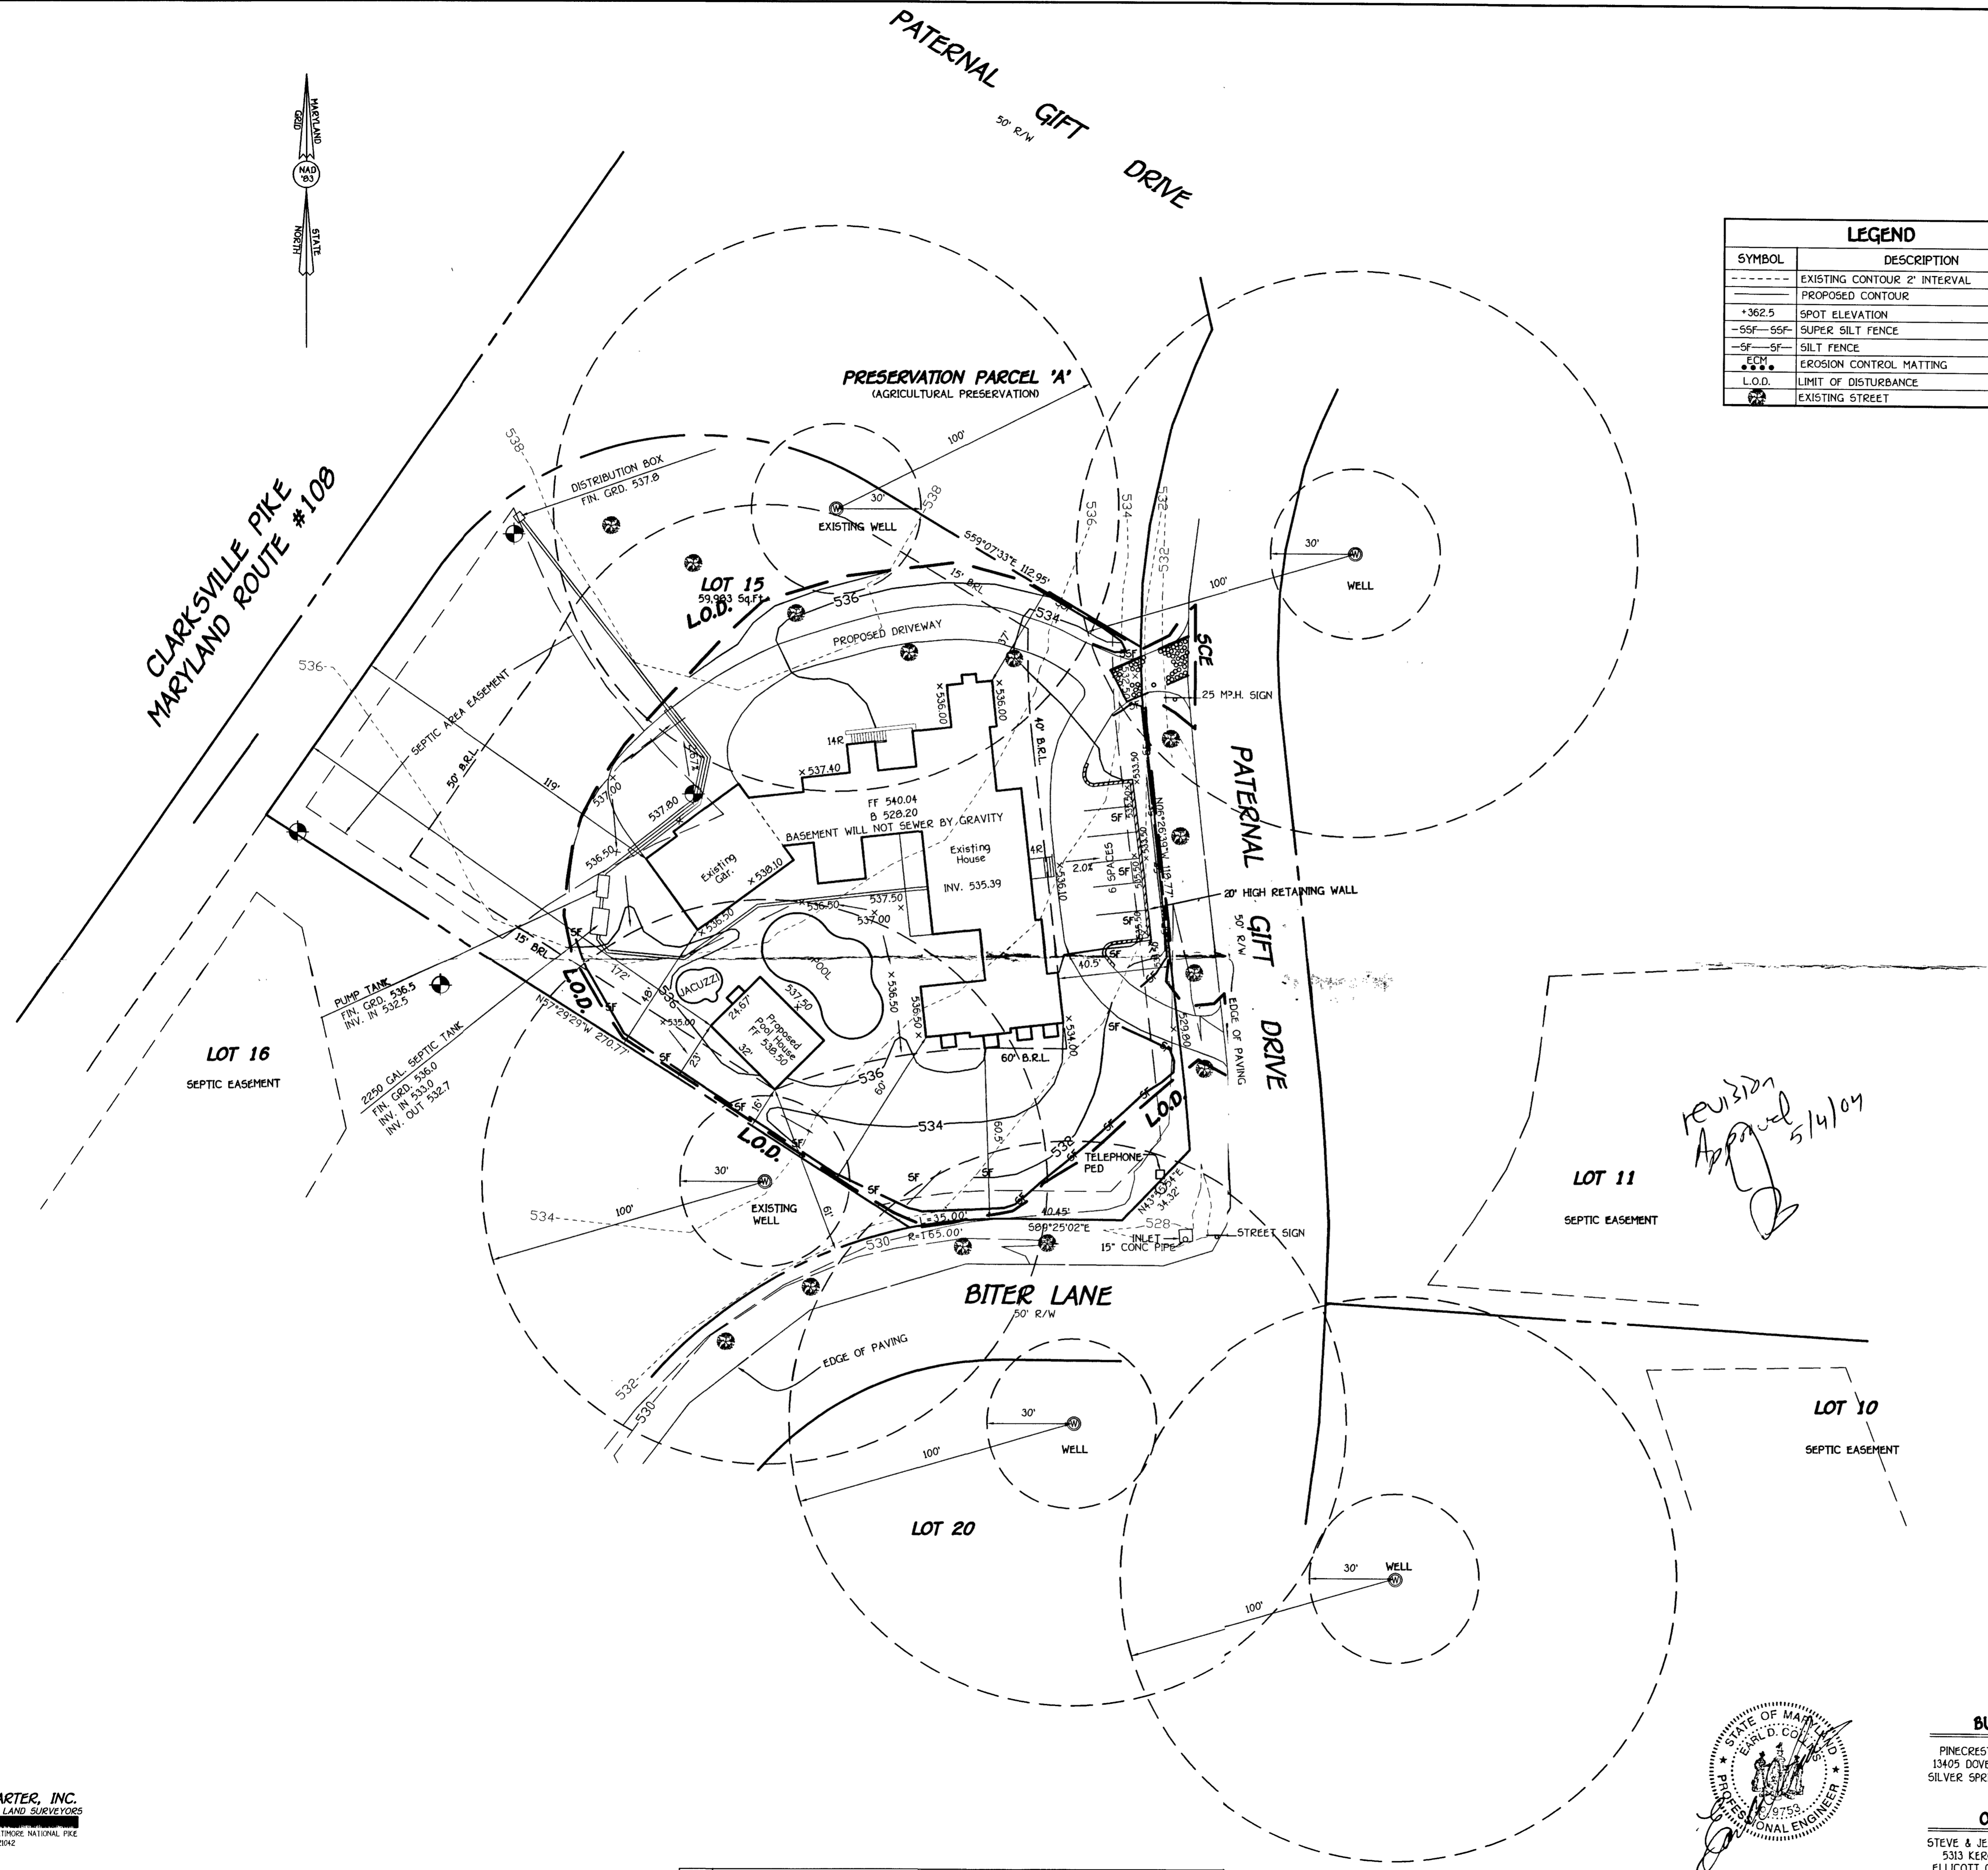

FISHER, COLLINS & CARTER, INC.
CIVIL ENGINEERING CONSULTANTS & LAND SURVEYORS
EDITIONAL SQUARE OFFICE PARK - 1022 BALTIMORE NATIONAL PKE
ELLCOTT CITY, MARYLAND 21042
4101 488 - 2855

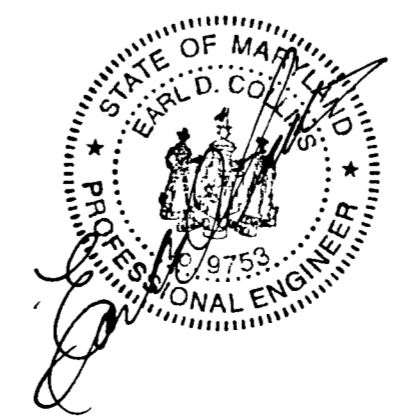

BUILDER
PINECREST BUILDERS
13405 DOVE STREET
SILVER SPRING, MD. 20904

OWNER
STEVE & JEANNE ROBINSON
5313 KERGER ROAD
ELLCOTT CITY, MD. 21043

Revised Plan Approved 5/14/04 KEEP

PLOT PLAN
FOR POOL HOUSE
13516 PATERNAL GIFT DRIVE
PATERNAL GIFT FARM
LOT 15
ZONED:RR TAX MAP NO. 40
FIFTH ELECTION DISTRICT, HOWARD COUNTY, MARYLAND
SCALE: 1" = 30' DATE: NOVEMBER, 2002
SHEET 1 OF 1 REVISED JANUARY 23, 2003

NO.	REVISIONS	DATE
1	Add Pool House and Jacuzzi	4-07-04

K:\Drawings\3303455\Paternal Gift Farm - Sched#16\80501803 LOT 15 POOL PLAN.dwg, 4/29/2004, 10:48:16 AM