

# PERMIT

## SEWAGE DISPOSAL SYSTEM

### DEPARTMENT OF HEALTH AND MENTAL HYGIENE

P 49908

A REPAIR

DISTRICT \_\_\_\_\_

DATE 3/8/94

DATE SYSTEM APPROVED 3/31/94

INSPECTOR M. Ripkin

#### HOWARD COUNTY HEALTH DEPARTMENT

BUREAU OF ENVIRONMENTAL HEALTH

~~461-9933~~ 313-2640

INDEXED

J. A. Smith & Company, Inc. P & H IS PERMITTED TO INSTALL \_\_\_\_\_ ALTER

ADDRESS 5918 Hunt Club Road, Jessup, Maryland 21227 PHONE 796-7532

SUBDIVISION \_\_\_\_\_ LOT \_\_\_\_\_ ROAD 9225 Baltimore Washington Boulevard

PROPERTY OWNER Poist Gas Co. (Walter Boswell, V.P.)

ADDRESS \_\_\_\_\_

SEPTIC TANK CAPACITY \_\_\_\_\_ GALLONS

NUMBER OF BEDROOMS \_\_\_\_\_

\_\_\_\_\_ SQUARE FEET PER BEDROOM

LINEAR FEET OF TRENCH REQUIRED \_\_\_\_\_

REPAIR - PURPOSE - SEPTIC SYSTEM HAS FAILED.

Call for inspection when ground is opened so sanitarian can recommend repair. 03/01/94

PLANS APPROVED BY \_\_\_\_\_ DATE \_\_\_\_\_

COVER NO WORK UNTIL INSPECTED AND APPROVED

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM

NOTE: CLEANOUT REQUIRED EVERY 70 FEET OF SEWER LINE AND/OR AT 90° SWEEPS IN LINES FROM HOUSE TO DRAIN FIELDS, 90° ELBOWS NOT ACCEPTABLE.

NOTE: ALL PARTS OF SEPTIC SYSTEMS (I.E. TANK, DISTRIBUTION BOX TRENCHES) TO BE 100 FEET FROM WELL (UNLESS OTHERWISE SPECIFICALLY AUTHORIZED)

NOTE: IF DEEP TRENCH(ES) ARE USED CALL FOR INSPECTION BEFORE AND AFTER PLACING GRAVEL IN TRENCH(ES)

NOTE: NO DRY WELL SHALL EXCEED 15 FOOT IN DIAMETER NO ABSORPTION TRENCH TO EXCEED 100 FEET IN LENGTH

NOTE: ALL PIPE FROM HOUSE TO SEPTIC TANK MUST BE CAST IRON OR SCHEDULE 35/40 PVC OR ABS


PERMIT VOID AFTER TWO YEARS

NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL STAND PIPES MUST BE 6 INCHES IN DIAMETER CAST IRON. CONCRETE OR TERRA COTTA OR PVA OR ABS ACCEPTED. IF TOP OF SEPTIC TANK IS DEEPER THAN 3 FEET. MANHOLE TO GRADE REQUIRED.

NOTE: DISTRIBUTION BOXES MUST HAVE BAFFLES

**\*INSTALLER IS RESPONSIBLE FOR OBTAINING FINAL APPROVAL ON THIS PERMIT**

P 49908

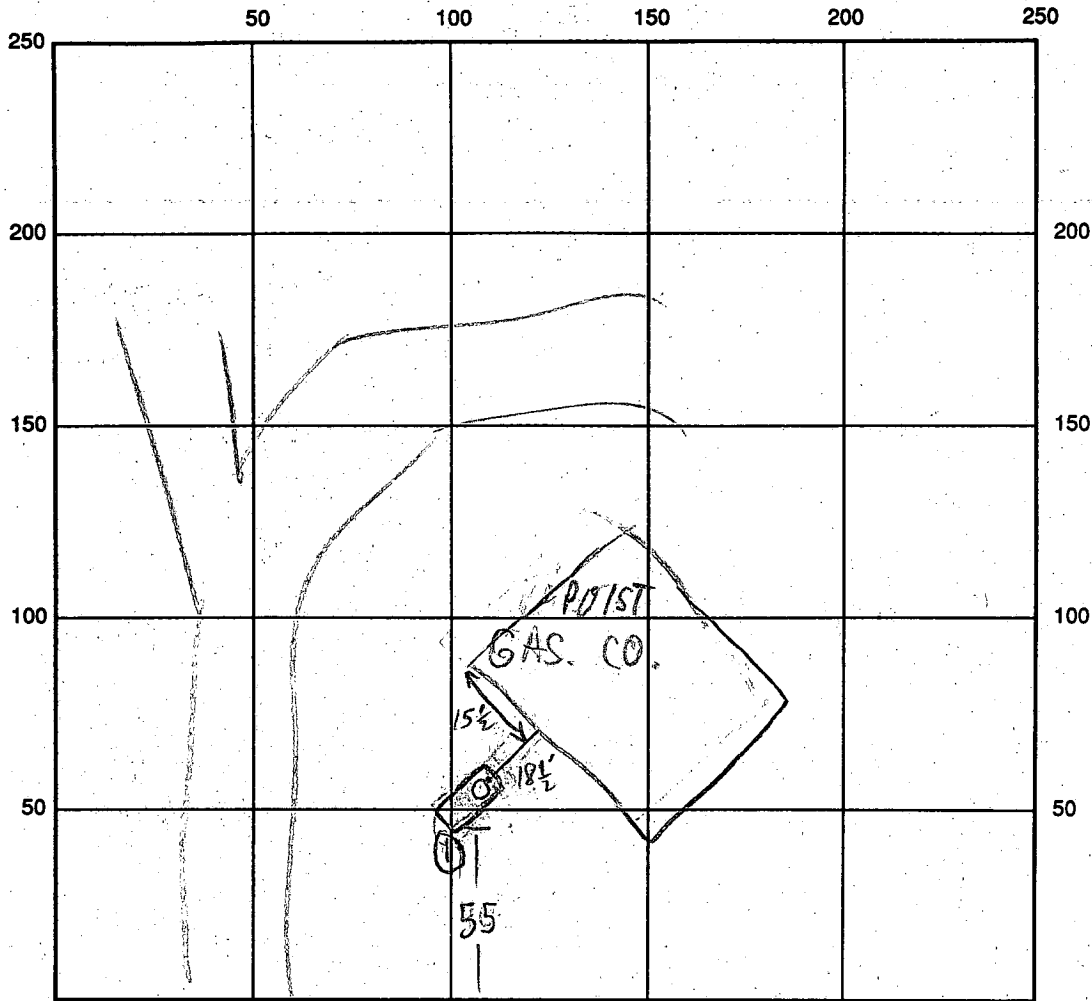

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE

→ Laurel

SEPTIC TANK LEVEL 2000 GAL - OK

CLEANOUTS MANHOLE AND 8" - OK

DISTRIBUTION BOX LEVEL \_\_\_\_\_

DRAIN FIELD/TITLE DEPTH \_\_\_\_\_ FT.

TRENCH WIDTH \_\_\_\_\_ FT.

INLET DEPTH \_\_\_\_\_ FT.

EFFECTIVE GRAVEL DEPTH \_\_\_\_\_ FT.

TOTAL LENGTH \_\_\_\_\_ FT.

NUMBER OF TRENCHES \_\_\_\_\_

ONE SIDEWALL/BOTTOM AREA \_\_\_\_\_ SQ. FT.

DRYWALL INSIDE DIAMETER \_\_\_\_\_ FT.

EFFECTIVE DEPTH BELOW INLET \_\_\_\_\_ FT.

ABSORBENT AREA \_\_\_\_\_ SQ. FT.

REMARKS: 3/30/94 #1 DUE TO POOR SOILS, HOLDING TANK REQ'D; TOP-SEAM REQUESTED, NOT AVAIL. ⇒ STANDARD TANK W/TAR OK MR

3/30/94 #2 S.T. SET, NOT YET FINISHED MR

3/31/94 OK TO COVER ALL; SMALL EX. TANK TO BE FILLED TOMORROW MR

4/?/94 OLD S.T. FILLED IN (UNKNOWN DATE)

DATE SYSTEM APPROVED 3/31/94

INSPECTOR M. Ripkin



**HOWARD COUNTY HEALTH DEPARTMENT**

*Joyce M. Boyd, M.D., County Health Officer*

Reply to:

Name: MR WALTER BOSWELL

Address: C/O POIST GAS COMPANY

360 MAIN ST.

LAUREL MD. 20707

NOTICE OF VIOLATION

Address: 9225 WASHINGTON BLVD.

Dear MR BOSWELL:

On FEB 2, 1994, MARK RIEKIN sanitarian(s) from this office inspected your property known as Tax Map: 47, Parcel: 315,

Lot:        Subdivision:       

located at 9225 WASHINGTON BLVD.

in response to a report of an overflowing septic system. On that occasion

MR RIEKIN observed AN OPEN STEEL SEPTIC TANK

cont'd

This condition is in violation of Section 12.110 of the Howard County Code.

As the failing septic system creates a condition which is, or may be hazardous to the public health, you are hereby ordered to connect to public sewer within fifteen (15) days of receipt of this letter. (As completion of sewer connections may reasonable need more time than the fifteen (15) days allotted, you may be granted an extension of up to fifteen (15) additional days upon presentation to this office of substantial evidence of your intention to comply with this order, such as a copy of the cash receipt for the payment submitted with a sewer connection application.

(WITHIN 48 HOURS OF RECEIPT OF THIS NOTICE)

Until connection to the public sewer system is complete you must immediately have the septic tank contents pumped by a licensed sewage scavenger, and, as often as necessary, to prevent future sewage overflows.

COVERED AND ITS

If you believe that the condition described above is not and could not be a hazard to health, or that the Health Department is not acting in compliance with pertinent laws and regulations, you may request a formal hearing before the Board of Health within ten (10) days of receipt of this letter. If you wish to discuss the evidence, the regulations, or your individual circumstances, you are encouraged to request a meeting with us by calling ~~461-9933~~ and scheduling an appointment.  
313-2640

The investigation of this complaint and the enforcement powers of the Health Department are set forth in Section 12 of the Howard County Code, a copy of which is available for your investigation at this office.

If you have any questions, please contact MARK RIFKIN or myself at ~~461-9933~~.  
313-2640

Very truly yours,

Craig Williams, Director  
Water and Sewerage Program

CW/?:cm

cc: Sanitarian  
Howard County Bureau of Utilities

File

WHILE THIS PROPERTY IS BELIEVED TO BE IN THE METROPOLITAN SERVICE DISTRICT, THIS OFFICE COULD NOT IMMEDIATELY CONFIRM THE AVAILABILITY OF SEWER SERVICE. SHOULD YOUR APPLICATION TO CONNECT TO SEWER RESULT IN A DETERMINATION THAT PUBLIC SEWER IS NOT AVAILABLE, THEN A SEPTIC SYSTEM REPAIR SHOULD BE ACCOMPLISHED WITHIN THE SAME TIME FRAME SUBMISSION OF THE STANDARD PERMIT FEE ALONG WITH A WRITTEN STATEMENT FROM THE HOWARD COUNTY DEPT. OF PUBLIC WORKS CONFIRMING THAT PUBLIC SEWER IS UNAVAILABLE, WOULD BE NECESSARY FOR A SEPTIC REPAIR PERMIT TO BE ISSUED FOR THIS PROPERTY.

300-125-3222

REGION \_\_\_\_\_

AREA \_\_\_\_\_ RATING \_\_\_\_\_

| ACKNOWLEDGMENT AND CONTROLS | DATE |
|-----------------------------|------|
|                             |      |
|                             |      |
|                             |      |
|                             |      |

Howard County Department of Health  
BUREAU OF ENVIRONMENTAL HEALTH

| DISPOSITION | DATE |
|-------------|------|
|             |      |
|             |      |
|             |      |
|             |      |

**RECORD OF INVESTIGATION**

V.P. Bill Boswell SITE #:  
725

LOCATION 9225 Washington Blvd. 9878 ZIP 20763

OWNER  H.J. Poist Gas Co. ADDRESS 360 Main St Laurel 20707 PHONE \_\_\_\_\_

COMPLAINANT \_\_\_\_\_ ADDRESS \_\_\_\_\_ PHONE \_\_\_\_\_

REASON FOR INVESTIGATION sewage from building going to open pit

RECEIVED BY B. Banes/MDE DATE 2/2/94 ASSIGNED TO M. Ripkin DATE 2/3/94

DATE OF INVESTIGATION 2/3/94 TIME 2:30 WEATHER clear, cold

REPORT VP of company showed me open tank (300-500 gal) @ grade drain field loc. approx.; lot is ~ 3/4 Acre w/ large amt of fuel tanks & equip. on lot => virtually no room to install any new tank; fib. sewer likely across pt. 1 & may be inaccessible; "tank" may also be manhole to larger S.T. below grade; Waterloo Sanitation pumps tank; call for size, condition; T/C w/ Waterloo reveals no record of tank capacity, but his opinion is that tank is 300-500 gal cylindrical steel tank; drain fields likely frozen (as is tank contents) so no discharge visible, but tank certainly overflows in rain to nearby river; letter (Notice of Violation) req'd to company

- 2/7/94 MESSAGE LEFT FOR MR BOSWELL TO CALL & DISCUSS HIS PLANS FOR REMEDIATION. (CW)

DATE SUBMITTED \_\_\_\_\_ SANITARIAN \_\_\_\_\_

301-725-3272

REGION \_\_\_\_\_ AREA \_\_\_\_\_ RATING \_\_\_\_\_

| ACKNOWLEDGMENT AND CONTROLS | DATE |
|-----------------------------|------|
|                             |      |
|                             |      |
|                             |      |
|                             |      |

Howard County Department of Health  
BUREAU OF ENVIRONMENTAL HEALTH

| DISPOSITION | DATE |
|-------------|------|
|             |      |
|             |      |
|             |      |
|             |      |

**RECORD OF INVESTIGATION**

V.P. Bill Boswell SITE #: 725

LOCATION 9225 Washington Blvd. 9878 ZIP 20763

OWNER  H.J. Poist Gas Co. ADDRESS 360 Main St Laurel 20707 PHONE \_\_\_\_\_

COMPLAINANT \_\_\_\_\_ ADDRESS \_\_\_\_\_ PHONE \_\_\_\_\_

REASON FOR INVESTIGATION sewage from building going to open pit

RECEIVED BY B. Banes/MDE DATE 2/2/94 CODES \_\_\_\_\_ ASSIGNED TO M. Rifkin DATE 2/3/94

DATE OF INVESTIGATION 2/3/94 TIME 2:30 WEATHER clear, cold

REPORT VP of company showed me open tank (300-500 gal) @ grade drain field loc. approx.; lot is ~ 3/4 Acre w/ large amt of fuel tanks & equip on lot => virtually no room to install any new tank; pub. sewer likely across Rt. 14 may be inaccessible; "tank" may also be manhole to larger S-T. below grade; Waterloo Sanitation pumps tank; call for size, condition; T/C w/ Waterloo reveals no record of tank capacity, but his opinion is that tank is 300-500 gal cylindrical steel tank; drain fields likely frozen (as is tank contents), so no discharge visible, but tank certainly overflows in rain to nearby river; letter (Notice of Violation) req'd to company

- 2/7/94 MESSAGE LEFT FOR MR BOSWELL TO CALL & DISCUSS HIS PLAN FOR REMEDIATION. (CW)

DATE SUBMITTED \_\_\_\_\_ SANITARIAN \_\_\_\_\_

SITE INSPECTION SHEET

OWNER: Poist Gas Co.

DATE REQUESTED: 2/3/24

ADDRESS: 9225 Wash. Blvd


DRILLER: \_\_\_\_\_

WELL TAG # \_\_\_\_\_

COUNTY # \_\_\_\_\_

PROPOSAL: open sewage pit

LOCATION DIAGRAM

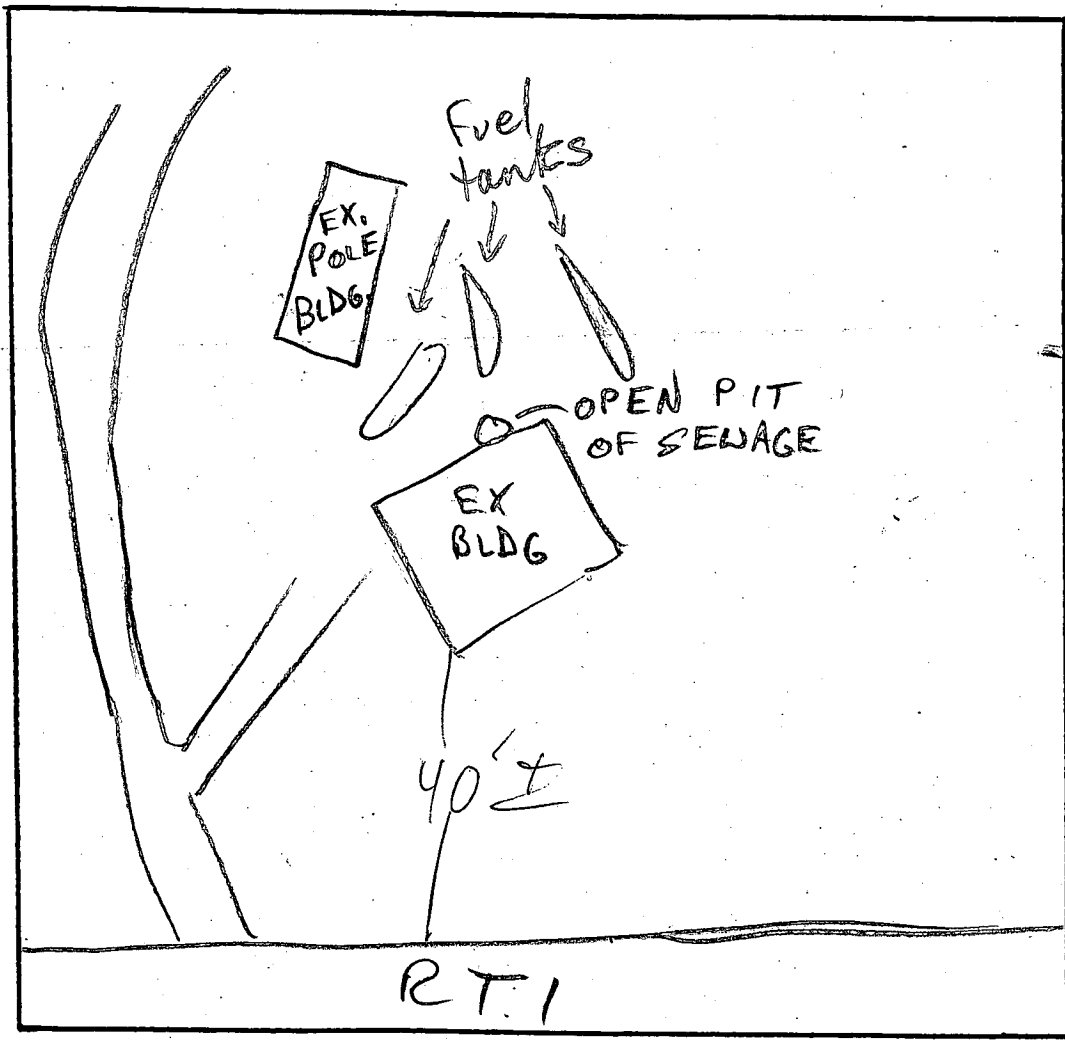

COMMENTS: SEE ~~NO~~ COMPLAINT SHEET ATTACHED

DATE: \_\_\_\_\_

INSPECTOR: \_\_\_\_\_

*The* **Poist** GAS company

PLANT: WASHINGTON BLVD.

360 MAIN STREET  
LAUREL, MD. 20707  
725-3232

February 8, 1994

Howard County Department of Environmental Health  
3525 Ellicott Mill Drive, Suite H  
Ellicott City, Maryland 21043

Attention: Craig Williams

Dear Mr. Williams:


In reference to the repair of the sewage system at our plant located at 9225 Baltimore Washington Blvd. in Savage Md, our plan of action is as follows.

1. Today the holding tank will be covered with a wood delidary until work can be done.
2. Today I have contacted J. A. Smith Company, in Ellicott City Md. (410-796-7532) to come look this job over. Mr. Smith will come to our plant Feb. 10th or 11th and meet with me to discuss the repair of the system and doing a percolation test of the ground. Mr. Smith or myself will contact you letting you know the date the work will take place.

I hope this meets with your approval and thank you for your cooperation in this matter.

Sincerely,

THE POIST GAS COMPANY



Walter E. Boswell,  
Vice President

WEB:cw

HOLDING TANK EXEMPTION CERTIFICATE APPLICATION

Provide the following information in full and submit the completed application to:

Compliance Monitoring Coordinator  
Little Patuxent Wastewater Treatment Plant  
8900 Greenwood Place  
Savage, Maryland 20763

APPLICANT'S NAME (1) Poist Gas Co

ADDRESS: 9225 Wash. Blvd  
Savage Md. 20763

TELEPHONE NO. 301-725-9878

HOLDING TANK SIZE 2000 GALLONS

Describe source(s) of waste discharged to holding tank:



Toilet + washing hands

Provide frequency at which holding tank is emptied by waste hauler (example: 1 time/week, 2 times/month, etc.) approx. 2 Time Mo.

Provide sketch below showing holding tank location:

EXAMPLE:

PUT YOUR SKETCH HERE:

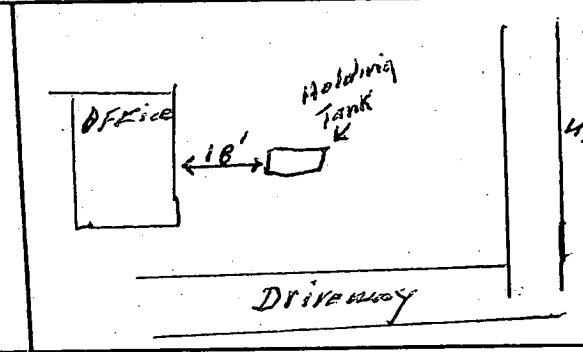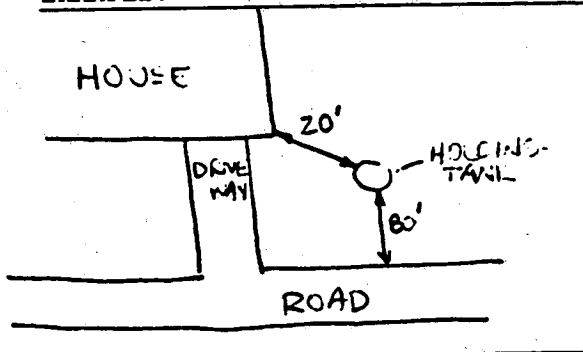

DO NOT WRITE BELOW THIS LINE

NOTES: (1) Applicant must be property owner.

APPROVED \_\_\_\_\_ DENIED BY HEALTH DEPT., REVIEWER M.R. DATE 4/21/94

IF DENIED, STATE REASON \_\_\_\_\_

OFFICIAL SIGNATURE