

PERMIT

SEWAGE DISPOSAL SYSTEM

MARYLAND STATE DEPARTMENT OF HEALTH

P 41232

A 35519

DISTRICT 4th

HOWARD COUNTY
BUREAU OF ENVIRONMENTAL HEALTH
461-9933

04-345754

DATE 3/18/88

DATE SYSTEM APPROVED 4-4-88

INDEXED

INSPECTOR JEN

Bill Ingram IS PERMITTED TO INSTALL ALTER

ADDRESS 15044 ~~14954~~ Bushy Park Road, Woodbine, Maryland 21797 PHONE 442-2139

SUBDIVISION Country View ROAD 17508 Country View Way LOT 2

PROPERTY OWNER Brian Stabley Carroll L. Roles

ADDRESS _____

IF GARBAGE GRINDER IS USED INCREASE SEPTIC TANK CAPACITY BY 50% AND ABSORPTION AREA BY 22%.

GARBAGE GRINDER? YES _____ NO

SEPTIC TANK CAPACITY 1250 GALLONS NUMBER OF BEDROOMS 4

TRENCHES - 210 sq. ft. per bedroom. Trench to be 2 feet wide. Inlet 4 feet below original grade. Bottom maximum depth 8 feet below original grade. Effective area begins at 4 feet below original grade. 4 feet of stone below distribution pipe.

LOCATION - Place the distribution box 190 feet from the front lot line and 60 feet from the ~~left~~ side of the lot as seen when facing the lot from Country View Way.

Run the trenches toward County View Way AND RIGHT SIDE LINE 1/4

NOTE - No trench to exceed 100 feet in length. Provide 6" - 8" diameter cleanout and cap to grade or above on septic tank.

OK

PLANS APPROVED BY Raymond Hodges DATE 9/14/87

COVER NO WORK UNTIL INSPECTED AND APPROVED.

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM.

NOTE: CLEANOUT REQUIRED EVERY 70 FEET OF SEWER LINE AND/OR AT 90° SWEEPS IN LINES FROM HOUSE TO DRAIN FIELDS.

NOTE: ALL PARTS OF SEPTIC SYSTEMS (I.E., TANK, DISTRIBUTION BOX, TRENCHES) TO BE 100 FEET FROM WELL. (UNLESS OTHERWISE SPECIFICALLY AUTHORIZED)

NOTE: IF DEEP TRENCH(IES) ARE USED CALL FOR INSPECTION BEFORE AND AFTER PLACING GRAVEL IN TRENCH(IES).

NOTE: NO DRY WELL SHALL EXCEED 15 FOOT IN DIAMETER. NO ABSORPTION TRENCH TO EXCEED 100 FEET IN LENGTH.

NOTE: ALL PIPE FROM HOUSE TO SEPTIC TANK MUST BE CAST IRON OR SCHEDULE 40 PVC OR ABS.

BLDG. PERMIT SIGNED

PERMIT VOID AFTER TWO YEARS.

AND RETURNED 11/7/90

NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL. STAND PIPES MUST BE 6 INCHES IN DIAMETER. CAST IRON, CONCRETE OR TERRA COTTA OR PVC OR ABS ACCEPTED. IF TOP OF SEPTIC TANK IS DEEPER THAN 3 FEET, MANHOLE TO GRADE REQUIRED.

Storage Building

NOTE: DISTRIBUTION BOXES MUST HAVE BAFFLES.

*INSTALLER IS RESPONSIBLE FOR OBTAINING FINAL APPROVAL ON THIS PERMIT

*CALL 461-9933 FOR INSPECTION OF SEPTIC SYSTEMS.

EH - 2-1186

A-35519


4/4/88

210
870

4-4-08

WPI
Pitless adaptor
at 4 1/2 inches
Well line in
covered in trench.
Ground attached.
House connection
covered. JEN

Country View Way

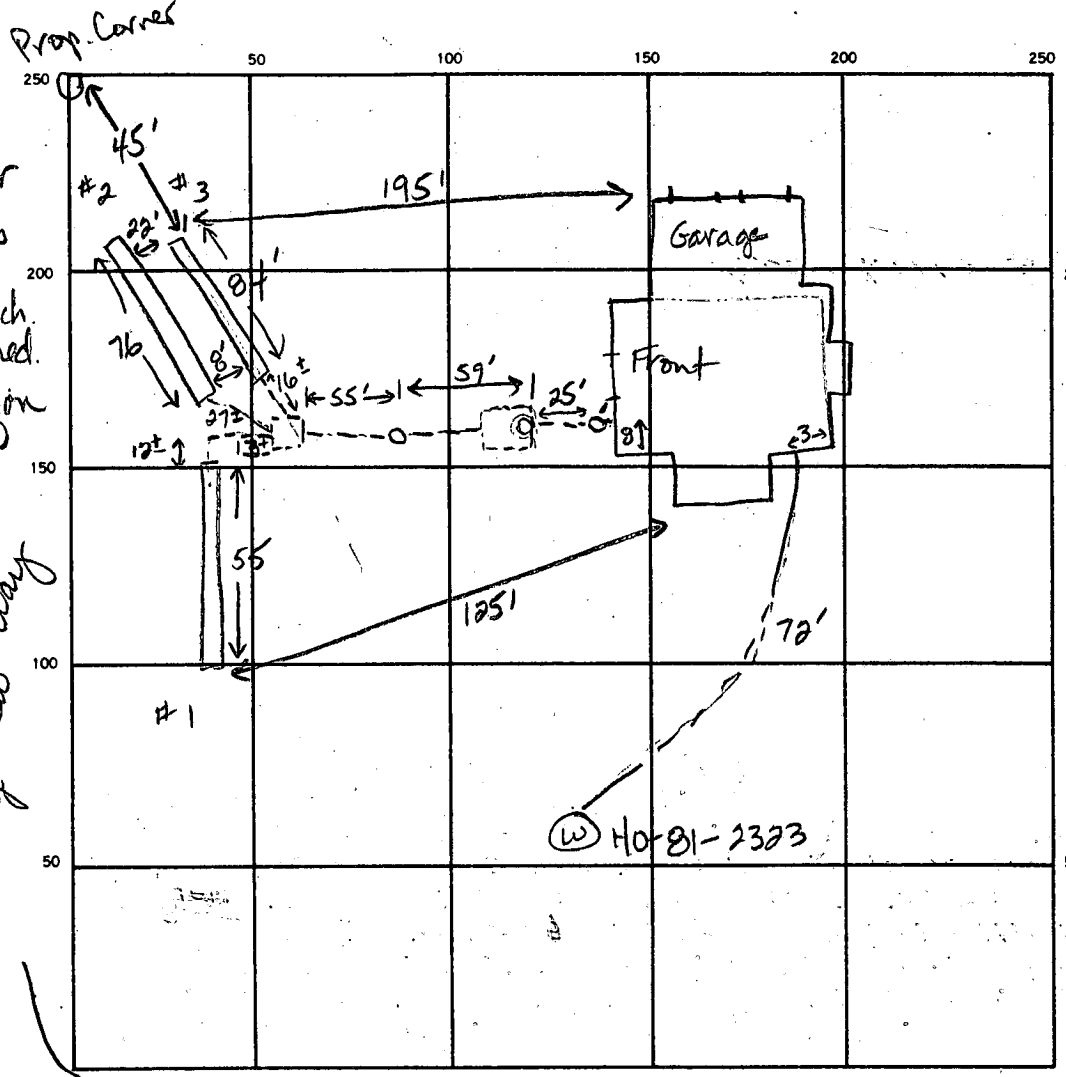

INDICATE NORTH. - NAME ADJOINING ROADWAY AS BASE LINE.

Route 144

79 19
24
76
38
45

81
24
304
162
194

53
24
117
06

30
24
130
60

100
16
84

SEPTIC TANK LEVEL 1250 gal? CLEANOUTS 2 in line, 1 on septic tank

DISTRIBUTION BOX LEVEL ? covered

DRAIN FIELD TILE FIELD DEPTH covered FT. TRENCH WIDTH 2 FT. INLET DEPTH 4 FT.

EFFECTIVE GRAVEL DEPTH 4 4 4 FT. TOTAL LENGTH 55 76 84 FT.

NUMBER OF TRENCHES 3 ONE SIDEWALL/BOTTOM AREA 220/304/336 SQ. FT.

DRYWELL INSIDE DIAMETER _____ FT. EFFECTIVE DEPTH BELOW INLET _____ FT.

ABSORBENT AREA 860 SQ. FT.

REMARKS 4-4-08 All work was covered except ends of trenches. Assume all joints are secure and slope to septic tank is within codes, OK to cover all remaining work. JEN

DATE SYSTEM APPROVED 4-4-08 INSPECTOR Jane E. Madigan

A 35519

SUBDIVISION: COUNTRY VIEW
(HOUGH PROP)

LOT NUMBER:

DRY WELL OR DRY WELL AND TRENCH

_____ sq. ft./bedroom

	<u>Septic Tank</u>	<u>Minimum Total Square Feet</u>
3 bedroom	1000 gallon	_____
4 bedroom	1250 gallon	_____
5 bedroom	1500 gallon	_____

Inlet _____ feet below original grade.

Bottom maximum depth _____ feet below original grade.

Effective area begins at _____ feet below original grade.

NOTE: If trench is used to make up absorbent area, run the trench on level ground and leave a 5-foot earth buffer between dry well and trench. No trench is to exceed 100 feet in length. Trench inlet to be same as dry well, with _____ feet of stone below distribution pipe.

TRENCHES

210 sq. ft./bedroom

Trench to be 2 wide.

Inlet 4 feet below original grade.

Bottom maximum depth 8 feet below original grade.

Effective area begins at 4 feet below original grade.

4 feet of stone below distribution pipe.

- NOTE:
- (1) No trench to exceed 100 feet in length.
 - (2) If more than one trench used, a distribution box is required.
 - (3) Trenches to be installed on level ground.
 - (4) Call for inspection of trench before gravel is installed.
 - (5) Provide 6" - 8" diameter cleanout and cap to grade or above on septic tank and drywell.
 - (6) If a garbage disposal is used, increase septic tank capacity by 50% and increase absorbent sidewall area by 22%.

LOCATION: 9/4/87 - PLACE THE DISTRIBUTION BOX 190 FT FROM THE FRONT LOT LINE AND 60 FT FROM THE RIGHT-SIDE OF THE LOT AS SEEN WHEN FACING THE LOT FROM COUNTRY VIEW WAY. RUN THE TRENCHES TOWARD COUNTRY VIEW WAY AND RIGHT SIDE LINE

APPLICATION

SEWAGE DISPOSAL TESTING

STATE OF MARYLAND - DEPARTMENT OF HEALTH AND MENTAL HYGIENE

A 35579

P _____

HOWARD COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SERVICES

P. O. BOX 476 - ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 992-2330

DISTRICT 4TH

DATE May 3, 1985

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I, HEREBY, APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER ~~Richard M. Hough~~ BRIAN STAHLLEY

ADDRESS 17591 Route 144 PHONE 489-4014

PROPERTY LOCATION: COUNTRY VIEW
SUBDIVISION ~~Hough Property~~ LOT NO. 2

ROAD AND DESCRIPTION On Maryland Route 144, 600'± East of Long Corner Rd.
17508 Country View Way

SIZE OF LOT 3 ACRES + TYPE BLDG. 4 Bedroom
(NUMBER OF BEDROOMS)

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE. I FULLY UNDERSTAND THE FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER ANY CIRCUMSTANCES. I ALSO AGREE TO COMPLY

WITH ALL M.O.S.H.A. REQUIREMENTS IN TESTING THIS LOT. Dennis M. Rusli
(SIGNATURE OF APPLICANT)

APPROVED BY Raymond Hodge FOR Trencher DATE 9/14/87

REJECTED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING 7/17/85 PERC OK HOLD FOR PWAT R/H
9/14/87 Specs Violated R/H

BLDG. PERMIT SIGNED
AND RETURNED 11-5-87

BPI5461
Stalvey

THIS IS NOT A PERMIT

APPLICATION

SEWAGE DISPOSAL TESTING

STATE OF MARYLAND - DEPARTMENT OF HEALTH AND MENTAL HYGIENE

HOWARD COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SERVICES

P. O. BOX 476 ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 992-2330

A 35519

P _____

DISTRICT 4TH

DATE May 3, 1985

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I HEREBY APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER Richard M. Hough

ADDRESS 17591 Route 144 PHONE 489-4014

PROPERTY LOCATION: Country View

SUBDIVISION Hough Property LOT NO. 2

ROAD AND DESCRIPTION On Maryland Route 144, 600'± East of Long Corner Rd.

SIZE OF LOT 3 Acres + TYPE BLDG. 4 Bedroom
(NUMBER OF BEDROOMS)

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE. I FULLY UNDERSTAND THE FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER ANY CIRCUMSTANCES. I ALSO AGREE TO COMPLY

WITH ALL M.O.S.H.A. REQUIREMENTS IN TESTING THIS LOT. Dennis M. Rusli
(SIGNATURE OF APPLICANT)

APPROVED BY _____ FOR _____ DATE _____

REJECTED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING _____

THIS IS NOT A PERMIT

SOIL PROFILE (2)

BROWN CLAY

4.5

LIGHT BROWN SAND LOAM & SOME SAPROLITE

12.5

(3)

CLAY

4

BEIGE SAND LOAM


12

(4)

BROWN CLAY

4

LIGHT BROWN SAND & SAPROLITE

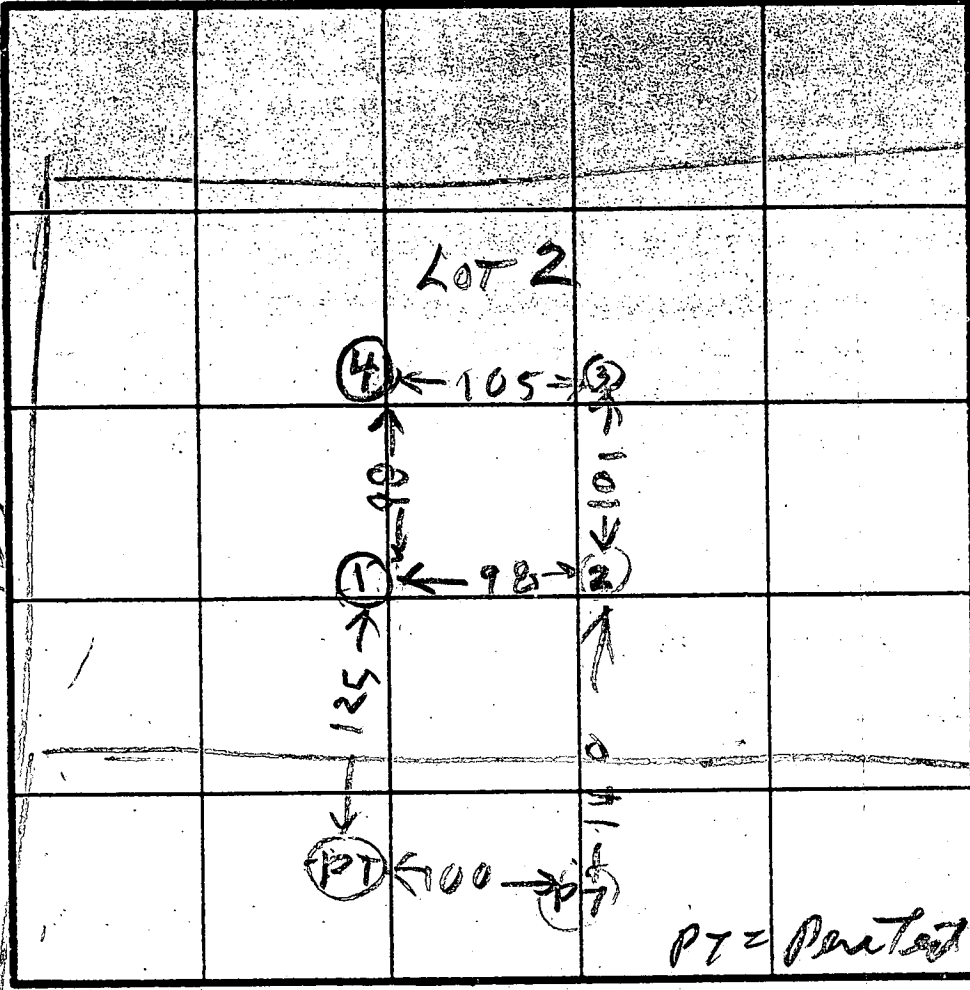

HOLE ELEVATIONS

(3, 4) = HIGH

(1, 2) = LOW

4-10-81
PER LOCATION OK

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE.

PT = Perched on lot 1

DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME
			START	STOP	START	STOP	
7/17/88	1 S	5.5	249	251	251	254	3
	1 V	12.5	LOOKS	OK			
	2 S	6.5	259	313	313	343	20
	2 V	12.5	LOOKS	OK			
	3 S	5	306	314	314	320	16
	3 V	12	LOOKS	OK			
	4 V	12	LOOKS	OK			


X 12 MIN

INLET 5'

REMARKS HOLES NOT DUG PER SURVEYOR PLAT

TYPE OF SOIL R HUDGES

SKIP & DIM of FLOCK CO

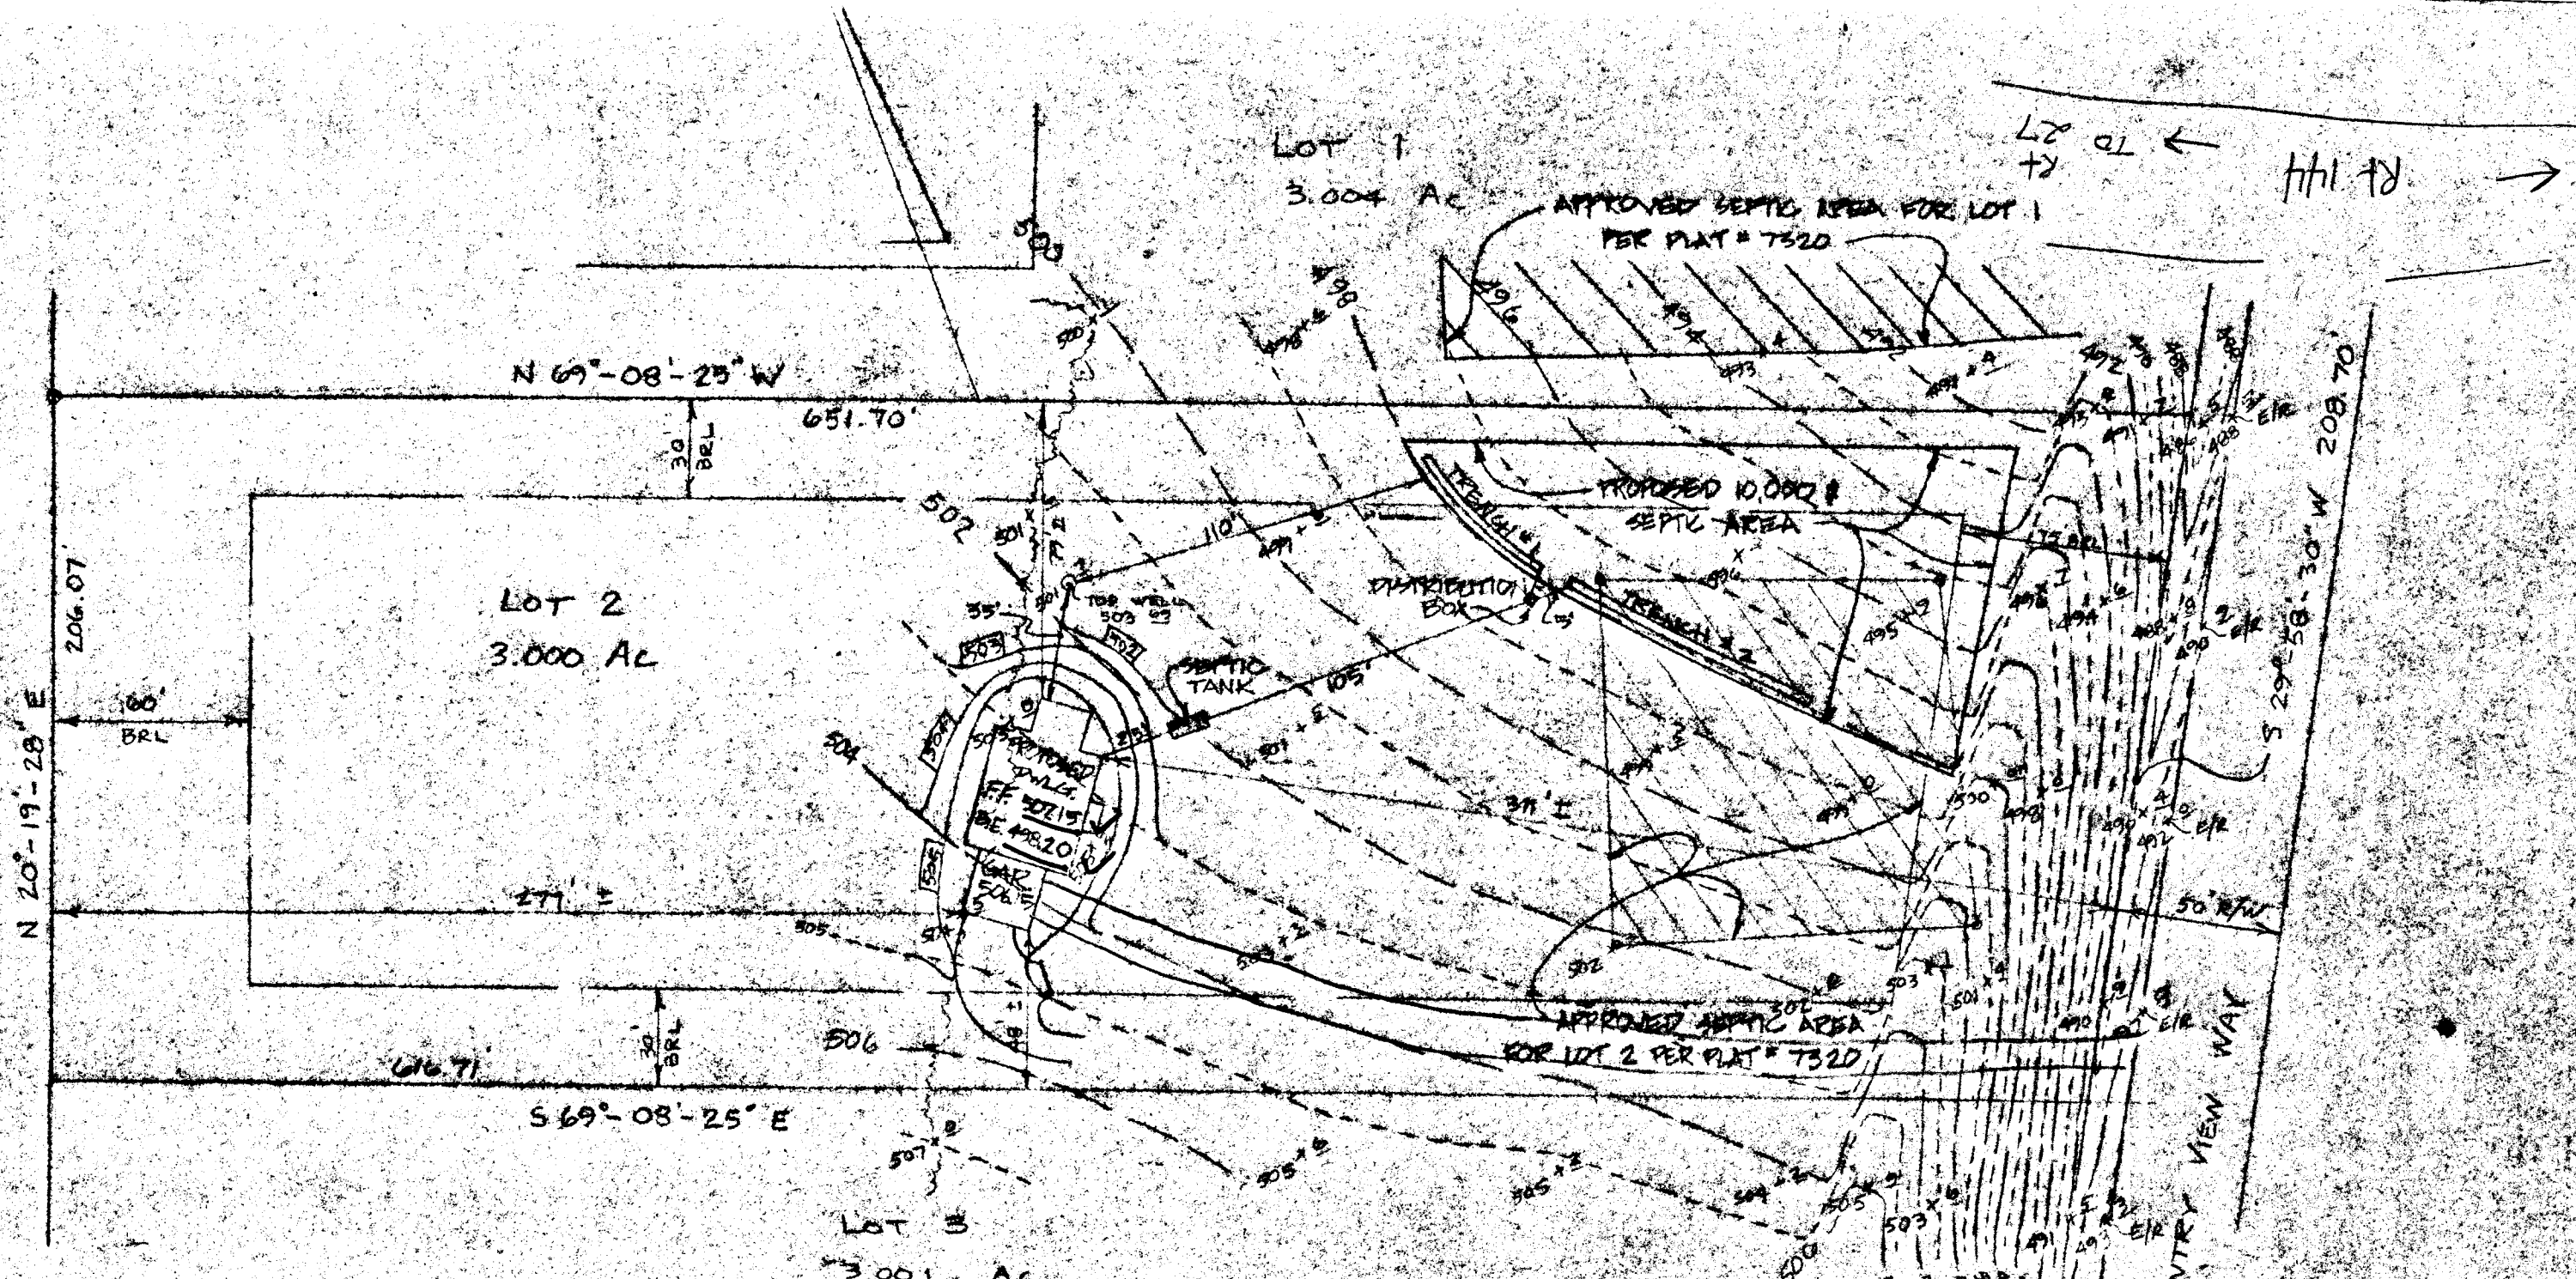

SHANABERGER AND LANE
 8726 TOWN AND COUNTRY BLVD
 SUITE 103
 ELLICOTT CITY, MARYLAND 21043

SEPTIC SYSTEM DATA

INV. @ HOUSE	496.20	⊕ BSMT	
<u>SEPTIC TANK</u>		<u>DISTRIBUTION BOX</u>	
EX. GRADE	502.0	EX. GRADE	498.8
FIN. GRADE	502.0	FIN. GRADE	499.3
INV. IN	495.95	INV. IN	494.6
INV. OUT	495.65	INV. OUT	494.4
<u>TRENCHES</u>			
	<u>TRENCH #1</u>	<u>TRENCH #2</u>	
EX. GRADE	497.8	497.8	
FIN. GRADE	497.8	497.8	
INV. IN	493.8	493.8	
BOTTOM	489.8	489.8	
LENGTH	50'	80'	

11/5/87
 elevations
 w/changes in
 inlet. S. 80

SITE PLAN
 LOT 2
 COUNTRY VIEW ESTATES
 LOTS 1-12
 Scale: 1" = 50' 11-2-87

BLDG. PERMIT SIGNED
 AND RETURNED 11-5-87
 SAU
 BP 1546/

Insufficient for 3BR need 158

B 7 1730

SEQUENCE NO. (OEP USE ONLY)

STATE OF MARYLAND PERMIT TO DRILL WELL

OEP PERMIT NUMBER

HO-81-2323

(THIS NUMBER IS TO BE PUNCHED IN COLS. 3-6 ON ALL CARDS)

please print or type.

fill in this form completely

Date Received

093087

997-5039

OWNER INFORMATION

Stanley Brian

10445A Hickory Ridge

Columbia MD 21074

LOCATION OF WELL

Howard

Country View Est

SECTION LOT 2

Mount Airy

MILES FROM TOWN (enter 0 if in town) 2 MI

DRILLER INFORMATION

Harry Edmondson 252


Harry Edmondson Drilling

741 Klee Mill Rd Westminster

Harry Edmondson 9-30-87

B 4

DIRECTION OF WELL FROM TOWN (CIRCLE BOX)



Country View Way

NEAR WHAT ROAD

ON WHICH SIDE OF ROAD (CIRCLE APPROPRIATE BOX)



320 DISTANCE FROM ROAD

ENTER FT or MI FT

B 2

WELL INFORMATION

APPROX. PUMPING RATE (GAL. PER MIN.) 5

AVERAGE DAILY QUANTITY NEEDED (GAL. PER DAY) 500

USE FOR WATER (CIRCLE APPROPRIATE BOX)

- HOME (SINGLE OR DOUBLE HOUSEHOLD UNIT ONLY)
FARMING (LIVESTOCK WATERING & AGRICULTURAL IRRIGATION)
INDUSTRIAL, COMMERCIAL, STATE AND FEDERAL GOV. OTHER (REQUIRES APPROPRIATION PERMIT)
PUBLIC OR PRIVATE WATER COMPANY (REQUIRES APPROPRIATION PERMIT AND STATE HEALTH DEPARTMENT APPROVAL)
TEST, OBSERVATION, MONITORING (MAY REQUIRE APPROPRIATION PERMIT)

NOT TO BE FILLED IN BY DRILLER HEALTH DEPARTMENT APPROVAL

HOWARD A 35519
COUNTY NAME COUNTY NO.
OEP SIGNATURE STATE HEALTH INSERT S
DATE ISSUED 09/30/87 B Edmondson 03/30/88
NORTH GRID 552000 EAST GRID 0763000

APPROXIMATE DEPTH OF WELL 200 FEET

APPROXIMATE DIAMETER OF WELL 6 INCH


METHOD OF DRILLING (circle one)

- BORED (or Augered) JETTED Jetted & DRIVEN
AIR-ROTary AIR-PERCussion ROTARY (Hydraulic Rotary)
CABLE REVERSE-ROTary DRIVE-POINT
other

SHOW MAJOR FEATURES OF BOX & LOCATE WELL WITH AN X


SOURCES OF DRILLING WATER

- 1.
2.
3.
WRITE THE BOX NUMBER FROM THE MAP HERE



106-87 Grout Location ok
78 ft casing
2 ft above ground
60+ ft open hole
bags cement
JE Nadeau

DRAW A SKETCH BELOW SHOWING LOCATION OF WELL IN RELATION TO NEARBY TOWNS AND ROADS AND GIVE DISTANCE FROM WELL TO NEAREST ROAD JUNCTION

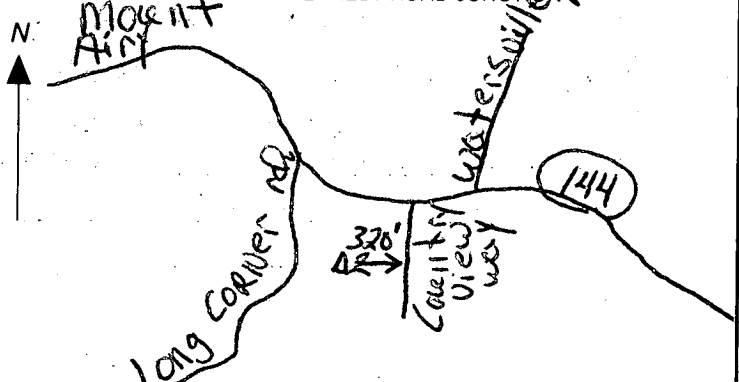

REPLACEMENT OR DEEPEMED WELLS (CIRCLE APPROPRIATE BOX)

- THIS WELL WILL NOT REPLACE AN EXISTING WELL
THIS WELL WILL REPLACE A WELL THAT WILL BE ABANDONED AND SEALED
THIS WELL WILL REPLACE A WELL THAT WILL BE USED AS A STANDBY
THIS WELL WILL DEEPEM AN EXISTING WELL
PERMIT NUMBER OF WELL TO BE REPLACED OR DEEPEMED (IF AVAILABLE)

Not to be filled in by driller (OEP USE ONLY)

APPROP. PERMIT NUMBER GAP

FORCE INITIALS PERMIT No. HO-81-2323

SPECIAL CONDITIONS

C1 1924

SEQUENCE NO. (OEP USE ONLY)

STATE OF MARYLAND WELL COMPLETION REPORT

THIS REPORT MUST BE SUBMITTED WITHIN 45 DAYS AFTER WELL IS COMPLETED.

COUNTY NUMBER A 35519

(THIS NUMBER IS TO BE PUNCHED IN COLS. 3-6 ON ALL CARDS)

DATE RECEIVED

DATE WELL COMPLETED 100687

DEPTH OF WELL 175 (TO NEAREST FOOT)

PERMIT NO. FROM "PERMIT TO DRILL WELL" HO-81-2323

OWNER STANLEY BRIAN, STREET OR RFD COUNTRY VIEW ESTATE, TOWN MOUNT AIRY, SUBDIVISION COUNTRY VIEW ESTATE, SECTION, LOT 2

WELL LOG Not required for driven wells. STATE THE KIND OF FORMATIONS PENETRATED, THEIR COLOR, DEPTH, THICKNESS AND IF WATER BEARING

Table with columns: DESCRIPTION (Use additional sheets if needed), FEET (FROM, TO), Check if water bearing. Rows include Brown Clay, Brown soil, Shell, White & gray Browns rock, Gray & white.

GROUTING RECORD WELL HAS BEEN GROUTED (Circle Appropriate Box) TYPE OF GROUTING MATERIAL CEMENT (CM) BENTONITE CLAY (BC)

NO. OF BAGS 24 NO. OF POUNDS 2256 GALLONS OF WATER 144 DEPTH OF GROUT SEAL (to nearest foot) from 0 ft. to 60 ft.

CASING RECORD MAIN Nominal diameter top (main) casing TYPE ST 06 Total depth of main casing (nearest foot) 78

OTHER CASING (if used) diameter inch depth (feet) from to

SCREEN RECORD screen type or open hole insert appropriate code below ST BR HO STEEL BRASS OPEN HOLE PL OT PLASTIC OTHER

DEPTH (nearest ft.) H O 76 175

SLOT SIZE 1 2 3 DIAMETER OF SCREEN (NEAREST INCH) from to GRAVEL PACK IF WELL DRILLED WAS FLOWING WELL INSERT F IN BOX 68


OEP USE ONLY (NOT TO BE FILLED IN BY DRILLER) T (E.R.O.S.) WQ TELESCOPE CASING LOG INDICATOR OTHER DATA

DRILLERS IDENT. NO. 282, DRILLERS SIGNATURE, SITE SUPERVISOR responsible for sitework if different from permittee

C 3

PUMPING TEST HOURS PUMPED (nearest hour) 04 PUMPING RATE (gal. per min. to nearest gal.) 4 METHOD USED TO MEASURE PUMPING RATE 1 gal. WATER LEVEL (distance from land surface) BEFORE PUMPING 50 WHEN PUMPING 94 TYPE OF PUMP USED (for test) S submersible

PUMP INSTALLED DRILLER WILL INSTALL PUMP YES (NO) IF DRILLER INSTALLS PUMP, THIS SECTION MUST BE COMPLETED FOR ALL WELLS EXCEPT HOME USE TYPE OF PUMP INSTALLED PLACE (A,C,J,P,R,S,T,O) IN BOX - SEE ABOVE: CAPACITY: GALLONS PER MINUTE (to nearest gallon) PUMP HORSE POWER PUMP COLUMN LENGTH (nearest ft.) CASING HEIGHT (circle appropriate box and enter casing height) LAND SURFACE 02 (nearest foot)

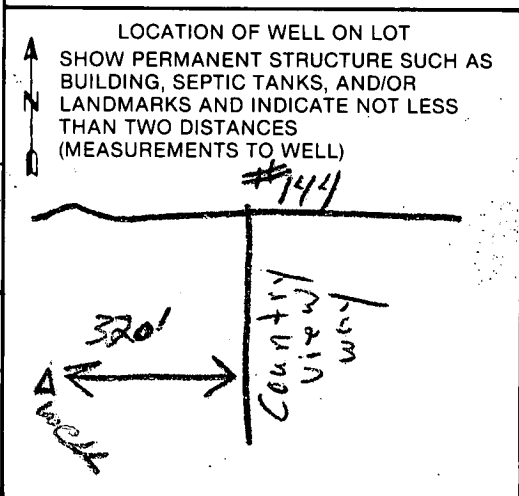

HOWARD COUNTY HEALTH DEPARTMENT
 Bureau of Environmental Health
 3525-H Ellicott Mills Drive
 Ellicott City, MD 21043
 461-9933

APPLICATION FOR PITLESS ADAPTER, WELL PUMP AND PRESSURE TANK INSTALLATION

New Installation Replacement Receipt # 41472
 Date 4-8-88

Name of Installer VAN SANT PLUMBING Telephone _____

License Number _____ Certified Well Pump Installer Well Driller _____ Registered Plumber _____

Name of Property Owner BRIAN S. STAHLEY Telephone 301-997-5039
 Subdivision COUNTRY VIEW Lot # 2 Well Tag # 40-81-2325
 Site Address 17508 COUNTRY VIEW WAY MT. AIRY MD

Pump	Motor	Pitless Adapter
1. Type	1. Horsepower _____	1. Make _____
a. Deep well jet _____	2. RPM _____	2. Model # _____
b. Shallow well jet _____	3. Voltage _____	3. Depth _____
c. Submersible _____	a. 110 _____	
2. Make _____	b. 220 _____	
3. Model # _____		
4. Capacity _____ GPM		
5. Pump exceeds well capacity Yes _____ No _____		
6. If Yes, is low pressure cutoff switch installed? Yes _____ No _____		
7. What methods are used to protect the pump and electrical wiring from vibrations? Torque arrestors _____ Cable guards _____ Other _____		

Tank	Piping	Well data
1. Capacity _____	1. Type _____	1. Depth <u>175</u> ft.
2. Pressure relief valve? _____	2. Size _____	2. Yield <u>4</u> GPM
	3. NSF and/or BOCA Code approved _____	3. Static water level <u>50</u> ft.
	4. Depth of supply line _____	4. Will water supply be disinfected by installer? <input checked="" type="checkbox"/>

4-4-88
 Pitless adaptor at 42 inches. Well line covered in trench. Ground line attached. House connection covered. Owner said no pump-tank was installed yet. SD

I understand that it is my responsibility to notify the Howard County Health Department when the installation is ready for inspection (otherwise this permit is null and void).

All information given above is true to the best of my knowledge.
 Signature of Applicant: B. S. Stahley
 Date: 4-9-88


Note: A sticker indicating approval/status of the installation will be placed on the well casing at the time of the inspection.

Roles Storage Building
17508 Country View Way


LEE E. MUMMAU
PLAT #3862



HOUSE DETAIL
SCALE 1"=30'

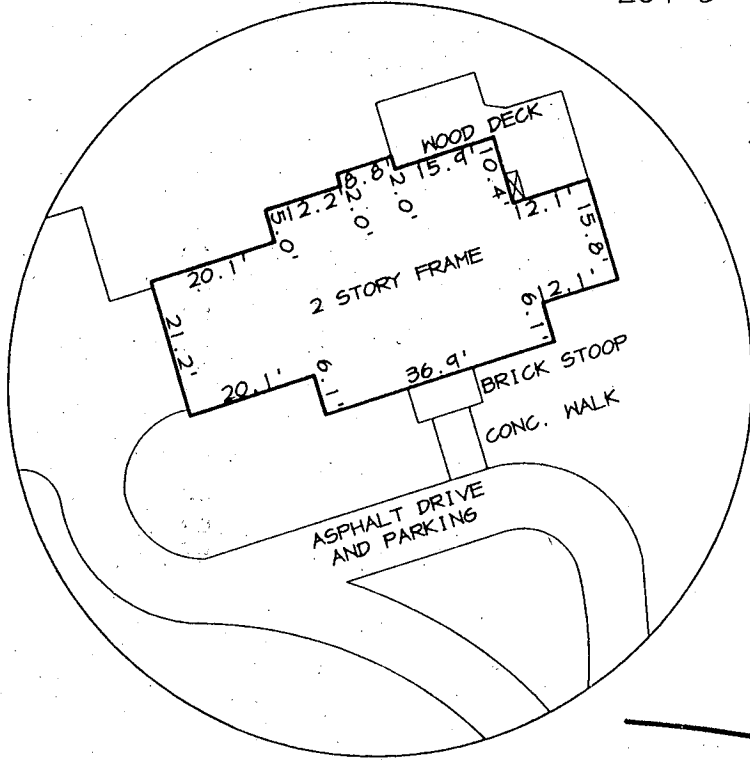

B. 00102923
STORAGE BUILDING
NO IMPACT TO WILL ON
OR TO PA
78'10"

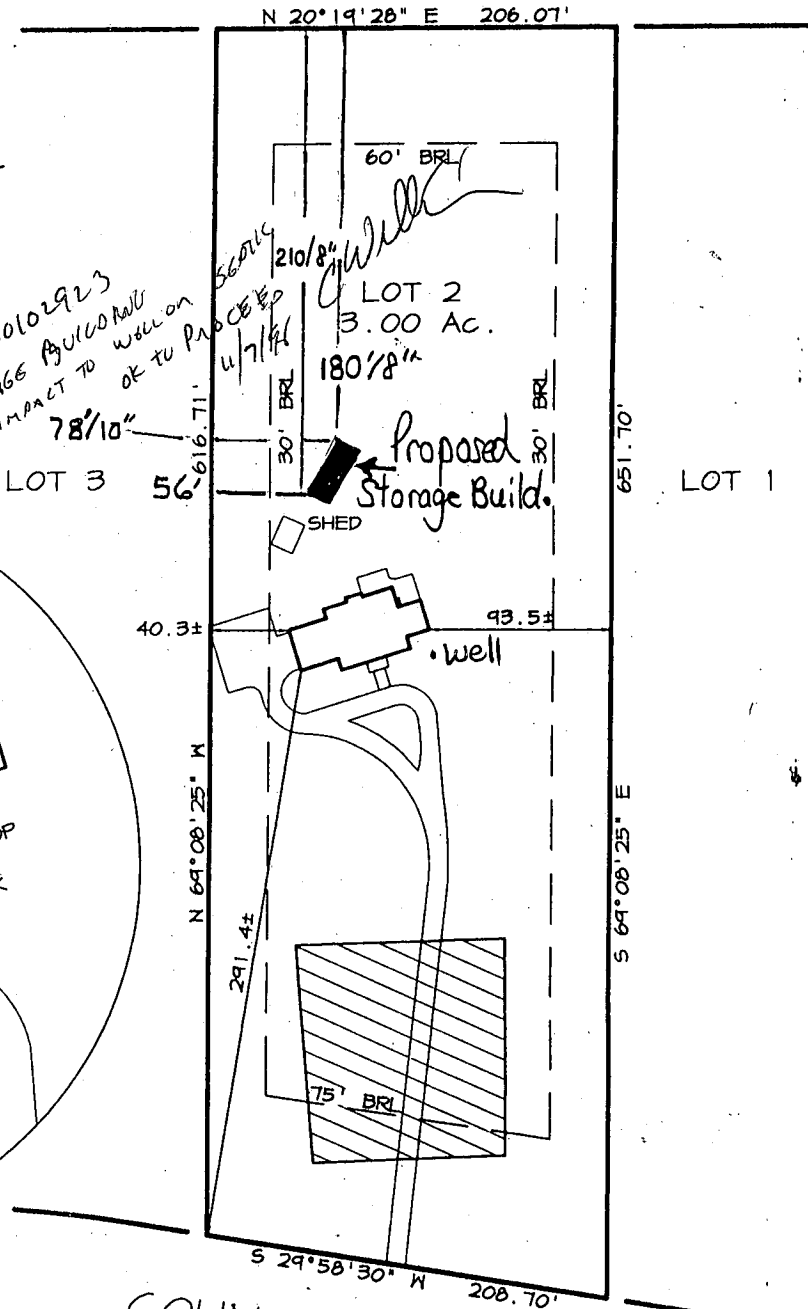

COUNTRY VIEW WAY
(50' R/W)

NOTE:

- THIS PLAT IS OF BENEFIT TO A CONSUMER ONLY INSOFAR AS IT IS REQUIRED BY A LENDER OR A TITLE COMPANY OR ITS AGENT IN CONNECTION WITH CONTEMPLATED TRANSFER, FINANCING, OR RE-FINANCING;
- THE PLAT IS NOT TO BE RELIED UPON FOR THE ESTABLISHMENT OR LOCATION OF FENCES, GARAGES, BUILDINGS, OR OTHER EXISTING OR FUTURE IMPROVEMENTS; AND
- THE PLAT DOES NOT PROVIDE FOR THE ACCURATE IDENTIFICATION OF PROPERTY BOUNDARY LINES, BUT SUCH IDENTIFICATION MAY NOT BE REQUIRED FOR THE TRANSFER OF TITLE.

THIS IS TO CERTIFY THAT I HAVE SURVEYED THE PROPERTY SHOWN HEREON FOR THE PURPOSE OF LOCATING THE IMPROVEMENTS ON SAID PROPERTY AND THAT THE IMPROVEMENTS ARE LOCATED AS SHOWN; AND FURTHER CERTIFY THAT THE SUBJECT PROPERTY LIES IN ZONE "C" (AREA OF MINIMAL FLOODING) AS SHOWN ON F.I.R.M. MAP No. 240044 0007B DATED 12-4-86 FOR HOWARD COUNTY, MARYLAND.

ALAN V. SHACKELFORD

DATE

RIEMER MUEGGE & ASSOCIATES, INC.

ENGINEERING • ENVIRONMENTAL SERVICES • PLANNING • SURVEYING

8818 Centre Park Drive, Columbia, Maryland 21045

tel 410.997.8900 fax 410.997.9282

LOCATION DRAWING

LOT 2
COUNTRY VIEW
4th ELECTION DISTRICT
PLAT #7320

SCALE: 1"=100'

PROJ. No.

DRAWN BY: D.M.M.

DATE: 8-8-96