

Approved 12/5/84
Stamps

10/5/84
(11-12 AM)

PERMIT

P 34489

A 32185

SEWAGE DISPOSAL SYSTEM

MARYLAND STATE DEPARTMENT OF HEALTH

ELLICOTT CITY

HOWARD COUNTY
BUREAU OF ENVIRONMENTAL HEALTH
992-2330

DISTRICT 5th

INDEXED

DATE 10-19-84

C. C. Cissel

IS PERMITTED TO INSTALL ALTER

ADDRESS 14079 Brighton Dam Road, Clarksville, MD 21029 PHONE 854-2006

SUBDIVISION Jocelyn Acres ROAD 13405 Highland Road LOT 11, Sec. 3

PROPERTY OWNER Paul Warshowsky

ADDRESS 10644 Highbeam Court
Columbia, Maryland 21044

IF GARBAGE GRINDER IS USED INCREASE SEPTIC TANK CAPACITY BY 50% AND ABSORPTION AREA BY 22%.

GARBAGE GRINDER? YES NO

SEPTIC TANK CAPACITY 1000 GALLONS NUMBER OF BEDROOMS 3

DEEP TRENCHES - 158 sq. ft. one sidewall area per bedroom. Ditch is to be 2 feet wide. 8 feet deep, with inlet at 3 feet below original grade and filled with 5 ft. of stone. Length of the ditch depends on the number of sq. ft. needed. Start the ditch at perc hole #3 and run it along level ground toward perc hole #2. Perc hole #3 is located 160 feet from the front lot line and 190 feet from the right lot line as seen when facing the lot from Rich Lynn Court. Perc hole #2 is located 160 feet from the front lot line and 70 feet from the right lot line as seen when facing the lot from Rich Lynn Court.

NOTE: No Trench to exceed 100 feet in length. If more than one trench used, a distribution box is required. Trenches to be installed on level ground. Call for inspection of trench before and after gravel is installed. Provide 6" - 8" diameter cleanout and cap to grade or above on septic tank.

BLDG. PERMIT SIGNED AND RETURNED 10/20/83
Serial # 50938 - addition

PLANS APPROVED BY Raymond Hodges DATE 10/11/83

COVER NO WORK UNTIL INSPECTED AND APPROVED.

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM.

NOTE: IF TRENCH IS USED CALL FOR INSPECTION BEFORE AND AFTER PLACING GRAVEL IN TRENCH.

NOTE: NO DRY WELL SHALL EXCEED 15 FOOT IN DIAMETER. NO ABSORPTION TRENCH TO EXCEED 100 FEET IN LENGTH.

NOTE: ALL PIPE FROM HOUSE TO SEPTIC TANK MUST BE CAST IRON OR SCHEDULE 40 PVC OR ABS.

BLDG. PERMIT SIGNED AND RETURNED 9/14/88
Serial # 21236
Addition - garage

PERMIT VOID AFTER THREE YEARS.


NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL. STAND PIPES MUST BE 6 INCHES IN DIAMETER. CAST IRON, CONCRETE OR TERRA COTTA, OR PVC OR ABS ACCEPTED. IF TOP OF SEPTIC TANK IS DEEPER THAN 3 FEET MANHOLE TO GRADE REQUIRED.

***INSTALLER IS RESPONSIBLE FOR OBTAINING FINAL APPROVAL ON THIS PERMIT**

*CALL 992-2330 FOR INSPECTION OF SEPTIC SYSTEMS.

EH - 2-1082

A 32185

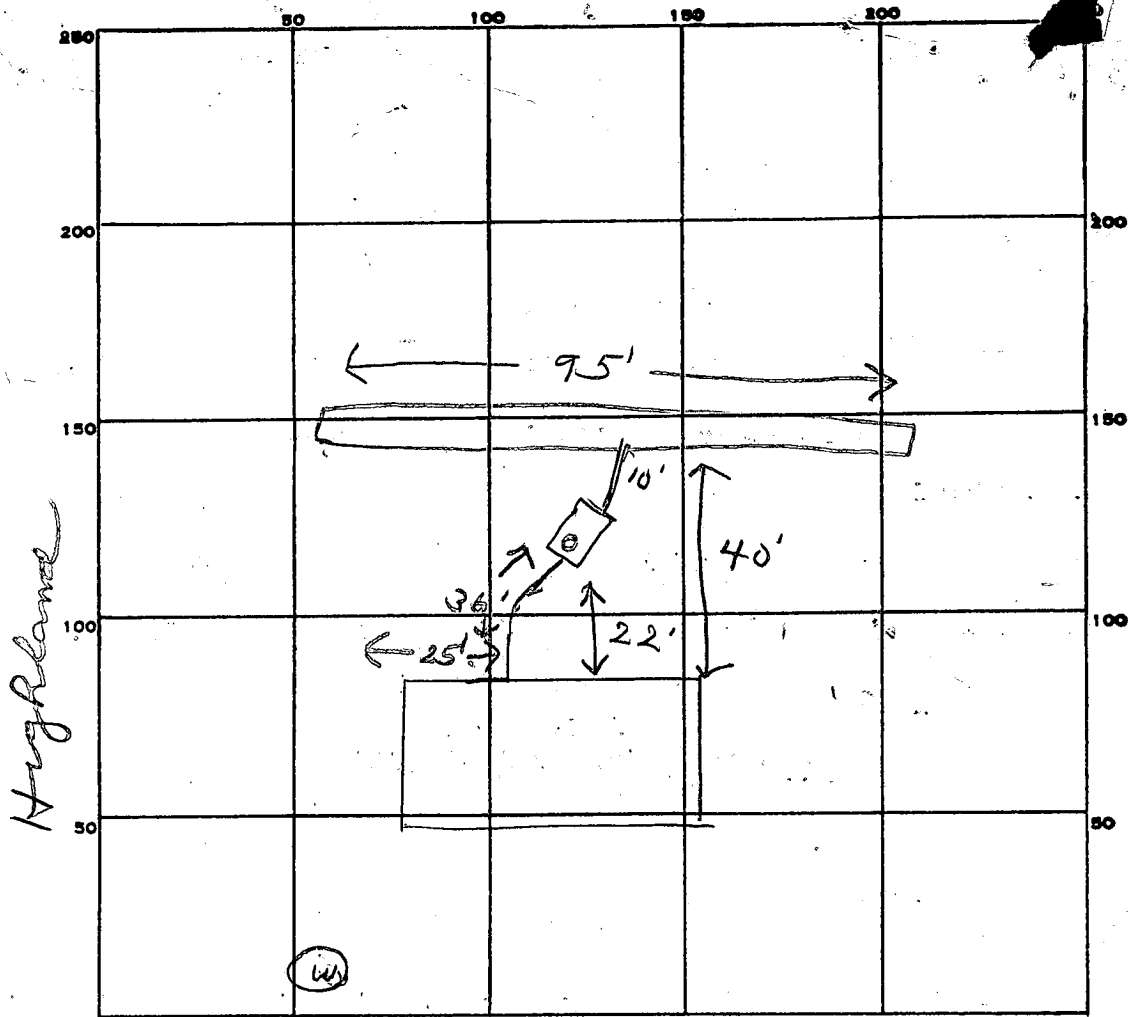

INDICATE NORTH. - NAME ADJOINING ROADWAY AS BASE LINE.

PERMIT CARD Rich Lynn
 SEPTIC TANK, LEVEL 1000 gal CLEANOUTS ST
 DISTRIBUTION BOX, LEVEL _____
 TILE FIELD, DEPTH 8 FT. TRENCH WIDTH 2 FT.
 GRAVEL DEPTH 5 +' TOTAL LENGTH 95 FT.
 NUMBER OF TRENCHES 1 TOTAL BOTTOM AREA 475
 SEEPAGE PITS, INSIDE DIAMETER _____ FT. DEPTH BELOW INLET _____ FT.
 ABSORBENT AREA 475 SQ. FT.

REMARKS 12/4/84 OK to add stone in trench. JS
12/5/84 OK to cover all work JS

DATE SYSTEM APPROVED 12/5/84 INSPECTOR Stover

APPLICATION

A 32185

SEWAGE DISPOSAL TESTING

STATE OF MARYLAND - DEPARTMENT OF HEALTH AND MENTAL HYGIENE

HOWARD COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SERVICES
P. O. BOX 473 ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 992-2330

DISTRICT 5th

DATE 9-16-82

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I HEREBY APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER RICHARD DEMITT Paul Warshowsky
ADDRESS 9966 MARYLAND ROUTE 99 10644 Highbeam Ct. Columbia, Md 21046 PHONE 465-4544 997-8929

PROPERTY LOCATION:

SUBDIVISION JOCELYN ACRES, SECTION 3 LOT NO. 11

ROAD AND DESCRIPTION HIGHLAND ROAD, DIRECTLY ACROSS FROM ALLNUT LANE

SIZE OF LOT 3 ACRES TYPE BLDG. SINGLE FAMILY DWELLING
(NUMBER OF BEDROOMS) 13405

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE. I FULLY UNDERSTAND THE FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER ANY CIRCUMSTANCES. I ALSO AGREE TO COMPLY

WITH ALL M.O.S.H.A. REQUIREMENTS IN TESTING THIS LOT. Charles J. Conner
(SIGNATURE OF APPLICANT)

APPROVED BY Raymond Hodge FOR BENCH DATE 10/11/83

REJECTED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING 9/29/82 PERC OK HOLD FOR PWA T
10/11/83 spec written BLDG. PERMIT SIGNED AND RETURNED 5/6/84
Serial # 58797-SFD

THIS IS NOT A PERMIT

SOIL PROFILE

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE.

DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME
			START	STOP	START	STOP	

REMARKS _____

TYPE OF SOIL _____

TESTED BY _____ ALSO PRESENT _____

EII-12-1079

APPLICATION

A 32185

SEWAGE DISPOSAL TESTING

STATE OF MARYLAND - DEPARTMENT OF HEALTH AND MENTAL HYGIENE

P _____

HOWARD COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SERVICES
P. O. BOX 473 ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 992-2330

DISTRICT 5th

DATE 9-16-82

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I HEREBY APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER RICHARD DEMMITT

ADDRESS 9966 MARYLAND ROUTE 99 PHONE 465-4544

PROPERTY LOCATION:

SUBDIVISION JOCELYN ACRES, SECTION 3 LOT NO. 11


ROAD AND DESCRIPTION HIGHLAND ROAD, DIRECTLY ACROSS FROM ALLNUT LANE

SIZE OF LOT 3 ACRES TYPE BLDG. SINGLE FAMILY DWELLING
(NUMBER OF BEDROOMS)

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE. I FULLY UNDERSTAND THE

FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER ANY CIRCUMSTANCES. I ALSO AGREE TO COMPLY

WITH ALL M.O.S.H.A. REQUIREMENTS IN TESTING THIS LOT.



(SIGNATURE OF APPLICANT)

APPROVED BY _____ FOR _____ DATE _____

REJECTED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING _____

THIS IS NOT A PERMIT

B 1 732 SEQUENCE NO. (OEP USE ONLY)
THIS NUMBER IS TO BE PUNCHED IN COLS. 3-6 ON ALL CARDS


STATE OF MARYLAND
PERMIT TO DRILL WELL
9/21/83
11:00 A.M. please print or type

OEP PERMIT NUMBER
HO-81-0273
fill in this form completely

Date Received 091383
OWNER INFORMATION
Last Name: WARSHOWSKY
Owner: PAZL
Street or RFD: 10644 HIGH BEAN COURT
Town: COLUMBIA MD 21044

LOCATION OF WELL
COUNTY: HOWARD
SUBDIVISION: JOCELYN ACRES
SECTION: 3 LOT: 11
NEAREST TOWN: HIGHLAND
MILES FROM TOWN: 1.5 MI

DRILLER INFORMATION
Driller's Name: Joseph L. Mayne License No. 238
Firm Name: Joseph L. Mayne Well Drilling
Address: 5512 Ridge Rd. Mt. Airy MD 21771
Signature: Joseph L. Mayne Date: 9/9/83

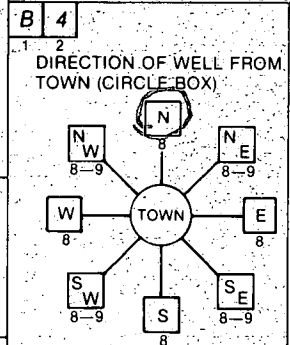

NEAR WHAT ROAD: Rich Lynn Ct.
ON WHICH SIDE OF ROAD (CIRCLE APPROPRIATE BOX): WEST
DISTANCE FROM ROAD: 42 FT

WELL INFORMATION
APPROX. PUMPING RATE (GAL. PER MIN.): 5
AVERAGE DAILY QUANTITY NEEDED (GAL. PER DAY): 500

NOT TO BE FILLED-IN BY DRILLER HEALTH DEPARTMENT APPROVAL
COUNTY NAME: HOWARD COUNTY NO. A 32185
OEP SIGNATURE: Frank Shinn DATE ISSUED: 091683
CO SIGNATURE: Frank Shinn EXP. DATE: 3/16/84
NORTH GRID: 496000 EAST GRID: 0806000


USE FOR WATER (CIRCLE APPROPRIATE BOX)
D HOME (SINGLE OR DOUBLE HOUSEHOLD UNIT ONLY)
F FARMING (LIVESTOCK WATERING & AGRICULTURAL IRRIGATION)
I INDUSTRIAL, COMMERCIAL, STATE AND FEDERAL GOV. OTHER (REQUIRES APPROPRIATION PERMIT)
P PUBLIC OR PRIVATE WATER COMPANY (REQUIRES APPROPRIATION PERMIT AND STATE HEALTH DEPARTMENT APPROVAL)
T TEST, OBSERVATION, MONITORING (MAY REQUIRE APPROPRIATION PERMIT)

APPROXIMATE DEPTH OF WELL: 200 FEET


APPROXIMATE DIAMETER OF WELL: 6 INCH NEAREST

METHOD OF DRILLING (circle one)
BORED (or Augered) AIR-ROTary
JETTED JETTED & DRIVEN
CABLE REVERSE-ROTary DRIVE-POINT

SHOW MAJOR FEATURES OF BOX & LOCATE WELL WITH AN X
SOURCES OF DRILLING WATER: 1. well
WRITE THE BOX NUMBER FROM THE MAP HERE:
E 800 6
N 490 6

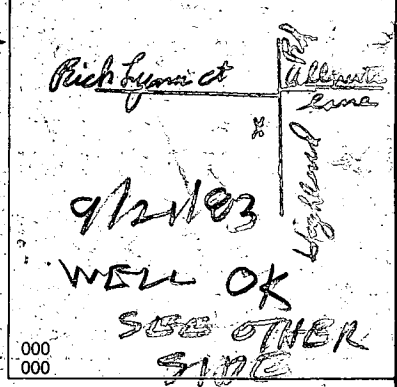


REPLACEMENT OR DEEPEMED WELLS (CIRCLE APPROPRIATE BOX)
N THIS WELL WILL NOT REPLACE AN EXISTING WELL
Y THIS WELL WILL REPLACE A WELL THAT WILL BE ABANDONED AND SEALED
S THIS WELL WILL REPLACE A WELL THAT WILL BE USED AS A STANDBY
D THIS WELL WILL DEEPEMED AN EXISTING WELL
PERMIT NUMBER OF WELL TO BE REPLACED OR DEEPEMED (IF AVAILABLE):

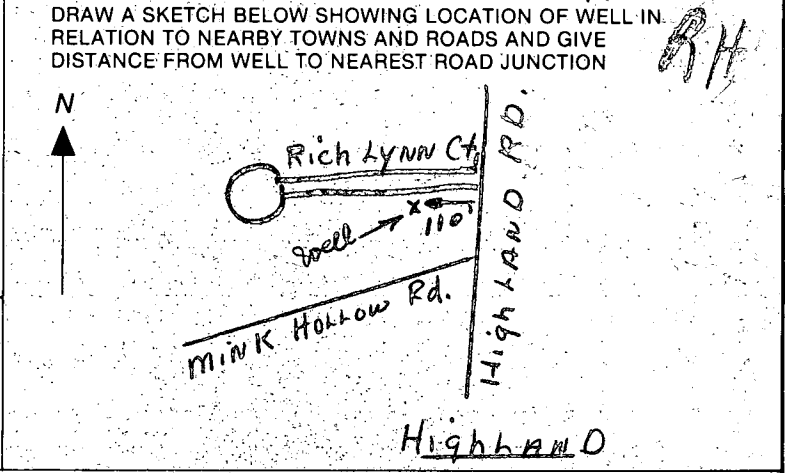


Not to be filled in by driller (OEP USE ONLY)
APPROX. PERMIT NUMBER: GAP
FORCE INITIALS IN BOX: FS PERMIT NO.: HO-81-0273

SPECIAL CONDITIONS

also present Larry Mayne
Tom called in well grout

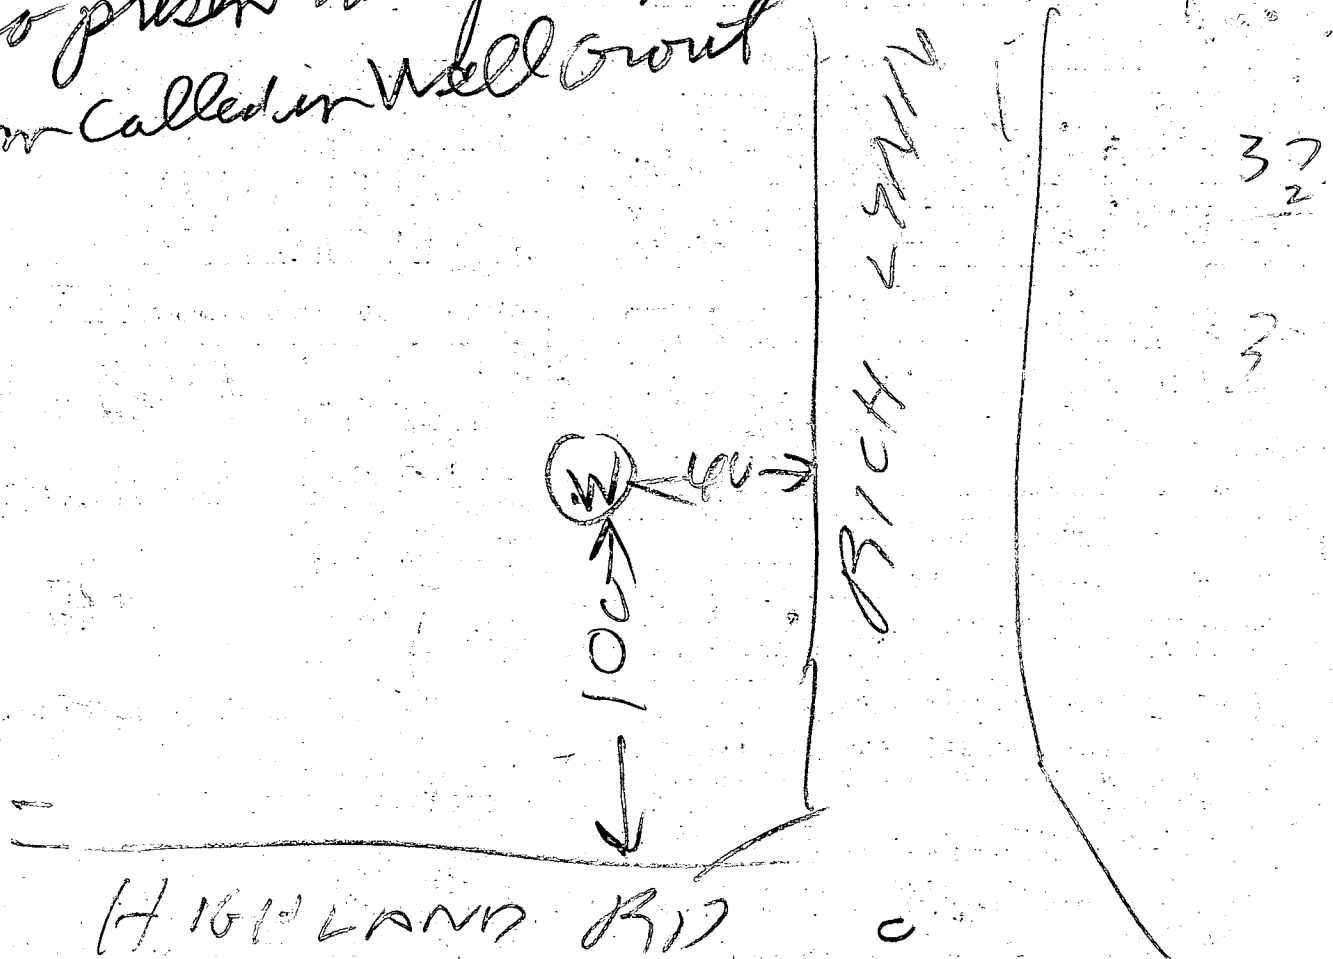

- ① Arrive 1105 Well already grouted L. Mayne said he thought it was to be grouted 830 AM & He grouted it at 245
- ② 8 Bags used
- ③ 33 ft open hole
- ④ 35 ft casing
- ⑤ LOCATION OK
- ⑥ HOLD FOR REVIEW PROBABLY
- ⑦ MIX UP IN COMMUNICATION RN
- ⑧ HELP FOR REVIEW FS SAID OK CONFUSION ABOUT APPOINTMENT

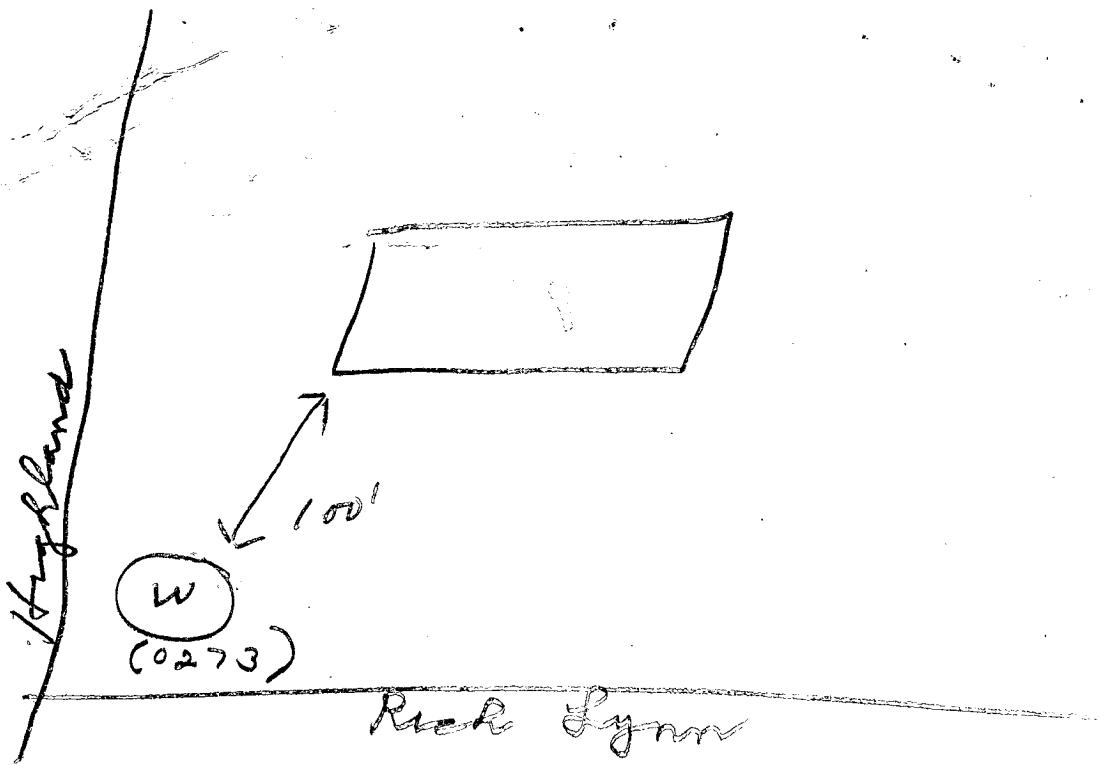

12/5/84 Pump, pitless & line installed
at 5 ft below grade. No work completed
inside. S

C1 4447 SEQUENCE NO. (OEP USE ONLY)

STATE OF MARYLAND WELL COMPLETION REPORT

THIS REPORT MUST BE SUBMITTED WITHIN 45 DAYS AFTER WELL IS COMPLETED.

(THIS NUMBER IS TO BE PUNCHED IN COLS. 3-6 ON ALL CARDS)

COUNTY NUMBER A 32185

DATE RECEIVED

DATE WELL COMPLETED

DEPTH OF WELL

PERMIT NO. FROM "PERMIT TO DRILL WELL"

DATE RECEIVED grid

DATE WELL COMPLETED grid: 09/21/93

DEPTH OF WELL grid: 143

PERMIT NO. grid: 40-81-0273

OWNER: Warshawsky Paul; STREET OR RFD: Rich Lynn Court; TOWN: Highland; SUBDIVISION: Jocelyn Acres; SECTION: 3; LOT: 11

WELL LOG: Not required for driven wells. STATE THE KIND OF FORMATIONS PENETRATED, THEIR COLOR, DEPTH, THICKNESS AND IF WATER BEARING

Table with columns: DESCRIPTION (Use additional sheets if needed), FEET (FROM, TO), Check if water bearing. Includes handwritten entries: Brown Shale, Gray mica rock.

GROUTING RECORD: WELL HAS BEEN GROUTED (Circle appropriate box) YES [Y] NO [N]

TYPE OF GROUTING MATERIAL: CEMENT [CM] BENTONITE CLAY [BC]; NO. OF BAGS: 9; NO. OF POUNDS: 752

CASING RECORD: casing types insert appropriate code below. Includes codes: ST (STEEL), CO (CONCRETE), PL (PLASTIC), OT (OTHER)

MAIN CASING: Nominal diameter, Total depth. Includes codes: S (STEEL), B (BRASS), H (HOLE), P (PLASTIC), O (OTHER)

OTHER CASING (if used): diameter, depth (feet)

SCREEN RECORD: screen type or open hole insert appropriate code below. Includes codes: ST (STEEL), BR (BRASS), HO (OPEN HOLE), PL (PLASTIC), OT (OTHER)

DEPTH (nearest ft.) grid: 143. Includes SLOT SIZE and DIAMETER OF SCREEN

GRAVEL PACK: IF WELL DRILLED WAS FLOWING WELL INSERT F IN BOX 68

OEP USE ONLY (NOT TO BE FILLED IN BY DRILLER): T (TELESCOPE CASING), WQ (WELL QUALITY), LOG INDICATOR, OTHER DATA

PUMPING TEST: HOURS PUMPED (nearest hour)


PUMPING RATE (gal. per min. to nearest gal.), METHOD USED TO MEASURE PUMPING RATE, WATER LEVEL (distance from land surface)

WHEN PUMPING: TYPE OF PUMP USED (for test). Includes codes: A (air), P (piston), T (turbine), C (centrifugal), R (rotary), O (other), J (jet), S (submersible)

PUMP INSTALLED: DRILLER WILL INSTALL PUMP YES [X] NO []

TYPE OF PUMP INSTALLED PLACE (A,C,J,P,R,S,T,O) IN BOX - SEE ABOVE: CAPACITY, GALLONS PER MINUTE, PUMP HORSE POWER, PUMP COLUMN LENGTH, CASING HEIGHT

LOCATION OF WELL ON LOT: SHOW PERMANENT STRUCTURE SUCH AS BUILDING, SEPTIC TANKS, AND/OR LANDMARKS AND INDICATE NOT LESS THAN TWO DISTANCES (MEASUREMENTS TO WELL)

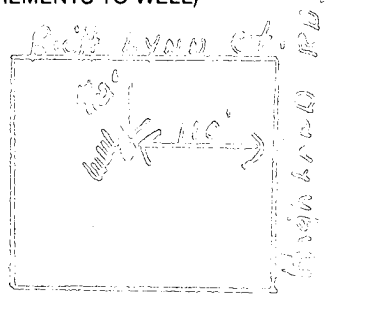


RECEIVED SEP 30 3 26 PM '93 HOWARD COUNTY HEALTH DEPT. ELICOTT CITY, MD


THE COORDINATES SHOWN HEREON ARE BASED ON HOWARD COUNTY CONTROL STATIONS AS FOLLOWS:
 STATION 2535003-R N 497,692.128 E 805,559.325
 STATION 2535007-R N 497,679.862 E 805,047.269

PAUL WERTHowsky
 70644 High Beam Ct
 Columbia Md 21047
 997-8929 (h)
 997-4101 (w)

LAND DEDICATED TO HOWARD COUNTY FOR THE PURPOSE OF A PUBLIC ROAD.
 0.3836 Ac ±

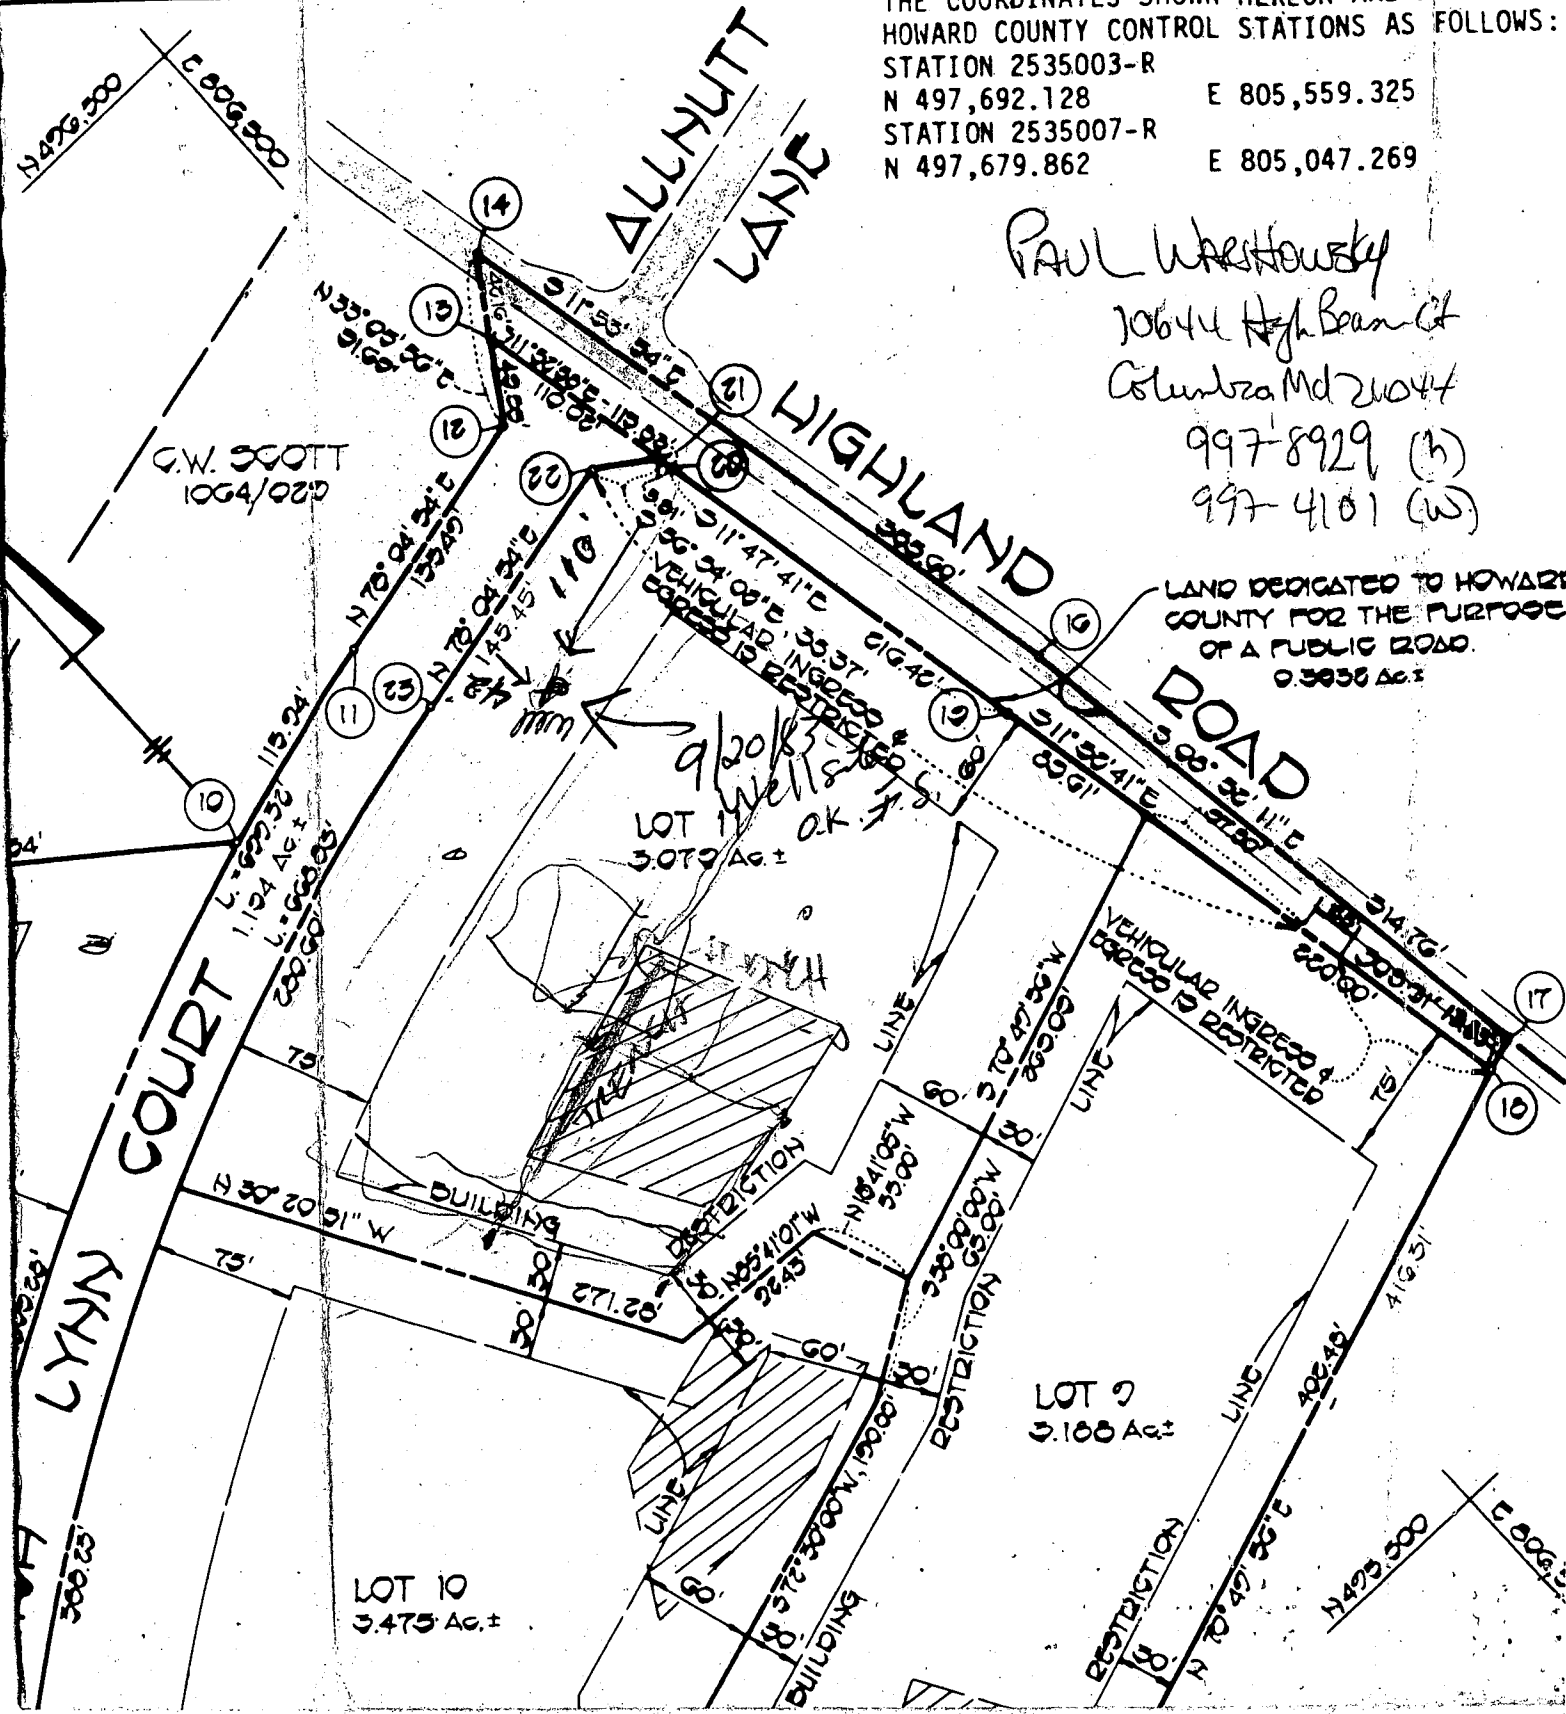

Plot # 5585

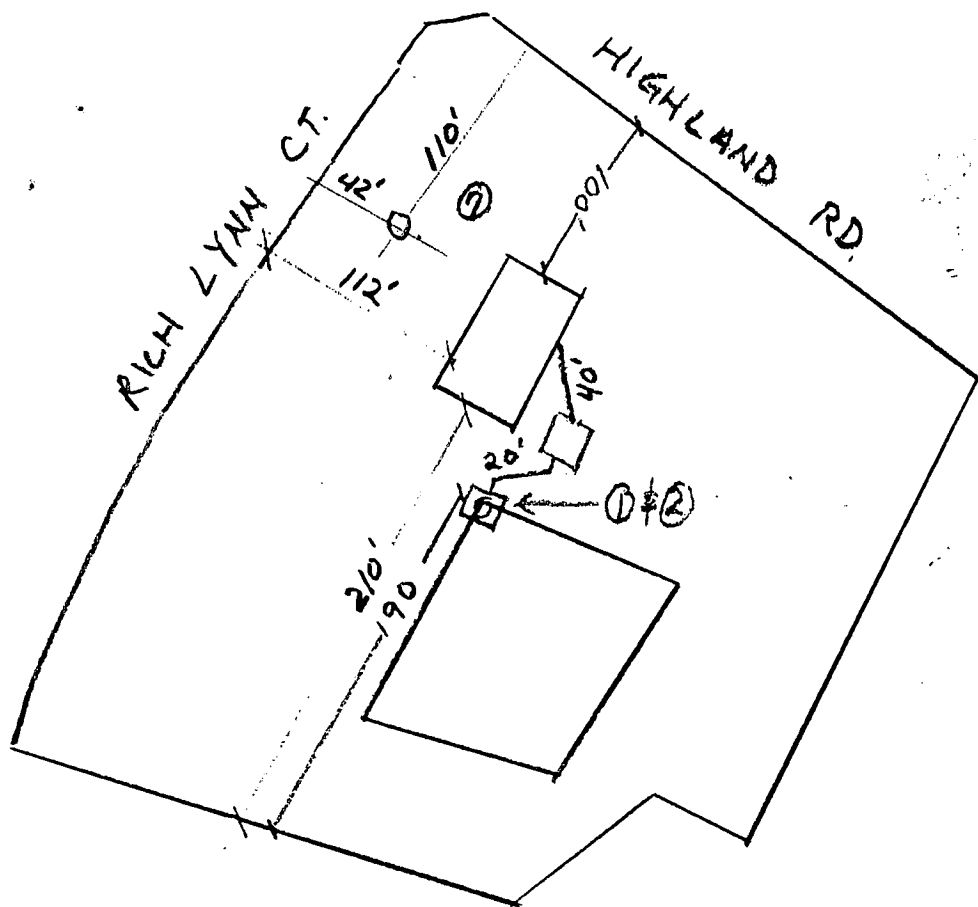



Elevations are relative elevations

- ① ORIG. ELEV. AT TIME OF PERC 100.0
- ② EXIST. ELEV. 100.0
- ③ DISTRIBUTION BOX INVERT ELEV. 97.0
- ④ INVERT OUT OF SEPTIC TANK 97.8 EXIST. ELEV. 99.5
- ⑤ INVERT INTO SEPTIC TANK 98.05
- ⑥ INVERT OUT OF HOUSE 98.45
- ⑦ WELL ELEVATION 109.3
- ⑧ 1ST FLOOR ELEVATION. 104.0
- ⑨ BASEMENT ELEVATION 95.25


5/2/84
 Sketch OK.
 J.S.

I certify that the above measurements and elevations are actual and correct for this property.

Daniel Ostericher
 Daniel Ostericher
 627-1789

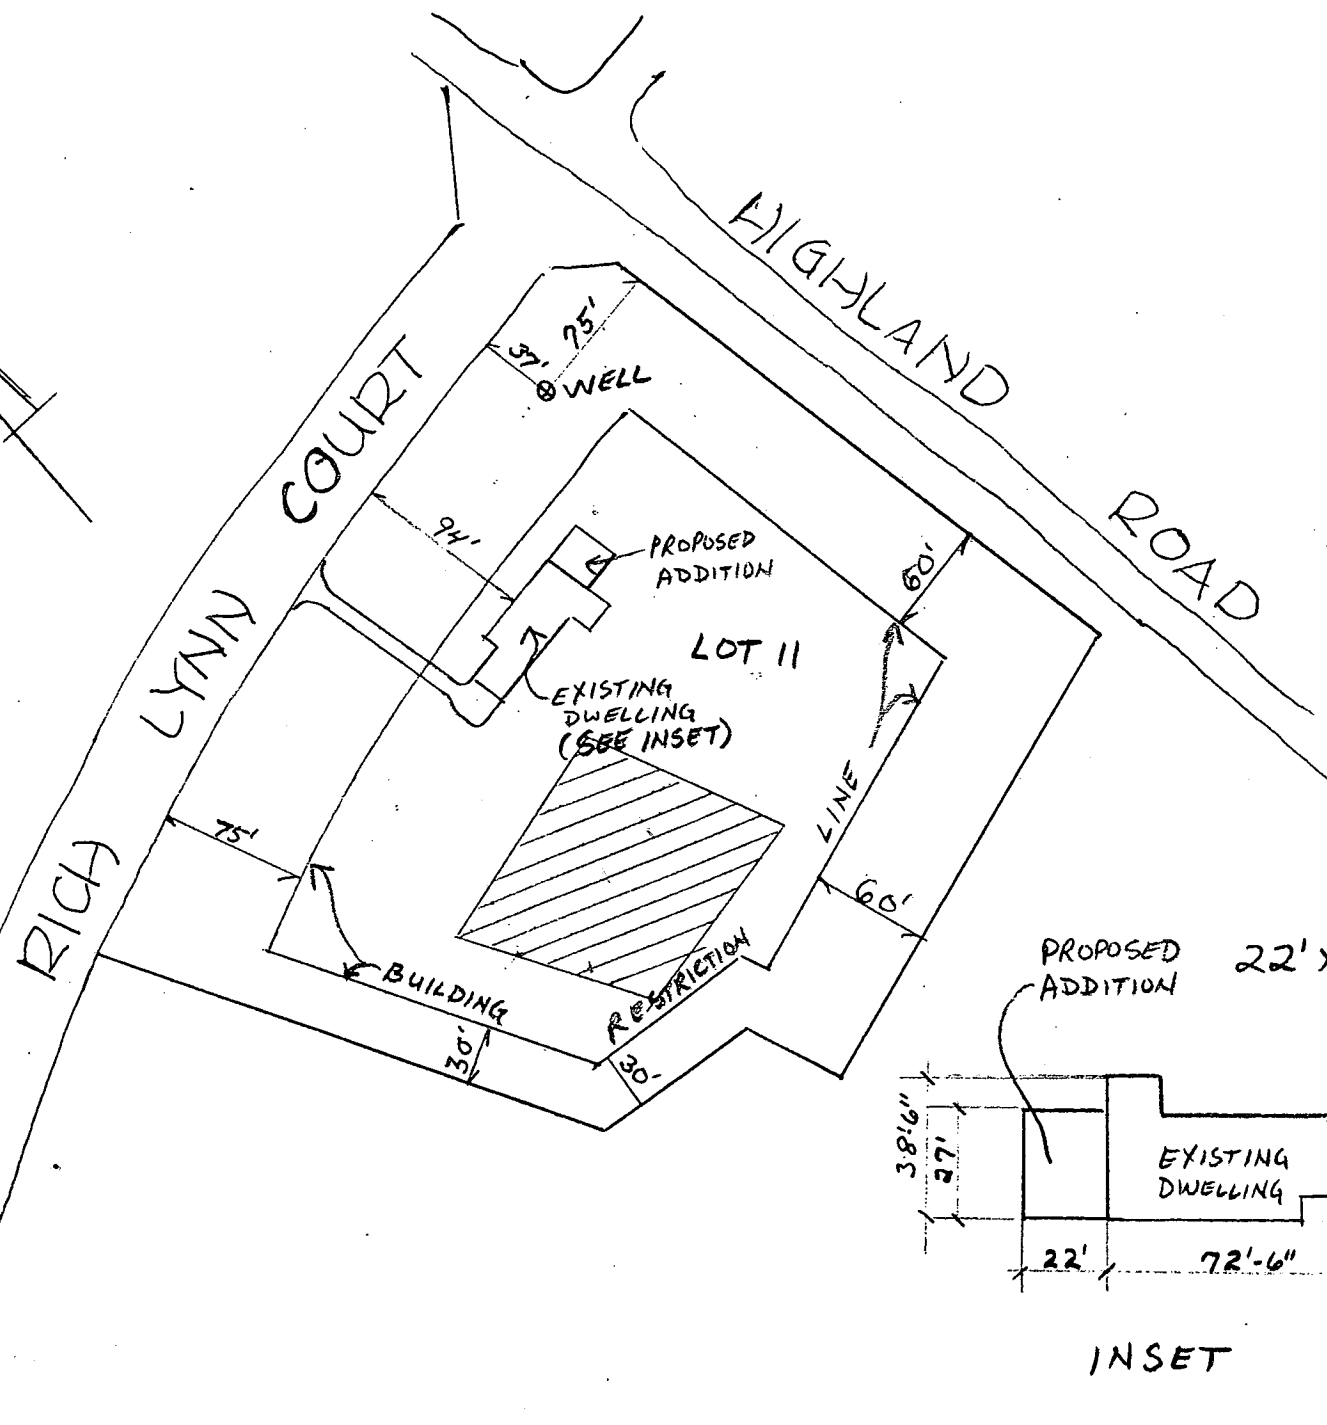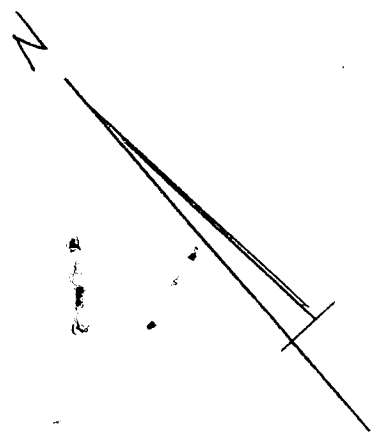

9/14/88
OK to sign PJ

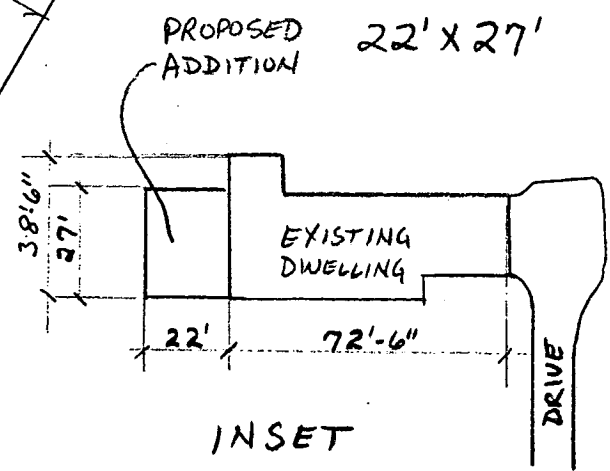


INSET

A 32185

BP 50938
113405 Rich Lynn Ct
EXISTING B.R.

REMOVE EXISTING DOORWAY

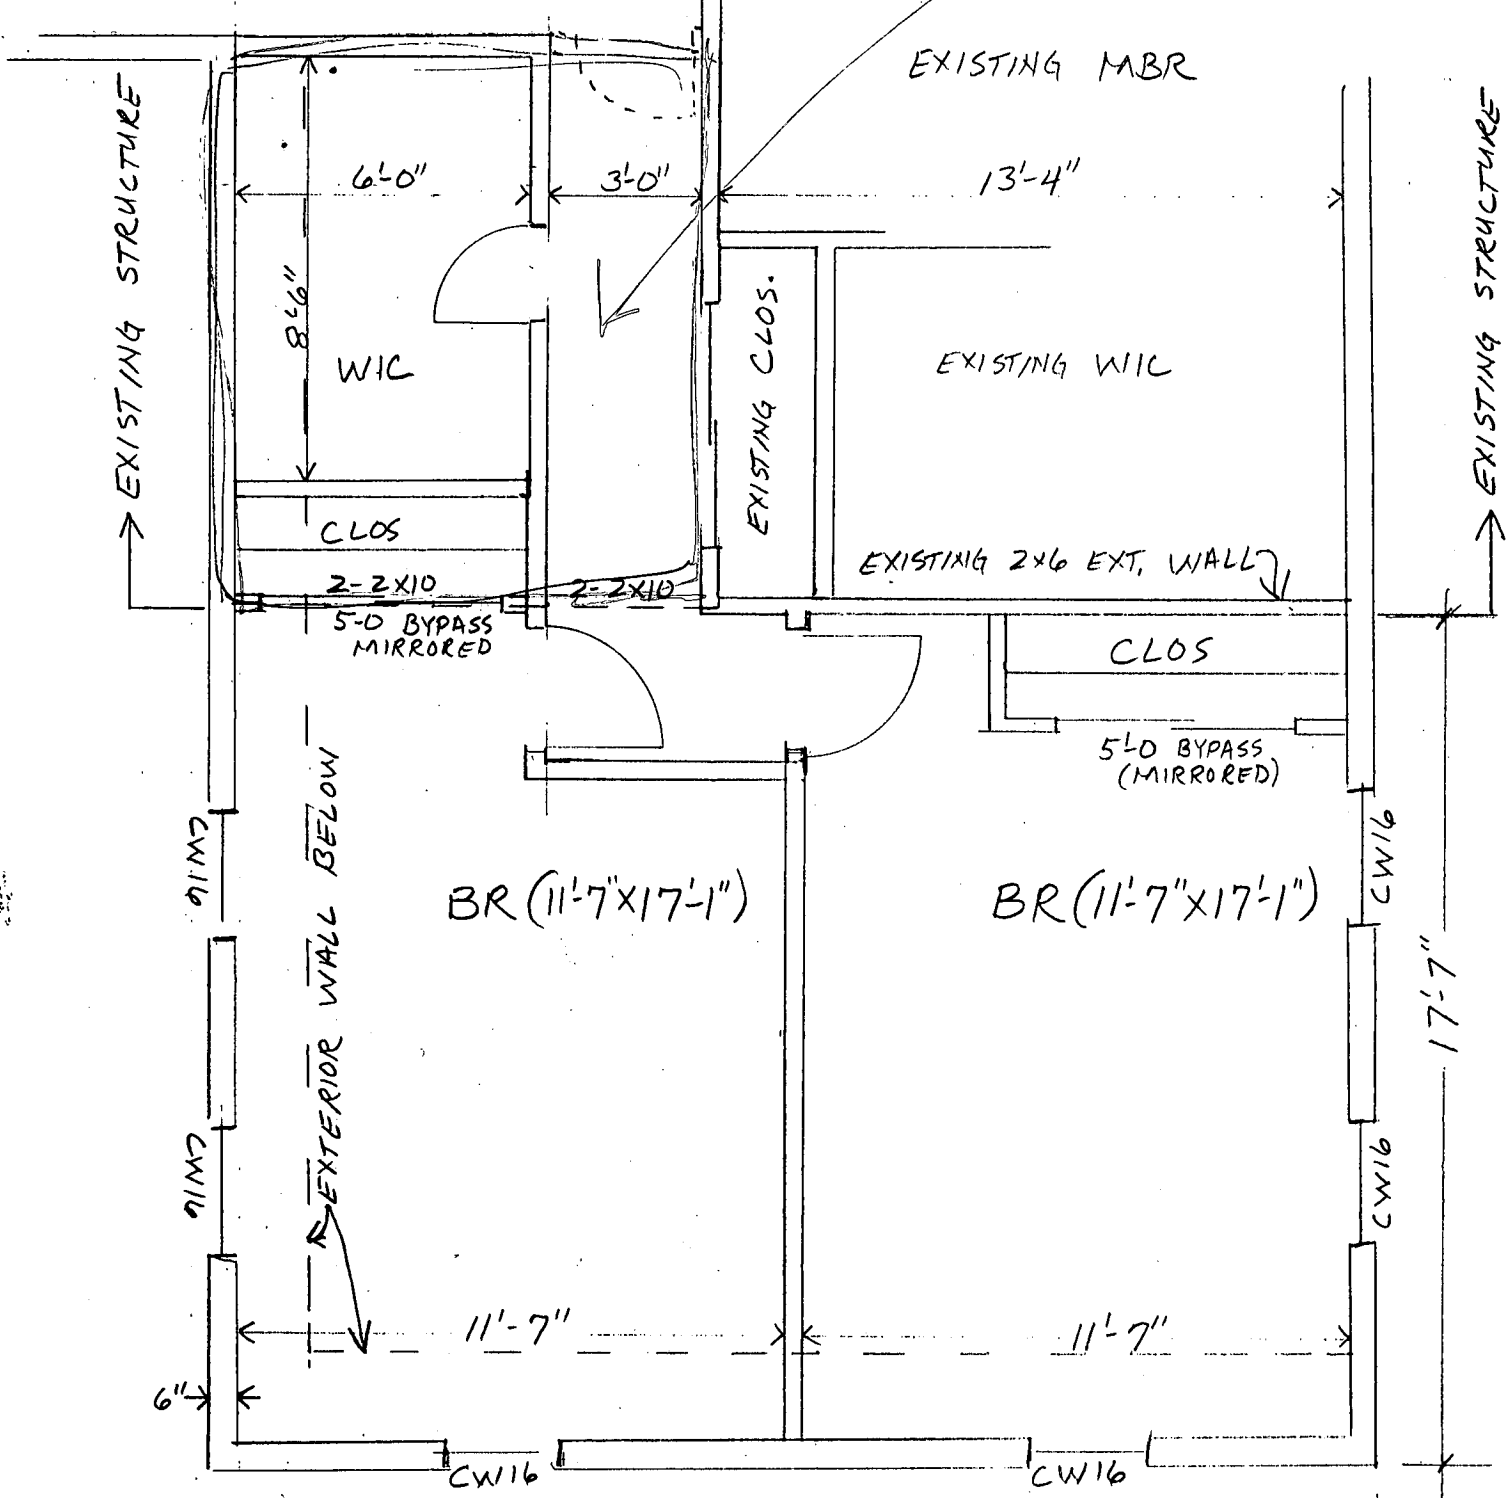


10/29/93 This plan shows One of Bedrooms in house is to be converted to walk in closet & two bedrooms to be installed in garage After construction there will be 4 bedrooms hooked up to the old system
WARSHOWSKY ADDITION
 FRAME 2 BR'S OVER EXISTING GARAGE
 CONVERT EXISTING BR. TO HALL & CLOSERS
 OK TO SIGN R/H

SCALE: 1/4" = 1'

B 50938

HIGHLAND ROAD

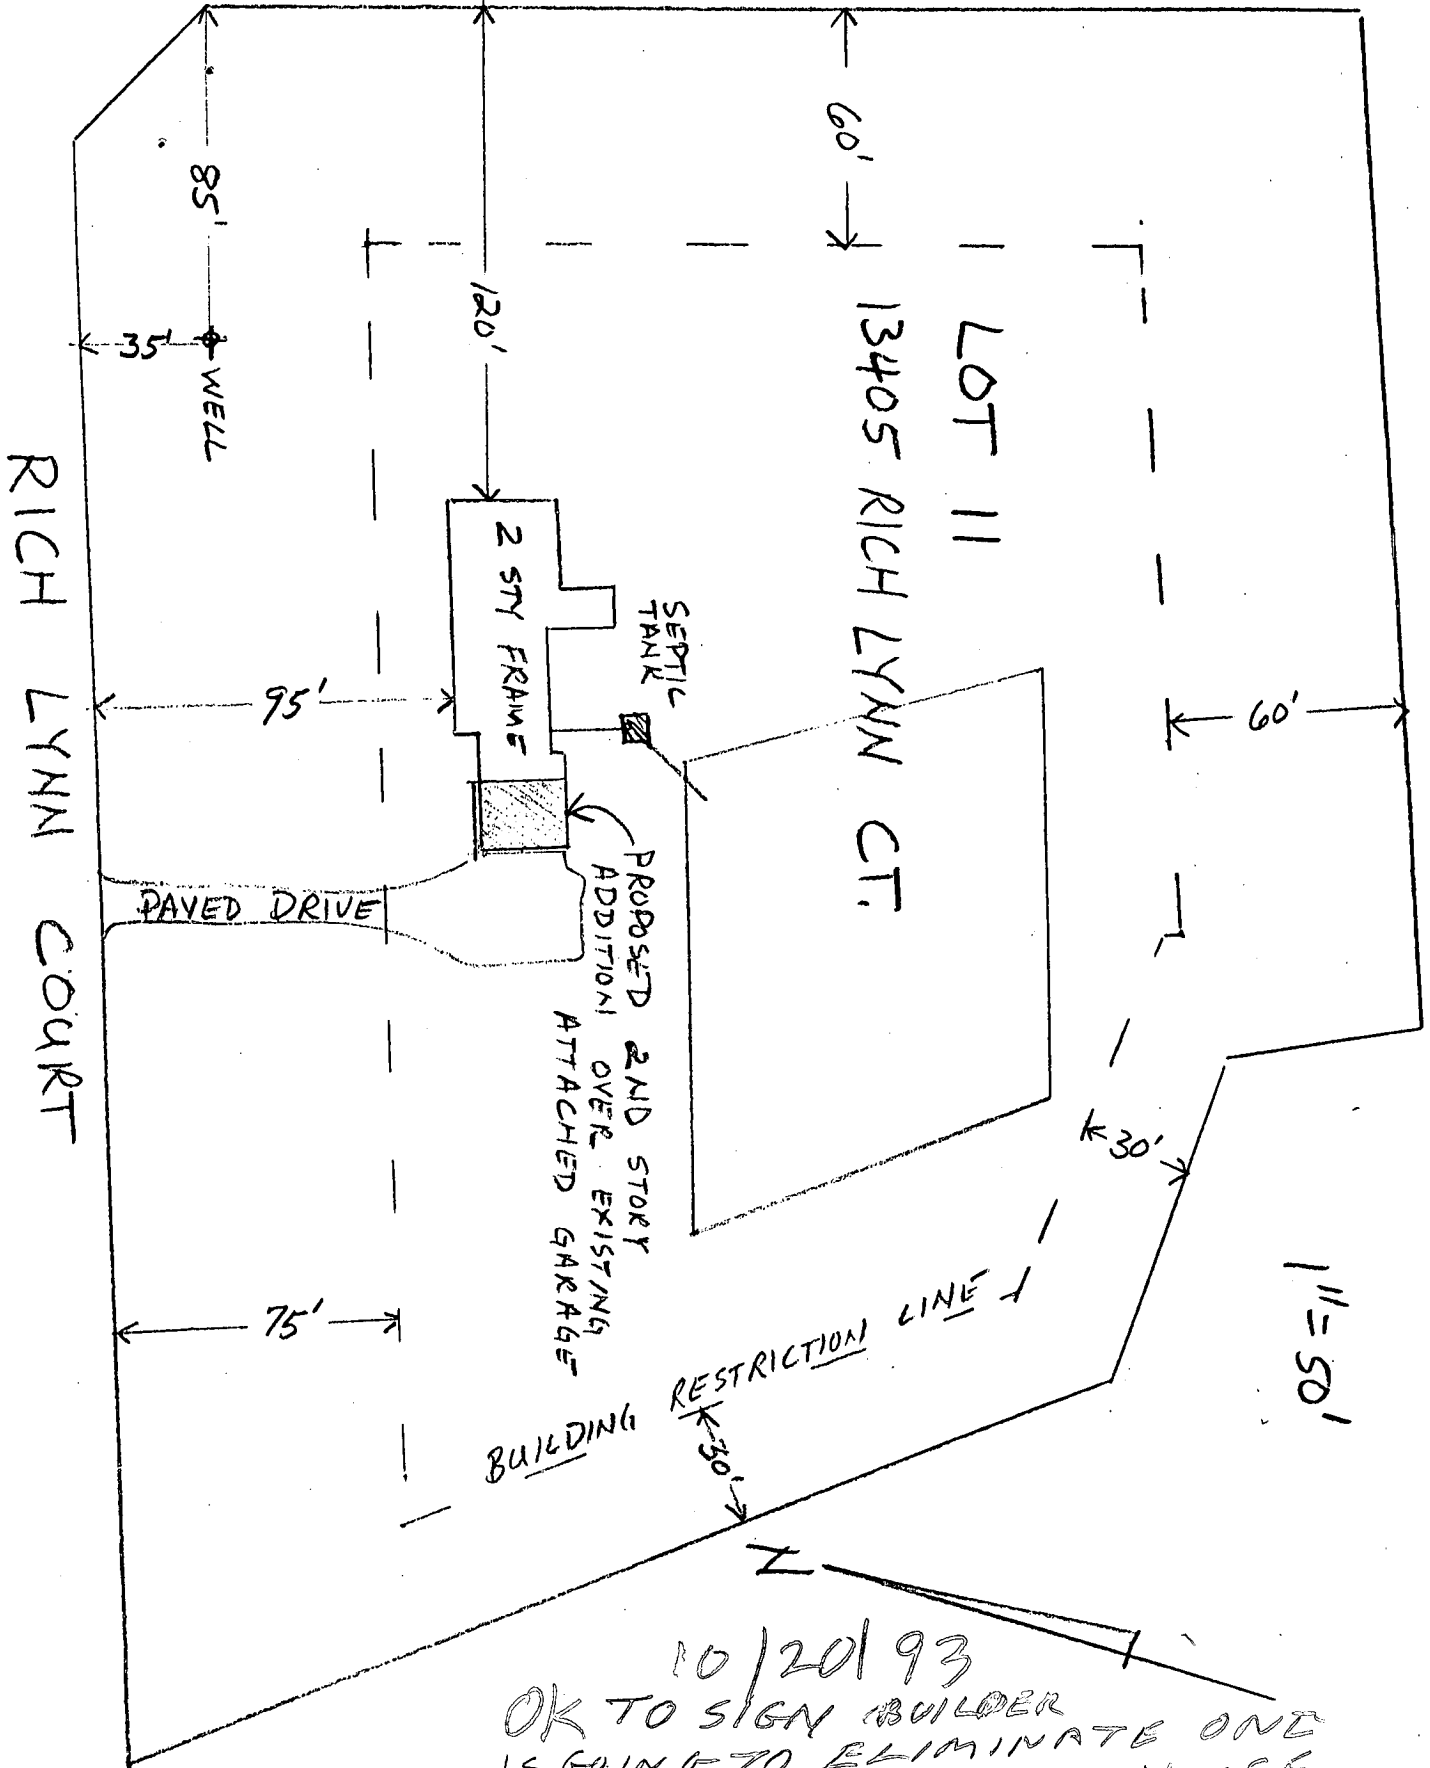

10/20/93
 OK TO SIGN BUILDER
 IS GOING TO ELIMINATE ONE
 BED ROOM IN THE OLD HOUSE
 SEE OTHER PLAN R/H