

✓ *cap. Repair/Replacement*
6/5/95
+ Lot

PERMIT

SEWAGE DISPOSAL SYSTEM

DEPARTMENT OF HEALTH AND MENTAL HYGIENE

05-380 723

P 50759E
A22377
A REPAIR

DISTRICT 5th

DATE 6/30/95

DATE SYSTEM APPROVED 6/5/95

INSPECTOR C.B.D.

HOWARD COUNTY HEALTH DEPARTMENT

BUREAU OF ENVIRONMENTAL HEALTH

~~461-9933~~ 313-2640

INDEXED

Jack Fyock Septic Service _____ IS PERMITTED TO INSTALL _____ ALTER

ADDRESS 13775 Triadelphia Road, Glenelg, Maryland 21737 PHONE 988-9270

SUBDIVISION The Heritage LOT 41 ROAD 14193 Day Farm Road

PROPERTY OWNER Dr. and Mrs. Luxman Mallya

ADDRESS _____

SEPTIC TANK CAPACITY 1250 GALLONS

NUMBER OF BEDROOMS 4

_____ SQUARE FEET PER BEDROOM

LINEAR FEET OF TRENCH REQUIRED _____

REPAIR - PURPOSE - IN SUPPORT OF BUILDING PERMIT APPLICATION #59532 FOR THE LARGE ADDITION.
Old System to be abandoned and a new system to be installed.

TRENCHES - Trench to be 2 feet wide. Inlet 4 feet below original grade. Bottom maximum
depth 10 feet below original grade. 6 feet of stone below distribution pipe.
83 to 85 feet of trench required.

PLANS APPROVED BY (C. B. Streaker at site for C.W.) DATE 05/24/95

COVER NO WORK UNTIL INSPECTED AND APPROVED

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM

NOTE: CLEANOUT REQUIRED EVERY 70 FEET OF SEWER LINE AND/OR AT 90° SWEEPS IN LINES FROM HOUSE TO DRAIN FIELDS, 90° ELBOWS NOT ACCEPTABLE.

NOTE: ALL PARTS OF SEPTIC SYSTEMS (I.E. TANK, DISTRIBUTION BOX TRENCHES) TO BE 100 FEET FROM WELL (UNLESS OTHERWISE SPECIFICALLY AUTHORIZED)

NOTE: IF DEEP TRENCH(ES) ARE USED CALL FOR INSPECTION BEFORE AND AFTER PLACING GRAVEL IN TRENCH(ES)

NOTE: NO DRY WELL SHALL EXCEED 15 FOOT IN DIAMETER NO ABSORPTION TRENCH TO EXCEED 100 FEET IN LENGTH

NOTE: ALL PIPE FROM HOUSE TO SEPTIC TANK MUST BE CAST IRON OR SCHEDULE 35/40 PVC OR ABS


PERMIT VOID AFTER TWO YEARS

NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL STAND PIPES MUST BE 6 INCHES IN DIAMETER CAST IRON. CONCRETE OR TERRA COTTA OR PVA OR ABS ACCEPTED. IF TOP OF SEPTIC TANK IS DEEPER THAN 3 FEET. MANHOLE TO GRADE REQUIRED.

NOTE: DISTRIBUTION BOXES MUST HAVE BAFFLES

***INSTALLER IS RESPONSIBLE FOR OBTAINING FINAL APPROVAL ON THIS PERMIT**

P 50759E

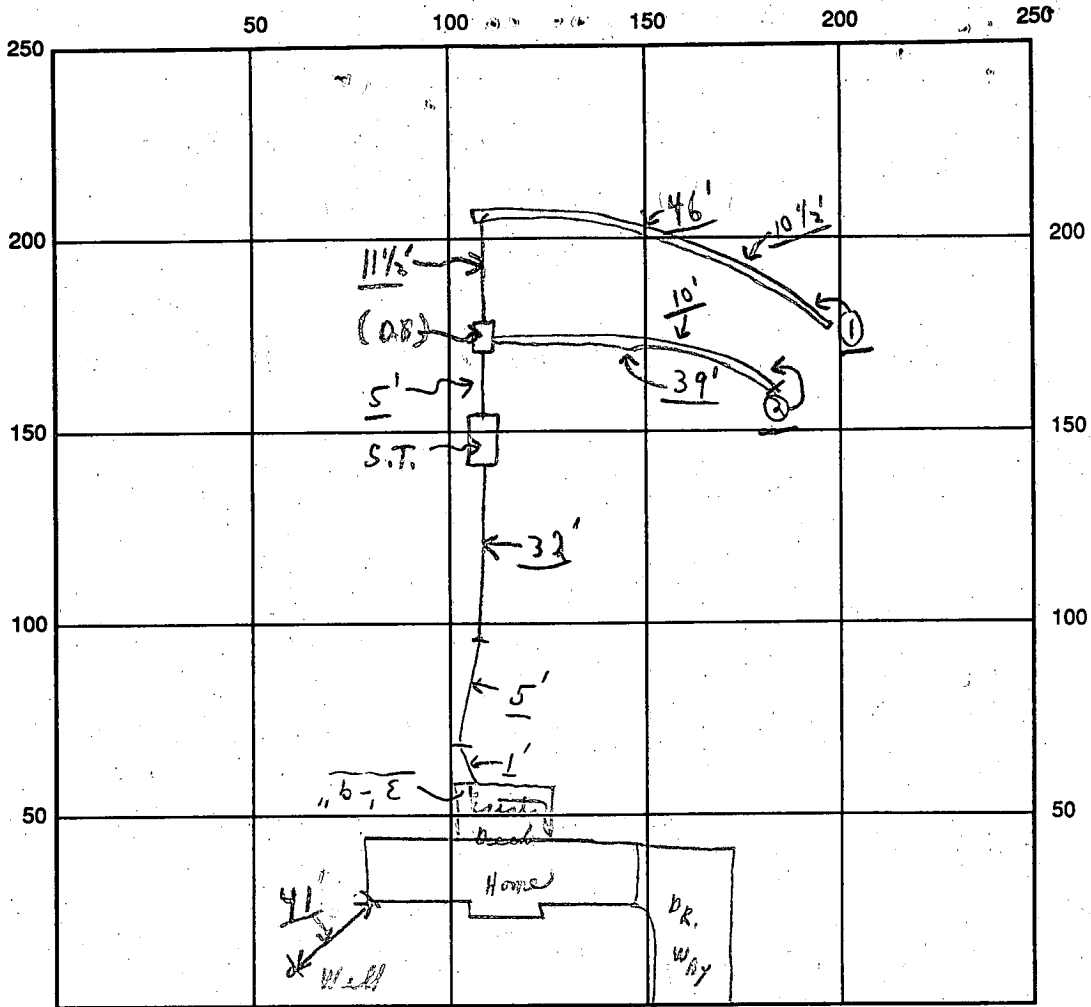

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE

← PAY FARM ROAD →

SEPTIC TANK LEVEL OK CLEANOUTS S.T. OK

DISTRIBUTION BOX LEVEL OK (Baffles in)

DRAIN FIELD/TITLE DEPTH 10¹⁺ average FT. TRENCH WIDTH 2 FT. INLET DEPTH 4 FT.

EFFECTIVE GRAVEL DEPTH 6 FT. TOTAL LENGTH 85 FT.

NUMBER OF TRENCHES 2 ONE SIDEWALL/BOTTOM AREA 510⁺ SQ. FT.

DRYWALL INSIDE DIAMETER — FT. EFFECTIVE DEPTH BELOW INLET — FT.

ABSORBENT AREA 510⁺ SQ. FT.

REMARKS: 6/5/95 2 Trenches - new ok for stone, etc;
Note!! old S.T. drain well pumped and filled; partial ckd
6/5/95 with all pipes now in and connected; trenches
complete; Fend.
ckd

DATE SYSTEM APPROVED 6/5/95 asper INSPECTOR Charles Bryan Street
above

app - 11/2/79
10

PERMIT

P 30341
A 22377

SEWAGE DISPOSAL SYSTEM

MARYLAND STATE DEPARTMENT OF HEALTH*

HOWARD COUNTY

ELLICOTT CITY

DISTRICT 5th

DATE 10/30/79

INDEXED

Jim Brittingham

IS PERMITTED TO INSTALL ALTER

ADDRESS 3004 N. Rogers Avenue, Ellicott City, Md. 21043 PHONE 461-1870

SUBDIVISION The Heritage ROAD 14193 Day Farm Road LOT 41

PROPERTY OWNER Floyd Grayson

ADDRESS _____

SPECIFICATIONS 4 bedrooms

SEPTIC TANK CAPACITY 1250 GALLONS

DRAIN FIELD _____ DEPTH _____ FEET, BOTTOM AREA _____ SQ. FT.

DEEP TRENCH _____ DEPTH _____ FEET, BOTTOM AREA _____ SQ. FT.

SEEPAGE PITS ABSORBENT SIDE-WALL AREA 125 SQ. FT. per bedroom

INLET PIPE 4 FT. BELOW ORIGINAL GRADE, MAXIMUM DEPTH 10 FT. BELOW ORIGINAL GRADE

EFFECTIVE DEPTH AT _____ FT. BELOW ORIGINAL GRADE.

LOCATE DISPOSAL AREA 135 FT. FROM front LOT LINE AND 20 FT. FROM left LOT LINE AS SEEN WHEN FACING LOT FROM the road.

NOTE: OKAY TO USE TRENCH OFF DRY WELL TO MAKE UP ABSORBENT SIDEWALL AREA IN SYSTEM.
LEAVE 5 FT. EARTH BUFFER BETWEEN TRENCH AND DRY WELL. TRENCH TO FOLLOW CONTOUR OF THE LAND.

PLANS APPROVED BY Robert T. Moorefield

DATE 10/17/77

COVER NO WORK UNTIL INSPECTED AND APPROVED.

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM.

NOTE: IF TRENCH IS USED CALL FOR INSPECTION BEFORE PLACING GRAVEL IN TRENCH.

NOTE: NO DRY WELL SHALL EXCEED 15 FOOT IN DIAMETER.


NOTE: ALL PIPE FROM HOUSE TO DISPOSAL AREA MUST BE CAST IRON.

PERMIT VOID AFTER THREE YEARS.

NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL. STAND PIPES MUST BE 6 INCHES IN DIAMETER. CAST IRON, CONCRETE OR TERRA COTTA ACCEPTED.

***INSTALLER IS RESPONSIBLE FOR OBTAINING FINAL APPROVAL ON THIS PERMIT.**

A 22377

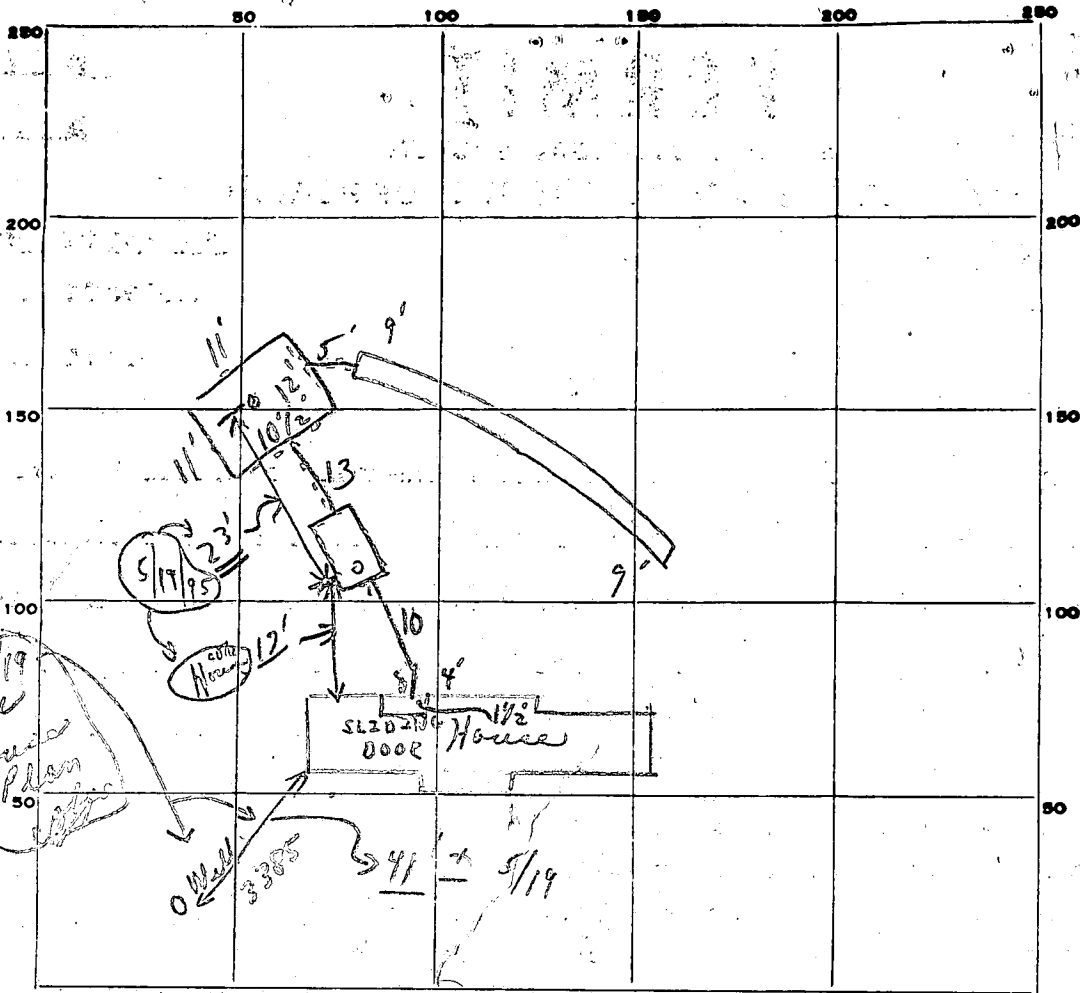

INDICATE NORTH. - NAME ADJOINING ROADWAY AS BASE LINE.

Day Farm Road

PERMIT CARD

S.T. D.W.

SEPTIC TANK, LEVEL _____

CLEANOUTS _____

DISTRIBUTION BOX, LEVEL _____

TILE FIELD, DEPTH 9 FT. TRENCH WIDTH 2 FT.

GRAVEL DEPTH 72 IN. TOTAL LENGTH 49 FT.

NUMBER OF TRENCHES 1 TOTAL BOTTOM AREA 294 ϕ

SEEPAGE PITS, INSIDE DIAMETER 44.5 FT. DEPTH BELOW INLET 6 FT.

ABSORBENT AREA 284.0 SQ. FT. 5784

REMARKS 11/6/79 SYSTEM SHORT - ADDED TO TRENCH LENGTH WHILE SANITARIAN ON SITE; OK FOR STONE IN TRENCH. C.B.S.

DATE SYSTEM APPROVED 11/7/79

INSPECTOR Steve M mag lan

S.T. 3 BR. - 1000 gal 4 BR. - 1250 gal Dry Well Lot 43
Locate the D.W. 135' from the front prop. line, and 20' 41
from the left prop. line as seen from the road. The inv.
will enter the D.W. at 4' below O.G. and the max depth of the D.W.
will not exceed 10' below O.G. The D.W. will have no less than
125 sq' of vert sidewall per BR., with the sidewall beginning at 4' below O.G.

4-12' holes
at 40,000 ft.

APPLICATION

A 22377

Preliminary

SEWAGE DISPOSAL TESTING

P _____

STATE OF MARYLAND - DEPARTMENT OF HEALTH AND MENTAL HYGIENE

HOWARD COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SERVICES
P. O. BOX 476, ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 465-5000, EXT. 356

DISTRICT 5
DATE 10/24/75

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I, HEREBY, APPLY FOR THE NECESSARY TEST IN ORDER TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER Walgrove Joint Venture Co.

ADDRESS Floyd Grayson PHONE _____

PROPERTY LOCATION:

SUBDIVISION Walgrove Jnt. The Heritage LOT NO. 43

ROAD AND DESCRIPTION 14193 May Farm Road

SIZE OF LOT _____ TYPE BLDG. 3 or 4
NUMBER OF BEDROOMS

IF NOT SINGLE RESIDENCE DESCRIBE _____

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE.

SIGNATURE OF APPLICANT John Schneider

APPROVED BY _____ FOR _____ DATE _____
(KIND OF SYSTEM)

REJECTED BY _____ FOR _____ DATE _____
(KIND OF SYSTEM)

HOLD PENDING FURTHER TESTS _____ DATE _____

REASONS FOR REJECTION OR HOLDING _____


BLDG. PERMIT SIGNED
AND RETURNED 9/11/79
serial 40613

THIS IS NOT A PERMIT

Lot 40

Lot 40

Normanshire Circle

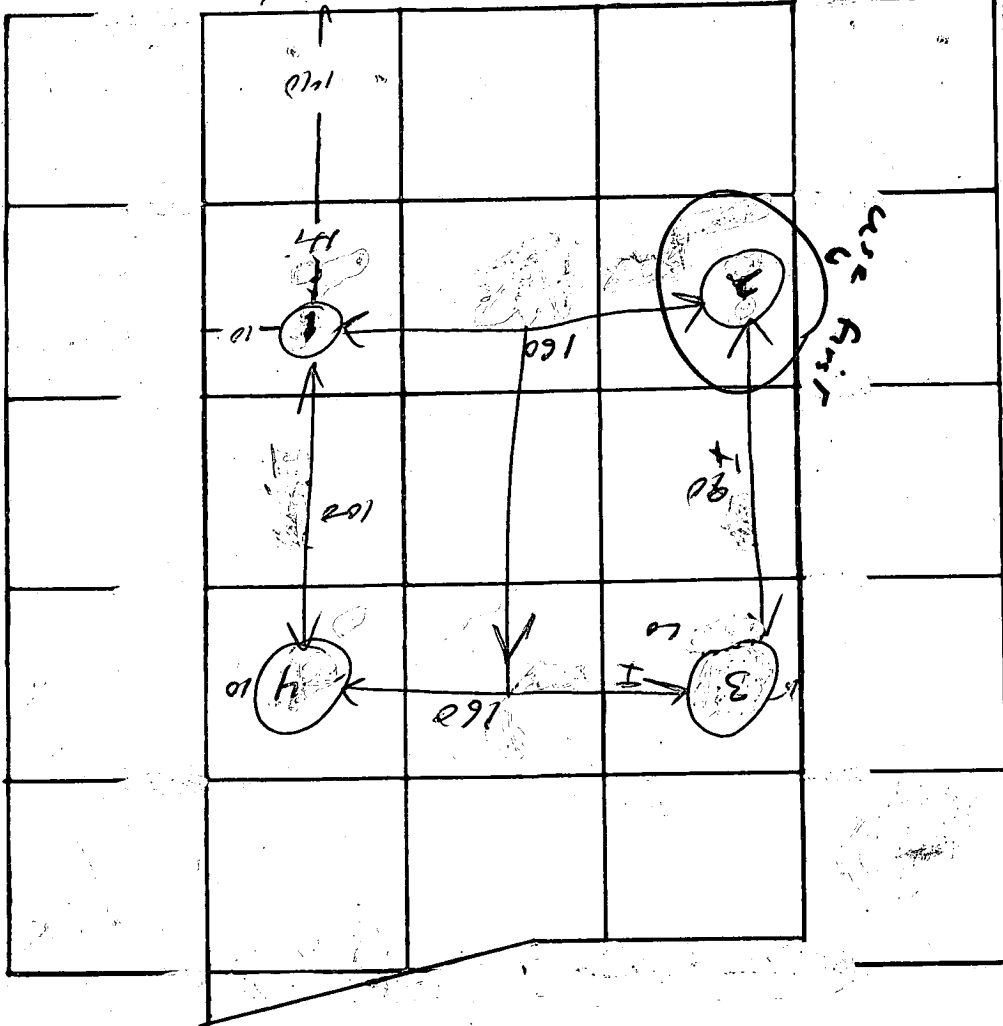


Measurements between holes approx.

DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME
			START	STOP	START	STOP	
11/24	1	4'	1236	1238	1238	1243	5
	1A	12'	1236	1239	1239	1242	3
	2	12'	SAME	-	DRY	-	-
	3	4'	1240	1245	1245	1251	6
	3A	12'	1240	1247	1247	1250	3
	4	4'	1240	1242	1242	1245	3
	4A	12'	1240	1242	1242	1246	4

REMARKS _____

TYPE OF SOIL _____

TESTED BY HZ, RM ALSO PRESENT: _____

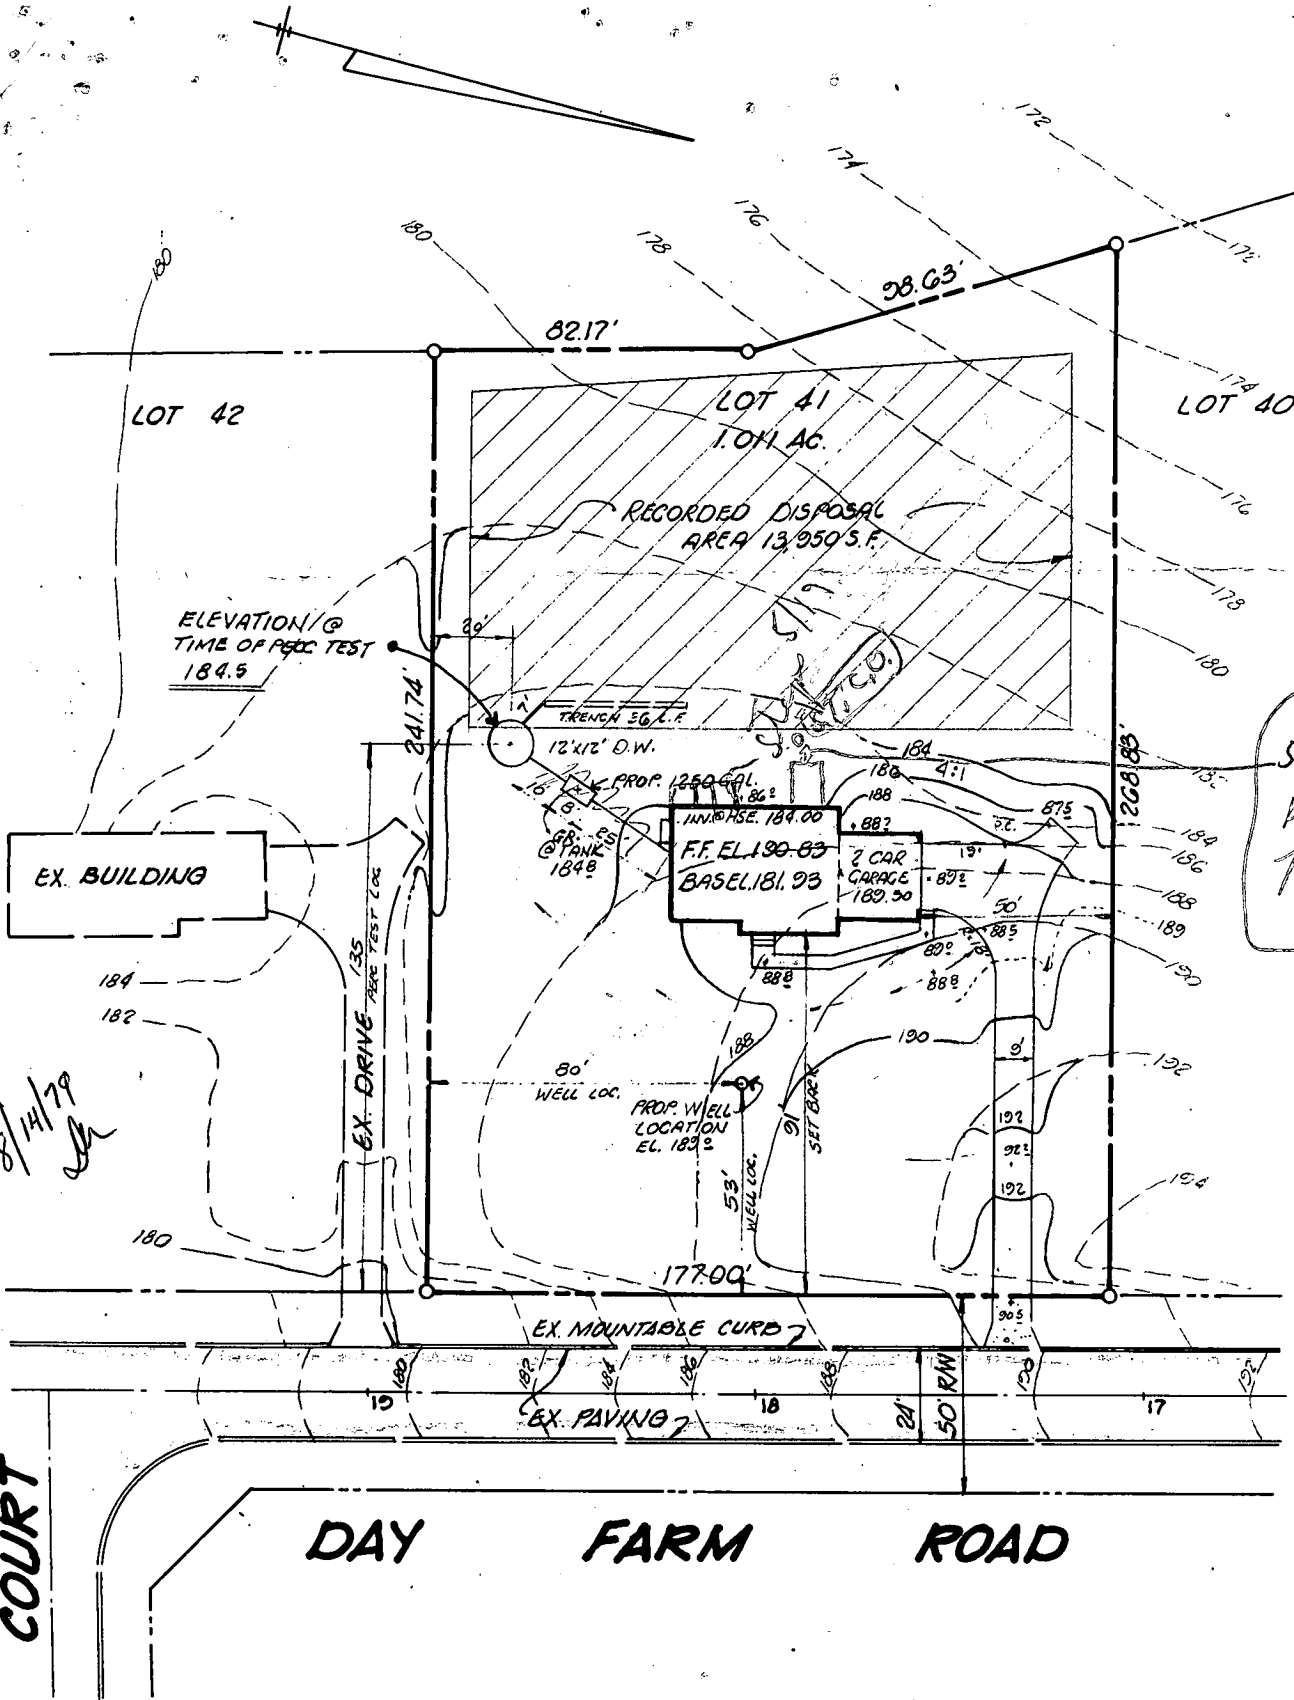

8/14/79

5 1/2' to peak from S.I.T.C.O.

GENERAL NOTES :

40'x28' 2 STY. FULL BASEMENT
FRAME & ALUM. SIDING DWELLING

WELL DATA (See plan for location)
EX. GRADE 189.0 / PROP. GRADE 189.0

SEPTIC DATA (1,250 Gal.)
INV. @ HOUSE 184.00
INV. @ TANK 183.50 } 2%
INV. OUT 183.50

DRY WELL
INV. IN 180.5 (4' BELOW EX. GR. 184.5)
REQUIRED S.F. ABS. 4x125 = 500 S.F.
PROVIDED 12'x12' D.W. = 48 ABS. S.F. & 6 V.F. = 288 S.F.
PLUS TRENCH @ 36 L.F. x 6 V.F. = 216 S.F.
TOTAL ABS. S.F. 504 S.F.

House type BURKE 2

**ON SITE
GRADING PLAN**
FOR
**THE HERITAGE SECTION 1, AREA 2
LOT 41**

5TH ELECTION DISTRICT
SCALE: 1"=50'

HOWARD COUNTY, MARYLAND
DATE: JULY 10, 1979

GRAYSON HOMES INC.
BUILDER:
2000 CENTURY PLAZA SUITE 245
COLUMBIA, MARYLAND
21044

PREPARED BY:
RON WAGNER LAND DEV. CONSULTING
200 WASHINGTON AVE TOWSON, MD
OFFICE 301-821-6280

** TRANSMIT CONFIRMATION REPORT **


Journal No. : 001
Receiver : 95311256
Transmitter : HCCG ENVHEALTH
Date : May 22, 95 12:10
Time : 00:37
Mode : NORM
Document : 01 Pages
Result : O K

** TRANSMIT CONFIRMATION REPORT **

Journal No. : 002
Receiver : 95311256
Transmitter : HOCO ENVHEALTH
Date : May 23, 95 9:37
Time : 01'18
Mode : NORM
Document : 02 Pages
Result : 0 K

49
29

See House Plan

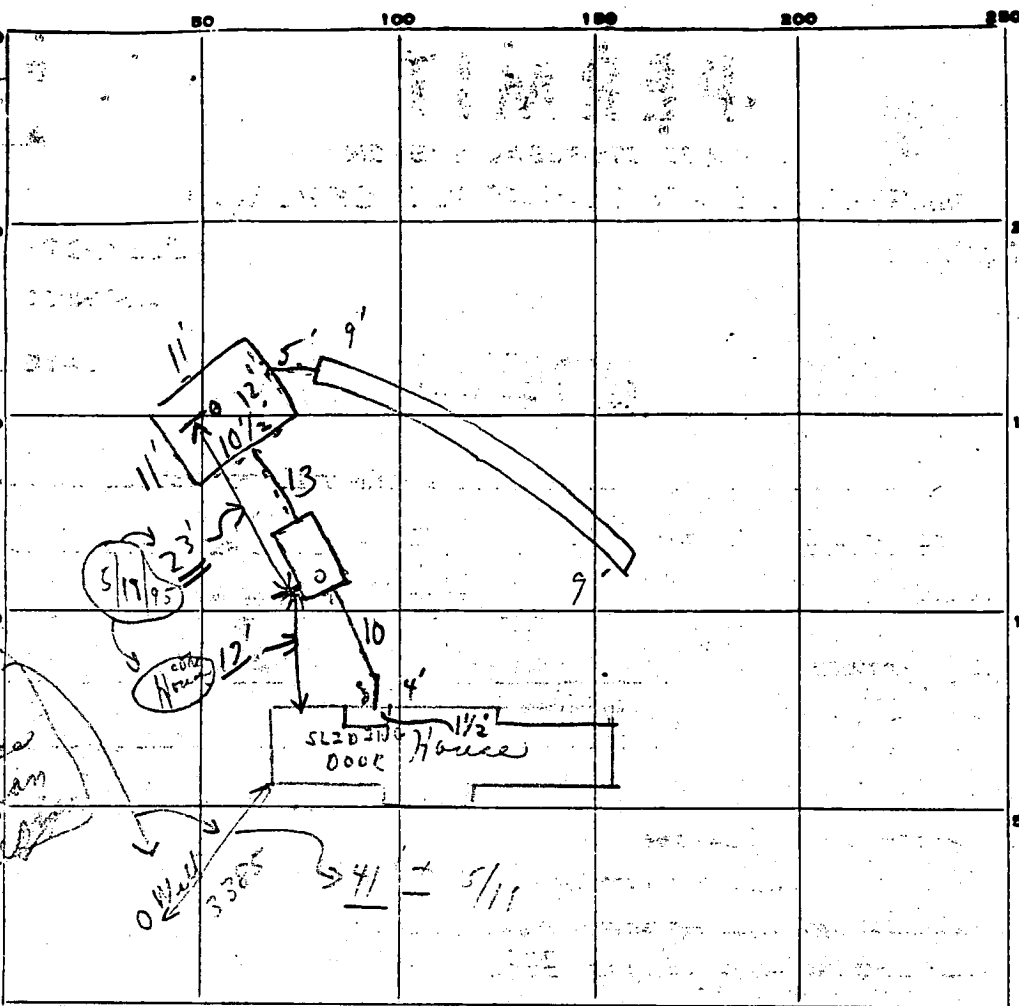

INDICATE NORTH. - NAME ADJOINING ROADWAY AS BASE LINE.

Day Farm Road

PERMIT CARD

S.T. D.W.

SEPTIC TANK, LEVEL _____

CLEANOUTS _____

DISTRIBUTION BOX, LEVEL _____

TILE FIELD, DEPTH 9 FT. TRENCH WIDTH 2 FT.

GRAVEL DEPTH 72 IN. TOTAL LENGTH 49 FT.

NUMBER OF TRENCHES 1 TOTAL BOTTOM AREA 294 \square

SEEPAGE PITS, INSIDE DIAMETER 44.5 FT. DEPTH BELOW INLET 6 FT.

ABSORBENT AREA 284.0 SQ. FT. 5784

REMARKS 11/6/79 SYSTEM SHORT - ADDED TO TRENCH LENGTH WHILE SANITARIAN
ON SITE; OK FOR STONE IN TRENCH. C.B.S.

DATE SYSTEM APPROVED 11/7/79

INSPECTOR D.W. M. MacLean

APPLICATION

HOWARD COUNTY

\$ 25.00
to

SERIAL NUMBER

59532

PERMIT APPLICATION

DEPARTMENT OF INSPECTIONS, LICENSES & PERMIT
3430 COURT HOUSE DRIVE, ELLICOTT CITY, MARYLAND 21043

BUILDING ADDRESS (HOUSE NO., STREET, TOWN OR AREA)

14193 Day Farm Rd.
Glenelg Md. 21237

GRADING/SEDIMENT CONTROL YES NO

SDP #

DESCRIPTION OF WORK AUTHORIZED

214 S.F. Sun Room 13'-6" x 16"
134 S.F. Hot Tub Room 12' x 11"
120 S.F. open Deck 10' x 12'

LOT NO.	PARCEL NO.	SEC.	AREA	BLOCK NO.	LIBER	FOLIO
41						

SUB DIVISION	ZONE	ZONE MAP	ELEC. DIST.	CENSUS TR.

OWNER NAME AND ADDRESS

Mrs Mrs LUXMAN MA Ilya 410
14193 Day Farm Rd
Glenelg Md. 21237
4421487

OCCUPANT'S NAME AND ADDRESS

Same

ARCHITECT OR ENGINEER'S NAME AND ADDRESS

CONTRACTOR'S NAME AND ADDRESS

Vernon + Bobs Home Imp 410
5 Shepton Rd Randallstown 21133 5214738

EXISTING USE

Single Family Home
Proposed Use: Single Family Home with Deck Sun Room

EST. CONSTRUCTION COST

21000

LICENSE NUMBER

19504

PERMIT FEE

SDP #

Check payable to: DIRECTOR OF FINANCE OF HOWARD COUNTY

CAUTION

To begin construction before a permit placard has been issued and displayed on the job is a violation of the law.

Use and occupancy permit must be applied for two weeks before it will be issued.

IMPORTANT: PLEASE SHOW ZIP CODES AND AREA CODES WHEREVER REQUIRED.

LP-69-591

SIZE OF BLDG.	FRONT	DEPTH	HEIGHT

TYPE OF BLDG.	AREA	VOLUME	ROOF
B. ROOMS			
ROOMS			
BATHS			
FIREPLACES			

FOOTINGS	FOUNDATION	S. WALLS
Part on Concrete		
Piers		

UTILITIES				
WATER	WELL	SEWER	SEPTIC	AC
<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
GAS	ELECTRICITY	TYPE OF HEAT		
<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>			

I have carefully examined and read this application and know the same is true and correct, and that is doing this work, all provisions of Howard County Ordinances and the State Laws of Maryland will be complied with, whether specified or not; and I will notify the Department of Inspections, and Permits twenty-four hours in advance when I am ready for the inspections called for elsewhere in the application; and that no work will be covered up until such inspections have been complied with.

Ann Billea SIGNATURE
5-10-95 DATE
TITLE

FOR OFFICE USE ONLY

DISTRICT IN FEET FROM R/W LINE TO FRONT BUILDING LINE

SIDE YARD (DISTANCE IN FEET FROM SIDE BLDG. LINE TO SIDE PROPERTY LINE)

TO SIDE BUILDING LINE DISTANCE IN FEET, REAR YD. REQUIRING SET

BACK (CORNER LOT ONLY) SDP #

FUNCTION	DATE	SIGNATURE APPROVAL
ZONING/PLANNING	X	
SHA	X	
SEDIMENT/GRADING		
BUILDING OFFICIAL	X	5/19/95
WATER & SEWER	X	(HOLD) Field
HEALTH DEPT.	X 5/19/95	check
FIRE PROTECTION	X	
STORM WATER MGMT.	X	

APPROVED

DATE

Distribution of Copies:
White - Building Official
Green - Planning & Zoning

Yellow - Engineering
Pink - Health Dept.
Gold - S.H.A.

551011

APPLICATION

HOWARD COUNTY

PERMIT APPLICATION

DEPARTMENT OF INSPECTIONS, LICENSES & PERMIT
3430 COURT HOUSE DRIVE, ELLICOTT CITY, MARYLAND 21043

SERIAL NUMBER

59532

BUILDING ADDRESS (HOUSE NO., STREET, TOWN OR AREA)

14193 Day Farm Rd.
Glenely Md. 21237

GRADING/SEDIMENT CONTROL YES NO

SDP #

DESCRIPTION OF WORK AUTHORIZED

214 S.F. Sun Room 13'6" x 16'
134 S.F. Hot Tub Room 12' x 11'
120 S.F. open Deck 10' x 12'

LOT NO.	PARCEL NO.	SEC.	AREA	BLOCK NO.	LIBER	FOLIO
41						

SUB DIVISION	ZONE	ZONE MAP	ELEC. DIST.	CENSUS TR.

OWNER NAME AND ADDRESS

PHONE NO.

Mrs Mrs LUXMAN MA Ilya 410 4421487
14193 Day Farm Rd
Glenely Md. 21237

SIZE OF BLDG.	FRONT	DEPTH	HEIGHT

OCCUPANT'S NAME AND ADDRESS

PHONE NO.

Same

TYPE OF BLDG.	AREA	VOLUME	ROOF

ARCHITECT OR ENGINEER'S NAME AND ADDRESS

PHONE NO.

FOOTINGS	FOUNDATION	S. WALLS
Piston Concrete		
Piers		

CONTRACTOR'S NAME AND ADDRESS

PHONE NO.

Vernon + Bobs Home Imp 410 514738
5 SHERATON Rd Randallstown 21133

UTILITIES	WATER	WELL	SEWER/SEPTIC	GAS	ELECTRICITY	TYPE OF HEAT	AC

I have carefully examined and read this application and know the same is true and correct, and that in doing this work, all provisions of Howard County Ordinances and the State Laws of Maryland will be complied with, whether specified or not; and I will notify the Department of Inspections, and Permits twenty-four hours in advance when I am ready for the inspections called for elsewhere in the application; and that no work will be covered up until such inspections have been complied with.

EXISTING USE

PROPOSED USE

Single Family Home Single Family Home
with - Deck Sun Room

EST. CONSTRUCTION COST

LICENSE NUMBER

PERMIT FEE

21,000 19504

Signature: *William Biller* 5-10-95
TITLE: DATE

FOR OFFICE USE ONLY

DISTRICT IN FEET FROM R/W LINE TO FRONT BUILDING LINE

SIDE YARD

(DISTANCE IN FEET FROM SIDE BLDG. LINE TO SIDE PROPERTY LINE)

TO SIDE BUILDING LINE

DISTANCE IN FEET, REAR YD. REQUIRING SET

BACK (CORNER LOT ONLY)

SDP #

Check payable to: DIRECTOR OF FINANCE OF HOWARD COUNTY

CAUTION

To begin construction before a permit placard has been issued and displayed on the job is a violation of the law.

Use and occupancy permit must be applied for two weeks before it will be issued.

FUNCTION	DATE	SIGNATURE APPROVAL
ZONING/PLANNING	X	
SHA		
SEDIMENT/GRADING		
BUILDING OFFICIAL	X	
WATER & SEWER		
HEALTH DEPT.	X 5/5/95	Charles Bush
FIRE PROTECTION		
STORM WATER MGM	X	

APPROVED

DATE

IMPORTANT: PLEASE SHOW ZIP CODES AND AREA CODES WHEREVER REQUIRED.

LP-69-591

Distribution of Copies:
White - Building Official
Green - Planning & Zoning

Yellow - Engineering
Pink - Health Dept.
Gold - S.H.A.



HOWARD COUNTY HEALTH DEPARTMENT

Joyce M. Boyd, M.D., County Health Officer

May 22, 1995

Mr. and Mrs. Luxman Mallya
14193 Day Farm Road
Glenelg, Maryland 21237

RE: Building Permit Application
Serial Number: 59532
The Heritage Subdivision - Lot 41
14193 Day Farm Road
Proposed Use: Addition

Dear Mr. and Mrs. Mallya:

This letter is to advise you that this office cannot recommend approval of the above referenced building permit application at this time.

While water well location is not in conflict with the new addition plan; septic tank appears too close to the proposed construction. The septic tank should be 10 feet plus from the new addition. A field check on May 19, 1995 confirmed that the septic tank was too close to the proposed addition.

Please contact this office (313-2640) to discuss any questions concerning this project.

Very truly yours,

Charles B. Streaker, Sr. R.S.
Charles B. Streaker, Sr., R. S.
Water and Sewerage Program

CBS:jf

cc; Department of Licenses and Permits
Vernon & Bobs Home Improvement
File

*Repaired on 6/5/95
Bldg permit released 6/5/95 (P.M.) CBS*

42

S75°38'44"W 241.74'




STEPS TO
BASEMENT

HOT
TUB

SUN
Room



60±

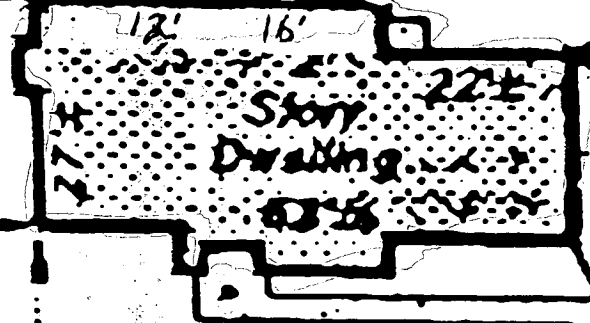

S75°38'44"W 268.83'

75

Lot 4i

100±