

2/23/99
12:00

PERMIT

SEWAGE DISPOSAL SYSTEM

DEPARTMENT OF HEALTH AND MENTAL HYGIENE

03-326349

P 571428
56430
A ~~576218~~ X

DISTRICT _____

DATE 2-19-99

HOWARD COUNTY HEALTH DEPARTMENT

BUREAU OF ENVIRONMENTAL HEALTH

~~XXXXXX~~ 410-313-2640

DATE SYSTEM APPROVED 2/23/99

INSPECTOR CW

INDEXED

Lehsac Plumbing & Heating, IS PERMITTED TO INSTALL ALTER

ADDRESS 202 Azar Court, Baltimore, Maryland 21227 PHONE 410-242-6888

SUBDIVISION Gaither Hunt I LOT 71 ROAD 11038 Dorsch Farm Road

PROPERTY OWNER Ryan Homes BRIAN JOHNSON

ADDRESS _____

SEPTIC TANK CAPACITY 1250 GALLONS

NUMBER OF BEDROOMS 4

180 SQUARE FEET PER BEDROOM

LINEAR FEET OF TRENCH REQUIRED 240

TRENCHES - Trench to be 3 feet wide. Inlet 4 feet below original grade. Bottom maximum depth 6 feet below original grade. Effective area begins at 4 feet below original grade. 2 feet of stone below distribution pipe.

LOCATION - Place the distribution box 140 feet down the left lot line and 80 feet off this same lot line as seen from Dorsch Farm Road. Run trenches along contour in both directions.

NOTES - No trench to exceed 100 feet in length. Provide 6" - 8" diameter cleanout and cap to grade or above on septic tank.

OK KM 1-25-99

PLANS APPROVED BY Donna K. Soe DATE 1-21-1999

COVER NO WORK UNTIL INSPECTED AND APPROVED

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM

NOTE: CLEANOUT REQUIRED EVERY 70 FEET OF SEWER LINE AND/OR AT 90° SWEEPS IN LINES FROM HOUSE TO DRAIN FIELDS. 90° ELBOWS NOT ACCEPTABLE.

NOTE: ALL PARTS OF SEPTIC SYSTEMS (I.E. TANK, DISTRIBUTION BOX TRENCHES) TO BE 100 FEET FROM WELL (UNLESS OTHERWISE SPECIFICALLY AUTHORIZED)

NOTE: IF DEEP TRENCH(ES) ARE USED CALL FOR INSPECTION BEFORE AND AFTER PLACING GRAVEL IN TRENCH(ES)

NOTE: NO DRY WELL SHALL EXCEED 15 FOOT IN DIAMETER NO ABSORPTION TRENCH TO EXCEED 100 FEET IN LENGTH

NOTE: ALL PIPE FROM HOUSE TO SEPTIC TANK MUST BE CAST IRON OR SCHEDULE 25/40 PVC OR ABS

PERMIT VOID AFTER TWO YEARS

NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL STAND PIPES MUST BE 6 INCHES IN DIAMETER CAST IRON, CONCRETE OR TERRA COTTA OR PVA OR ABS ACCEPTED. IF TOP OF SEPTIC TANK IS DEEPER THAN 3 FEET, MANHOLE TO GRADE REQUIRED.

NOTE: DISTRIBUTION BOXES MUST HAVE BAFFLES


*INSTALLER IS RESPONSIBLE FOR OBTAINING FINAL APPROVAL ON THIS PERMIT

*CALL 461-9933 FOR INSPECTION OF SEPTIC SYSTEM.

GOOD PERMITS SIGNED
AND RETURNED 2-17-99
Serial # B10118754
dick

56430
X

NOT TO SCALE

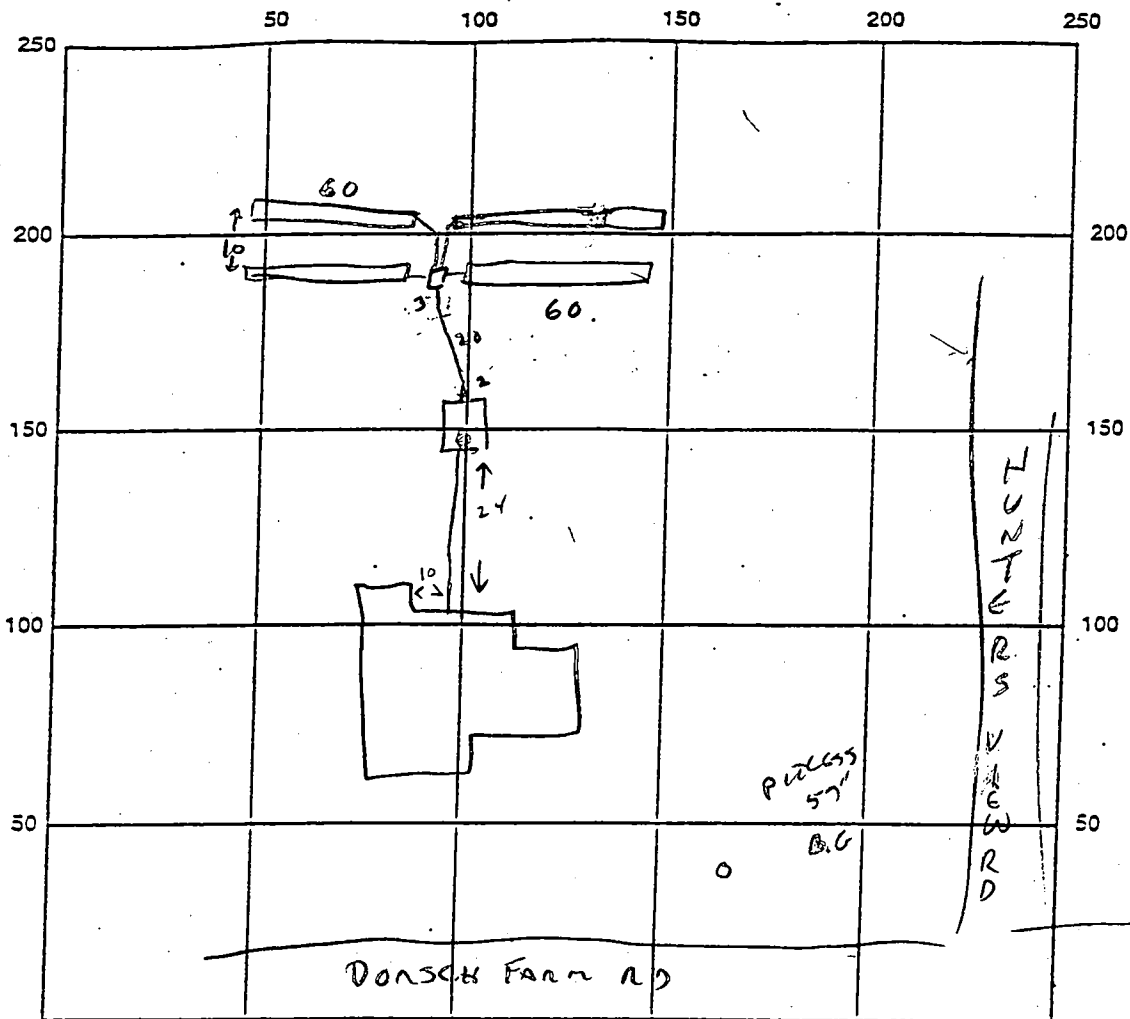

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE

SEPTIC TANK LEVEL CLEANOUTS ST

DISTRIBUTION BOX LEVEL

DRAIN FIELD/TILE DEPTH 6 FT. TRENCH WIDTH 3 FT. INLET DEPTH 4 FT.

EFFECTIVE GRAVEL DEPTH 2 FT. TOTAL LENGTH 240 FT.

NUMBER OF TRENCHES 4 @ 60' ONE SIDEWALL/BOTTOM AREA 960 SQ. FT.

DRYWELL INSIDE DIAMETER N/A FT. EFFECTIVE DEPTH BELOW INLET N/A FT.

ABSORBENT AREA N/A SQ. FT.

REMARKS: SYSTEM COMPLETE EXCEPT FOR HOUSE CONNECTION 2/23/99 CW
CONNECTION COMPLETED THRU FOUNDATION WALL 2/23/99 CW

DATE SYSTEM APPROVED 2/23/99 INSPECTOR [Signature]

Approved Septic System Plan
Howard County Health Department


Total linear feet of trench required 240 feet
Width of trench(es) 3 feet
Depth of trench(es) 6 feet
Depth of stone required below distribution pipe 2 feet

[Signature] 12/21/99
Signature Date

BULK PARCEL
GATHER HUNT
SECTION ONE AREA ONE
ZONED: RC-DEO

Post-it Fax Note 7571	Date 12-29-98	# of Pages 1
To Scott James	From BEY	
Co./Dept. RYAN	Co. CFS	
Phone Gather Hunt	Phone #	
Fax # Lot 71	Fax #	

NOV 20 1999
GATHER HUNT

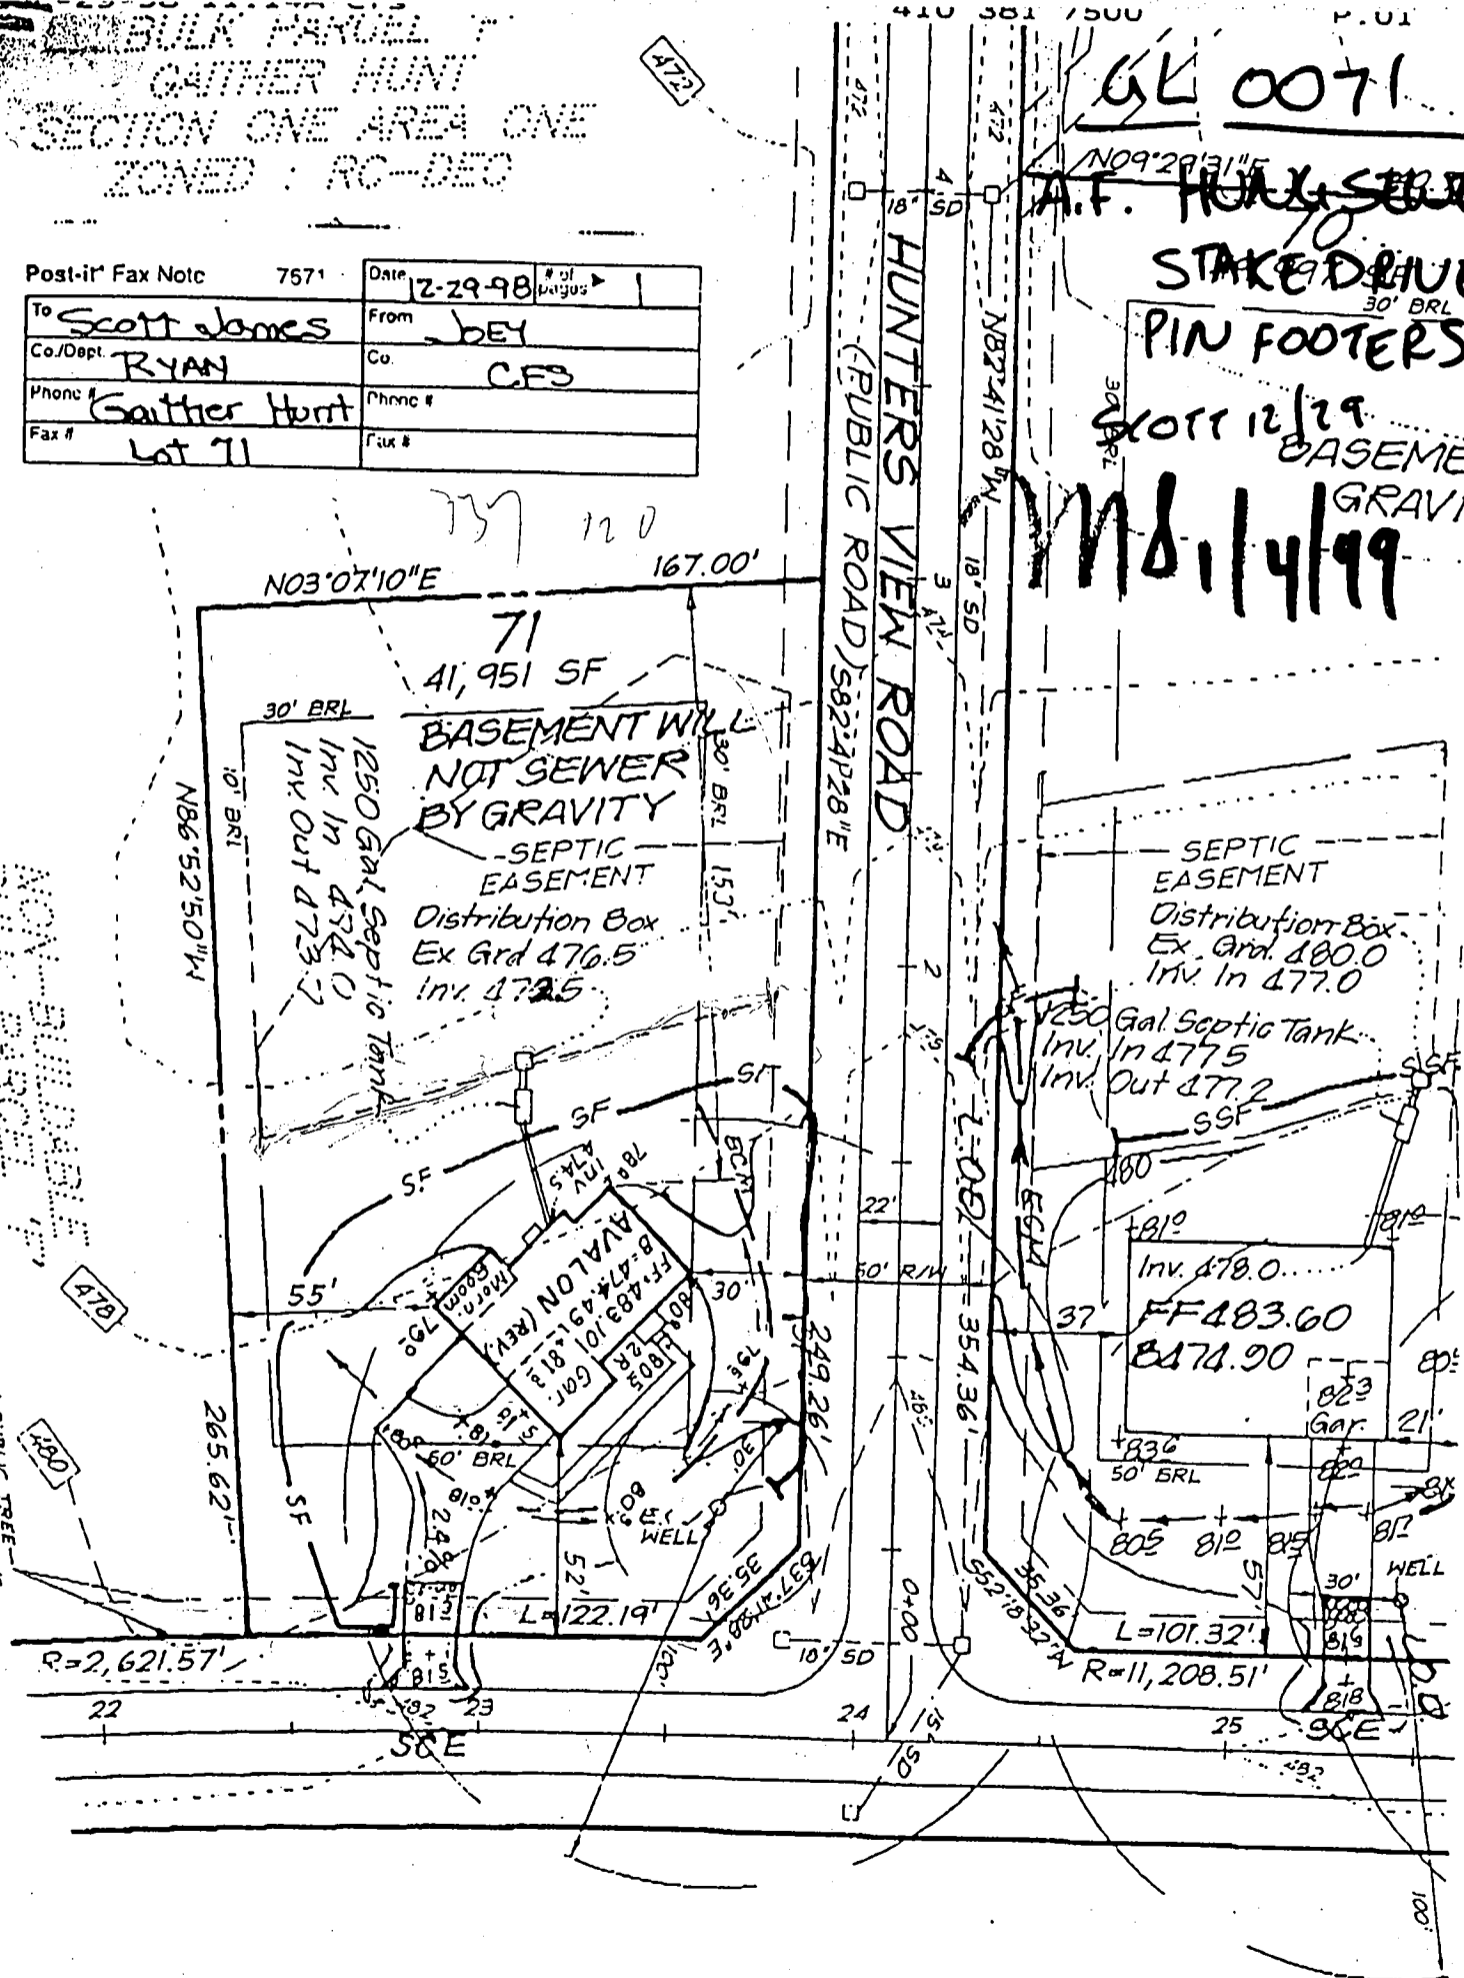

GL 0071
NOV 20 1999
A.F. HALL SEWER
STAKE DRIVE
PIN FOOTERS
SCOTT 12/29
BASEMENT
GRAVITY
12/14/99

SCALE: 1"=50'

APPLICATION

PERCOLATION TESTING

57624B
A 57629
P _____

HOWARD COUNTY HEALTH DEPARTMENT
BUREAU OF ENVIRONMENTAL HEALTH
3525-H ELLICOTT MILLS DRIVE/ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 313-2640

DISTRICT _____
DATE 4/3/96

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I HEREBY APPLY FOR THE NECESSARY TEST PRIOR TO APPLICATION FOR PERMIT TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER J Thomas Scrivener Ryan Homes

ADDRESS c/o Land Design & Development PHONE 410 740 5176

AGENT OR PROSPECTIVE BUYER Donald R. Renner Jr

ADDRESS 10805 Hickory Ridge Rd PHONE _____
21044

PROPERTY LOCATION:

SUBDIVISION _____ LOT NO. 89-71

ROAD AND DESCRIPTION 11038 Dorsch Farm Road

TAX MAP 29 PARCEL # 21

SIZE OF LOT 1+ Acres TYPE BLDG. _____
(SINGLE FAMILY DWELLING OR COMMERCIAL)

~~THIS RETURN SHEET~~
~~AND RETURNED 1-21-99~~
Serial # B70115723
SFD-4Bom

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE. I FULLY UNDERSTAND THE FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER ANY CIRCUMSTANCES. I ALSO AGREE TO COMPLY WITH ALL M.O.S.H.A. REQUIREMENTS IN TESTING THIS LOT.

(SIGNATURE OF APPLICANT)

APPROVED BY _____ FOR _____ DATE _____

DISAPPROVED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____

REASONS FOR REJECTION OR HOLDING _____

PERCOLATION TEST PLAT/PRELIMINARY PLAT - TITLE OR I.D. # _____ DATE _____

SITE DEVELOPMENT PLAN/FINAL PLAT - TITLE OR I.D. # _____ DATE _____

THIS IS NOT A PERMIT


57624B

56429

COUNTY #

SOIL PROFILE

0'

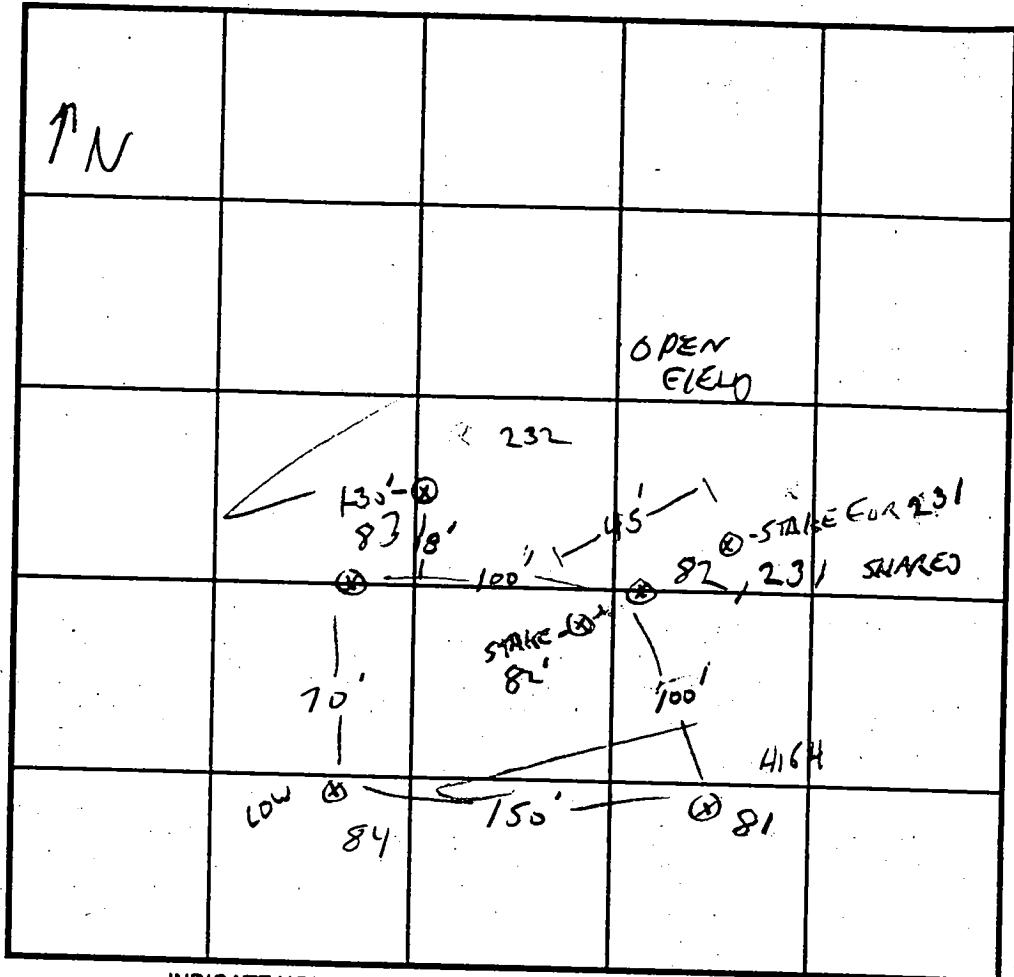

SOIL PROFILE 81-84

TOP SOIL

BROWN CLAY

ORANGE MACESS CLAY LENS

TAN S.S.L.

1'
4'6"
6'
12'

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE.
PRYOR ROAD

LOT 92 ACROSS ROAD

DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME
			START	STOP	START	STOP	
4/3/96	81	5'	11:27	11:30	11:30	11:43	13 MW
	82	5' <small>OK TO 11'6"</small>	11:32	11:35	11:35	11:41	6 MW
	84	5'6" <small>OK TO 11'6"</small>	11:40	11:41	11:41	11:42:30	1.5 210 MW <small>REVIEW</small>
	83	5'	11:57	11:58	11:58	12:14	16 MW

REMARKS LOT 87 DUG PER PLAN

TYPE OF SOIL FOR LOT 71 USE LOT 84

TESTED BY G. SAVAGE ALSO PRESENT Don REWNER MIKE

TRENCH DESIGN DATA: AVERAGE PERCOLATION TIME 10 MW TRENCH WIDTH 3

INLET DEPTH 4 MAXIMUM BOTTOM DEPTH 6 SQ. FT./BEDROOM 270 / 180

APPLICATION

PERCOLATION TESTING

57624B

A 56429

P _____

HOWARD COUNTY HEALTH DEPARTMENT
BUREAU OF ENVIRONMENTAL HEALTH
3525-H ELLICOTT MILLS DRIVE/ELLICOTT CITY, MARYLAND 21043
TELEPHONE: 313-2640

DISTRICT _____

DATE 4/3/96

TO: THE COUNTY HEALTH OFFICER
ELLICOTT CITY, MARYLAND

I HEREBY APPLY FOR THE NECESSARY TEST PRIOR TO APPLICATION FOR PERMIT TO CONSTRUCT (OR RECONSTRUCT) A SEWAGE DISPOSAL SYSTEM.

PROPERTY OWNER J Thomas Scrivener

ADDRESS c/o Land Design & Development PHONE 410 740 5176

AGENT OR PROSPECTIVE BUYER Donald R. Reuver Jr

ADDRESS 10805 Hickory Ridge Rd PHONE _____
21044

PROPERTY LOCATION:


SUBDIVISION _____ LOT NO. 21 SE 71

ROAD AND DESCRIPTION _____

TAX MAP 29 PARCEL # 21

SIZE OF LOT 1 + Acres TYPE BLDG. _____
(SINGLE FAMILY DWELLING OR COMMERCIAL)

THE SYSTEM INSTALLED UNDER THIS APPLICATION IS ACCEPTABLE ONLY UNTIL PUBLIC FACILITIES BECOME AVAILABLE. I FULLY UNDERSTAND THE FEE CONNECTED WITH THE FILING OF THIS PERC TEST APPLICATION IS NON-REFUNDABLE UNDER ANY CIRCUMSTANCES. I ALSO AGREE TO COMPLY WITH ALL M.O.S.H.A. REQUIREMENTS IN TESTING THIS LOT.

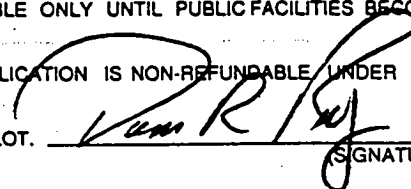

(SIGNATURE OF APPLICANT)

APPROVED BY _____ FOR _____ DATE _____

DISAPPROVED BY _____ FOR _____ DATE _____

HOLD PENDING FURTHER TESTS _____

REASONS FOR REJECTION OR HOLDING _____

PERCOLATION TEST PLAT/PRELIMINARY PLAT - TITLE OR I.D. # _____ DATE _____

SITE DEVELOPMENT PLAN/FINAL PLAT - TITLE OR I.D. # _____ DATE _____

THIS IS NOT A PERMIT

57624 B

~~86429~~

COUNTY # 85


SOIL PROFILE 86

0' 87

TOP SOIL 1'

ORANGE SANDY CLAY LOAM 6.5'

TAN SIL 11.5'

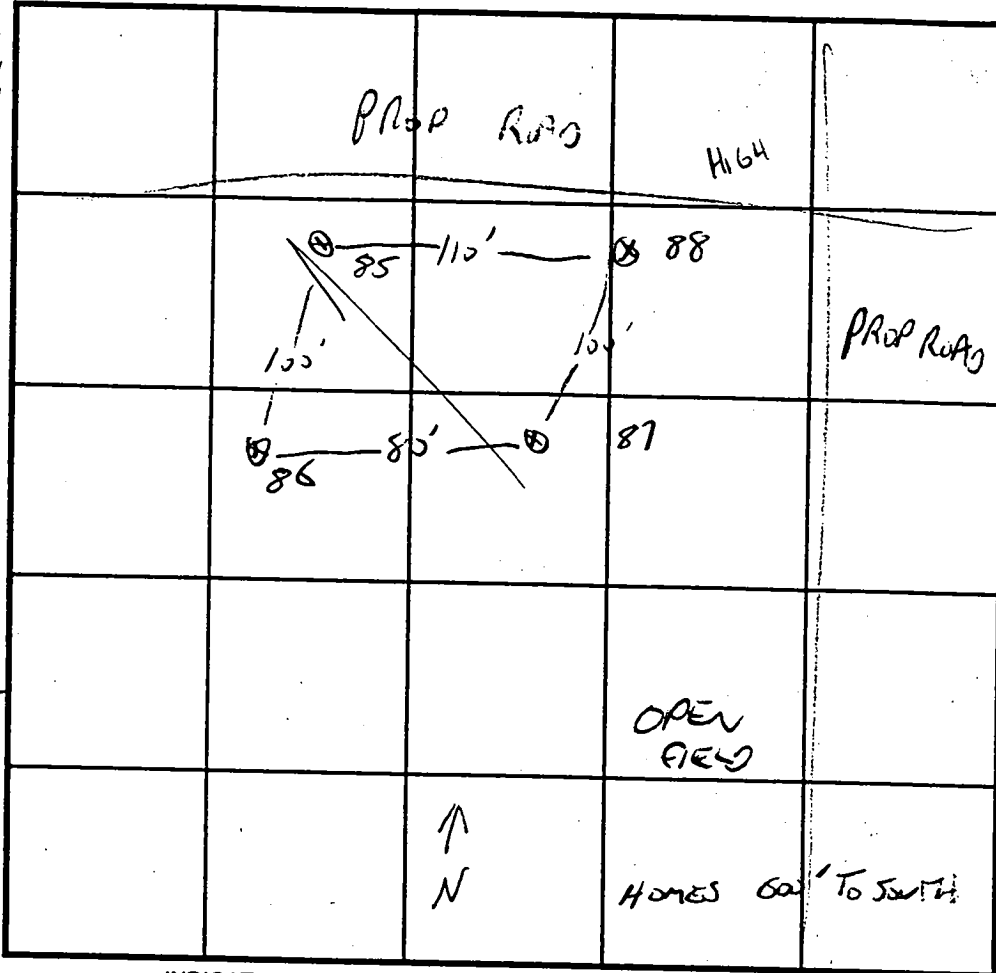

SOIL PROFILE 88

0'

TOP SOIL 2'

ORANGE CLAY LOAM 4'

WHITE + ORANGE CLAY SANDY LOAM 12'

INDICATE NORTH - NAME ADJOINING ROADWAY AS BASE LINE.

DATE	TEST NO.	DEPTH	PRE-WET		TEST - 1" DROP		TIME
			START	STOP	START	STOP	
4-3-96	88	5'	10:08	10:10	10:10	10:16	6 MIN
	87	4' 6"	10:13	10:14	10:14	10:17	3 MIN
	86	5' 6"	10:21	10:22	10:22	10:23:30	1.5 MIN
	85	5' <small>OK TO 13</small>	10:25	10:28	10:28	10:33	5 MIN

REMARKS ~~LOT 99~~ DUG PER PLAT FOR LOT 71 USE 85, 84

TYPE OF SOIL: _____

TESTED BY: G. SAUSAGE

ALSO PRESENT DON RIVER MIKE + MIKE

TRENCH DESIGN DATA: AVERAGE PERCOLATION TIME 5 MIN

TRENCH WIDTH 3'

INLET DEPTH 4'

MAXIMUM BOTTOM DEPTH 6'

SQ FT/BEDROOM 180

180

PROPERTY OF
MARY CARTER CARROLL ZIEGLER, ET AL
LIBER 2720, FOLIO 310

copy of signed final
F-98-24

LOT 69
50,000 Sq.Ft.*

LOT 70
49,997 Sq.Ft.*
Public 10' Wide
Tree Maintenance
Easement

BIO-RETENTION WATER
QUALITY DRAINAGE AND
UTILITY EASEMENT

**HUNTERS
VIEW ROAD**

Public 10' Wide
Tree Maintenance
Easement

**NON-BUILDABLE
BULK PARCEL 'F'**
5.579 Ac.*

Non-Buildable Bulk Parcel 'F' Reserves
The Right To Be Further Subdivided.

LOT 17
GANNON FARM
PLAT No. 6611

Rebar w/ Cap
#10751 Found

LOT 18

FOX

HAVEN

WAY

LOT 19
40,019 Sq.Ft.*

LOT 18
42,663 Sq.Ft.*

LOT 20
40,531 Sq.Ft.*

LOT 21
43,330 Sq.Ft.*

LOT 22
42,327 Sq.Ft.*

HIDDEN

The Requirements 8 3-108, The Real Property Article, Annotated Code Of
Maryland, 1988 Replacement Volume, (As Supplemented) As Far As They Relate
to The Making Of This Plat And The Setting Of Markers Have Been Complied
With
James A. Fisher 4/10/98
James A. Fisher, I.S.#10692 (Surveyor), Date

C1-01323

SEQUENCE NO. (MDE USE ONLY)

STATE OF MARYLAND WELL COMPLETION REPORT

THIS REPORT MUST BE SUBMITTED WITHIN 45 DAYS AFTER WELL IS COMPLETED.

(THIS NUMBER IS TO BE PUNCHED IN COLS. 3-6 ON ALL CARDS)

COUNTY NUMBER A 57624-B

ST/CO USE ONLY DATE RECEIVED 5-3-98

DATE WELL COMPLETED 03-03-98

Depth of Well 22 230' 26 (TO NEAREST FOOT)

PERMIT NO. FROM "PERMIT TO DRILL WELL" HO-94-1421

OWNER Woodlot Enterprises STREET OR RFD Doish Farm Rd TOWN SUBDIVISION Gaither Overlook SECTION LOT 71

WELL LOG

Not required for driven wells

STATE THE KIND OF FORMATIONS PENETRATED, THEIR COLOR, DEPTH, THICKNESS AND IF WATER BEARING

Table with columns: DESCRIPTION (Use additional sheets if needed), FEET (FROM, TO), check if water bearing. Includes entries for ORANGE Silt SOIL, LIGHT TAN SOIL, DARK TAN SOIL, SOFT GRAY ROCK, MED HARD TO HARD GRAY & GREEN ROCK, and WATER 115'.

GROUTING RECORD

WELL HAS BEEN GROUTED (Y/N) TYPE OF GROUTING MATERIAL (Cement CM, Bentonite Clay BC) NO. OF BAGS 28 NO. OF POUNDS 2632

CASING RECORD

MAIN CASING TYPE ST Nominal diameter top (main) casing (nearest inch) 6" Total depth of main casing (nearest foot) 84'

OTHER CASING (if used)

Table for other casing with columns for diameter and depth.

SCREEN RECORD

screen type or open hole (ST, BR, HO, PL, OT) DEPTH (nearest ft.)

C 3

PUMPING TEST

HOURS PUMPED (nearest hour) 3 PUMPING RATE (gal. per min.) 10 METHOD USED TO MEASURE PUMPING RATE watch + bucket

PUMP INSTALLED

DRILLER WILL INSTALL PUMP YES NO DRILLER INSTALLS PUMP, THIS SECTION MUST BE COMPLETED FOR ALL WELLS. TYPE OF PUMP INSTALLED PLACE (A,C,J,P,R,S,T,O) IN BOX 29.

NUMBER OF UNSUCCESSFUL WELLS: 0 WELL HYDROFRACTURED (Y/N)

CIRCLE APPROPRIATE LETTER A WELL WAS ABANDONED AND SEALED WHEN THIS WELL WAS COMPLETED

I HEREBY CERTIFY THAT THIS WELL HAS BEEN CONSTRUCTED IN ACCORDANCE WITH COMAR 26.04.04 "WELL CONSTRUCTION"

DRILLERS LIC. NO. MLD 3551 DRILLERS SIGNATURE (MUST MATCH SIGNATURE ON APPLICATION)


LIC. NO. MWD 546 SITE SUPERVISOR (sign. of driller or journeyman responsible for sitework if different from permittee)

DEPTH (nearest ft.) 84 230

Table for well depth and diameter of screen.

GRAVEL PACK IF WELL DRILLED WAS FLOWING WELL INSERT F IN BOX 68

MDE USE ONLY (NOT TO BE FILLED IN BY DRILLER) T (E.R.O.S.) W Q

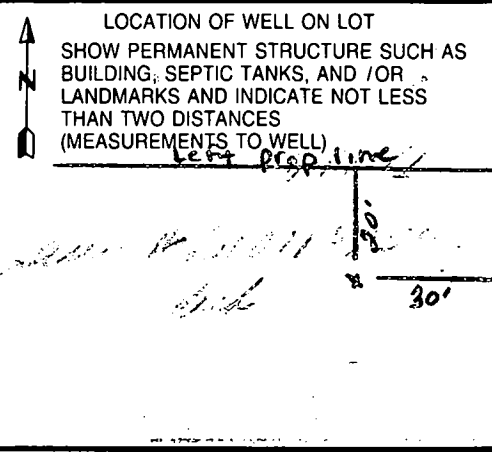

B 1 2018 SEQUENCE NO. (MDE USE ONLY) (THIS NUMBER IS TO BE PUNCHED IN COLS. 3-6 ON ALL CARDS)


STATE OF MARYLAND PERMIT TO DRILL WELL please print or type

STATE PERMIT NUMBER HO-94-1421 fill in this form completely

OWNER INFORMATION Date Received (APA) 2-5-98 WOOD LOT ENTERPRISES 5026 Dorsey Hall Dr. Ste 204. ELICOTT CITY MD 21042

LOCATION OF WELL COUNTY Howard SUBDIVISION GATHER OVERLOOK SECTION LOT 71 WILD LAKE MILES FROM TOWN 4

DRILLER INFORMATION MICHAEL BARLOW MW D355 MICHAEL BARLOW WELL DRILLING INC. 912 FAUN CT JOPPA, MD 21085 2-3-98

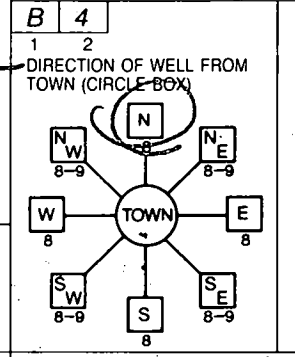

MANOE LANE NEAR WHAT ROAD ON WHICH SIDE OF ROAD (CIRCLE APPROPRIATE BOX) DISTANCE FROM ROAD 1500 ENTER FT OR MI TAX MAP: BLK: PARCEL:

WELL INFORMATION APPROX. PUMPING RATE 5 (GAL. PER MIN.) AVERAGE DAILY QUANTITY NEEDED 500 (GAL. PER DAY)

USE FOR WATER (CIRCLE APPROPRIATE BOX) D HOME (SINGLE OR DOUBLE HOUSEHOLD UNIT ONLY) F FARMING (LIVESTOCK WATERING & AGRICULTURAL IRRIGATION) I INDUSTRIAL, COMMERCIAL, STATE AND FEDERAL GOV. OTHER (REQUIRES APPROPRIATION PERMIT) P PUBLIC OR PRIVATE WATER COMPANY (REQUIRES APPROPRIATION PERMIT AND STATE APPROVAL) T TEST, OBSERVATION, MONITORING (MAY REQUIRE APPROPRIATION PERMIT)


NOT TO BE FILLED IN BY DRILLER HEALTH DEPARTMENT APPROVAL Howard A57624-B COUNTY NAME COUNTY NO. STATE SIGNATURE INSERT S DATE ISSUED 2-10-98 Kim Minto 2-10-99 CO SIGNATURE EXP. DATE NORTH GRID 830000 EAST GRID 520 000

APPROXIMATE DEPTH OF WELL 200 FEET APPROXIMATE DIAMETER OF WELL 6 INCH NEAREST INCH


SHOW MAJOR FEATURES OF BOX & LOCATE WELL WITH AN X SOURCES OF DRILLING WATER 1. 2. 3. WRITE THE BOX NUMBER FROM THE MAP HERE E 520 N 830

METHOD OF DRILLING (circle one) BORED (or Augered) JETTED Jetted & DRIVEN AIR-ROTary AIR-PERCussion ROTARY (Hydraulic Rotary) CABLE REVERSE-ROTary DRIVE-POINT other

REPLACEMENT OR DEEPEMED WELLS (CIRCLE APPROPRIATE BOX) N THIS WELL WILL NOT REPLACE AN EXISTING WELL Y THIS WELL WILL REPLACE A WELL THAT WILL BE ABANDONED AND SEALED S THIS WELL WILL REPLACE A WELL THAT WILL BE USED AS A STANDBY-CONTACT LOCAL APPROVING AUTHORITY FOR POLICY ON STANDBY WELLS D THIS WELL WILL DEEPEM AN EXISTING WELL PERMIT NUMBER OF WELL TO BE REPLACED OR DEEPEMED (IF AVAILABLE) 41 52

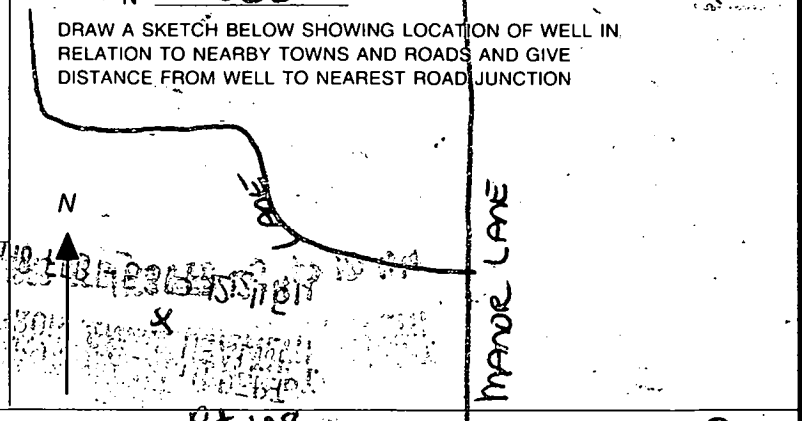

Not to be filled in by driller (MDE OR COUNTY USE ONLY) APPROX. PERMIT NUMBER FORCE Km PERMIT No. HO-94-1421 SPECIAL CONDITIONS

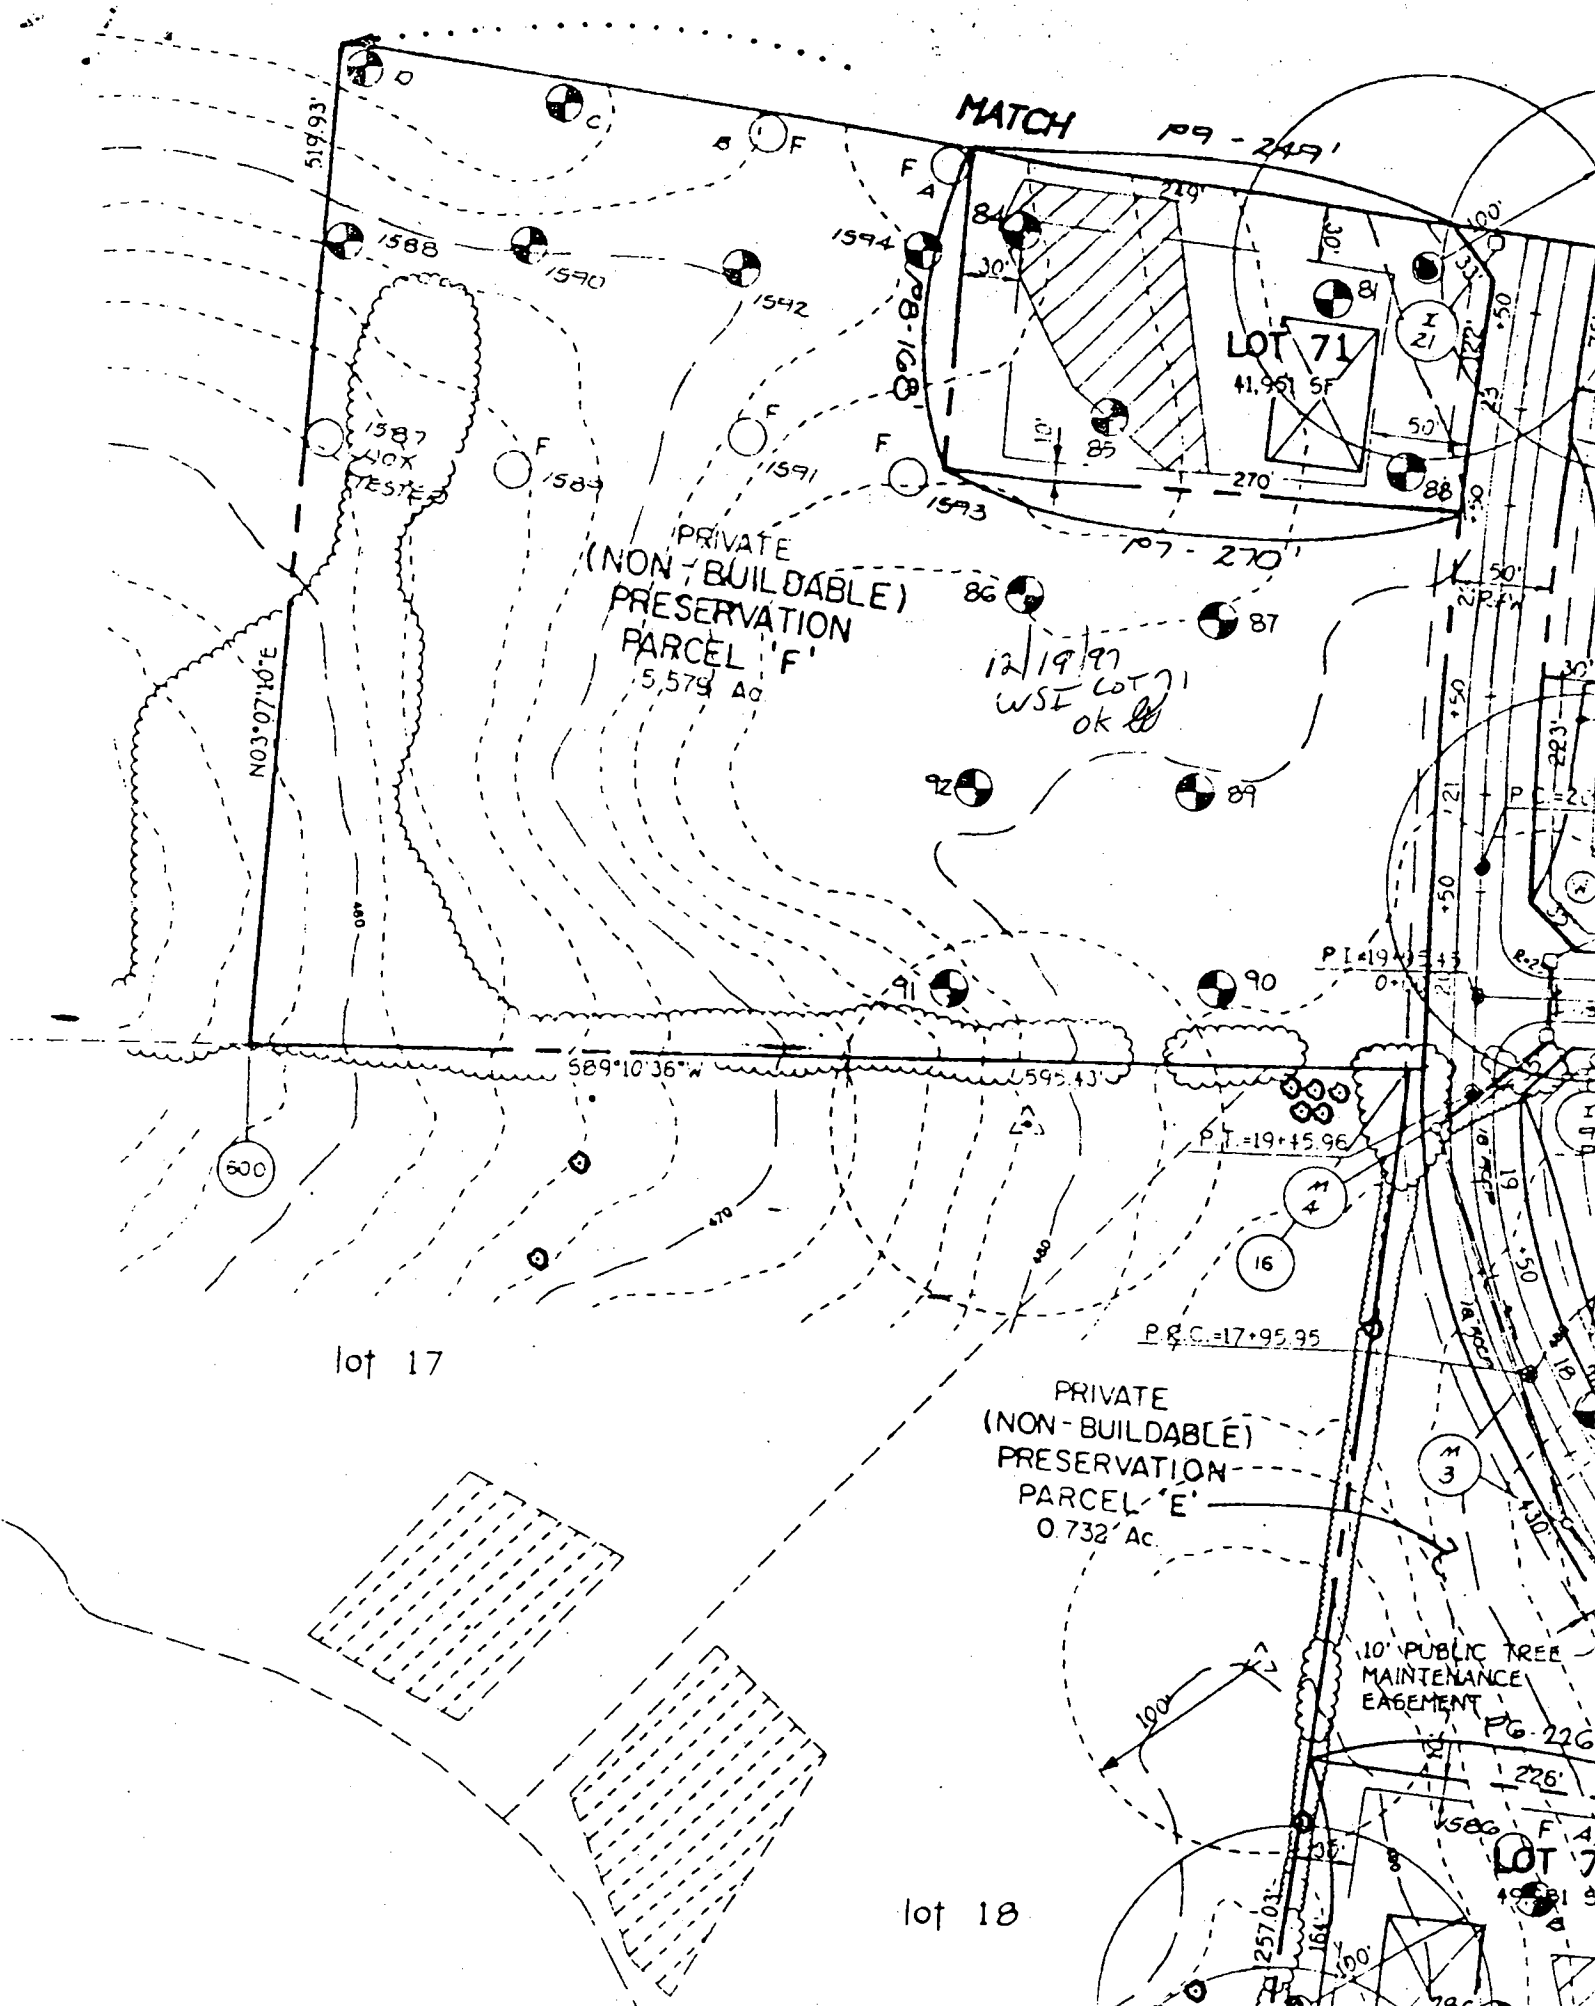

MATCH P9 - 249'

PRIVATE (NON-BUILDABLE) PRESERVATION PARCEL 'F' 5.579 Ac

PRIVATE (NON-BUILDABLE) PRESERVATION PARCEL 'E' 0.732 Ac


LOT 71 41,961 SF

LOT 7 40,811 SF

lot 17

lot 18

10' PUBLIC TREE MAINTENANCE EASEMENT



N03°07'10"E


500

P.B.C. = 17.95.95

P.I. = 19.45.96

P.I. = 19.45.43

12/19/97 WSI LOT 71 OK

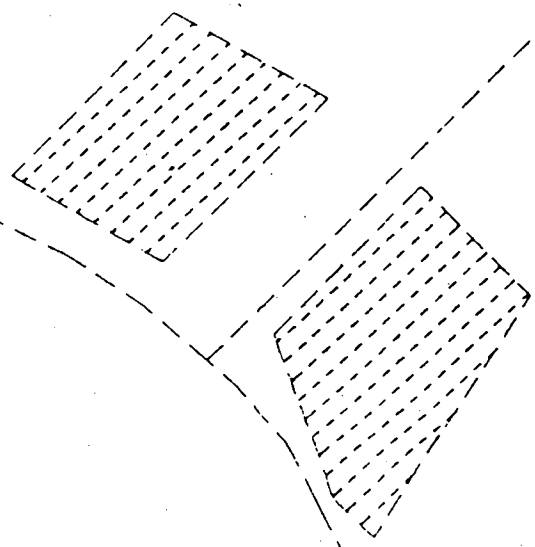

HOWARD COUNTY HEALTH DEPARTMENT
Bureau of Environmental Health
3525-H Ellicott Mills Drive
Ellicott City, MD 21043
461-9933

APPLICATION FOR PITLESS ADAPTER, WELL PUMP AND PRESSURE TANK INSTALLATION

New Installation
Replacement

Receipt # _____
Date _____

Name of Installer LEASAC CORP.

Telephone 410-242-6888

License Number #3344
Certified Well Pump Installer _____ Well Driller _____ Registered Plumber

Name of Property Owner Ryan Homes Telephone 410-654-0501
Subdivision Caribee Hunt Lot # 71 Well Tag # HO-94-1421
Site Address 11038 Dorch Farm Rd.

Pump
1. Type
a. Deep well jet _____
b. Shallow well jet _____
c. Submersible
2. Make JACCOZI
3. Model # 154521B-F2
4. Capacity 10 GPM
5. Pump exceeds well capacity Yes _____ No
6. If Yes, is low pressure cutoff switch installed? Yes _____ No _____
7. What methods are used to protect the pump and electrical wiring from vibrations? Torque arrestors _____ Cable guards Other _____

Motor
1. Horsepower 1
2. RPM _____
3. Voltage _____
a. 110 _____
b. 220

Pitless Adapter
1. Make _____
2. Model # _____
3. Depth _____

Tank
1. Capacity 86
2. Pressure relief valve? 9

Piping
1. Type 1"
2. Size Poly
3. NSF and/or BOCA Code approved _____
4. Depth of supply line _____

Well data
1. Depth 230 ft.
2. Yield 10 GPM
3. Static water level _____ ft.
4. Will water supply be disinfected by installer?

917655
57" below 6" AOC
2/23/99 (CW)

I understand that it is my responsibility to notify the Howard County Health Department when the installation is ready for inspection (otherwise this permit is null and void).

All information given above is true to the best of my knowledge.

Signature of Applicant: [Signature]


Date: 2/19/99

Note: A sticker indicating approval/status of the installation will be placed on the well casing at the time of the inspection.

UN-BUILDABLE
JLK PARCEL F'

ement, see General
13208

ide Tree -
Easement

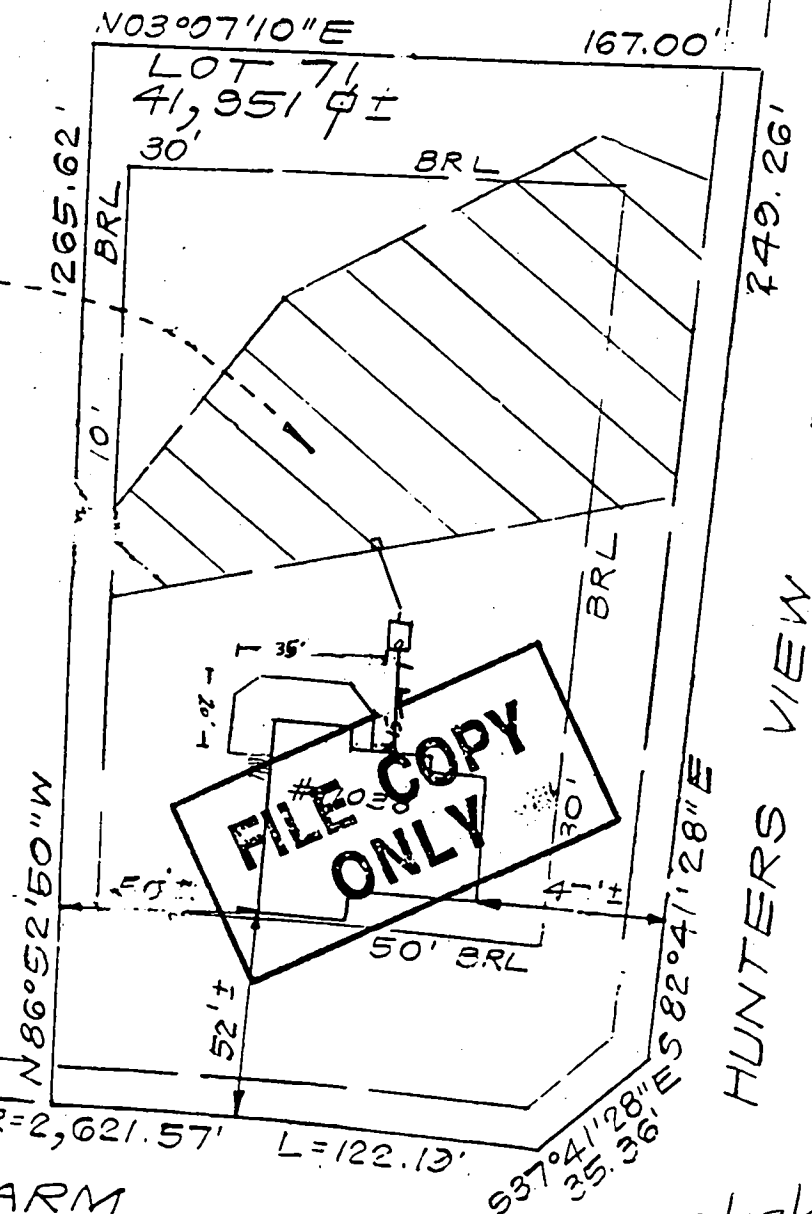

DORSCH FARM
50'R/W PLAT NO. 13358 ROAD
(FORMERLY FOX HAVEN WAY)

will check OK
4/19/99

6/17/99
proposed deck
location
OK as
shown
AS

SCALE: 1" = 50'